

**Extruded Aluminum Louver ▲ 4" Deep ▲ 0° Straight and 45° Baffle Blades ▲ Stationary ▲ Combined Intake/Discharge**

**For self contained condensing units.**

**STANDARD MATERIALS AND CONSTRUCTION**

**FRAME:** .081" thick (nominal) extruded aluminum, 6063-T52/T6 alloy.

**BLADE:** .081" thick (nominal) extruded aluminum, 6063-T52/T6 alloy.  
Intake blades at 45° angle and discharge blades at 0° angle shall be combined in one louver. Other angles available for discharge blades.

**LOUVER FACE:** All surfaces are flush, with jambs contained within the head and sill.

**SCREENS:** (When indicated, in a removable frame.)

½" flattened aluminum (.051" thick),

-or- ½" sq. mesh, intermediate double-crimped aluminum wire, .063" dia.,

-or- 19/16 mesh, .011" dia. aluminum wire, insect screen.

**FINISH:** Mill

**OPTIONS**

Finish - Baked Enamel, Kynar, Anodize

Other Discharge Blade Angles

Extended Separators - Between intake and discharge sections.

**NOTES**

1. ½" nominal deduction will be made to the opening size given.
2. List blades from top down as to which shall be intake and discharge.
3. Approximate shipping weight is 3.8 lbs./sq.ft.



**LOUVER SIZES**

Min Panel	Max Single Panel
12"W x 12"H	60"W x 96"H

The use of differently angled blades in one louver prevents discharge air from mixing with intake air. The combination provides more efficient separation of air flow.

Generally, the angle of the intake blades is 45° and that of the discharge blades is 0°. Other discharge blade angles are available.

Extended separators between intake and discharge sections which protects against air recycling is optional. Any number of intake and discharge blades may be used.

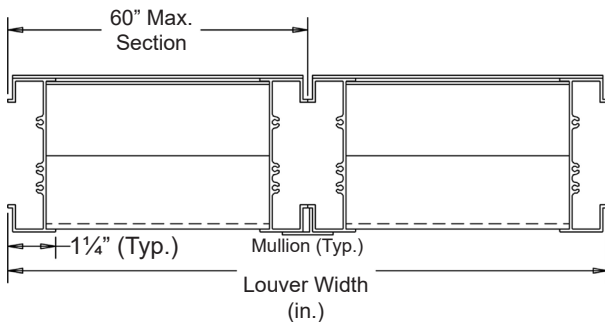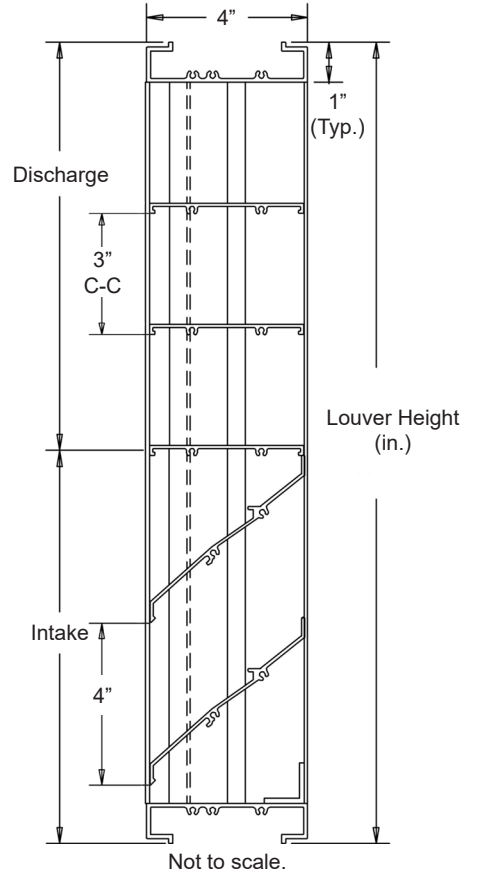

Item #	Qty	Width	Height	Width	Height	Mullion	Type	Location	Union Made
		Opening Size		Louver Size			Screens		
Arch. / Eng. :						EDR:		ECN:	Job:
Contractor:									
Project:						Date:		DWN:	DWG: