

STANDARD MATERIALS AND CONSTRUCTION

- FLANGED FRAME:** .080" thick (nominal) 6063-T52/T6 extruded aluminum.
- DOOR FRAME:** .080" thick (nominal) 6063-T52/T6 extruded aluminum.
- DOOR PANELS:** 20 GA. galvanized steel.
- INSULATION:** 2.25 lb. density polyurethane foam.
- HANDLES:** Dual-acting die cast zinc.
- GASKET:** Continuous length extruded foam santoprene.
- HINGE:** Stainless steel continuous type.
- FINISH:** Mill.

OPTIONS

Door panel material: bonderized steel, stainless steel, aluminum
 Finishes - Baked Enamel, Baked Epoxy, or Prime Coat

NOTES



1. Hinge always furnished on "B" height dimension.
2. (L) designates doors with louvers. Specify (L/H) left hand or (R/H) right hand hinge when viewing from the outside.
3. Minimum louver size is 12" x 12". Maximum louver size is full door panel size. For louver location, use "X" and "Y" dimensions.
4. Unless otherwise specified, door will be fabricated ¼" under listed size. Dimensional tolerance is ± .075.
5. Door width cannot exceed two times its height.
6. Please refer to the installation instructions for mounting of handles and door assembly mounting.
7. In-swing doors are recommended for positive pressures. Out-swing doors are recommended for negative pressures.

DOOR SIZES

Min Size	Max Size
12"W x 12"H	48"W x 96"H

Model	'C' Depth
15	1⅞"
20	2⅞"

Door Panel View Minus Door Frame
 (Left hinge units shown.)
 Not to scale.

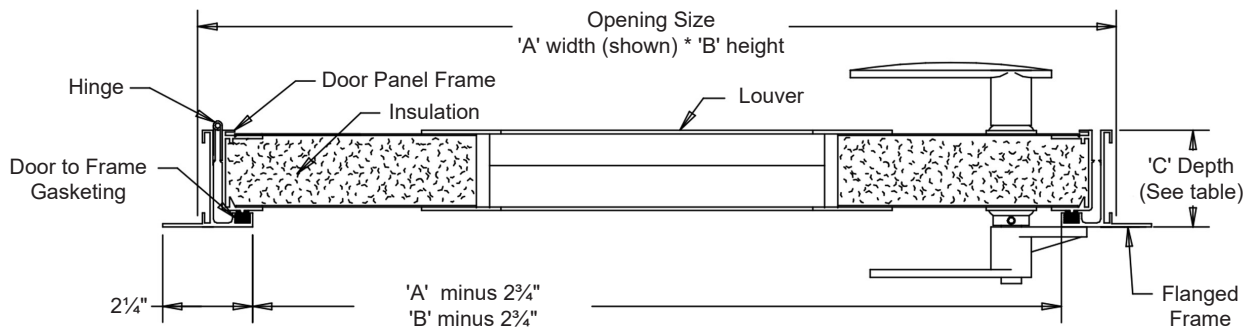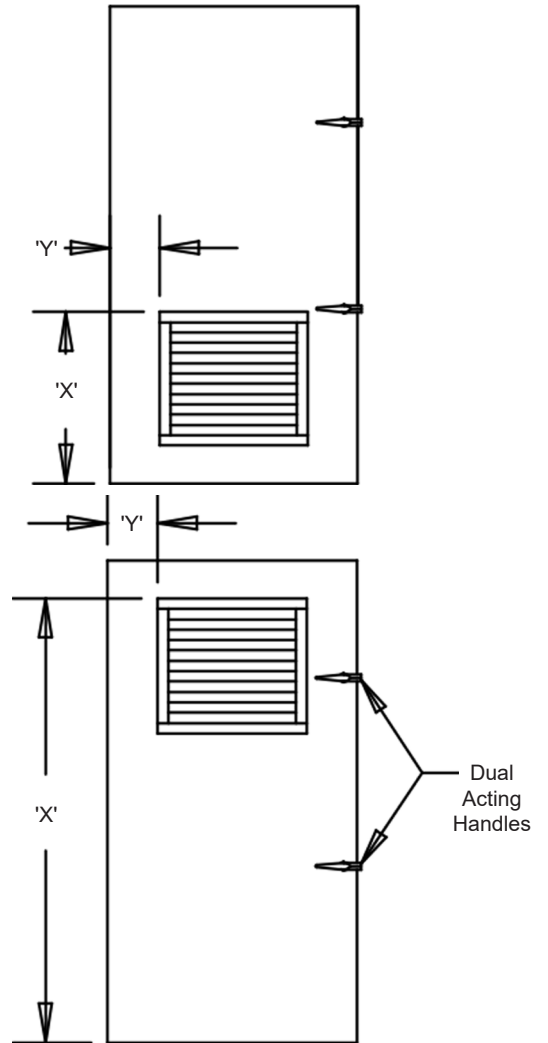

Item #	Qty	-15I	-20I	Left Hand	Right Hand	"A" Width	"B" Height	Model -15I (EA-150-F)	Model -20I (EA-200-F)	X	Y	Union Made
		Door Model		Door Hinge		Opening Size		Louver Size (Width, Height, O.D. of Flange)		Louver Location		
Arch. / Eng.:						EDR:		ECN:				Job:
Contractor:												
Project:						Date:		DWN:		DWG:		



Dampers ▲ Louvers
 UL Life Safety Products
 Division of Mestek
 Member of AMCA

airbalance.com

In the interest of product development, Air Balance reserves the right to make changes without notice.
 450 Riverside Dr • Wyalusing PA, 18853 • Phone 570-746-1888 • Fax 570-746-9286