



Cabinet Unit Heater
Option
118
Field Installed

25% MANUAL OUTSIDE
AIR DAMPER

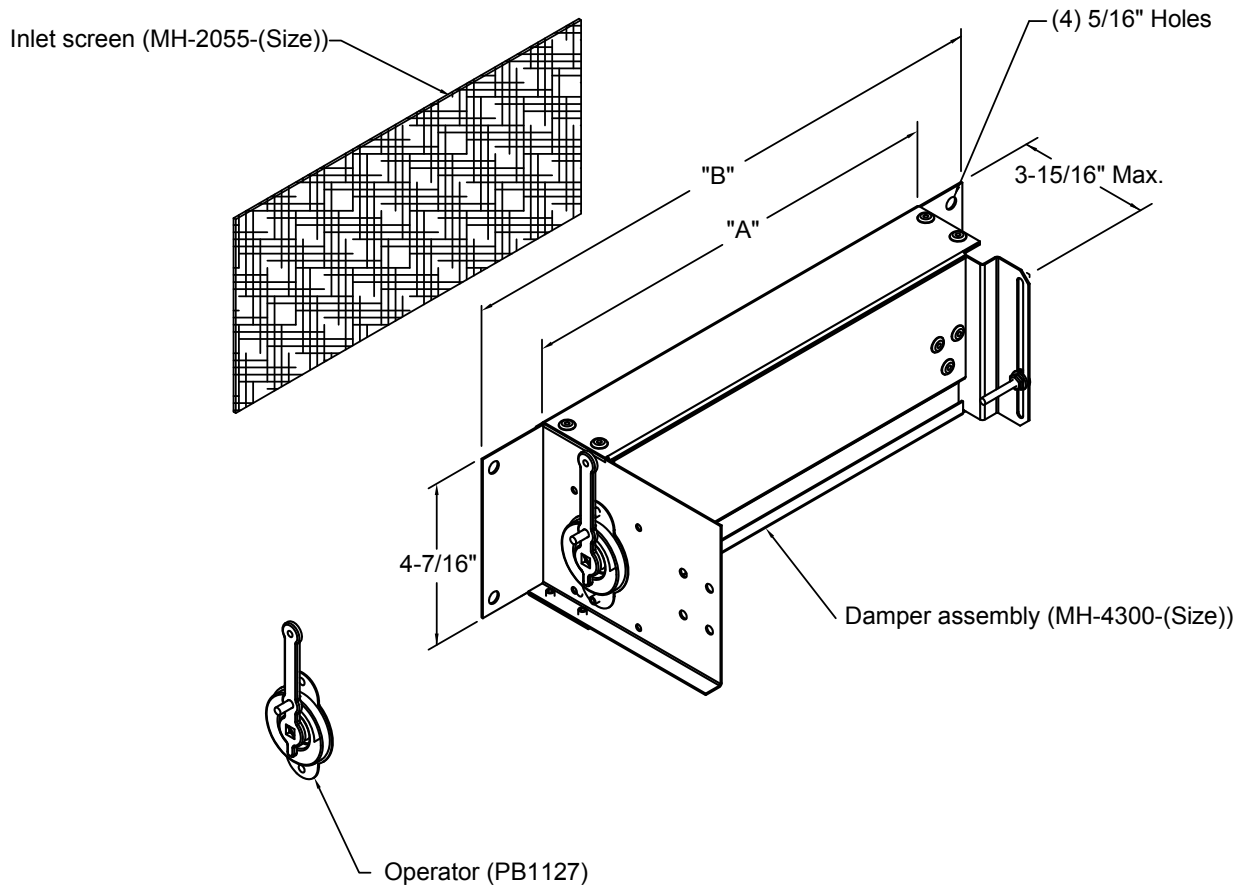

25% manual outside air damper - outside air intake can be adjusted from 0 to 25%.
Control is by manual quadrant. For use on floor units only.

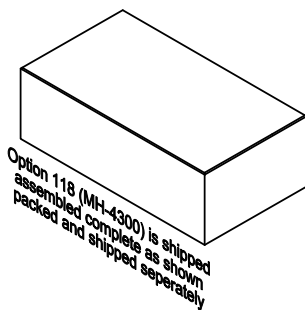

Option 118			
Size	Part Number	"A"	"B"
02	MH-4300-01	8-3/16"	11-7/16"
03	MH-4300-01	8-3/16"	11-7/16"
04	MH-4300-01	8-3/16"	11-7/16"
06	MH-4300-02	12-11/16"	15-15/16"
08	MH-4300-02	12-11/16"	15-15/16"
10	MH-4300-02	12-11/16"	15-15/16"
12	MH-4300-03	18-11/16"	21-15/16"
14	MH-4300-03	18-11/16"	21-15/16"