
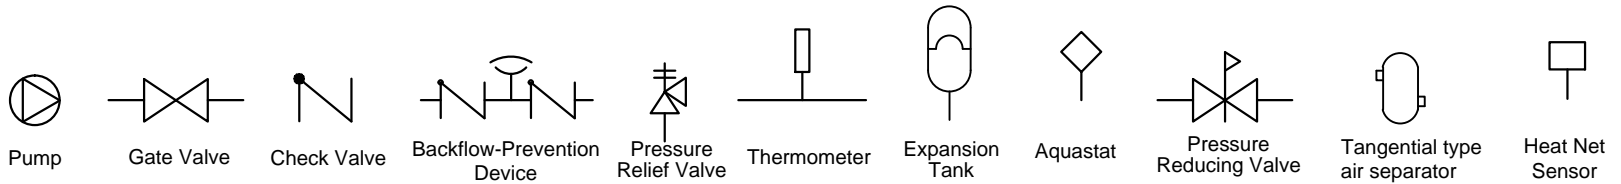


MULTIPLE BOILER PIPING PRIMARY/SECONDARY

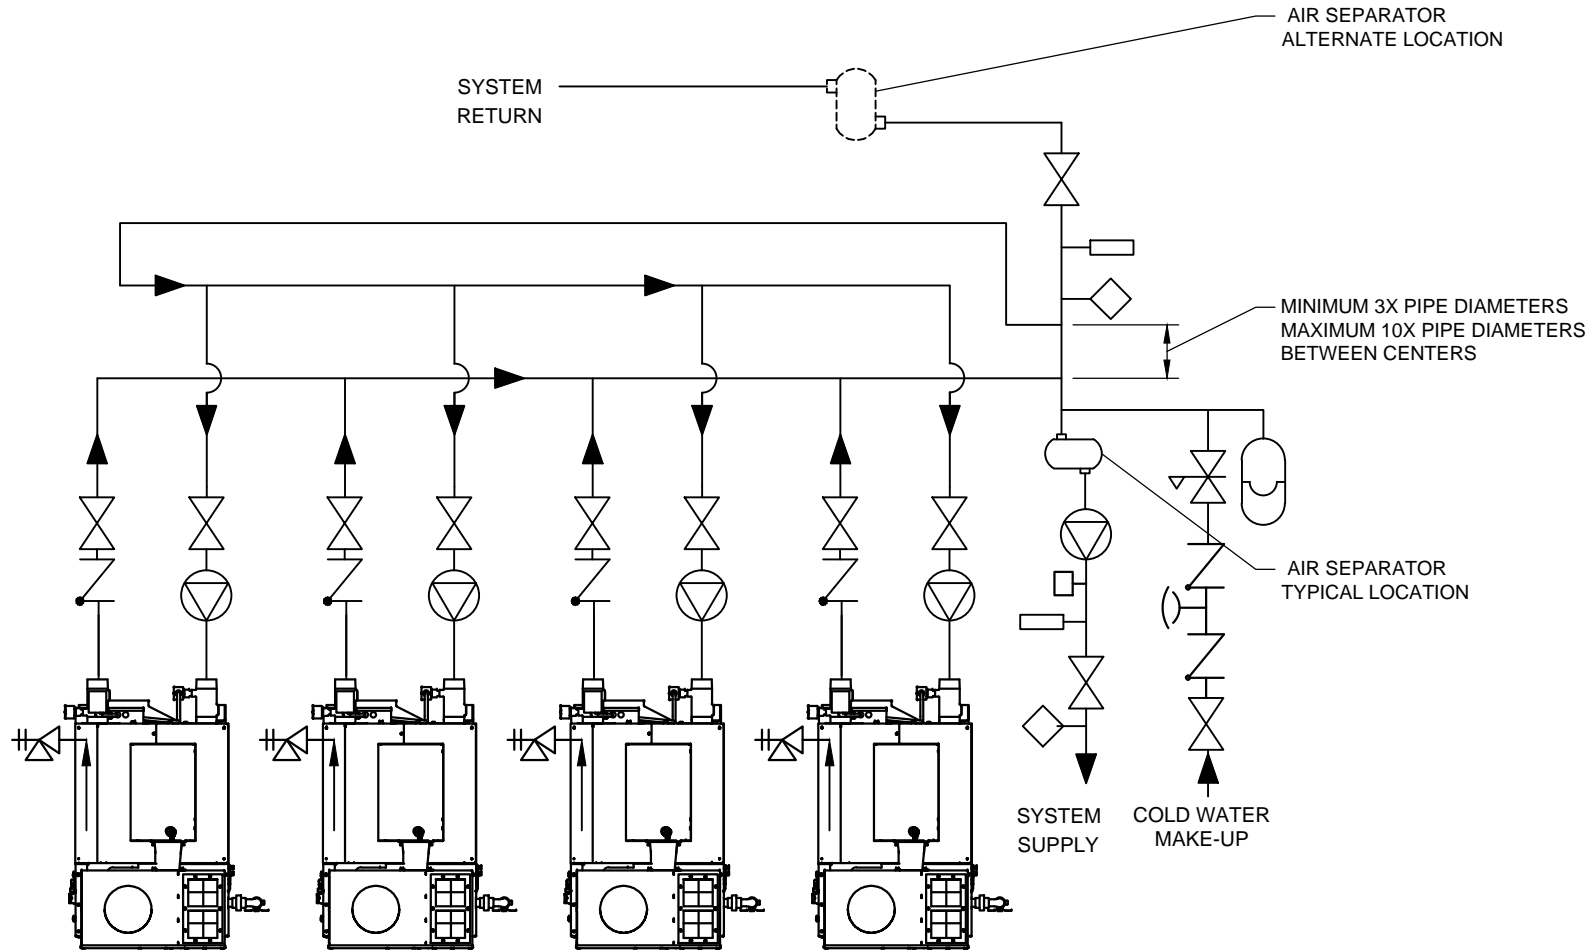

HIOM-10 REV.7

For Heat-Net operation, a sensor is required and installed at a minimum of 12" from primary loop tee.