




## Exterior Fastening Installation

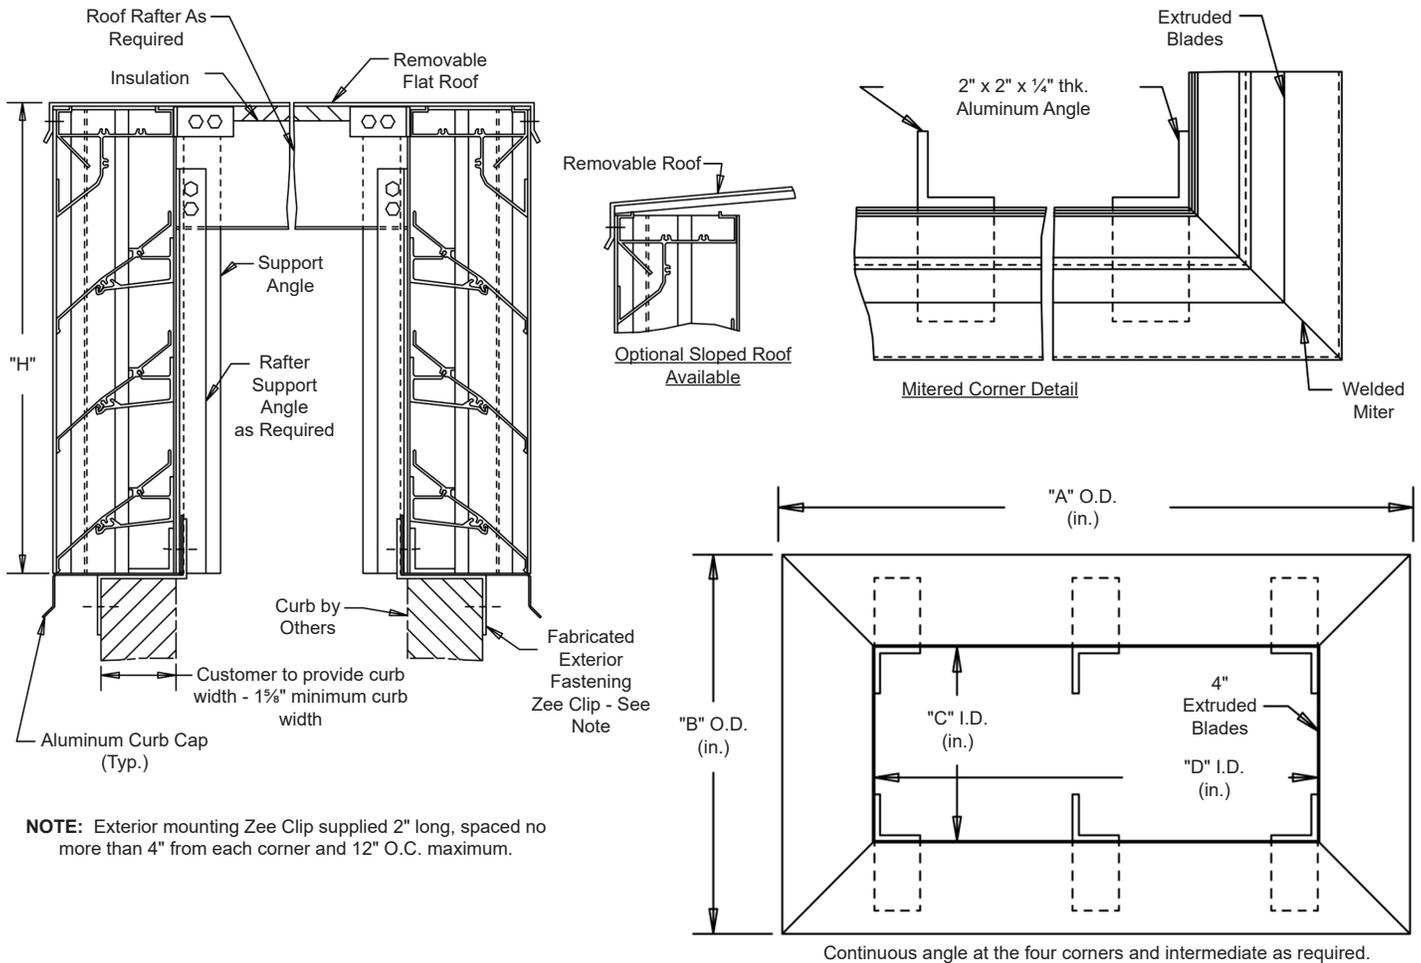

## SPECIFICATIONS

**MATERIAL:** .081" thick (nominal) or .125" thick (nominal) extruded aluminum, 6063-T52/T6 alloy, with reinforcing rib bosses.

**ROOF:** .060" thick (nominal) sheet aluminum removable roof, reinforced with aluminum bracing where required to take a snow load of 40 lbs./sq.ft., plus a required safety factor.

**SCREENS:** (When indicated)  
Bird Screen - 1/2" square mesh, 19 GA. galvanized steel, on interior.

**INSULATION:** Underside of roof is lined with 1/2" thick insulation.

**NOTES:** Penthouse dimensions "A" or "B" exceeding 84" shall be shipped in sections for field assembly by others.

Item #	Qty	A	B	C	D	H	Mullion	Type	Location	Screens	
		Penthouse Dimensions									
Arch. / Eng. :						EDR:		ECN:		Job:	
Contractor:											
Project:						Date:		DWN:		DWG:	