

Combination Fire/Smoke Damper • 11/2 Hr. Rated • Single Thickness Blade • Leakage Class II • 250°F or 350°F Rated • Out-of-Barrier • Galvanized Steel

STANDARD CONSTRUCTION

FRAME: 5 ¹ / ₂ " x 7/ ₆ " x 16 GA. galvanized steel hat ch galvanized steel head and sill for maximu	
dampers less than or equal to 13" high.	
BLADES: 16 GA. galvanized steel single thickness,	narallel action
o o o	parallel action.
AXLES: Plated solid steel stub.	
BEARINGS: Oil impregnated bronze.	
LINKAGE: Plated steel angle and crank plates with s	stainless steel pivots,
in-jamb type or on-blade type.	• •
STOPS: 18 GA. galvanized steel angles at head a	nd sill
BLADE SEALS: Silicone.	
JAMB SEALS: Stainless steel.	
SLEEVE: 20 GA. galvanized steel by 15" long (1 ¹ / ₂ "	grille clearance) or
17" long (3½" grille clearance) with ¹³ /16" fr	
INSULATION: Factory installed 0.2" thick intumescent in	0
, , , , , , , , , , , , , , , , , , ,	
both sides (vertical mount) or all four side	()
CAULKING: Hardcast irongrip 601 or UL-listed equival	lent.
ACTUATOR: Electric with heat response device (EHRE	0) or pneumatic with
heat response device (PHRD). Factory-in	, · ·
Open/Spring-Close (fail close) operation.	
	,
and accessible from grille side, or mounte	,
internally for continuous duct applications	i.
FINISH: Mill.	

OPTIONS

Integral Dual Position Indication (IDPI) Switches

Sensotherm Re-Openable Heat Response Device (ESOT) for electric actuators Sensotherm Re-Openable Heat Response Device (EPOT) for pneumatic actuators Model SM-501 flow-rated smoke detector

- Shipped loose

Model 2D51 no-flow smoke detector (12" minimum damper height)

Copper tubing (for pneumatic actuators)

Tab-lock retaining angles - 1 or 2 Sets Stainless steel bearings

Sleeves of various depths and gauge thickness (restriction apply) Round or oval transitions

Short-width (less than 10") and/or short-height (less than 10") transitions

NOTES

1. Damper frames are provided approximately 1/4" undersized. The addition of a sleeve and insulation will increase the size of the assembly. See SI-FAGM or SI-FACD for sizing openings.

2. Dampers smaller than minimum frame size require a transition. Refer to SD-TRFS. When transitioned on one-side only (which will be a damper supplied with a transition on the non-jackshafted side only), the grille size should be selected to match the damper frame size, not the transition collar size.

3. Damper with smoke detector must have a minimum sleeve of 16" (11/2" setback) or 18" (3" setback).

4. Dampers for horizontal installation can only be mounted in a fire barrier constructed of masonry/concrete materials.


DAMPER SIZES

	2000 fpm, 4 in.wg					
Orientation	Hor & Vert	Horizontal	Vertical			
Panel	Min Panel	Max Panel	Max Panel			
Rectangular	10"W x 10"H (10"W x 10"H frame)	36"W x 42"H	36"W x 42"H			
Round	8" dia. (10"W x 10"H frame)	34" dia.	34" dia.			
Oval	8"W x 8"H (10"W x 10"H frame)	34"W x 40"H	34"W x 40"H			

For handwritten orders, use the schedule block on page 2.

In the interest of product development, Louvers & Dampers reserves the right to make changes without notice.

www.louvers-dampers.com




Dampers

A Mestek Company

UNDERWRITERS LABORATORIES INC.® CLASSIFIED DYNAMIC FIRE AND SMOKE DAMPER FIRE RESISTANCE RATING 11/2 HR LEAKAGE RESISTANCE CLASS II Louvers Dampers FILE # R16591

This combination fire/smoke damper meets the construction and performance requirements of:

- Underwriters Laboratories Inc. Standards 555 and 555S
- National Fire Protection Association Standards 80, 90A, 92, 101, 105
- · ICC's International Building Code
- New York City MEA Listing #111-99-M
- California State Fire Marshal Listing #3225-1328:118
- Underwriters Laboratories Inc. Approved for dual direction airflow and dynamic conditions.
- · Underwriters Laboratories Inc. Classified for use in fire resistive ratings of less than 3 hours.
- Underwriters Laboratories Inc. Classified for use in smoke control systems for Leakage Class II and 250°F or 350°F.
- · Actuators must be arranged to operate automatically, must fail closed upon loss of power, and must be controlled by a smoke detection system.

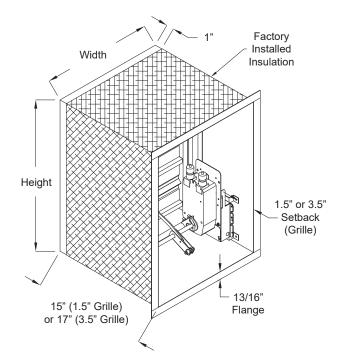



Combination Fire/Smoke Damper • 11/2 Hr. Rated • Single Thickness Blade • Leakage Class II • 250°F or 350°F Rated • Out-of-Barrier • Galvanized Steel

OPERATIONAL RATINGS

Maximum Differential Pressure: 4 in. w.g. Maximum Face Velocity: 2000 fpm


LEAKAGE RATINGS

UL Leakage Class II

20 cfm per sq. ft. maximum @ 4 in. w.g.

PRESSURE DROP

The pressure drop data shown below is based on laboratory conditions. The test setup does not take into account elbows or other duct fittings that are part of every actual duct system. The configuration of the actual duct system immediately upstream and downstream of the damper often contributes more pressure loss than the damper itself.

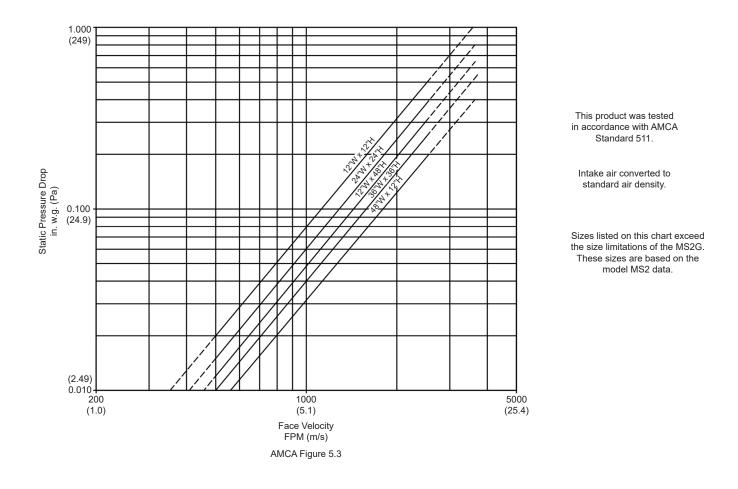

14	Qty	Damper Size	Horizontal	Vertical	250°F	350°F	Velocity	Pressure		
Item #			Orientation		Temp.	Rating	Operation	nal Rating	<u>Uni</u>	on Made
Arch.	/ Eng.:				EDR:		ECN:		Job:	
Conti	ractor:									
Р	roject:				Date:		DWN:		DWG:	

www.louvers-dampers.com

Dampers

A Mestek Company

Louvers



Combination Fire/Smoke Damper • 1¹/₂ Hr. Rated • Single Thickness Blade • Leakage Class II • 250°F or 350°F Rated • Out-of-Barrier • Galvanized Steel

INSTALLATION CONFIGURATIONS

MS	<u>2</u>	<u>G</u>	2
I	11	111	IV

- I. Base Model
 - MA = Airfoil Blade Fire-Smoke Damper
 - MS = Single-Thickness Blade Fire-Smoke Damper
 - 17MA = Airfoil Blade Dynamic Multi-Blade Fire Damper
 - 17MD = Single Thickness Blade Dynamic Multi-Blade Fire Damper
 - 17MS = Single Thickness Blade Static Multi-Blade Fire Damper
- II. Leakage Class (Fire-Smoke Dampers Only)
 - 1 = UL Class-I Leakage
 - 2 = UL Class-II Leakage

Blank = Leakage Class Not Applicable (Fire Dampers)

- III. Installation Configuration
 - D = Out-of-barrier Horizontal Grille Application, 31/2" Grille Clearance
 - E = Out-of-barrier Horizontal Grille Application, 11/2" Grille Clearance
 - F = Out-of-barrier Vertical Grille Application, 31/2" Grille Clearance
 - G = Out-of-barrier Vertical Grille Application, 1¹/₂" Grille Clearance
 - J = Out-of-barrier Horizontal, Continuous Duct
 - K = Out-of-barrier Vertical, Continuous Duct
- IV. Temperature Rating (Fire-Smoke Dampers Only)
 - 2 = 250°F
 - 3 = 350°F


www.louvers-dampers.com


Blank = Temperature Rating Not Applicable (Fire Dampers)

NOTE

- All Installations must be in accordance with SI-FAGM or SI-FACD
- Horizontal installations are only approved for masonry/concrete.

GRILLE ACCESS APPLICATIONS

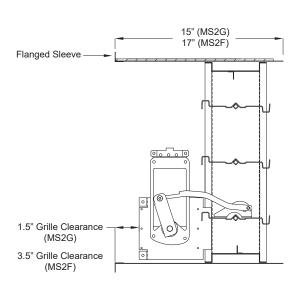

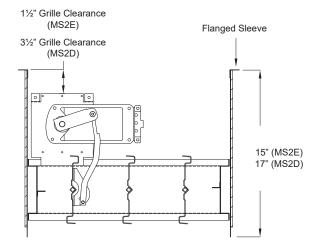






NOTE

- All Installations must be in accordance with SI-FAGM or SI-FACD.
- Horizontal installations are only approved for masonry/concrete.

CONTINUOUS DUCT APPLICATIONS

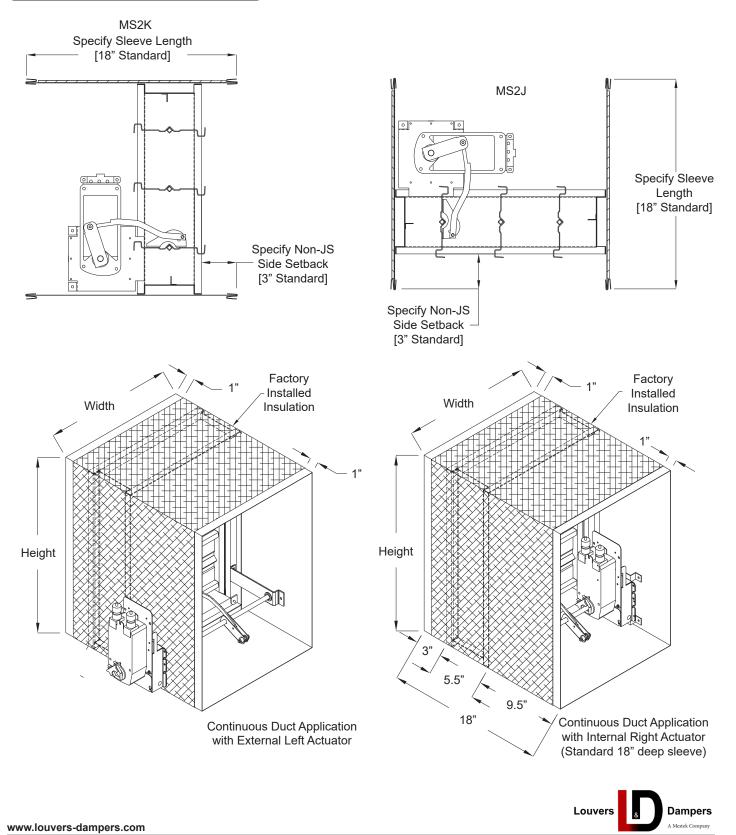

450 Riverside Drive • Wyalusing PA, 18853 • Phone 570-746-1888 • Fax 570-746-9286