
DOMINATOR 2100

Category I or Category III Appliance

(see Installation and Operation Manual for venting information)

CODE OPTIONS

CSD-1	UTC Lockout/Reset Control
C3D-1	Manual Reset I WCO

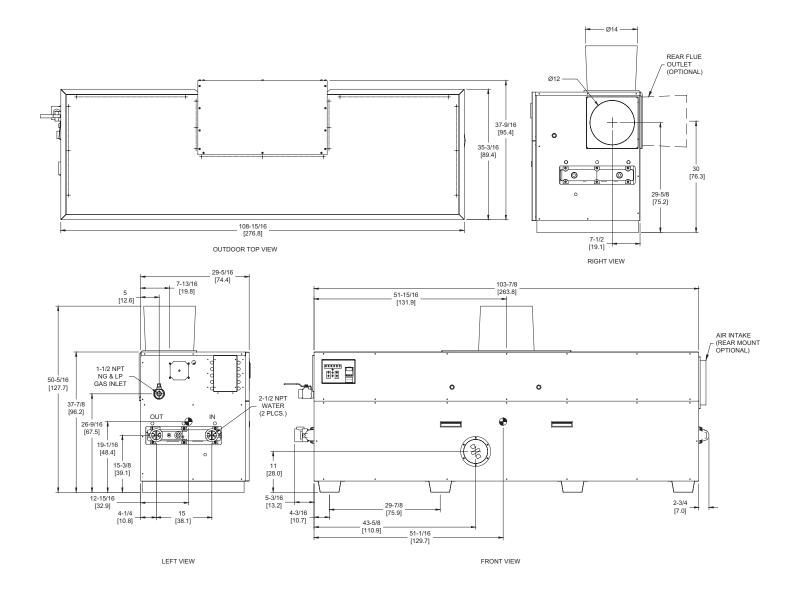

RSUB-36-G

Dominator 2100 model water heater not available for sale in Canada due to NRCan Regulations.

- Notes:
 1. Dimensions are approximate and should not be used to "rough-in" equipment.
 2. Dimensions are subject to change without notice.

- All dimensions are in inches (cm).
 Symbol indicates center of gravity.

BOILER CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural/Propane Gas	Boiler FLA	11.0*
Input BTU/hr.	2,100,000 / 616 kW	Min. Gas Pressure Required	7" WC**
Output BTU/hr.	1,764,000 / 517 kW	Max. Gas Pressure Allowed	14" WC
Electrical Requirements	120VAC/ 1 ph/ 60 hz	Operating Weight	1105 lbs. / 502 kg.

BOILER / WATER HEATER TRIM & CONTROLS

Main Gas Valve	Honeywell (2) V8944 1-1/4"	Pilot Valve	Honeywell VR8205
Firing Valve	Honeywell (2) B200T1041 1-1/4"	Air Switch	Cleveland RSS-495
Safety Valve	ASCO L8214G 1-1/2"	Blower Motor	(2) 1/4 hp - FLA 10.2
Ignition Control	UTC 1003-61A	Relief Valve - DW	3/4" x 3/4" set @ 125 psi
Operating Control	Tekmar BTC-2PA	Relief Valve - DB	3/4" x 1-1/4" set @ 50 psi
Operating Control	Tekmar BTC-4PA	Flow Switch	TACO
High Limit	Honeywell L4008E		

A.S.M.E.

ASME Sect IV Htg Surface	202.0 Sq. Ft. / 18.77 Sq. M.	Design Data	Max. 160 psig & 250°F	
Water Volume 5.6 gal / 21.4 Liters				

 ^{*} Add circulator amps.

BOILER TEMPERATURE RISE / PRESSURE DROP

30°F / 16.7°C				35°F / 19.4℃			
Flow	Rate	Pressure Drop		Flow Rate		Pressure Drop	
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa
117.6†	7.4†	11.00	32.4	100.8	6.4	8.27	24.4

[†] Flow exceeds recommended maximum use a greater temperature rise or consult manufacturer. Cupronickel heat exchanger should be considered.

WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)

40°F	22°C	60°F	33℃	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
5168	19535	3445	13024	2584	9768	2067	7814	1723	6512	1477	5582

Dominator 2100 model water heater not available for sale in Canada due to NRCan Regulations.

REP FIRM SUBMITTED BY	DOMINATOR 2100
JOB NAME ARCHITECT	Category I or Category III Appliance (see Installation and Operation Manual for venting information)
ENGINEER CONTRACTOR DATE	RELIABLE. BOLD. INNOVATIVE. A Division of Mestek, Inc. Westfield, MA 01085 (413) 564-5515

^{**} For incoming gas pressures lower than 7"WC natural or 11"WC propane, consult factory.