
## **DOMINATOR 300**

#### Category I or Category III Appliance


(see Installation and Operation Manual for venting information)

#### **CODE OPTIONS**


UTC Lockout/Reset Control CSD-1

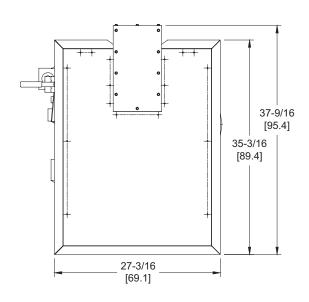


OUTDOOR TOP VIEW

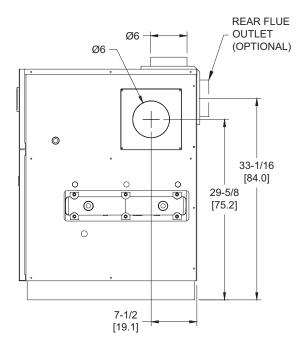

RIGHT VIEW

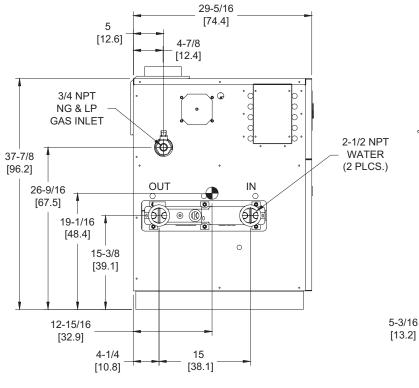

LEFT VIEW FRONT VIEW

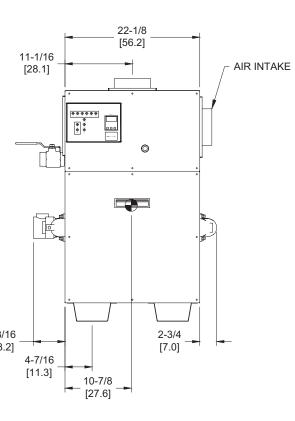

#### Dominator 300 model water heater not available for sale in Canada due to NRCan Regulations.

- **Notes:**1. Dimensions are approximate and should not be used to "rough-in" equipment.
- Dimensions are subject to change without notice.
- 3. All dimensions are in inches (cm).
  4. Symbol indicates center of gravity.

RSUB-27-E

#### **BOILER CERTIFIED RATINGS & CAPACITIES**

Fuel Type	Natural/Propane Gas	Boiler FLA	3.8*
Input BTU/hr.	300,000 / 88 kW	Min. Gas Pressure Required	7" WC**
Output BTU/hr.	252,000 / 74 kW	Max. Gas Pressure Allowed	14" WC
Electrical Requirements	120VAC/ 1 ph/ 60 hz	Operating Weight	416 lbs. / 189 kg.

#### **BOILER / WATER HEATER TRIM & CONTROLS**

Main Gas Valve	Honeywell VR8304 3/4"	Pilot Valve	Honeywell VR8304	
Firing Valve	Honeywell B200T1025 3/4"	Air Switch	Cleveland RSS-495	
Ignition Control	JTC 1003-61A Blower Motor		1/5 hp - FLA 3.0	
High Limit	Honeywell L4008E	ell L4008E <b>Relief Valve - DW</b>		
		Relief Valve - DB	3/4" x 3/4" set @ 50 psi	
		Flow Switch	TACO	

#### A.S.M.E.

ASME Sect IV Htg Surface	38.0 Sq. Ft. / 3.53 Sq. M.	Design Data	Max. 160 psig & 250°F		
Water Volume	3.5 gal / 13.2 Liters				

<sup>\*</sup> Add circulator amps.

#### **BOILER TEMPERATURE RISE / PRESSURE DROP**

15°F / 8.3°C			20°F / 11.1°C				25°F / 13.9℃				
Flow	Rate	Pressur	e Drop	Flow Rate		Pressure Drop		Flow Rate		Pressure Drop	
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa
33.6	2.1	0.21	0.6	25.2	1.6	0.13	0.4	20.2	1.3	0.08	0.2

### WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)

40°F	22°C	60°F	33℃	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
720	2723	480	1815	360	1361	288	1089	240	908	206	778

Dominator 300 model water heater not available for sale in Canada due to NRCan Regulations.

REP FIRM	
SUBMITTED BY	
JOB NAME	
ARCHITECT	
ENGINEER	
CONTRACTOR	
DATE	

# **DOMINATOR 300**

#### **Category I or Category III Appliance**

(see Installation and Operation Manual for venting information)



A Division of Mestek, Inc. Westfield, MA 01085 (413) 564-5515

<sup>\*\*</sup> For incoming gas pressures lower than 7"WC natural or 11"WC propane, consult factory.