
CODE OPTIONS


CSD-1

STANDARD

FlexCore 3500

Category II or Category IV Appliance (see Installation and Operation Manual for venting information)

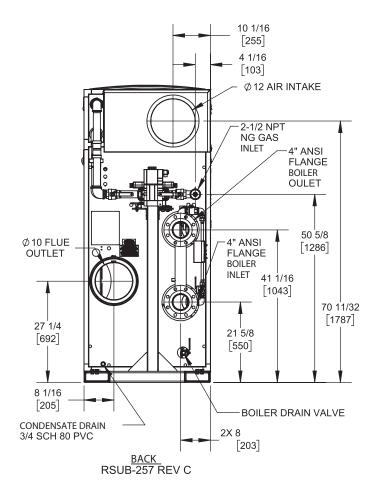

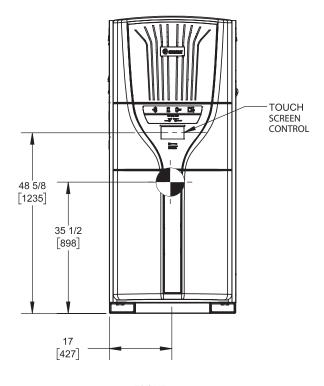


FRONT RSUB-257 REV C

- Notes:
 Dimensions are approximate and should not be used to "rough-in" equipment.
 Dimensions are subject to change without notice.
- All dimensions are in inches (mm).
 Symbol indicates center of gravity.

FlexCore 3500 **Category II or Category IV Appliance**

CSD-1

STANDARD

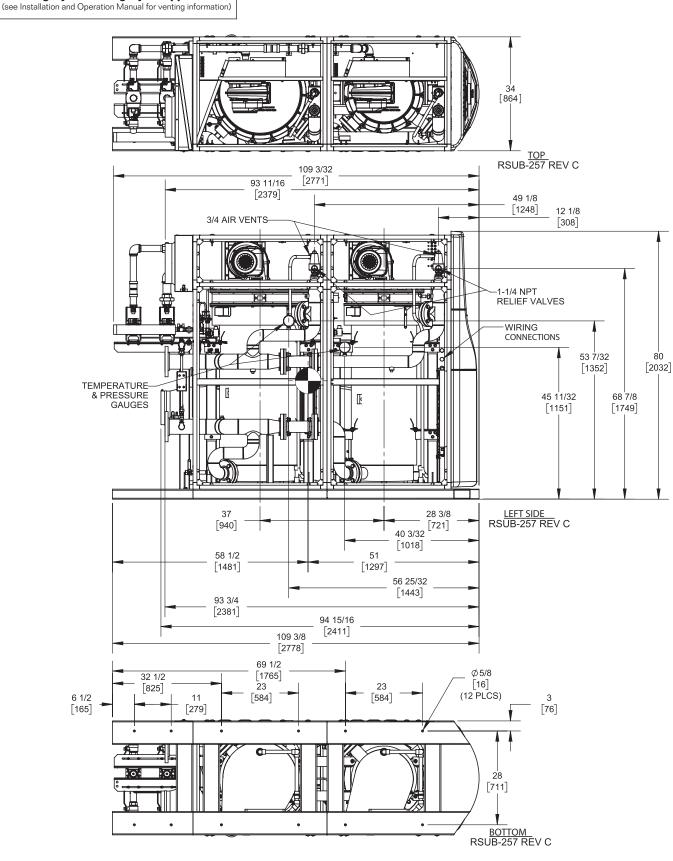

- Notes:
 Dimensions are approximate and should not be used to "rough-in" equipment.
 Dimensions are subject to change without notice.
- 3. All dimensions are in inches (mm).
- 4. Symbol indicates center of gravity.

BOILER CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural Gas	Boiler FLA	20.6*
Input BTU/hr.	3,499,000 / 1025 KW	Boiler HP	99.4
Output BTU/hr.	3,327,549 MBH / 975 KW	Min. Gas Pressure Required	3" W.C.
Electrical Requirements	230 VAC/60 Hz/3PH	Max. Gas Pressure Allowed	14" W.C.
		Operating Weight	4070 lbs / 1846 kg

BOILER TRIM & CONTROLS

Main Gas Valve	Dungs MBC	Air Switch	Huba
Firing Valve	1 1/2" Apollo	Flow Sensor	SIKA
Ignition Control	Honeywell RM7895C	Blocked Flue Switch	Cleveland NS2
Operating Control	HeatNet®	Blower Motor	Ametek
High Limit	Jumo	L.W.C.O.	800
Main Ball Valve	1 1/2" Apollo	Relief Valve (2)	1" x 1-1/4" set @ 50 psi
Pilot Cock	1/4"	Pilot Regulator	White-Rodgers

A.S.M.E.

ASME Sect IV Fire Side	292 Sq. Ft. / 21.7 Sq. M.	Design Data	Max. 160 psig & 210°F		
Htg Surface		Water Volume	102 gal / 385 liters		
ASME Sect IV Water Side	306 Sq. Ft. / 28.5 Sq. M.				
Htg Surface					
CV. GPM (1PSID)	165				

* Add circulator amps.

BOILER TEMPERATURE RISE / PRESSURE DROP (Based on Full Input)

	20°F /	11.1°C	,	40°F / 22.2°C			60°F / 33.3°C				80°F / 44.4°C				100°F / 55.5°C				
	ow ate		sure	Flo Ra	-		sure	Flo Ra	ow ite		sure	Flo Ra	-		sure		ow ate		sure
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa
332.9	21.0	9.4	28.1	166.4	10.5	2.3	7.0	111.0	7.0	1.0	3.1	83.2	5.3	0.6	1.8	66.6	4.2	0.4	1.1

Flow	GPM	Temp. Ri	se** (°F)	Vent Length	n (Equiv. Ft.)	Air Inlet Length (Equiv. Ft.)		
Min	Max	Min	Max	Min	Max	Min	Max	
66.6	332.9	20	100	6	100	0	100	

** Min/Max delta t reflects boiler operation at full input. For applications requiring operation above/below these parameters please consult factory.

REP FIRM	
SUBMITTED BY	
JOB NAME	
ARCHITECT	
ENGINEER	
CONTRACTOR	
DATE	

FlexCore 3500

Category II or Category IV Appliance (see Installation and Operation Manual for venting information)



A Division of Mestek, Inc. Westfield, MA 01085 (413) 564-5515