
CODE OPTIONS

CSD-1 Manual Reset LWCO

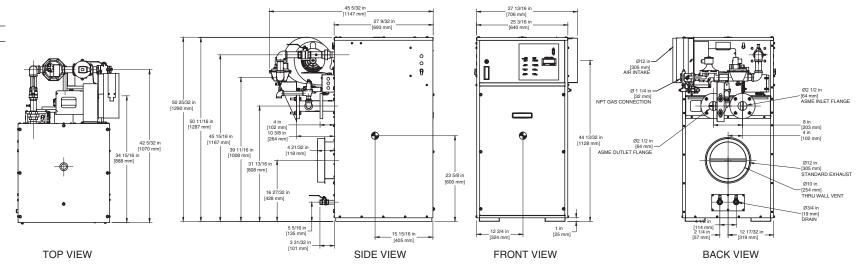

Notes:

- 1. Dimensions are approximate and should not be used to "rough-in" equipment.
- 2. Dimensions are subject to change without notice.

BOILER CERTIFIED RATINGS & CAPACITIES

| Fuel Type | Natural/Propane Gas | Boiler FLA | 9.9* | | |
|-------------------------|------------------------|----------------------------|--------------------|--|--|
| Input BTU/hr. | 1,250,000 / 366 kW | Min. Gas Pressure Required | 5"W.C.** | | |
| Output BTU/hr. | 1,062,500 / 311 kW | Max. Gas Pressure Allowed | 14" W.C. | | |
| Electrical Requirements | 120 VAC / 1 ph / 60 hz | Operating Weight | 673 lbs. / 306 kg. | | |

BOILER / WATER HEATER TRIM & CONTROLS

| Main Gas Valve | V4944B | Pilot Regulator | White-Rodgers 25M |
|---------------------------|--------------------|-------------------|---------------------------|
| Firing Valve | 1 1/4" | Main Ball Valve | 1 1/4" |
| Safety Valve | ASCO L8214G 1 1/4" | Air Switch | HUBA |
| Ignition Control | Honeywell RM7897C | Blower Motor | Fasco 1/2 hp - FLA 8.2 |
| Operating Control (FB/FW) | Jumo | Relief Valve - FB | 3/4" x 1" set @ 50 psi |
| High Limit | Honeywell L4008E | Relief Valve - FW | 3/4" x 3/4" set @ 125 psi |
| | | Flow Switch | TACO |

A.S.M.E.

| ASME Sect IV Htg Surface | 133.76 Sq. Ft. / 12.43 Sq. M. | Design Data | Max. 160 psig & 250°F | | |
|--------------------------|-------------------------------|-------------|-----------------------|--|--|
| Water Volume | 4.7 gal / 17.8 Liters | | | | |

- * Add circulator amps.
- ** For incoming gas pressures lower than 5" W.C. natural or 11" W.C. propane, consult factory.

BOILER TEMPERATURE RISE / PRESSURE DROP

| | 20°F / | 11.1°C | | | 25°F/ | 13.9°C | 13.9°C 30°F / 16. | | | 16.7°C | | 35°F / 19.4°C | | | |
|-------|--------|---------|---------|------|-------|---------|-------------------|------|------|---------|--------|---------------|------|---------|--------|
| Flow | Rate | Pressur | re Drop | Flow | Rate | Pressur | e Drop | Flow | Rate | Pressur | e Drop | Flow | Rate | Pressur | e Drop |
| GPM | L/s | Ft | kPa | GPM | L/s | Ft | kPa | GPM | L/s | Ft | kPa | GPM | L/s | Ft | kPa |
| 106.3 | 6.7 | 2.11 | 6.2 | 85.0 | 5.4 | 1.40 | 4.1 | 70.8 | 4.5 | 1.00 | 2.9 | 60.7 | 3.8 | 0.70 | 2.2 |


WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)

| 40°F | 22°C | 60°F | 33℃ | 80°F | 44°C | 100°F | 56℃ | 120°F | 67°C | 140°F | 78°C |
|------|-------|------|------|------|------|-------|------|-------|------|-------|------|
| 3121 | 11798 | 2081 | 7866 | 1561 | 5899 | 1248 | 4719 | 1040 | 3933 | 892 | 3371 |

Boilers & Water Heaters not available for sale in Canada due to NRCan regulations.

| REP FIRM | FUTERA II 1250 |
|--------------------------|--|
| JOB NAME | Category I or Category III Appliance (see Installation and Operation Manual for venting information) |
| ENGINEER CONTRACTOR DATE | A Division of Mestek, Inc. Westfield, MA 01085 (413) 568-9571 |

OUTDOOR UNIT

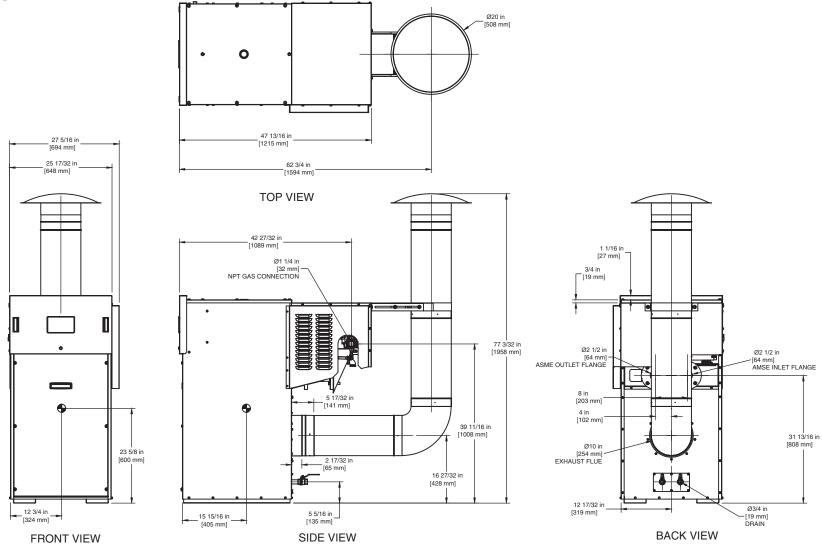

Boilers & Water Heaters not available for sale in Canada due to NRCan regulations.

Notes:

- Dimensions are approximate and should not be used to "rough-in" equipment.
 Dimensions are subject to change without notice.

FUTERA II 1250