
CODE OPTIONS

CSD-1

UTC Lockout/Reset Control Manual Reset LWCO

LCD 1650

Category I or Category III Appliance (see Installation and Operation Manual for venting information)

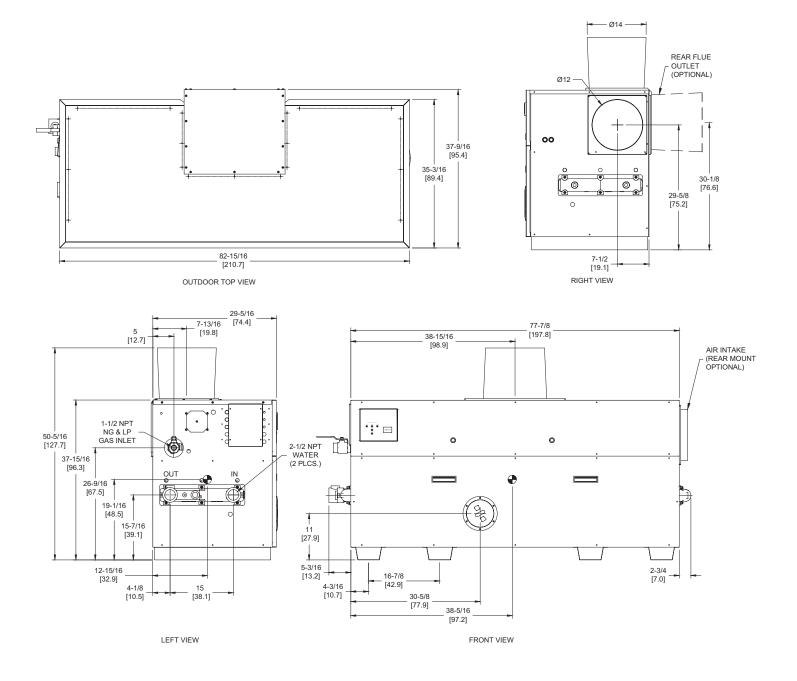

RSUB-22-F

LCD 1650 model water heater not available for sale in Canada due to NRCan Regulations.

Notes:

- Dimensions are approximate and should not be used to "rough-in" equipment. Dimensions are subject to change without notice.
- 2.
- All dimensions are in inches (cm).
 Symbol indicates center of gravity.

BOILER CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural/Propane Gas	Boiler FLA	11.0*
Input BTU/hr.	1,650,000 / 483 kW	Min. Gas Pressure Required	7" WC**
Output BTU/hr.	1,353,000 / 396 kW	Max. Gas Pressure Allowed	14" WC
Electrical Requirements	120VAC/ 1 ph/ 60 hz	Operating Weight	906 lbs. / 411 kg.

BOILER / WATER HEATER TRIM & CONTROLS

Main Gas Valve	Honeywell V8944B 1-1/2"	Pilot Valve	Honeywell VR8205Q
Firing Valve	Honeywell B200T1058 1-1/2"	Air Switch	Cleveland RSS-495
Safety Valve	Honeywell V48A 1-1/2"	Blower Motor	(2) 1/4 hp - FLA 10.2
Ignition Control	UTC 1003-61A	Relief Valve - LW	3/4" x 3/4" set @ 125 psi
Operating Control (LB/LW)	Jumo	Relief Valve - LB	1" x 1- 1/4" set @ 50 psi
High Limit (LB/LW)	Jumo	Flow Switch	ТАСО

A.S.M.E.

ASME Sect IV Htg Surface	149 Sq. Ft. / 13.84 Sq. M.	Design Data	Max. 160 psig & 250°F
Water Volume 4.9 gal / 18.6 Liters			

* Add circulator amps.

** For incoming gas pressures lower than 7" WC natural or 11" WC propane, consult factory.

BOILER TEMPERATURE RISE / PRESSURE DROP

	25°F / 13.9°C			30°F / 16.7°C				35°F / 19.4°C			
Flow	Rate	Pressur	re Drop	Flow	Rate	Pressur	re Drop	Flow	Rate	Pressur	re Drop
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa
108.2	6.8	7.02	20.7	90.2	5.7	5.01	14.8	77.3	4.9	3.77	11.1

WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)

40°F	22°C	60°F	33°C	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
4075	15405	2717	10270	2038	7703	1630	6162	1358	5135	1164	4402

LCD 1650 model water heater not available for sale in Canada due to NRCan Regulations.

REP FIRM	LCD 1650
JOB NAMEARCHITECT	Category I or Category III Appliance (see Installation and Operation Manual for venting information)
ENGINEER CONTRACTOR DATE	 A Division of Mestek, Inc. Westfield, MA 01085 (413) 564-5515