
SPECTRUM 250

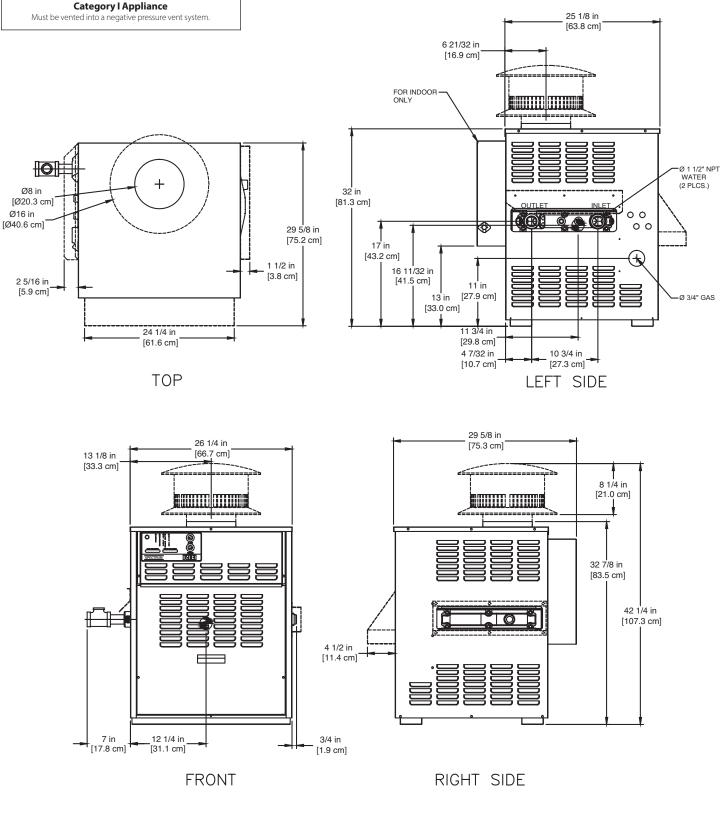

RSUB-4-C

Notes:

Dimensions are approximate and should not be used to "rough-in" equipment.
Dimensions are subject to change without notice.

NOTE:

FOR OUTDOOR ONLY

WATER HEATER CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural/Propane Gas	Boiler FLA	1*
Input BTU/hr.	250,000 / 73 kW	Min. Gas Pressure Required	5" WC**
Output BTU/hr.	200,000 / 58.6 kW	Max. Gas Pressure Allowed	14" WC
Electrical Requirements	120VAC / 1 ph / 60 hz	Operating Weight	218 lbs. / 99 kg.

WATER HEATER TRIM & CONTROLS

Gas Valve - INT	Honeywell VR8304M 3/4"	Ignition Control (SW)	Honeywell S86IOM
Gas Valve	Honeywell VR8304Q 3/4"- 2 Stg.	Relief Valve - SW	3/4" x 3/4" set @ 125 psi
Operating Control (SW)	Honeywell - On/Off	Flow Switch	ТАСО
Operating Control (SW)	Jumo - 2-Stage		
High Limit (SW)	Jumo		

A.S.M.E.

ASME Sect IV Htg Surface	36.7 Sq. Ft. / 3.41 Sq. M.	Design Data	Max. 160 psig & 250°F
Water Volume	1.3 gal / 4.85 Liters		

* Add circulator amps.

** For incoming gas pressures lower than 5" WC natural or 11" WC propane, consult factory.


WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)

40°F	22°C	60°F	33°C	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
600	2269	400	1513	300	1134	240	908	200	756	171	648

Spectrum 250 model available as a Water Heater only. Spectrum 250 model water heater not available for sale in Canada due to NRCan Regulations.

REP FIRM	SPECTRUM 250
JOB NAME	Category I Appliance Must be vented into a negative pressure vent system.
ENGINEER CONTRACTOR DATE	RELIABLE. BOLD. INNOVATIVE. A Division of Mestek, Inc. Westfield, MA 01085 (413) 568-9571

SPECTRUM 300

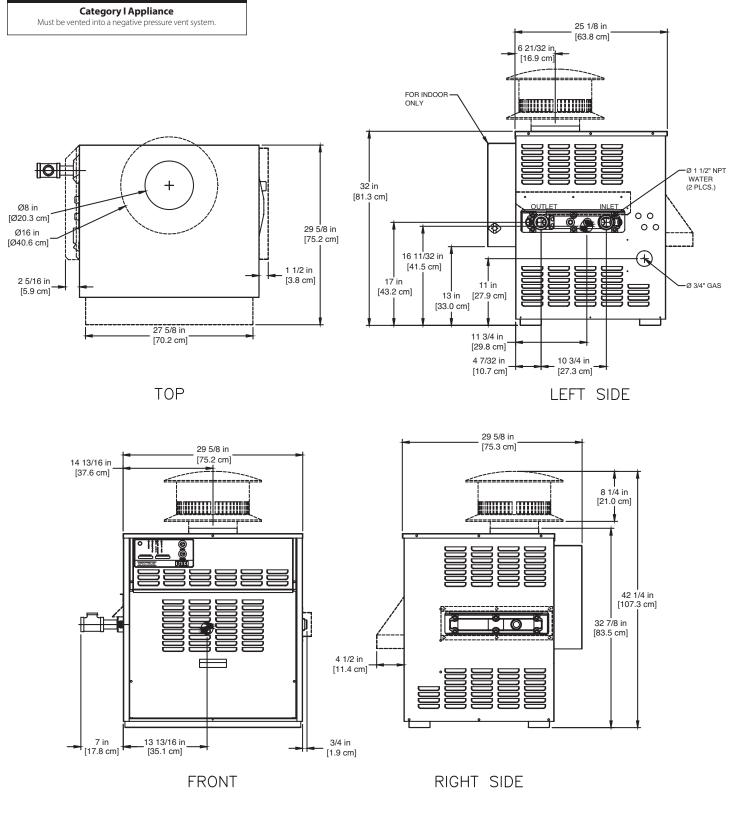

RSUB-5-C

Notes:

Dimensions are approximate and should not be used to "rough-in" equipment.
Dimensions are subject to change without notice.

NOTE:

FOR OUTDOOR ONLY

BOILER CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural/Propane Gas	Boiler FLA	1*
Input BTU/hr.	301,000 / 88 kW	Min. Gas Pressure Required	5" WC**
Output BTU/hr.	246,820 / 72 kW	Max. Gas Pressure Allowed	14" WC
Electrical Requirements	120VAC / 1 ph / 60 hz	Operating Weight	232 lbs. / 105 kg.

BOILER / WATER HEATER TRIM & CONTROLS

Gas Valve - INT	Honeywell VR8304M 3/4"	Ignition Control (SB On/Off)	Honeywell S9361A2085
Gas Valve	Honeywell VR8304Q 3/4"- 2 Stg.	Ignition Control (SB 2 Stg.)	Honeywell S86IOM
Operating Control (SB/SW)	Honeywell - On/Off	Ignition Control (SW)	Honeywell S86IOM
Operating Control (SB/SW)	Jumo - 2-Stage	Relief Valve - SW	3/4" x 3/4" set @ 125 psi
High Limit (SB/SW)	Jumo	Relief Valve - SB	3/4" x 3/4" set @ 30 psi
	·	Flow Switch	TACO

A.S.M.E.

ASME Sect IV Htg Surface	42.5 Sq. Ft. / 3.95 Sq. M.	Design Data	Max. 160 psig & 250°F	
Water Volume	1.4 gal / 5.11 Liters			

* Add circulator amps.

** For incoming gas pressures lower than 5" WC natural or 11" WC propane, consult factory.

BOILER TEMPERATURE RISE / PRESSURE DROP

	30°F / 16.7°C				20°F / 11.1°C					′ 5.5°C	10°F /	
	re Drop	Pressur	Rate	Flow	re Drop	Pressur	Rate	Flow	re Drop	Pressur	Rate	Flow
	kPa	Ft	L/s	GPM	kPa	Ft	L/s	GPM	kPa	Ft	L/s	GPM
2 Pass	0.3	0.10	1.0	16.5	0.7	0.22	1.6	24.7	2.4	0.80	3.1	49.4
4 Pass	2.2	0.80	1.0	16.5	4.7	1.60	1.6	24.7	17.1	5.79	3.1†	49.4†

† Flow exceeds recommended maximum use a greater temperature rise or consult manufacturer. Cupronickel heat exchanger should be considered.

WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)

40°F	22°C	60°F	33℃	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
720	2723	480	1815	360	1361	288	1089	240	908	206	778

Spectrum 300 model water heater not available for sale in Canada due to NRCan Regulations.

REP FIRM	
SUBMITTED BY	
JOB NAME	
ARCHITECT	
ENGINEER	
CONTRACTOR	
DATE	

SPECTRUM 300

Category I Appliance

Must be vented into a negative pressure vent system.



A Division of Mestek, Inc. Westfield, MA 01085 (413) 568-9571

SPECTRUM 350 Category I Appliance

Must be vented into a negative pressure vent system. 25 1/8 in [63.8 cm] 6 21/32 in [16.9 cm] ~ _____ ----FOR INDOOR ONLY £2 Ð Ø 1 1/2" NPT WATER (2 PLCS.) +Ø9 in 32 in INLE [Ø22.9 cm] [81.3 cm] 0 0 C (C) (I (H)I 0 0 ٩ 29 5/8 in [75.2 cm] Ø18 in [Ø45.7 cm] 17[']in [43.2 cm] + 16 11/32 in [41.5 cm] 13 in 1 1/2 in [33.0 cm] [11 in -Ø 3/4" GAS 2 5/16 in [3.8 cm] [5.9 cm] [27.9 cm] 31 in 11 3/4 in [78.7 cm] [29.8 cm] 4 7/32 in 10 3/4 in [27.3 cm] [10.7 cm] LEFT SIDE TOP 33 in 29 5/8 in [83.8 cm] [75.3 cm] 16 1/2 in [41.9 cm] 9 1/4 in [23.5 cm] 43 1/4 in [109.9 cm] þ 32 7/8 in [83.5 cm] 0 4 1/2 in [11.4 cm]

3/4 in

[1.9 cm]

RIGHT SIDE

_15 3/8 in [39.1 cm]

FRONT

7 in [17.8 cm]

FOR OUTDOOR ONLY

NOTE:

SSPEC-350-9

RSUB-6-C

BOILER CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural/Propane Gas	Boiler FLA	1*
Input BTU/hr.	350,000 / 103 kW	Min. Gas Pressure Required	5" WC**
Output BTU/hr.	285,600 / 84 kW	Max. Gas Pressure Allowed	14" WC
Electrical Requirements	120VAC / 1 ph / 60 hz	Operating Weight	252 lbs. / 114 kg.

BOILER / WATER HEATER TRIM & CONTROLS

Gas Valve - INT	Honeywell VR8304M 3/4"	Ignition Control (SB On/Off)	Honeywell S9361A2085
Gas Valve	Honeywell VR8304Q 3/4"- 2 Stg.	Ignition Control (SB 2 Stg.)	Honeywell S86IOM
Operating Control (SB/SW)	Honeywell - On/Off	Ignition Control (SW)	Honeywell S86IOM
Operating Control (SB/SW)	Jumo 2-Stage	Relief Valve - SW	3/4" x 3/4" set @ 125 psi
High Limit (SB/SW)	Jumo	Relief Valve - SB	3/4" x 3/4" set @ 30 psi
		Flow Switch	TACO

A.S.M.E.

ASME Sect IV Htg Surface	48.5 Sq. Ft. / 4.50 Sq. M.	Design Data	Max. 160 psig & 250°F
Water Volume	1.4 gal / 5.38 Liters		

× Add circulator amps.

** For incoming gas pressures lower than 5" WC natural or 11" WC propane, consult factory.

BOILER TEMPERATURE RISE / PRESSURE DROP

	10°F /	′ 5.5°C			20°F / 11.1°C				30°F / 16.7°C			
Flow	Rate	Pressur	re Drop	Flow	Rate	Pressur	re Drop	Flow	Rate	Pressur	re Drop	-
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	-
57.1	3.6	1.20	3.5	28.6	1.8	0.33	1.0	19.0	1.2	0.20	0.5	2 Pass
-	-	-	-	28.6	1.8	2.39	7.0	19.0	1.2	1.10	3.3	4 Pass

WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)


40°F	22°C	60°F	33°C	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
840	3176	560	2118	420	1588	336	1271	280	1059	240	908

Spectrum 350 model water heater not available for sale in Canada due to NRCan Regulations.

REP FIRM	SPECTRUM 350
JOB NAME	Category I Appliance Must be vented into a negative pressure vent system.
ENGINEER CONTRACTOR DATE	REBALA Division of Mestek, Inc.RELIABLE. BOLD. INNOVATIVE.Westfield, MA 01085(413) 568-9571

SSPEC-350-9

SPECTRUM 400

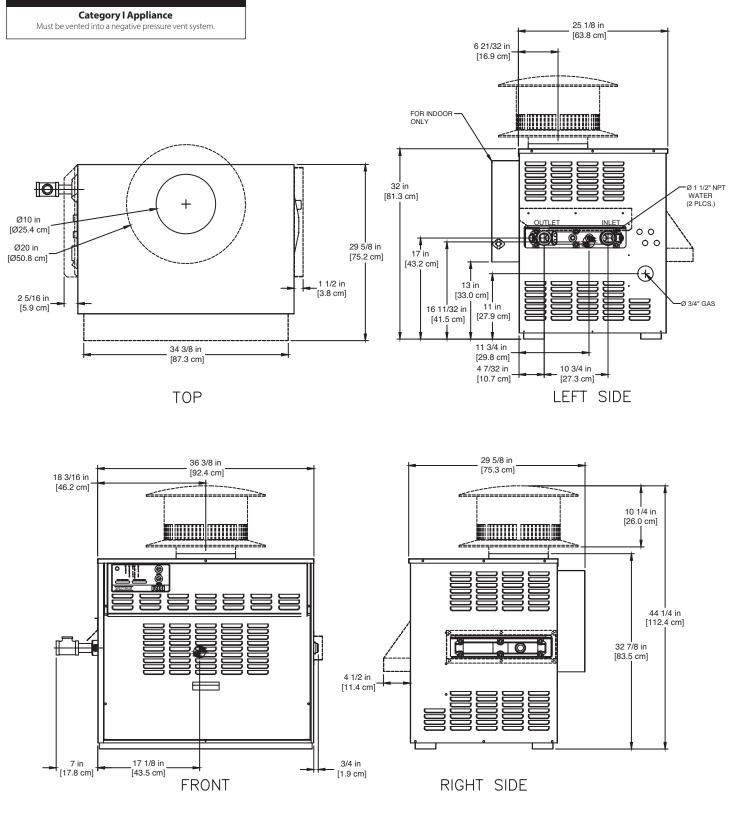

RSUB-7-C

Notes:

Dimensions are approximate and should not be used to "rough-in" equipment.
Dimensions are subject to change without notice.

NOTE:

FOR OUTDOOR ONLY

BOILER CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural/Propane Gas	Boiler FLA	1*
Input BTU/hr.	399,000 / 117 kW	Min. Gas Pressure Required	5" WC**
Output BTU/hr.	323,988 / 95 kW	Max. Gas Pressure Allowed	14" WC
Electrical Requirements	120VAC / 1 ph / 60 hz	Operating Weight	264 lbs. / 120 kg.

BOILER / WATER HEATER TRIM & CONTROLS

Gas Valve - INT	Honeywell VR8304M 3/4"	Ignition Control (SB On/Off)	Honeywell \$9361A2085
Gas Valve	Honeywell VR8304Q 3/4"- 2 Stg	Ignition Control (SB 2 Stg.)	Honeywell S86IOM
Operating Control (SB/SW)	Honeywell - On/Off	Ignition Control (SW)	Honeywell S86IOM
Operating Control (SB/SW)	Jumo - 2-Stage	Relief Valve - SW	3/4" x 3/4" set @ 125 psi
High Limit (SB/SW)	Jumo	Relief Valve - SB	3/4" x 3/4" set @ 30 psi
		Flow Switch	TACO

A.S.M.E.

ASME Sect IV Htg Surface	54.3 Sq. Ft. / 5.04 Sq. M.	Design Data	Max. 160 psig & 250°F
Water Volume	1.5 gal / 5.64 Liters		

* Add circulator amps.

** For incoming gas pressures lower than 5" WC natural or 11" WC propane, consult factory.

BOILER TEMPERATURE RISE / PRESSURE DROP

	10°F /	′ 5.5°C			20°F /	11.1°C			30°F /	16.7°C		
Flow	Rate	Pressur	re Drop	Flow	Rate	Pressur	re Drop	Flow	Rate	Pressur	re Drop	-
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	_
64.8	4.1	1.69	5.0	32.4	2.0	0.47	1.4	21.6	1.4	0.20	0.7	2 Pass
-	-	-	-	32.4	2.0	3.40	10.0	21.6	1.4	1.60	4.7	4 Pass

WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)

40°F	22°C	60°F	33°C	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
960	3630	640	2420	480	1815	384	1452	320	1210	274	1037

Spectrum 400 model water heater not available for sale in Canada due to NRCan Regulations.

REP FIRM	SPECTRUM 400
JOB NAME	Category I Appliance Must be vented into a negative pressure vent system.
ENGINEER CONTRACTOR DATE	RELIABLE. BOLD. INNOVATIVE. A Division of Mestek, Inc. Westfield, MA 01085 (413) 568-9571

SSPEC-400-9