TORUS 2500 VERTICAL

Category II or Category IV Appliance


(see Installation and Operation Manual for venting information)

CODE OPTIONS

CSD-1

FIRMWARE W/REMOTE TEST MANUAL RESET LWCO

INDOOR UNIT

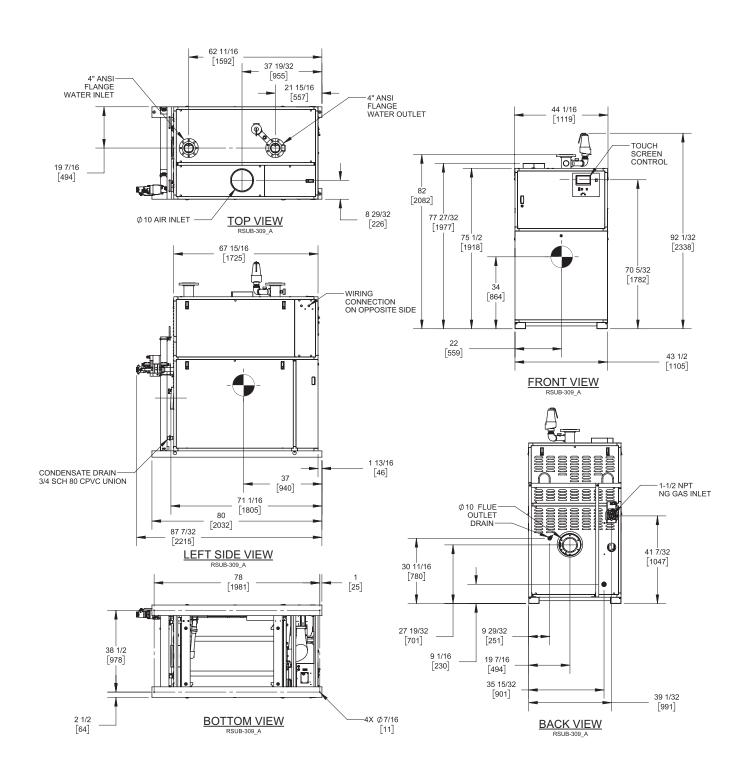

Notes:

- Dimensions are approximate and should not be used to "rough-in" equipment.
- 2. Dimensions are subject to change without notice.
- 3. All dimensions are in inches (mm).
- Symbol indicates center of gravity.

TORUS 2500 VERTICAL

Category II or Category IV Appliance


(see Installation and Operation Manual for venting information)

CODE OPTIONS

CSD-1

FIRMWARE W/REMOTE TEST MANUAL RESET LWCO

DUAL FUEL UNIT

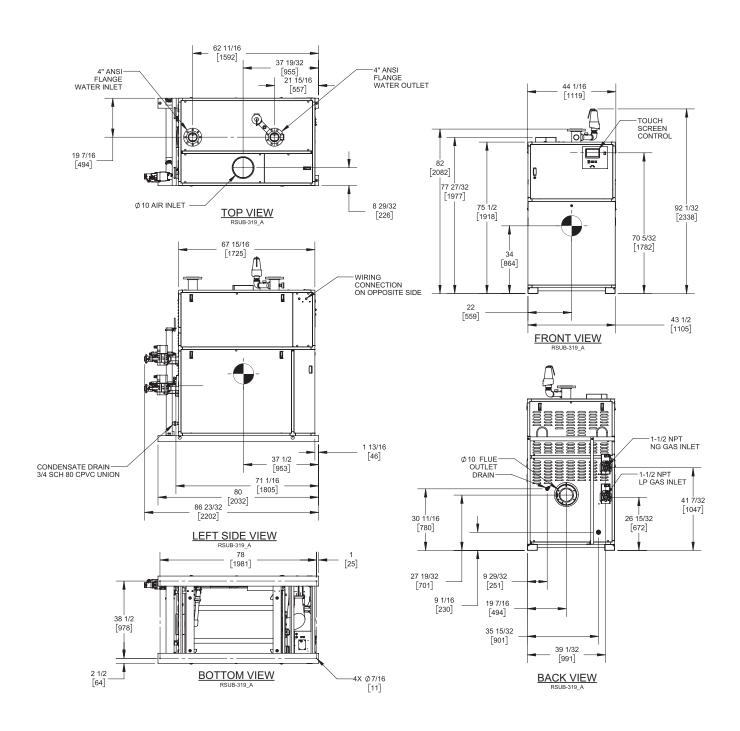

Notes:

- Dimensions are approximate and should not be used to "rough-in" equipment.
- 2. Dimensions are subject to change without notice.
- 3. All dimensions are in inches (mm).
- Symbol indicates center of gravity.

BOILER CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural/Propane Gas	Boiler FLA	15.05*
Input BTU/hr.	2,500,000 / 733 kW	Boiler HP	72.45
Output BTU/hr.	2,435,000 / 713 kW	Min. Gas Pressure Required	4" W.C.
Electrical Requirements	230 VAC/60 Hz/3PH	Max. Gas Pressure Allowed	14" W.C.
		Operating Weight	2311 lbs / 1048 kg

BOILER TRIM & CONTROLS

Main Gas Valve	Dungs MBC	Air Switch	Huba	
Firing Valve	1 1/2" Apollo	Flow Switch	SIKA	
Ignition Control	gnition Control Fenwal		Cleveland NS2	
Operating Control HeatNet®		Blower Motor	Ametek	
High Limit	High Limit Jumo		800	
Main Ball Valve 1 1/2" Apollo		Relief Valve (WB)	1" x 1 1/2" set @ 50 psi	
Pump contactor strongly recommended	for water heater applications.	Relief Valve (WW)	1 1/2" x 1 1/2" set @ 125 psi	

A.S.M.E.

ASME Sect IV Fire Side	300.69 Sq. Ft. / 27.94 Sq. M.	Design Data	Max. 160 psig & 210°F
Htg Surface		Water Volume	24.9 gal. / 94.3 Liters
ASME Sect IV Water Side	277.23 Sq. Ft. / 25.76 Sq. M.	pH Level	6.5-8.5
Htg Surface			

^{*} Add circulator amps.

BOILER TEMPERATURE RISE / PRESSURE DROP (Based on Full Input)

	20°F /	11.1°C		30°F / 16.7°C			40°F / 22.2°C			50°F / 27.8°C				60°F / 33.3°C					
	ow ate		sure op		ow ite		sure op	Flo Ra	ow ite		sure	Flo Ra	ow ate		sure	Flo Ra			sure op
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa
243.8	15.4	16.2	48.3	162.6	10.3	9.2	27.4	121.9	7.7	6.2	18.4	97.5	6.2	4.5	13.5	81.3	5.1	3.5	10.4

Flow GPI	И (Boiler)	Temp. Rise (°F) (Boiler**)	Vent Length	n (Equiv. Ft.)	Air Inlet Length (Equiv. Ft.)		
Min	Max	Min	Max	Min	Max	Min	Max	
81.3	243.8	20	60	10	160	0	160	

^{**} Min/Max delta t reflects boiler operation at full input. For applications requiring operation above/below these parameters please consult factory.

WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)

40°F	22°C	60°F	33°C	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
7278	27511	4852	18340	3639	13755	2911	11004	2426	9170	2079	7860

	Water Heater Min Flow Hates						
	Normal (4	to 12) gpg		Hard (12 to 15) gpg			
Flow	Rate	Pressu	re Drop	Flow	Rate	Pressure Drop	
gpm	L/s	Ft	kPa	gpm	L/s	Ft	kPa
214.0	13.5	13.4	40.1	285.0	18.0	20.2	60.4

REP FIRM	
SUBMITTED BY	
JOB NAME	
ARCHITECT	
ENGINEER	
CONTRACTOR	
DATE	

TORUS 2500 VERTICAL

Category II or Category IV Appliance

(see Installation and Operation Manual for venting information)



A Division of Mestek, Inc. Westfield, MA 01085 (413) 564-5515