TORUS 3000 VERTICAL

Category II or Category IV Appliance


(see Installation and Operation Manual for venting information)

CODE OPTIONS

CSD-1

FIRMWARE W/REMOTE
TEST MANUAL RESET LWCO

INDOOR UNIT

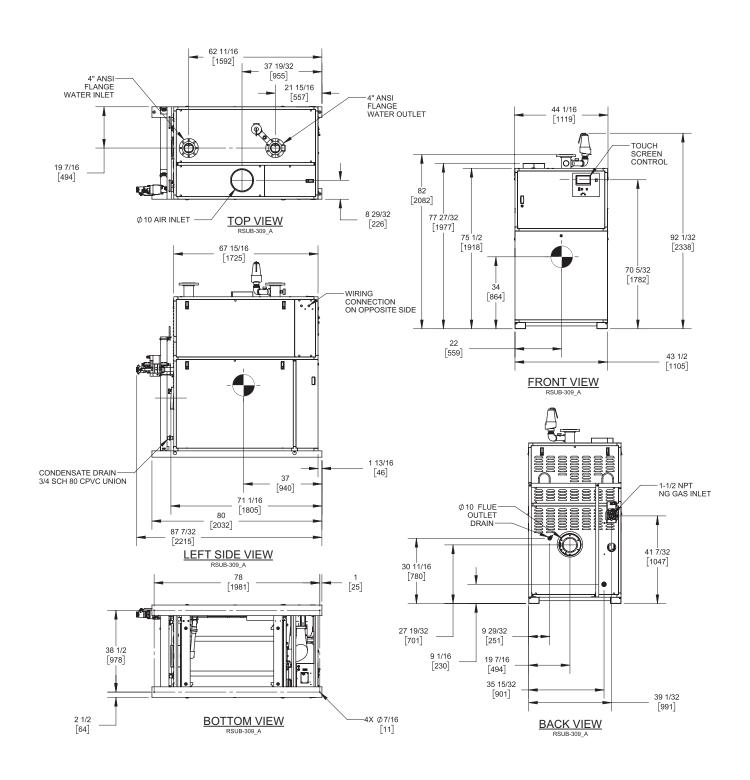

Notes:

- Dimensions are approximate and should not be used to "rough-in" equipment.
- 2. Dimensions are subject to change without notice.
- 3. All dimensions are in inches (mm).
- Symbol indicates center of gravity.

TORUS 3000 VERTICAL

Category II or Category IV Appliance


(see Installation and Operation Manual for venting information)

CODE OPTIONS

CSD-1

FIRMWARE W/REMOTE
TEST MANUAL RESET LWCO

DUAL FUEL UNIT

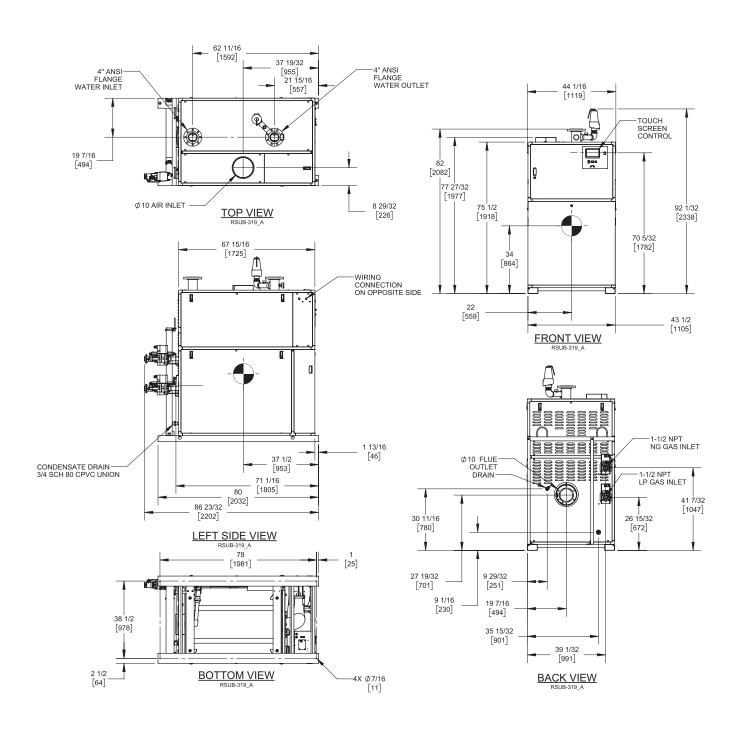

Notes:

- Dimensions are approximate and should not be used to "rough-in" equipment.
- 2. Dimensions are subject to change without notice.
- 3. All dimensions are in inches (mm).
- 4. Symbol indicates center of gravity.

BOILER CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural/Propane Gas	Boiler FLA	15.05*
Input BTU/hr.	3,000,000 / 879 kW	Boiler HP	87.39
Output BTU/hr.	2,925,000 / 857 kW	Min. Gas Pressure Required	4" W.C.
Electrical Requirements	230 VAC/60 Hz/3PH	Max. Gas Pressure Allowed	14" W.C.
	·	Operating Weight	2311 lbs / 1048 kg

BOILER TRIM & CONTROLS

Main Gas Valve	Dungs MBC	Air Switch	Huba	
Firing Valve	1 1/2" Apollo	Flow Switch	SIKA	
Ignition Control	Fenwal	Blocked Flue Switch	Cleveland NS2	
Operating Control HeatNet®		Blower Motor	Ametek	
High Limit	Jumo	L.W.C.O.	800	
Main Ball Valve 1 1/2" Apollo		Relief Valve (WB)	1" x 1 1/2" set @ 50 psi	
Pump contactor strongly recommended f	for water heater applications.	Relief Valve (WW)	1 1/2" x 1 1/2" set @ 125 psi	

A.S.M.E.

ASME Sect IV Fire Side	300.69 Sq. Ft. / 27.94 Sq. M.	Design Data	Max. 160 psig & 210°F
Htg Surface		Water Volume	24.9 gal. / 94.3 Liters
ASME Sect IV Water Side	277.23 Sq. Ft. / 25.76 Sq. M.	pH Level	6.5-8.5
Htg Surface			

^{*} Add circulator amps.

BOILER TEMPERATURE RISE / PRESSURE DROP (Based on Full Input)

	20°F / 11.1°C 30°F / 16.7°			16.7°C		40°F / 22.2°C			50°F / 27.8°C				60°F / 33.3°C						
	ow ate		sure op	1	ow ate		sure op		ow ate		sure op	1	ow ate		sure		ow ate		sure
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa
292.6	18.5	21.0	62.7	195.1	12.3	11.8	35.3	146.3	9.2	7.9	23.7	117.0	7.4	5.8	17.4	97.5	6.2	4.5	13.5

Flow GPN	И (Boiler)	Temp. Rise (°	°F) (Boiler**)	Vent Length	n (Equiv. Ft.)	Air Inlet Length (Equiv. Ft.)		
Min	Max	Min	Max	Min	Max	Min	Max	
97.5	292.6	20	60	10	160	0	160	

^{**} Min/Max delta t reflects boiler operation at full input. For applications requiring operation above/below these parameters please consult factory.

WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)

40°F	22°C	60°F	33°C	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
8824	33353	5882	22235	4412	16676	3529	13341	2941	11118	2521	9529

Water Heater Min Flow Rates

	Normal (4	to 12) gpg		Hard (12 to 15) gpg				
Flow Rate Pressure Drop			re Drop	Flow	Rate	Pressure Drop		
gpm	L/s	Ft	kPa	gpm	L/s	Ft	kPa	
214.0	13.5	13.4	40.1	285.0	18.0	20.2	60.4	

REP FIRM
SUBMITTED BY
JOB NAME
ARCHITECT
ENGINEER
CONTRACTOR
DATE

TORUS 3000 VERTICAL

Category II or Category IV Appliance

(see Installation and Operation Manual for venting information)



A Division of Mestek, Inc. Westfield, MA 01085 (413) 564-5515