


CODE OPTIONS

CSD-1* Manual Reset LWCO
 *Argus control is factory programmed for one ignition trial.

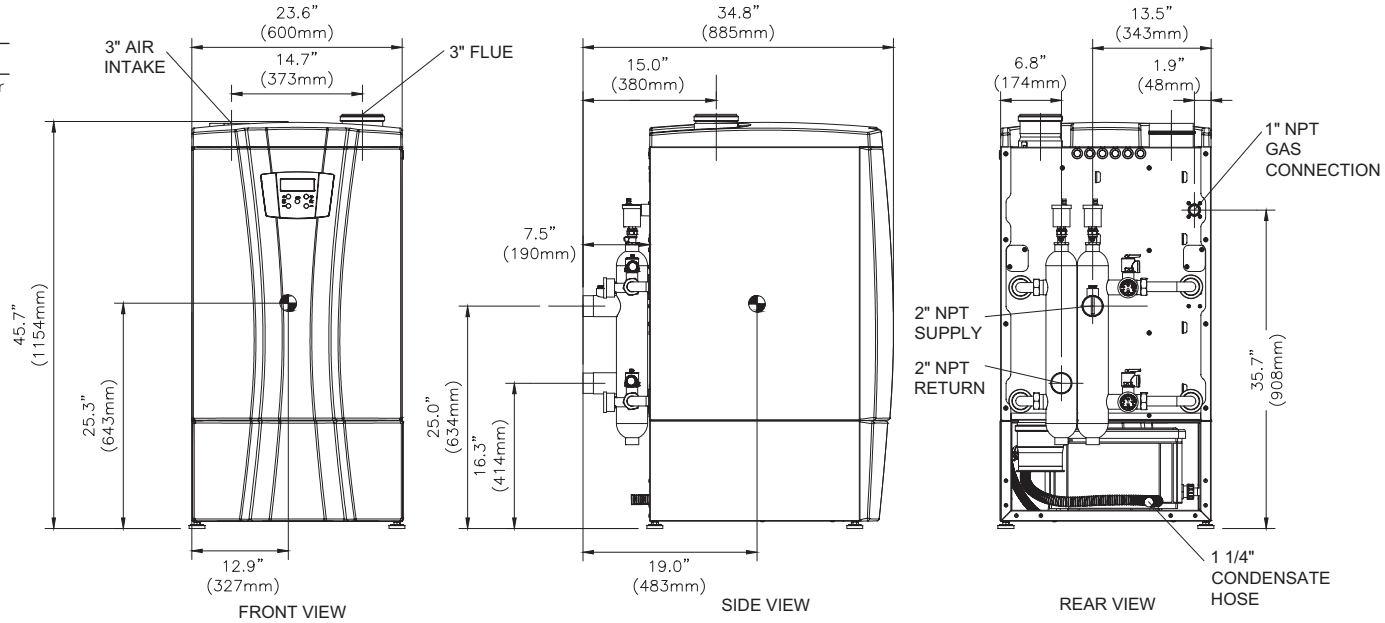

- Notes:**
 1. Dimensions are approximate and should not be used to "rough-in" equipment.
 2. Dimensions are subject to change without notice.
 3. Ⓞ Symbol indicates center of gravity.

BOILER CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural/Propane Gas	Boiler FLA	.92*
Input BTU/hr.	200,000 / 59 kW	Min. Gas Pressure Required	3" W.C.**
Output BTU/hr.	183,600 / 54 kW	Max. Gas Pressure Allowed	13" W.C.
Electrical Requirements	120VAC/ 1 ph/ 60 hz	Operating Weight	225 lbs. / 102 kg.

BOILER TEMPERATURE RISE / PRESSURE DROP

25°F / 13.9°C		30°F / 16.7°C				35°F / 19.4°C					
Flow Rate		Pressure Drop		Flow Rate		Pressure Drop		Flow Rate		Pressure Drop	
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa
14.6	.9	14.0	41.8	12.2	.8	10.1	30.2	10.4	.7	8.0	23.9

BOILER / WATER HEATER TRIM & CONTROLS

Main Gas Valve	Sit 848 Sigma	Air Switch	HUBA
Ignition Control	Argus	Blower Motor	EBM
Operating Control	Argus	Relief Valve - IW	3/4" x 3/4" @ 125 psi
High Limit	J2D-AOVJ	Relief Valve - IB	3/4" x 3/4" @ 50 psi

WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)

40°F	22°C	60°F	33°C	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
566	2140	377	1427	283	1070	226	856	189	713	162	611

A.S.M.E.

ASME Sect IV Htg Surface	4.80 Sq. Ft. / .45 Sq. M.	Design Data	Max. 160 psig & 210°F
Water Volume	1.7 gal / 6.43 Liters		

* Add circulator amps.
 ** For incoming gas pressures lower than 3" W.C. natural or propane, consult factory.

REP FIRM	_____	INFINITE ENERGY 2-199 Category II or IV Appliance (see Installation and Operation Manual for venting information)  RBI ® A Division of Mestek, Inc. Westfield, MA 01085 (413) 564-5515 <small>RELIABLE. BOLD. INNOVATIVE.</small>
SUBMITTED BY	_____	
JOB NAME	_____	
ARCHITECT	_____	
ENGINEER	_____	
CONTRACTOR	_____	
DATE	_____	