

Installer Certification Training

*Industry Leading Air to Water Heat
Pumps & Hydronic Solutions*



SPACE PAK®



FAQ's

I'm having problems with the audio, what should I do?

- If you joined this webinar using Computer/Internet Mode, you should dial in by phone with the number and access code provided in the invitation email.
- Call GoToWebinar Technical Support: (855) 352-9002

Will I receive the recording of this webinar?

- Yes, one hour after this webinar has ended you will receive an email with a link to the recorded video.

Can I receive a PDF copy of today's presentation?

- Yes! You will receive a copy of the presentation in a follow-up email.

House Keeping



Please make sure your **audio is kept on MUTE** unless you have been called on to ask a question.




Questions typed into the chat bar will be answered via written reply or by our trainer during the Q&A sessions, or throughout the presentation.

Mestek, Inc

- Established 1946 in Westfield, MA
- Privately owned
- Over 45 companies involved in the HVAC, Architectural, & Metal Forming Machinery & fabrication industries
- Began with founder John Reed and original Fin Tube Radiation in 1946 as Sterling Radiator Company
- 1975 Reed National
- 1986 merger becomes Mestek
- SpacePak joins Mestek family in 1991



Mestek Today

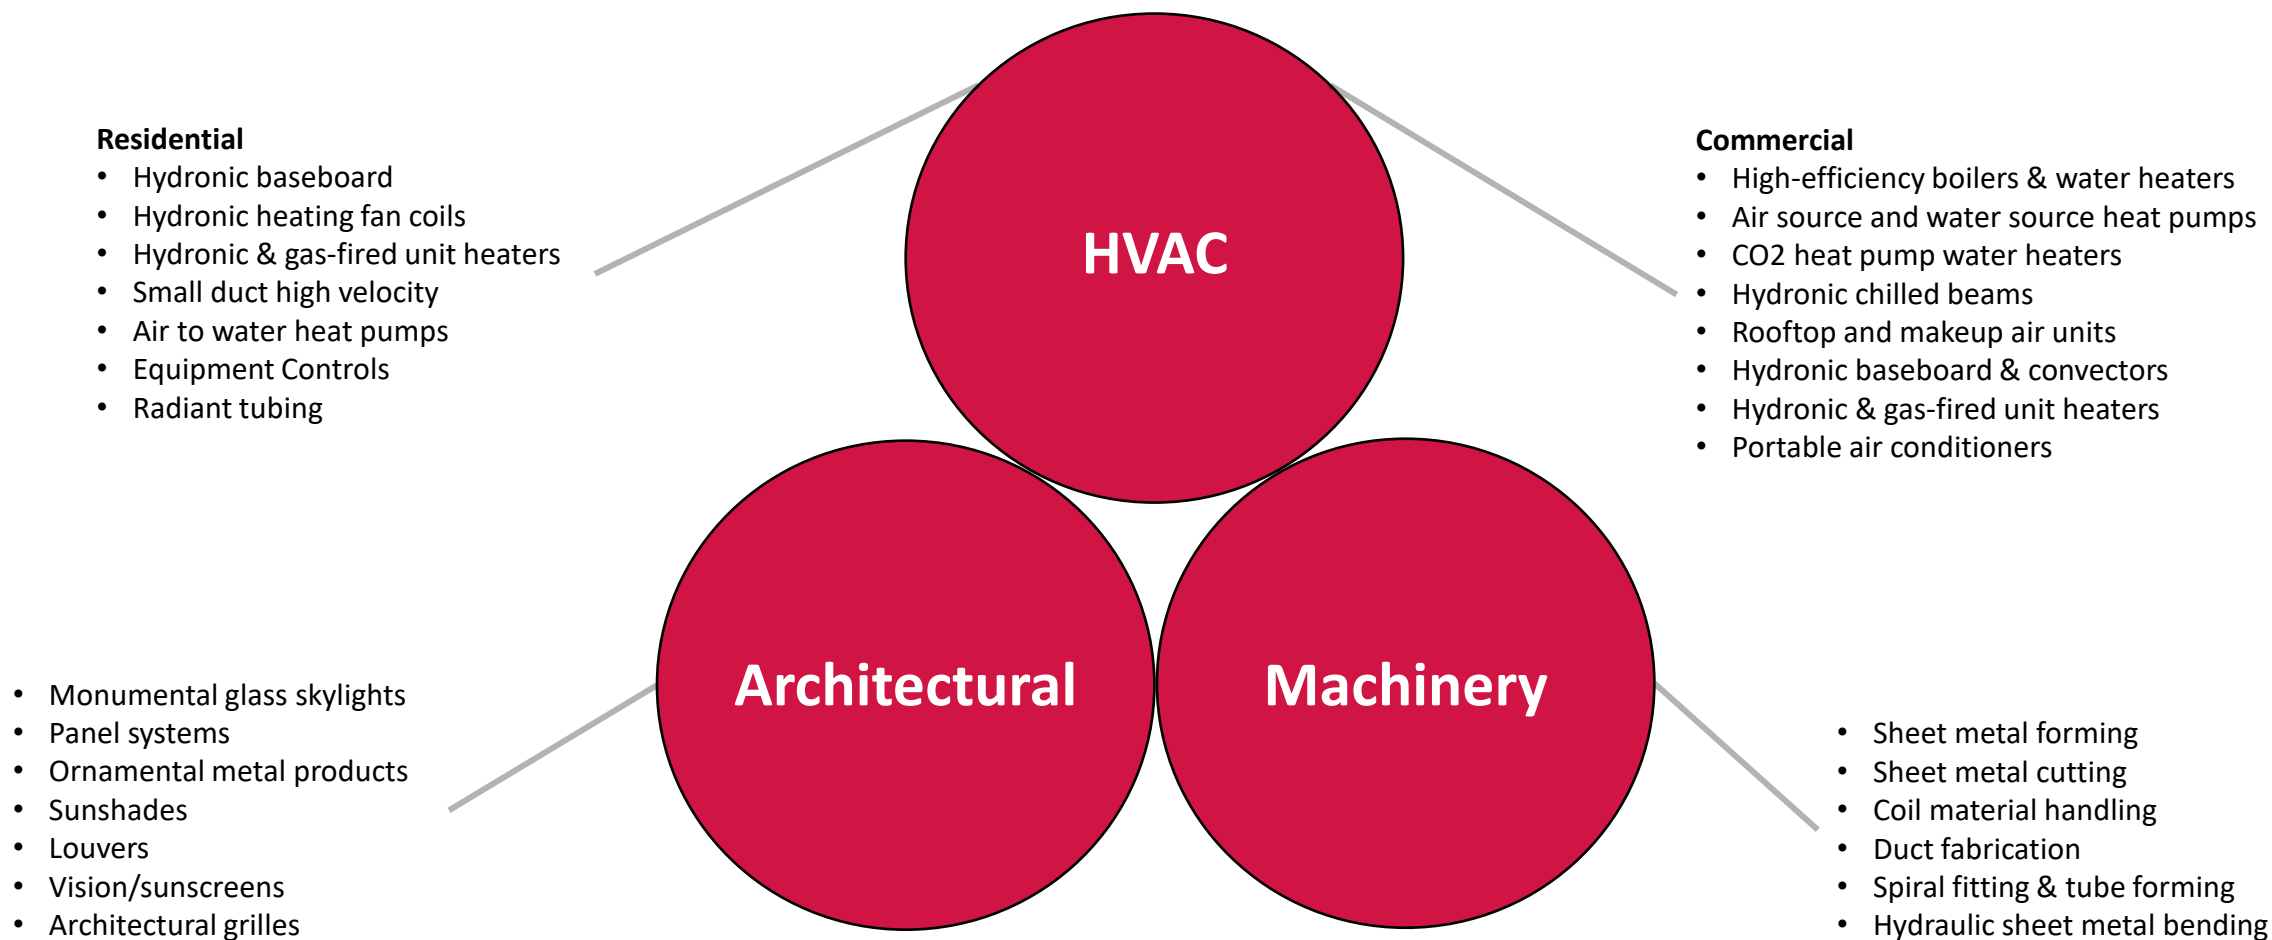









MESTEK, INC.

Carson, CA
Anemostat

Beijing - Formtek Asia Pacific
Switzerland - Formtek International

Dallas, TX
Applied Air, Sterling/Alton,
Airfan, LJ Wing, Tempriete

Cedar Rapids, IA
Iowa Precision, Engel,
Winpro, Lockformer

Lake in the Hills, IL
Axon

Grays Lake, IL
ISM Machinery

Carol Stream, IL
Hill Engineering

Lisle, IL
Lockformer Offices

Forrest City, AR
Airtherm, ABI, L&D,
Vulcan, & Cesco

Mooreville, IN
Linel

Cleveland, OH
Yoder, Dahlstrom,
Tishken, B&K

Bradner, OH
AWV, Colt

Holland, OH
AWV Offices

Mississauga, ON
RBI, Hydrotherm

Clinton, ME
Cooper-Weymouth
Rowe, Coilmate

Newport, ME
Newport Industrial
Fabrication

Barrie, ON
Transom Corporation

Westfield, MA
Corporate office headquarters &
manufacturing, all residential
baseboard, Dadanco,
Sterling/Beacon/Dadanco

Long Island, NY
Embassy

Wyalusing, PA
Arrow

New Berlinville, PA
Bouyertown Foundry,
Westcast

Farmville, NC
Manufacturing
SpacePak, Sterling Gas

Westfield, MA - Mestek Home Base



CORPORATE HEADQUARTER OFFICES

- Product & Engineering
- Sales & Marketing
- Executive Level Management
- Customer & Technical Service
- Accounting & Finance
- Human Resources & Legal
- IT & Technology



RESEARCH & DEVELOPMENT LAB

- New product development
- Product testing
- Performance testing



MANUFACTURING

- All residential baseboard lines
- Beacon Morris unit kickspace heaters
- Sterling Commercial
- Dadanco
- Vulcan
- MTI Controls



TRAINING CENTER & LIVE-FIRE SHOWROOM

- SpacePak
- Commercial Boilers
- Commercial Heat Pumps
- Show room

Jim Bashford

SpacePak National Sales & Training Manager

Jim has been with SpacePak for over 7 years. In addition to his role as National Sales and Training Manager, Jim has used his extensive knowledge of all SpacePak products to continually expand his role within the company, taking on greater responsibility with the training side of the business including instructing our SpacePak Systems and Applications seminars.

Before joining the SpacePak team, Jim was a manufacturer's representative for three years working with a variety of HVAC products. He has over 23 years of experience in the HVAC industry which includes experience as a contractor and business owner where he spent many years selling and installing SpacePak products.




MESTEK: SpacePak Manufacturing in Farmville, NC




Local Representative Support

For all local field support, including **pricing, availability, and project questions**, please contact your local SpacePak Representative. For contact information visit: www.spacepak.com/RepLocator

Look up your local
SpacePak Rep!

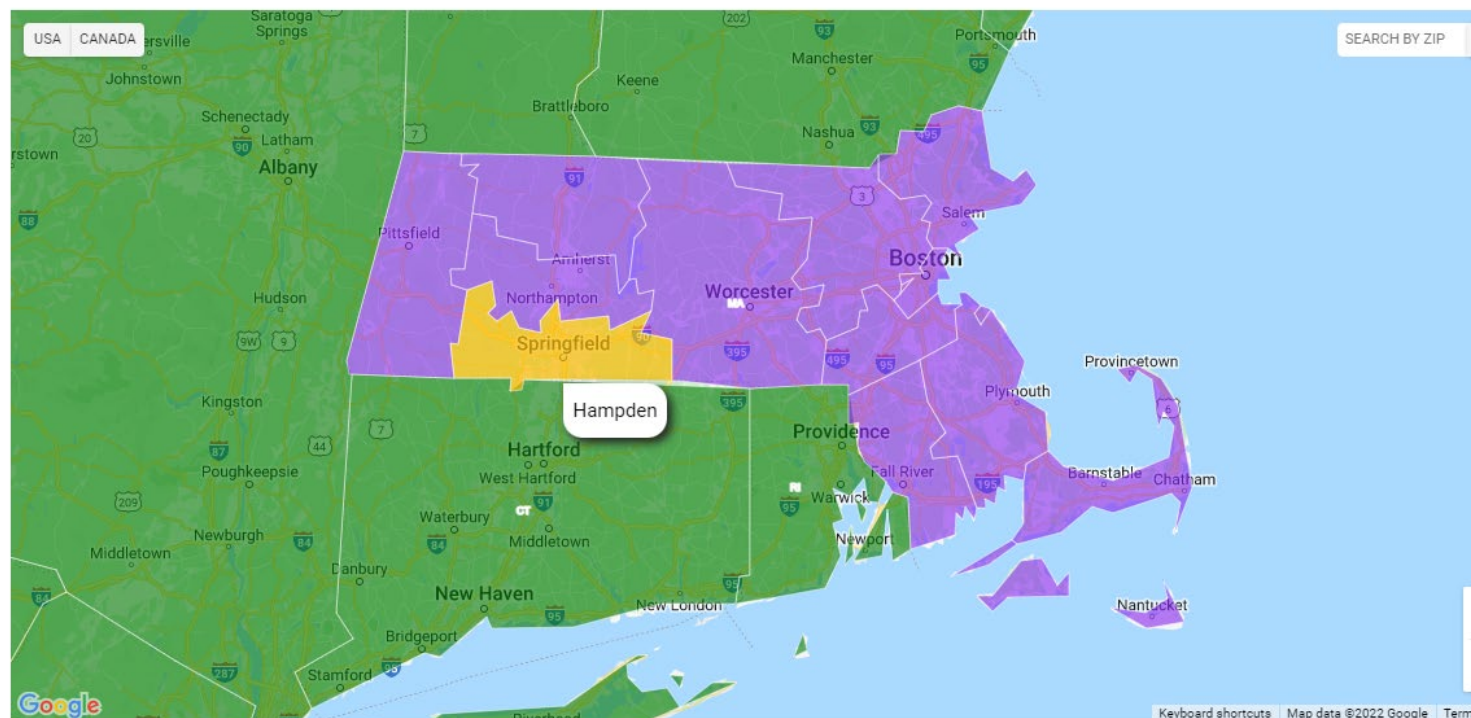

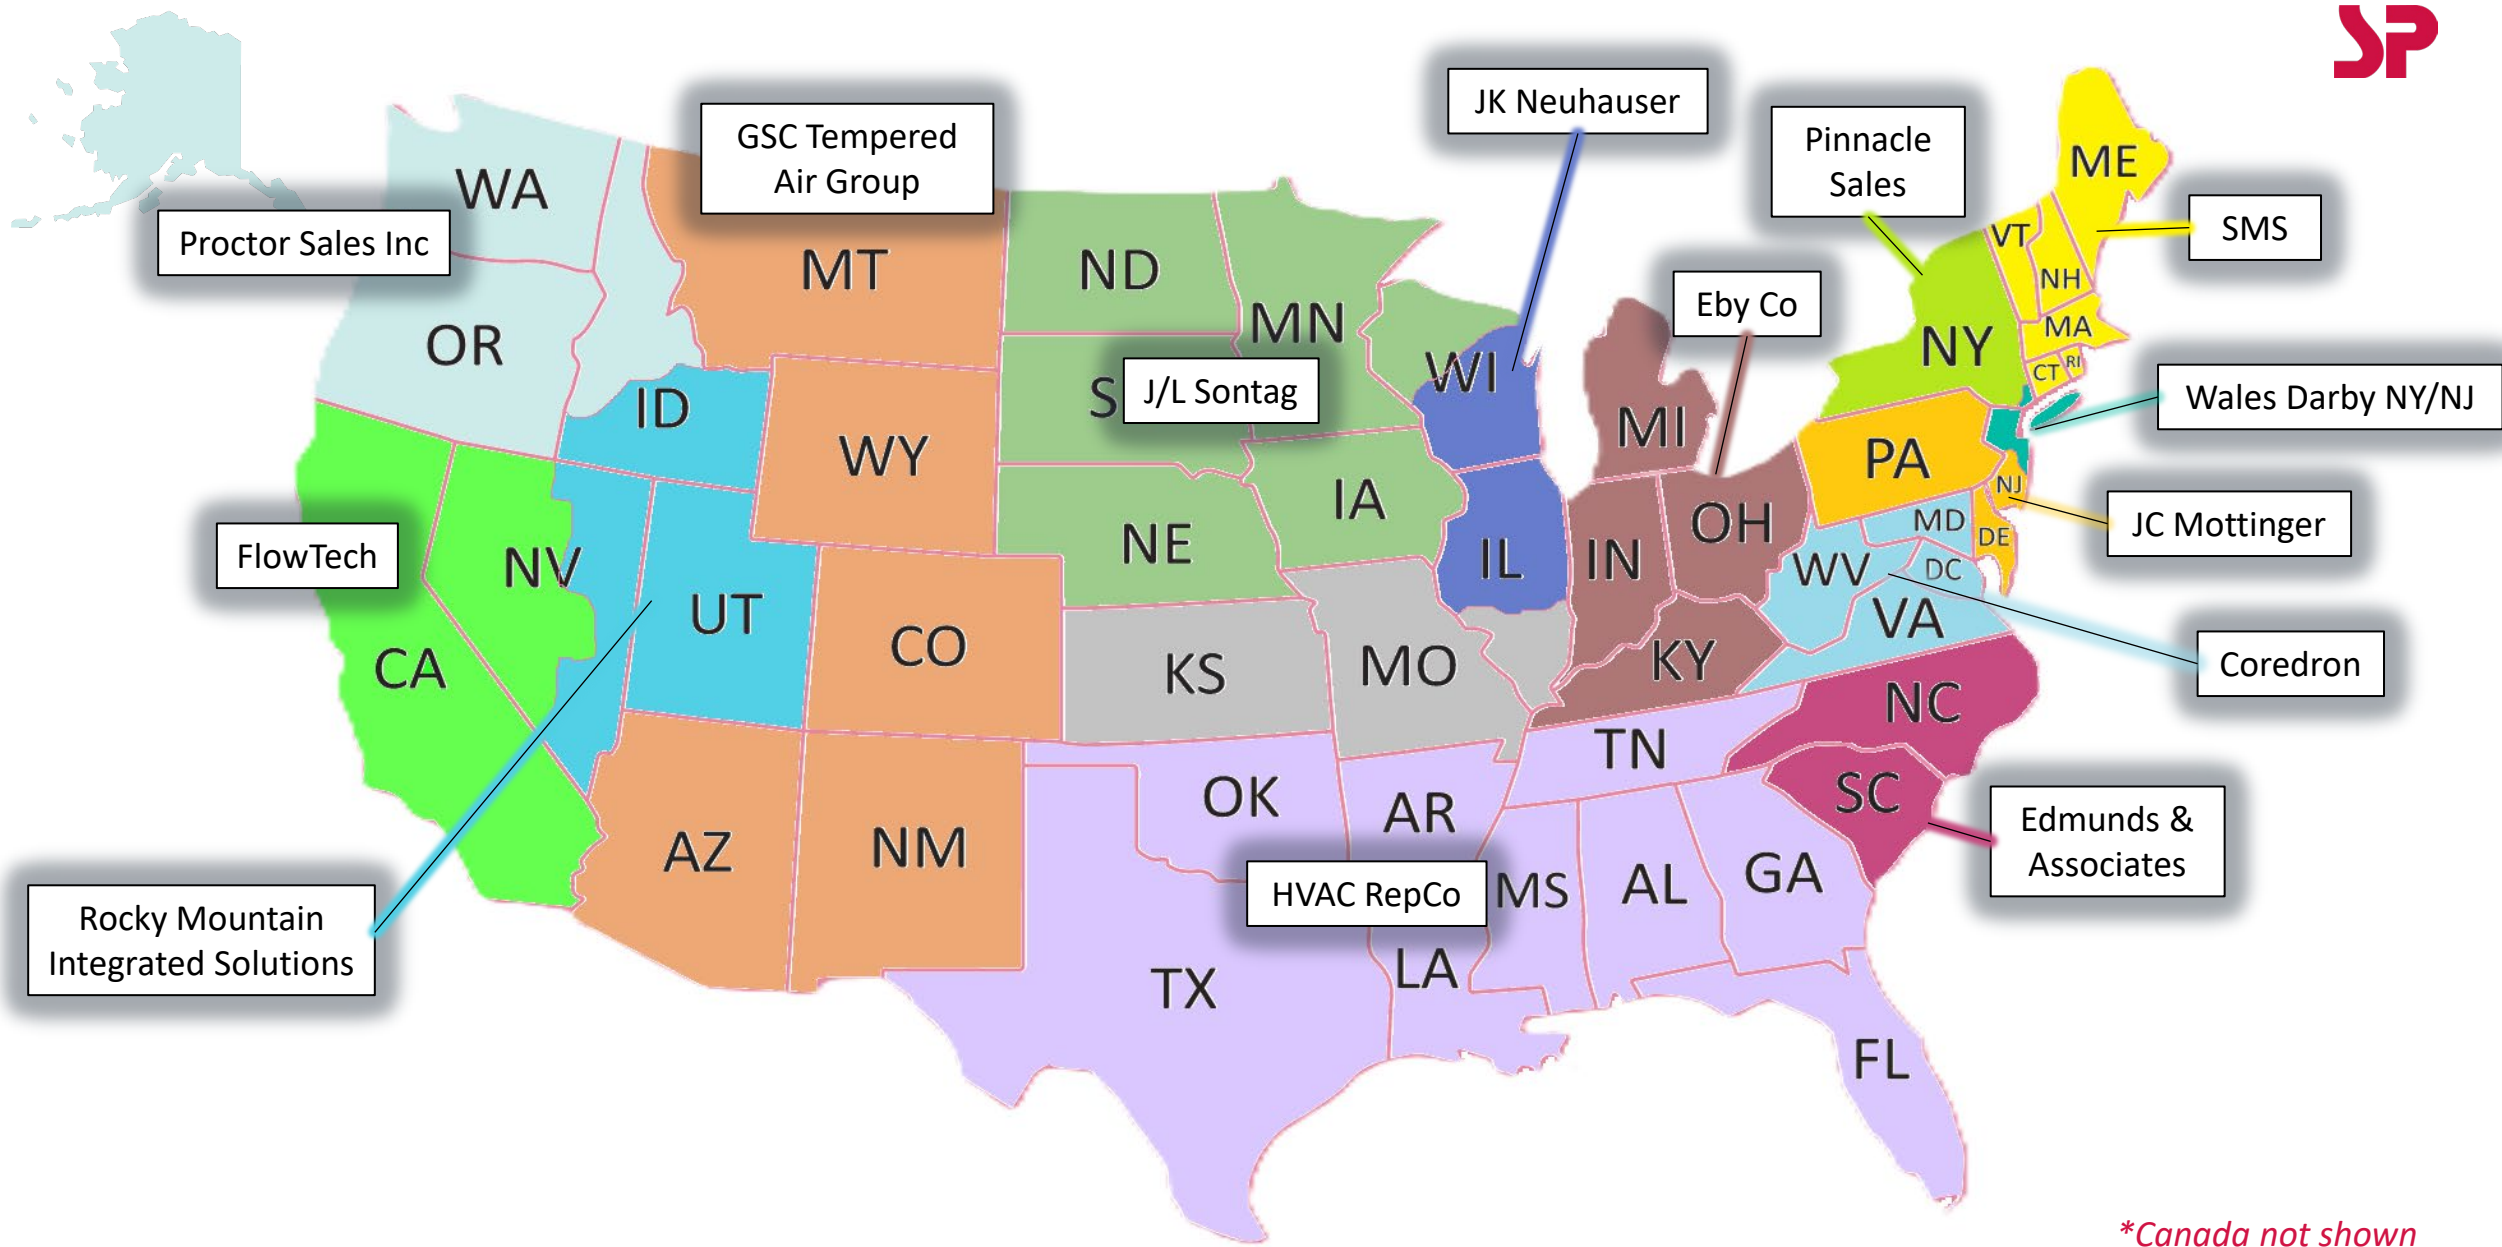

US Manufacturer Representative Network

Heat Pump Timeline

1991

SpacePak/Hydrotherm acquired by Mestek

The original small duct high velocity system – sole product focus for decades

2011

SpacePak introduces the SCM “chiller”

single speed

**2014**

SpacePak introduces the Solstice Extreme – Cold Climate HP

single speed

**2019**

SpacePak receives Energy Star Emerging Technology Award for Air to Water Heat Pump

ENERGY STAR 2019
Emerging Technology Award

2020

SpacePak begins roll out of new inverter-driven offering

**2022**

SpacePak introduces the Solstice Inverter Extreme - Cold Climate HP

**2024**

SpacePak introduces the R32 series of air to water heat pumps



Pre-Sale Application Support Team

PreSaleSupport@SpacePak.com

Available to Representatives, Wholesalers, Contractors etc.

- System application support
- Equipment selection
- Load calculation and rough material list

Any questions regarding equipment already shipped should be directed to

TechnicalService@SpacePak.com (413) 564 - 5530



Warranty Policy

Inverter Series Air-to-Water Heat Pumps

Standard Warranty

- 2-year parts and 5-year compressor

Extended Warranty

- 5-year parts and 10-year compressor *

SDHV, hydronic fan coils, & associated equipment

Standard Warranty

- 1-year parts


Extended Warranty

- 5-year parts*

Buffer Tanks

Standard Warranty

- 10-year on all buffer tanks

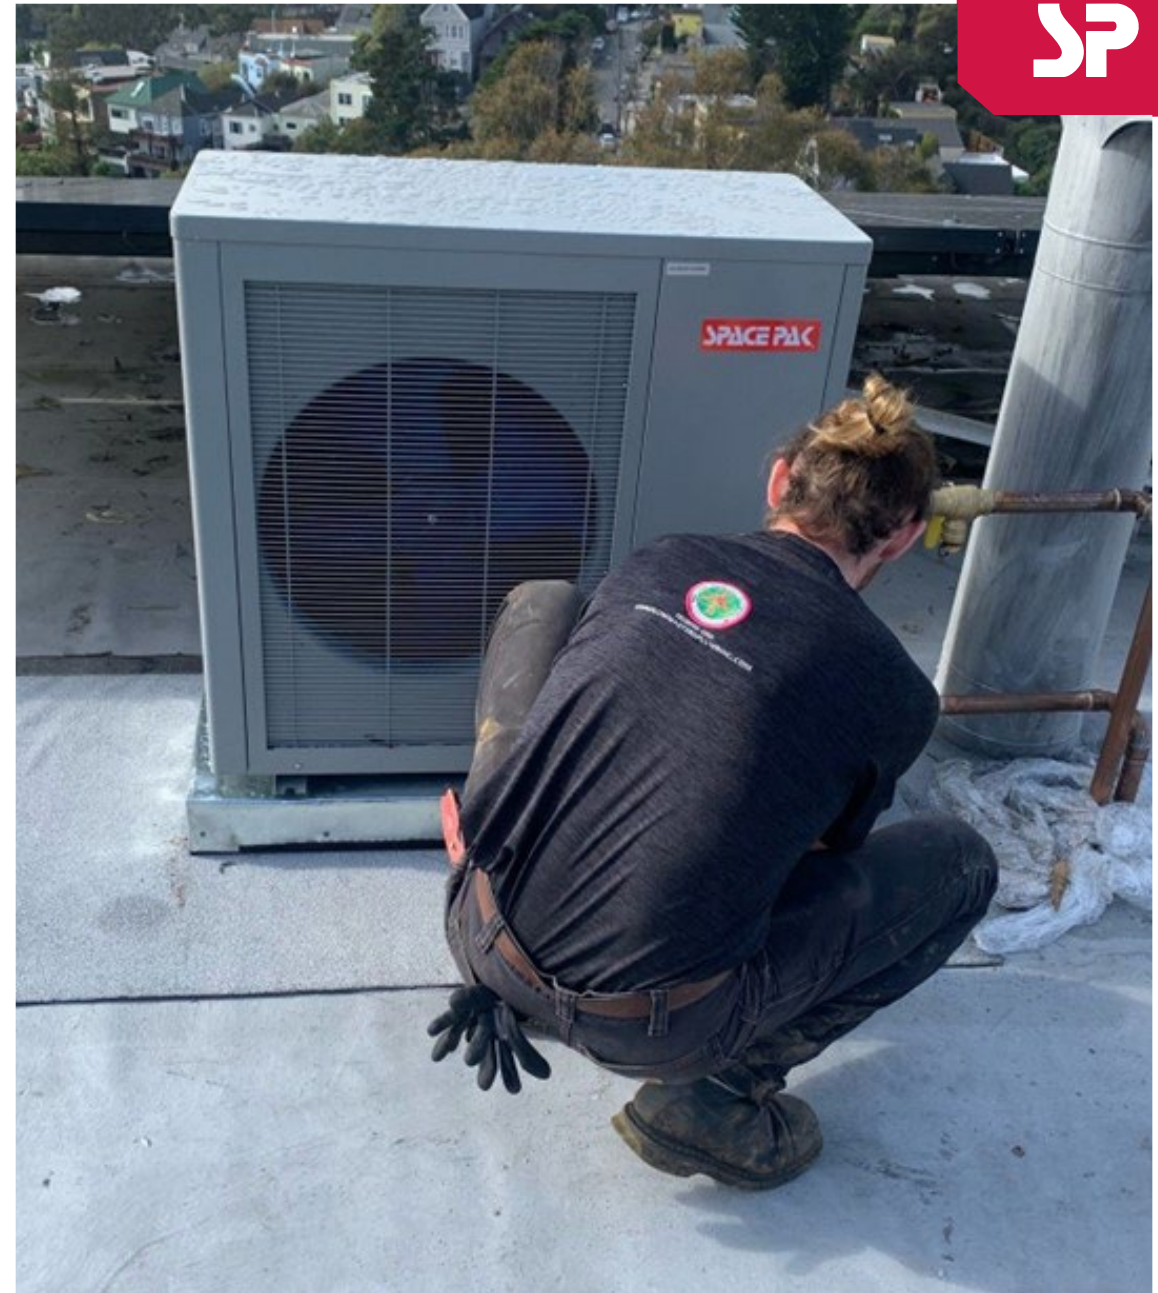

Extended Warranty Requirements

- Must be listed as a [SpacePak Certified Contractor](#) at time of installation
- Must register project/equipment via [Product Registration Page](#) on website




Certified Contractor Program


- Extended warranty*
- Listed on website
- Homeowner leads
- Pre-sale support
- Marketing support – co-op dollars

**with project registration*

Product Registration Form: <https://www.spacepak.com/warranty>

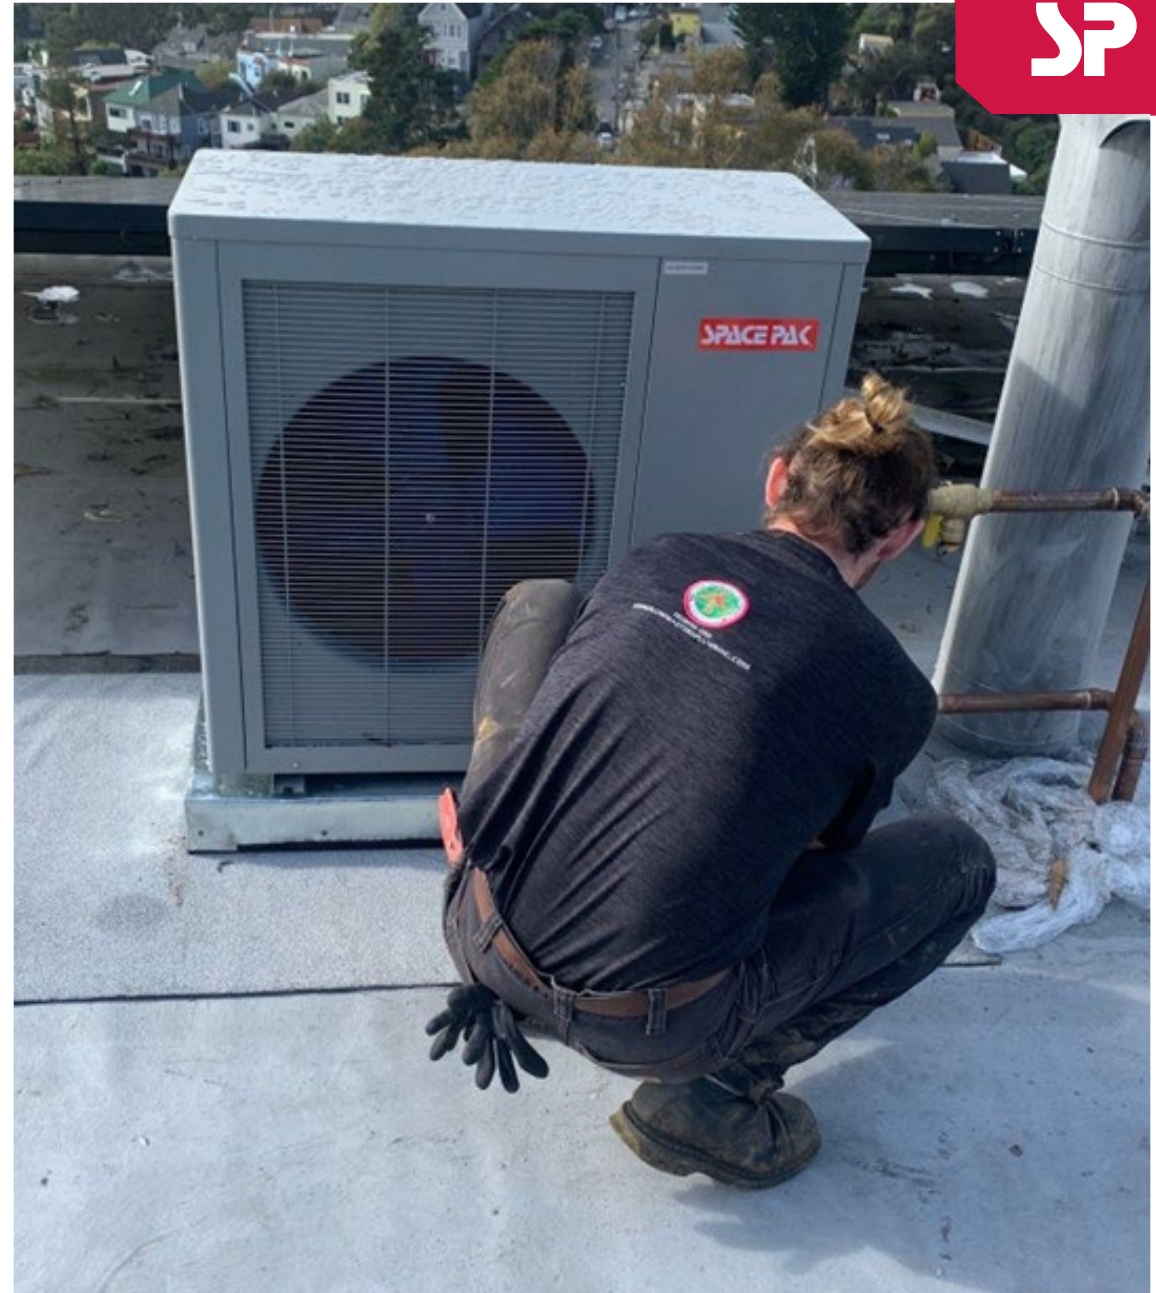

Contractor Locator Map & Lead Generation

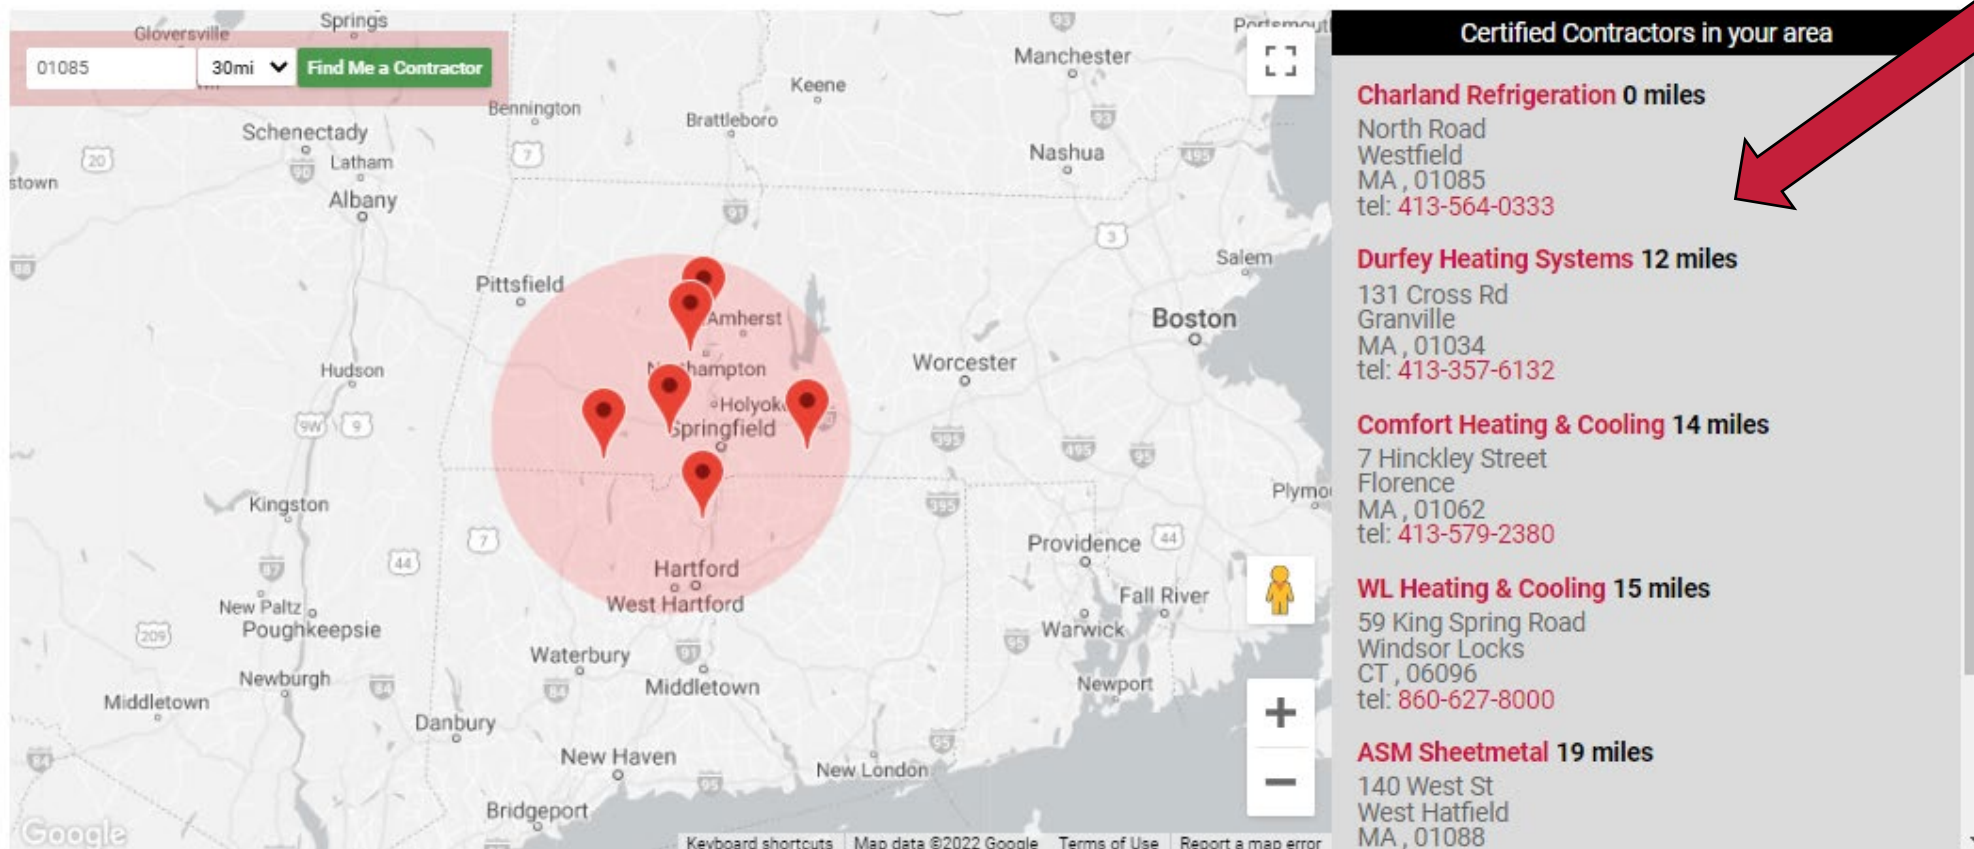

01085 30mi Find Me a Contractor

Certified Contractors in your area

- Charland Refrigeration 0 miles**
North Road
Westfield
MA, 01085
tel: 413-564-0333
- Durfev Heating Systems 12 miles**
131 Cross Rd
Granville
MA, 01034
tel: 413-357-6132
- Comfort Heating & Cooling 14 miles**
7 Hinckley Street
Florence
MA, 01062
tel: 413-579-2380
- WL Heating & Cooling 15 miles**
59 King Spring Road
Windsor Locks
CT, 06096
tel: 860-627-8000
- ASM Sheetmetal 19 miles**
140 West St
West Hatfield
MA, 01088

Your
Company
Here

Homeowner Leads Emailed Directly to you

Find a Certified Contractor

Are you interested in installing a SpacePak system in your home? Get the process started by requesting a free, no-commitment consultation. Once you've submitted your request, you'll receive contact information for local SpacePak certified contractors.



STEP 1

Who are you?

- ☐ Homeowner
- ☐ Contractor
- ☐ Architect
- ☐ Other

Which of these options best describes your need?

- ☐ Installing SpacePak in a current home
- ☐ Installing SpacePak in a new construction
- ☐ Installing SpacePak in a commercial space
- ☐ Service or repair for my SpacePak System

Which system are you most interested in?

- ☐ SpacePak Central Heating & Cooling
- ☐ SpacePak Hydronics
- ☐ Unsure

Next

NOTE: Extensive form guarantees only serious inquiries.



Find a Certified Contractor


Representative Locator



SpacePak System Spacepak Hydraulics ▾ About Us Resources Training **Product Registration** Contact Us

Technical Library

Warranty Registration



Who are you?

- ☐ Homeowner/End-user
- ☐ Installing Contractor

Next

CURRENT OFFERING



SIM



SIS



ILAHP



HP



CC32



TBD290

The future???



Rebate Programs are Slow to Recognize Air to Water

In 2018 Vermont established the first ATWHP rebate program in the country based on SpacePak's LAHP unit on a Habitat for Humanity project.

In 2019 the EPA recognized ATWHPs for Energy Star's Emerging Technology Award – SpacePak received this award.

In 2024 AHRI finally dedicated a working group to the establishment of a federal performance standard for **heating with air to water**.

By year-end, the AHRI air to water heating standard is expected.

We assume this will open the doors for fast and easy deployment and adoption of AWHP-specific incentive programs at both the federal and local levels.



Example residential ATWHP Rebates (and more!)

\$1,000/ton

**Efficiency
Vermont**

\$1,250/ton

mass save
Savings through energy efficiency

\$3,000

cleanBC
BETTER HOMES

\$3,000

**Sonoma
Clean
Power**

**Now Eligible
for NYS Rebate Program &
NYSERDA Low Interest Loans!**

NEW YORK
STATE OF
OPPORTUNITY. | **NYS Clean Heat
Program**

Prior to 2024, it only applied to geothermal,
air-to-air, and heat pump water heaters



—
Questions?

Air to water heat pumps, what are they?

IS IT A HEAT PUMP?



IS IT A CHILLER?

They are both a **Heat Pump** and a **Chiller**.

They can be called either, as they perform both operations. The deciding factor is your geographic location and the units primary use (**Heating** or **Cooling**).

Why Air to Water?

Ultimate design flexibility

Ease of zoning (limited only by one's ability to size systems)

Water carries more BTUs (per physical pipe size)

Integrates with existing hydronic, solar, geothermal

Partial load capabilities (vary water temperatures and flows)


Simpler maintenance - Water vs DX.. No reclaiming

Not restricted in length and lift of line set (monobloc)

Superior dehumidification



Complete System Integration

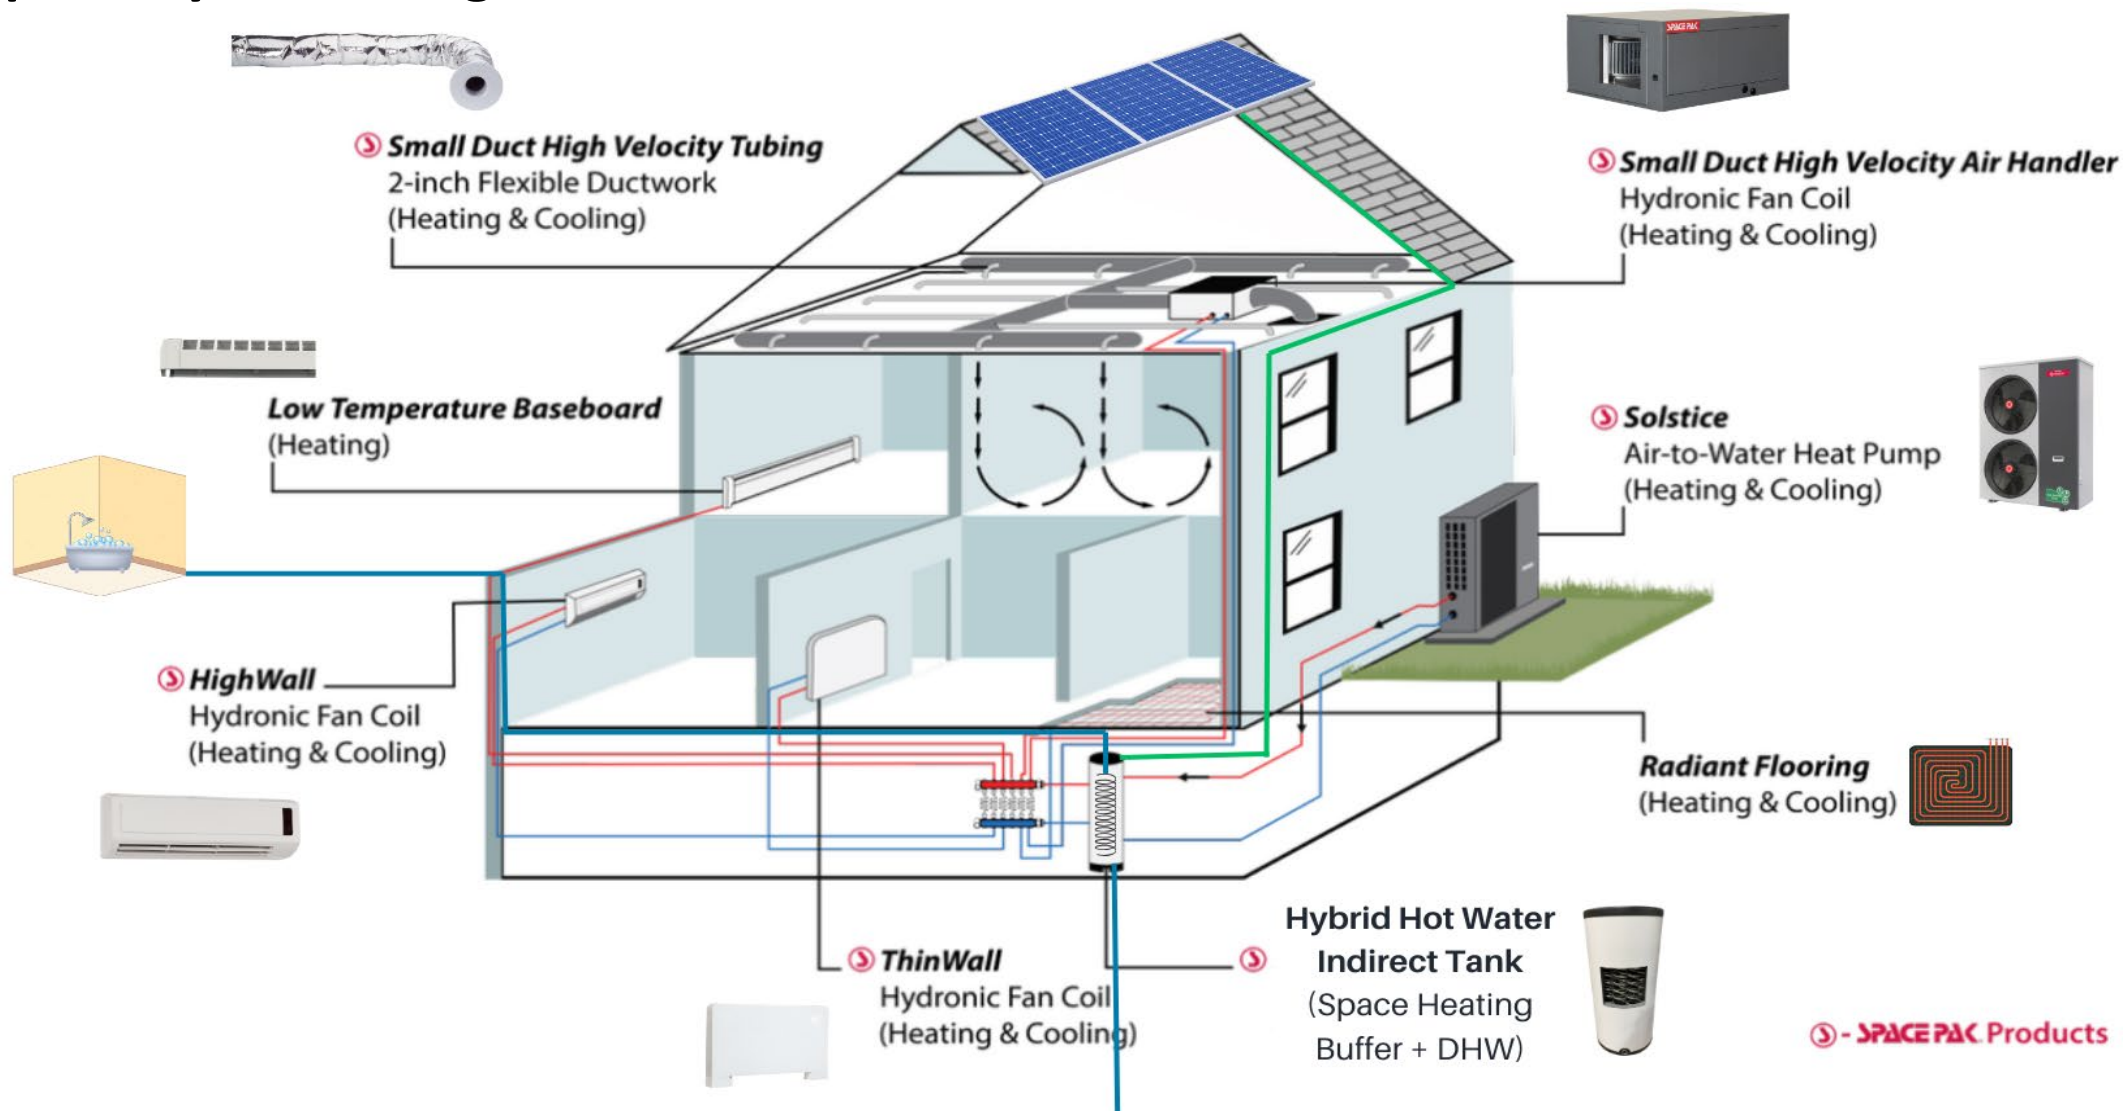

Two Types of Heat Pumps

Monobloc Design



This design arrives pre-charged and is installed outside. It is then piped to the buffer tank inside and then on to the system.

This unit requires no on-site refrigerant work.

Split System Design




This design leaves the compressor outside with the refrigerant to water exchanger inside. These units are connected with a Standard line set (included).

Refrigerant knowledge and certification is required for this type of installation.

How they work


(monobloc design)

(in heating mode)

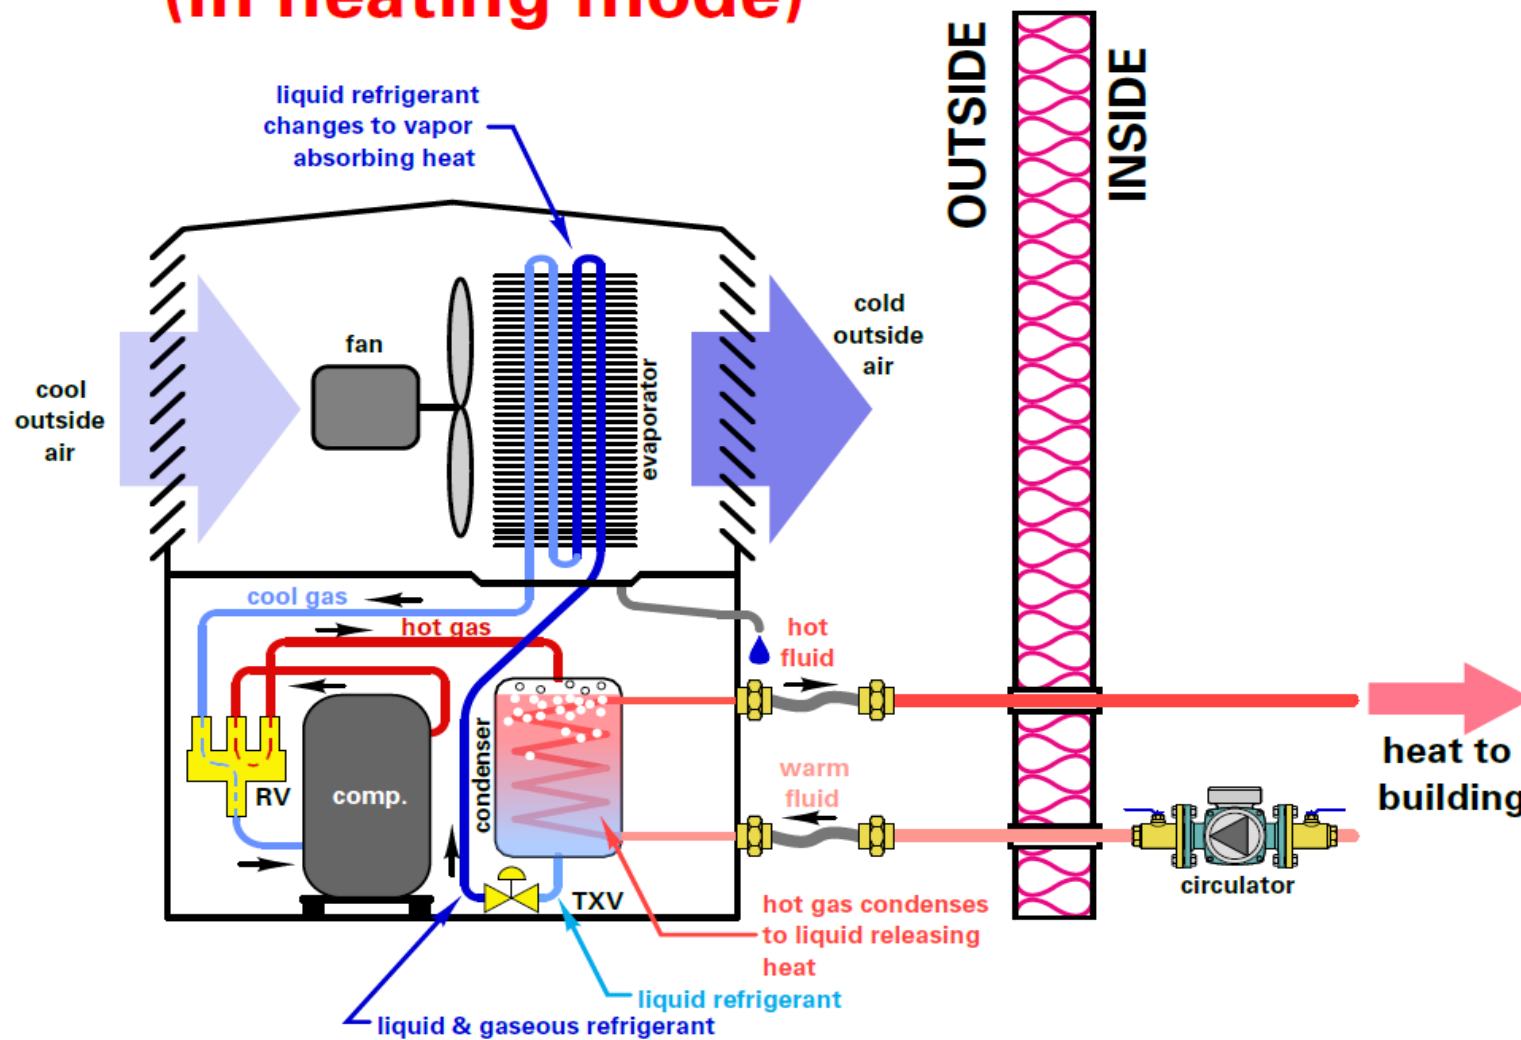

How they work

(monobloc design)

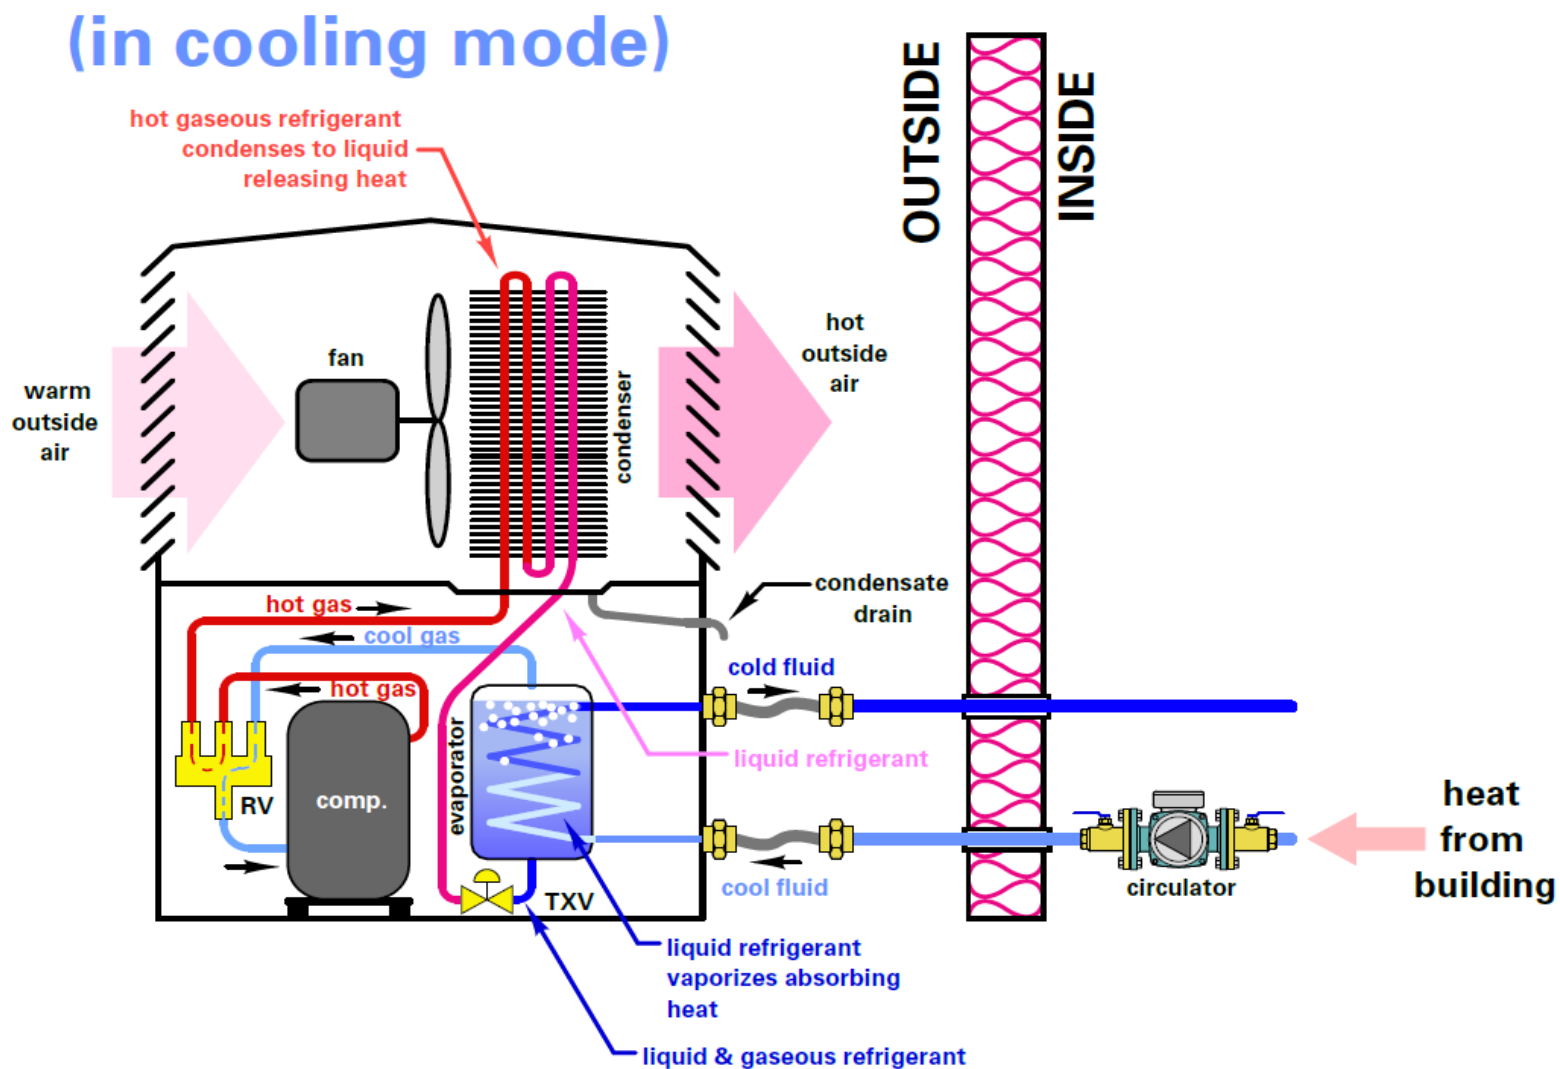

“COP” The measure of efficiency in ATW equipment


A COP is defined as the relationship between the power (kW) that is drawn out of the heat pump as Cooling or Heat, and the power (kW) that is supplied to the compressor.

“COP” can be thought of as a “Dollar”

For example, if the unit is running at the COP of 1, that would mean with 1 Dollar worth of Energy input you would receive 1 dollar worth of energy back (100% efficient)

In a higher operational COP of 3, it would show that with 1 Dollar worth of energy input you would receive 3 dollars worth of energy output in return - resulting in a much higher efficiency.

Low Temperature Heating

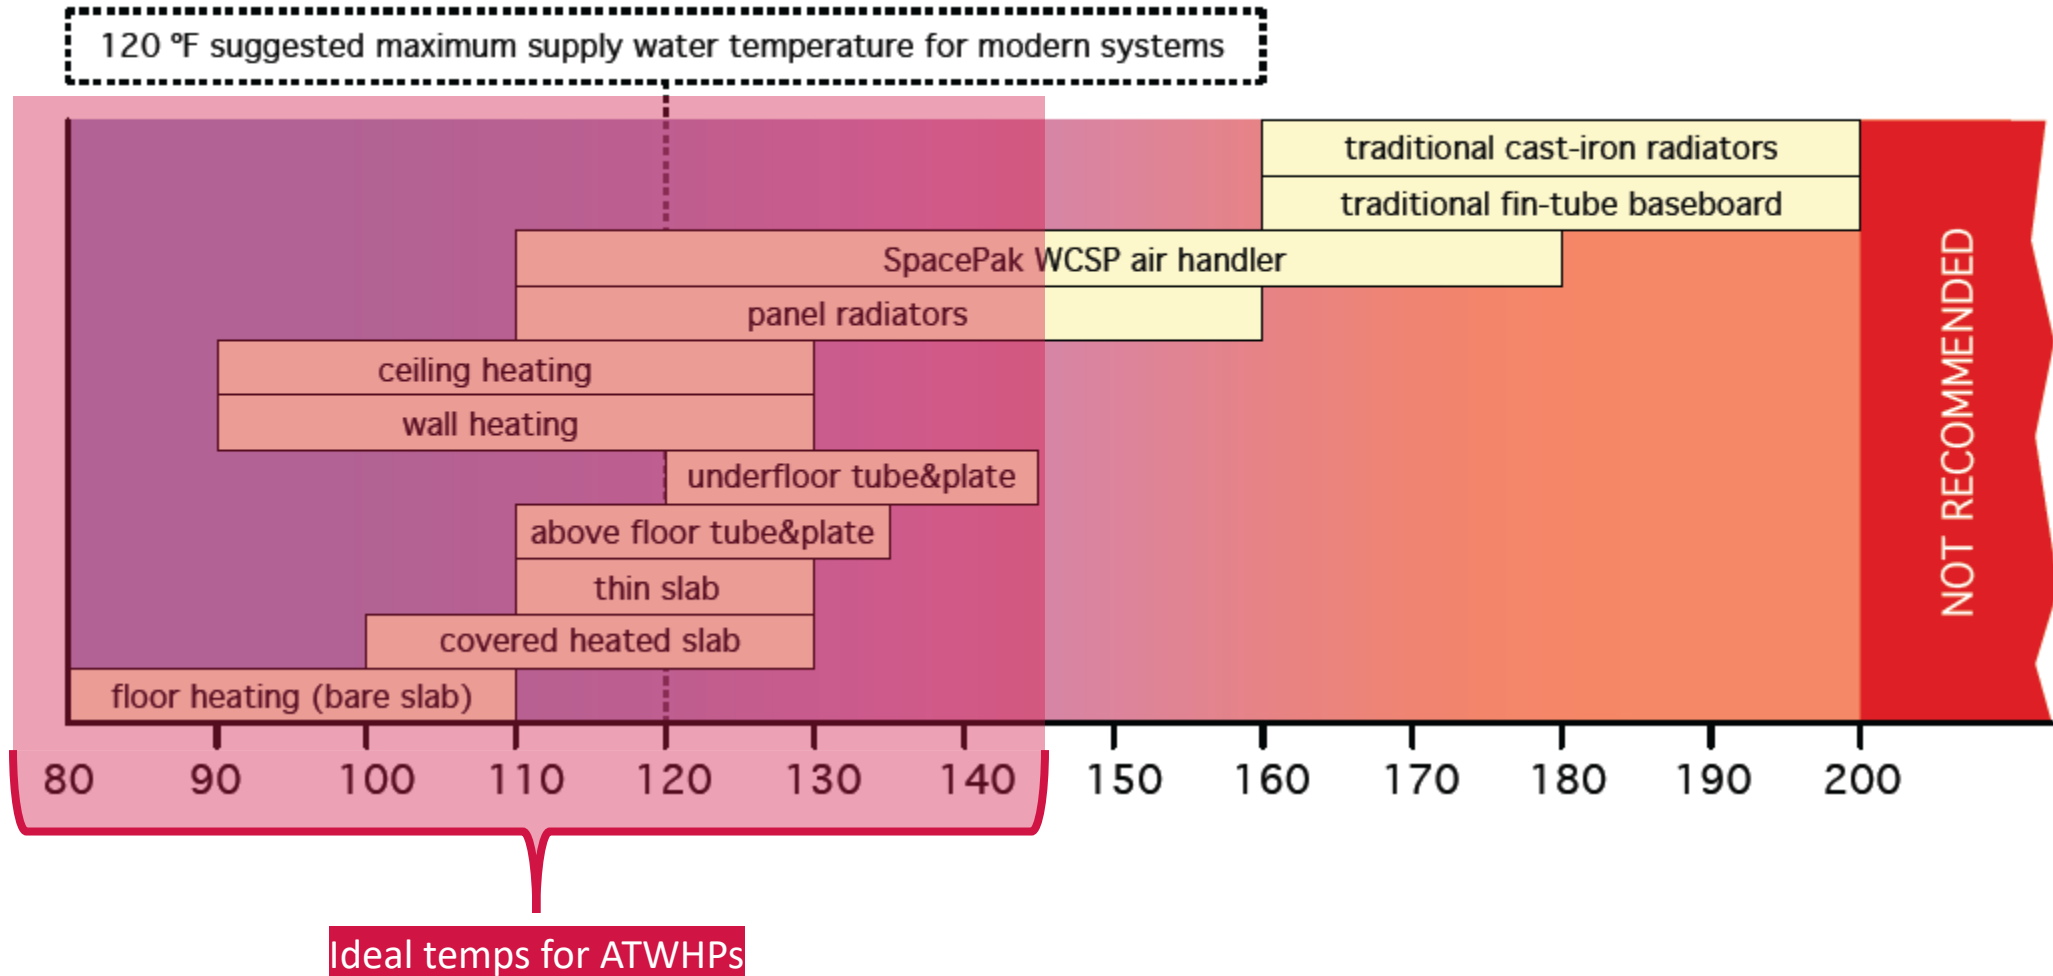

Application Examples

- Radiant heating
- Hydronic heating
- Forced air heating and cooling
- Centralized domestic hot water
- Snow melting
- Dehumidification
 - Mushroom farms
- Process cooling
 - Milk processing & distilleries
- Projects with limited interior space
- Projects with limited exterior space
- Projects with exterior façade restrictions

Unlimited. Design. Flexibility.



Will this work in my house?

Probably, but it depends

- New construction or retrofit
- Room-by-room load calculation (most important)
- Heating, cooling, domestic hot water
- Existing or desired forms of conditioning
 - Hydronic or forced air
- Existing or desired room emitters
 - Radiant, baseboard, fan coils, etc.
- Water temperature required to meet load
- Climate zone(s)
- Single source electric or dual fuel



Load Calculations


Results will determine air and water flow rates for sizing air handlers, ducts, piping, and pumps. ACCA Manual J or software based on that method should be used to ensure that each room or space receives the proper amount of heating and cooling. For systems with central air handlers and ducted air delivery, ACCA Manual D methods should also be used to properly size the ducts. ACCA lists several approved software-based sizing applications.

Inputs to these applications include:

- Building orientation
- Wall, roof, and floor u-values of exterior walls
- Window u-values and solar heat gain coefficients (SHGC)
- Floor areas and volumes of each room
- Building air leakage rate
- Duct insulation R-value
- Indoor “design” temperatures
- Outdoor “design” dry-bulb temperatures



Distribution Example

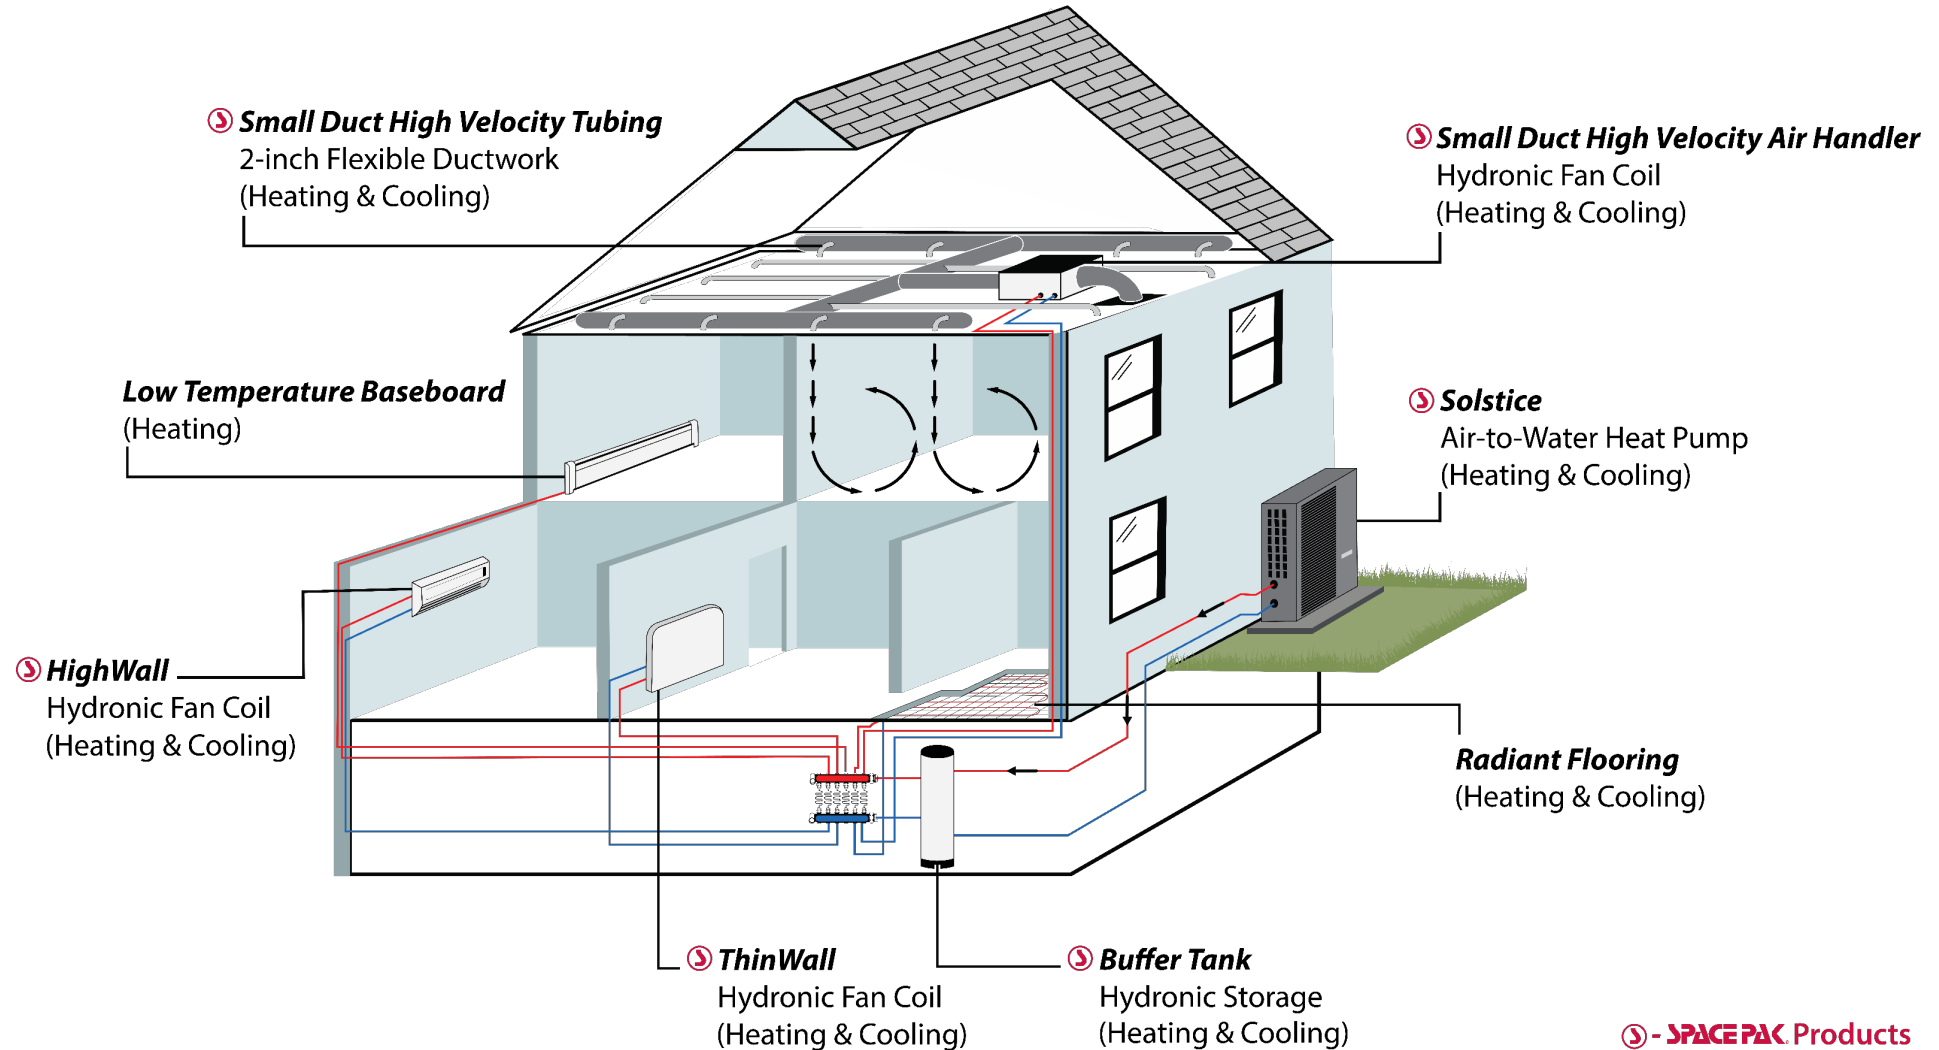

⑤ - **SPACEPAK** Products

Monobloc Models Can be Installed in Remote Locations



Note: Distances are only limited by the ability to size the pump and piping in accordance with required flow requirements and pressure drop, this creates opportunity for unlimited applications!

Up to 600 ft away!

Remote Mounting Examples

Hudson, NY



Cambridge, MA





—
Questions?

SIM

Solstice Inverter Monobloc (**SIM**)

MILD CLIMATE

AIR TO WATER HEAT PUMP

- Available in 3- and 5-ton Models
- Heating, cooling, domestic hot water
- Eco-friendly monobloc design
- Cold climate cooling capabilities
- 42-130°F Output Water Temperature Ranges
- Reliable Mitsubishi Inverter Compressor
- Inverter Driven Fans & Fan Motors
- Controls on Return Water Temperature
- Freeze Protection
- Low Amp Draw
- Ultra Quiet Operation



SIM-036



SIM-060






SIM

Monobloc Touch Screen Control


SIM036, SIM060, ILAHP48

Advanced Intelligent Internal Control Platform

- User-friendly color touchscreen
- Intelligent defrost
- Outdoor air reset
- Modbus compatible
- 24ga shielded 5 wire - can be remote mounted up to 600ft

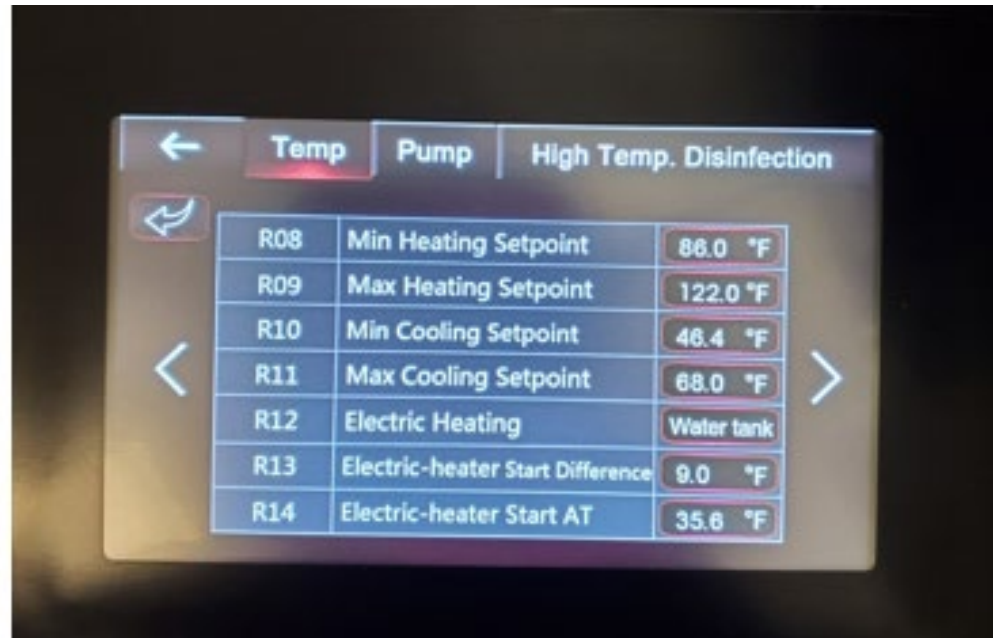

Monobloc Touch Screen Display Wiring Layout

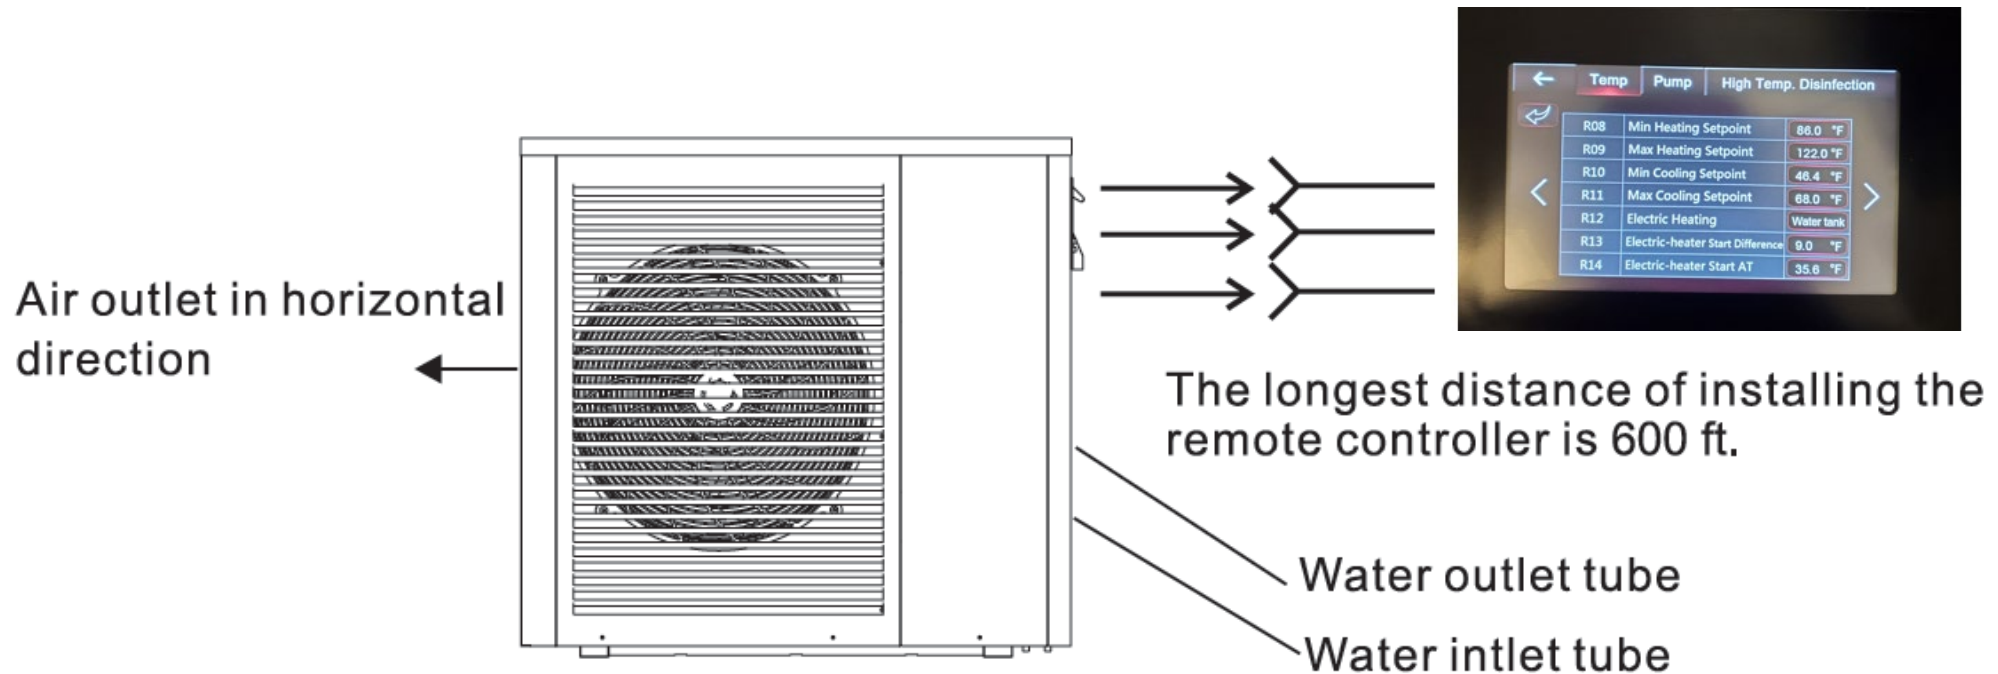


NOTE: A 65-foot 5 conductor shielded wire is supplied with the unit. In cases of longer runs, field supplied shielded wire can be used. However, the factory supplied Molex connectors will have to be attached at either end for proper installation.




		Units	SIM-036	SIM-060
Cooling	Capacity Range	BTU/hr	12,704 - 34,423	17,884 - 59,523
	Efficiency Range	EER	11.26 - 11.74	10.75 - 11.26
	Efficiency	IPLV	12.2	12.1
	Water Temperature Setpoint	°F	46-68	
	Ambient Temp Range	°F	5-110	
Heating	Capacity Range	BTU/hr	13,191 - 38,755	25,413 - 70,666
	Efficiency Range	COP	4.04 - 5.01	3.69 - 4.67
	Water Temperature Setpoint	°F	86-130	
	Ambient Temp Range	°F	5-109	
CEC Data	Cooling Capacity/Efficiency*	BTU/hr/COP	34,120/10	49,490/8.8
	Heating Capacity/Efficiency**	BTU/hr/COP	39,240/3	56,315/3
	Heating Capacity/Efficiency***	BTU/hr/COP	21,236/1.9	48,260/1.9
Electrical	Power	V/Ph/Hz	230/1/60	
Refrigerant	Type		R410A	
Fan	Type		EC	
Sound (@3meters)	Maximum	dBa	54	58
Hydronic	Rated Flow	GPM	7	13
	Max Water Temp	°F	131	
	Piping Connections	inch	1	1 1/4
	Rated Pressure Drop @ Rated Flow	PSI (ft W.C.)	6/13.8	10/23
Compressor	Type		Rotary Inverter	
	Speed Range	Hz	30-90	
Dimensions	Net Dimensions (L x W x H)	inch	39 x 18 x 35	39 x 13 x 52
	Shipping Dimensions (L x W x H)	inch	41 x 19 x 36	42 x 18 x 53
	Net Weight/Shipping Weight	lbs.	243/271	326/368

SIM-036 Performance Charts (pure water)

122°F Returning Water Temperature, Heating

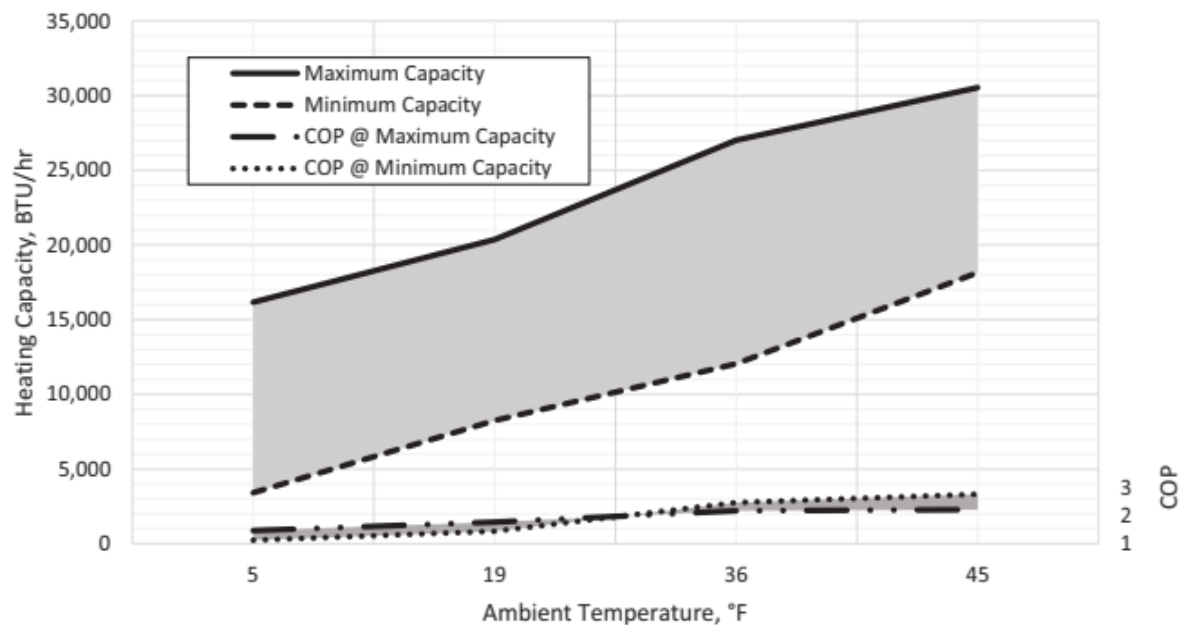


46°F Returning Water Temperature, Cooling

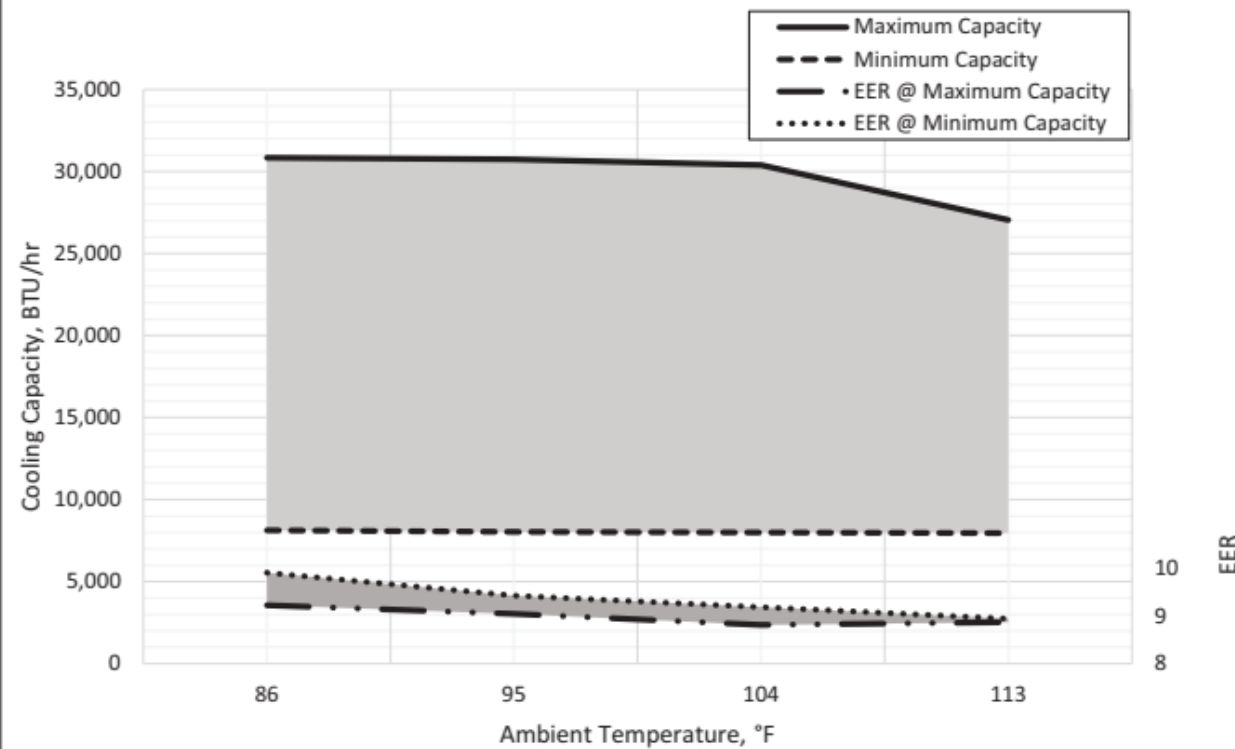


SIM-060 Performance Charts (pure water)

122°F Returning Water Temperature, Heating

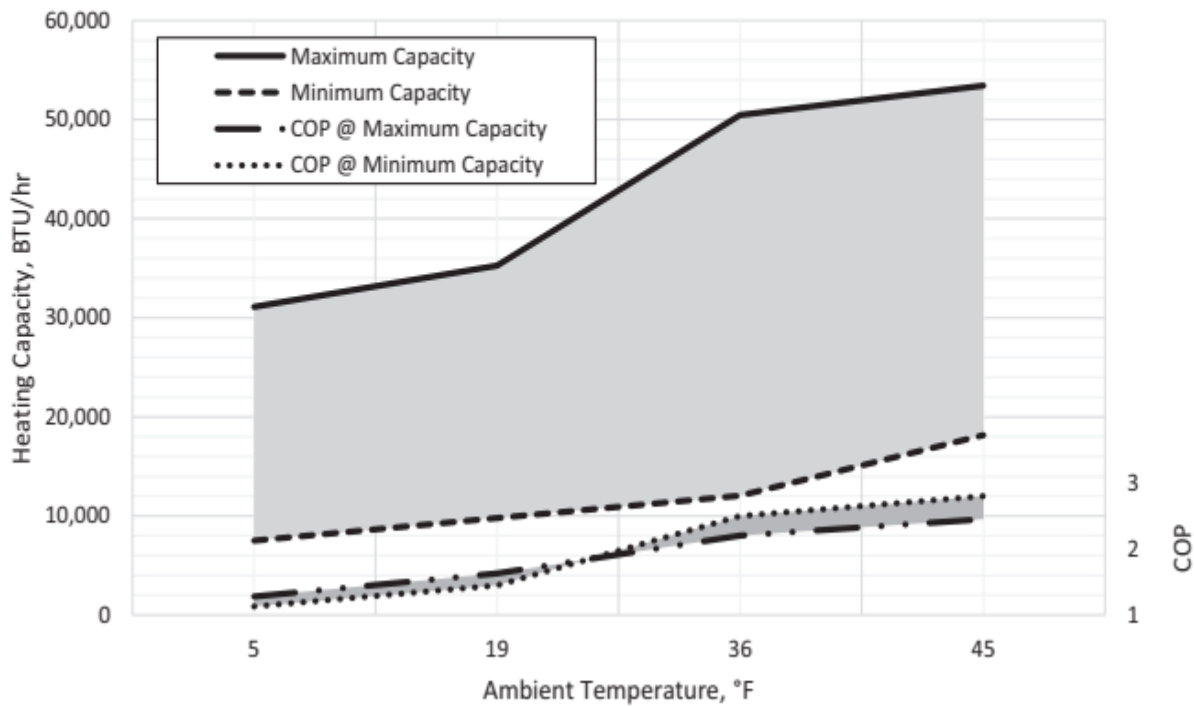

46°F Returning Water Temperature, Cooling

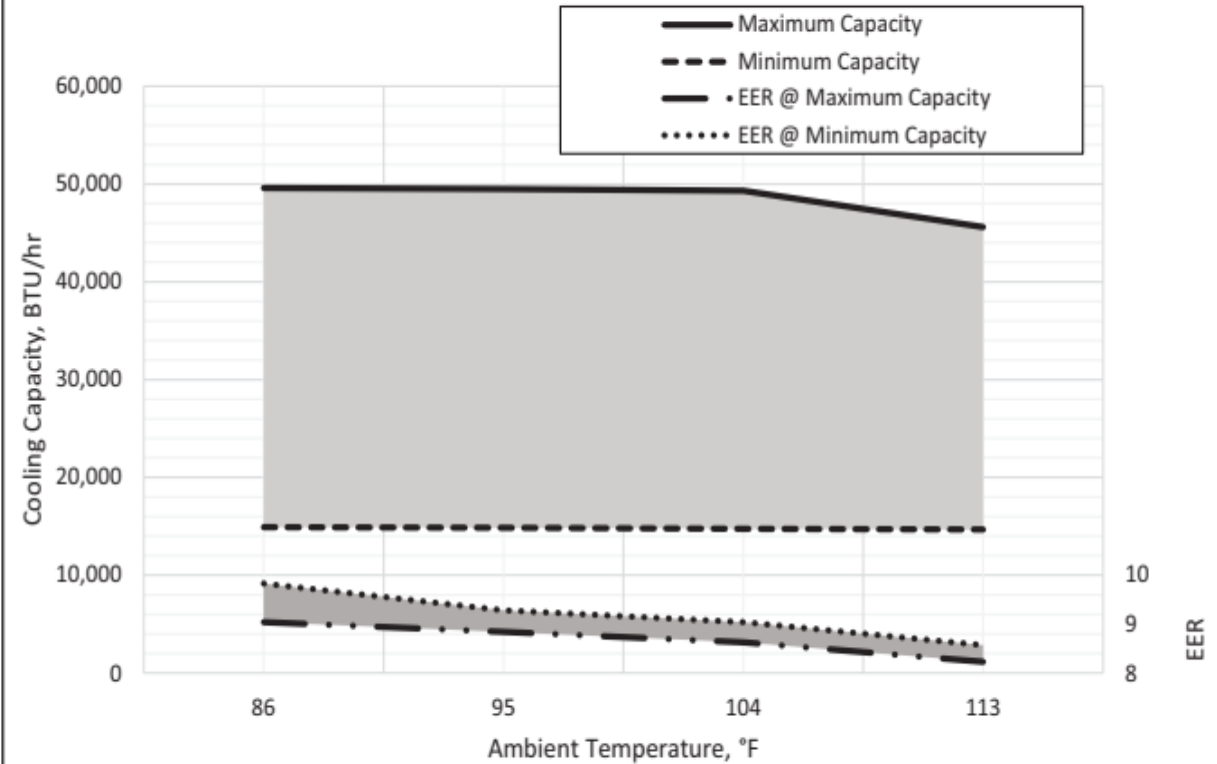

Glycol-Water System (Monobloc)

*You must **always** use
some level of Antifreeze!*

Table 1 ILAHP Glycol Concentrations (10% Minimum, 50% Maximum)


Ethylene Glycol %	10	20	30	40	50
Min. Ambient Temp for Operation	23°F/-5°C	14°F/-10°C	2°F/-17°C	-13°F/-25°C	-36°F/-38°C
SpacePak Capacity Multiplier	0.98	0.96	0.93	0.91	0.89
Pressure Drop Multiplier (Cooling)	1.06	1.12	1.16	1.25	1.36
Pressure Drop Multiplier (Heating)	1.06	1.12	1.16	1.22	1.28
Minimum Expansion Volume / System Volume					
Heating and Cooling (Gallons)	1 gallon expansion per 15 gallons system volume				
Heating only, HP only (Gallons)	1 gallon expansion per 20 gallons system volume				
Heating Only, with Boiler (Gallons)	1 gallon expansion per 15 gallons system volume				
Propylene Glycol %	10	20	30	40	50
Min. Ambient Temp for Operation	26°F/-3°C	18°F/-8°C	8°F/-13°C	-7°F/-22°C	-29°F/-34°C
SpacePak Capacity Multiplier	0.99	0.98	0.96	0.93	0.88
Pressure Drop Multiplier (Cooling)	1.10	1.20	1.34	1.5	1.65
Pressure Drop Multiplier (Heating)	1.10	1.20	1.34	1.46	1.5
Minimum Expansion Volume / System Volume					
Heating and Cooling	1 gallon expansion per 15 gallons system volume				
Heating only, HP only	1 gallon expansion per 20 gallons system volume				
Heating only, with Boiler	1 gallon expansion per 15 gallons system volume				

Non use of propylene glycol will void warranty.

This information is provided as a general guideline only, and is not intended to cover all possible conditions. It is ultimately the responsibility of the installer to ensure that proper freeze protection is provided.


Antifreeze % Per Geographic Region

*You must **always** use
some level of Antifreeze!*


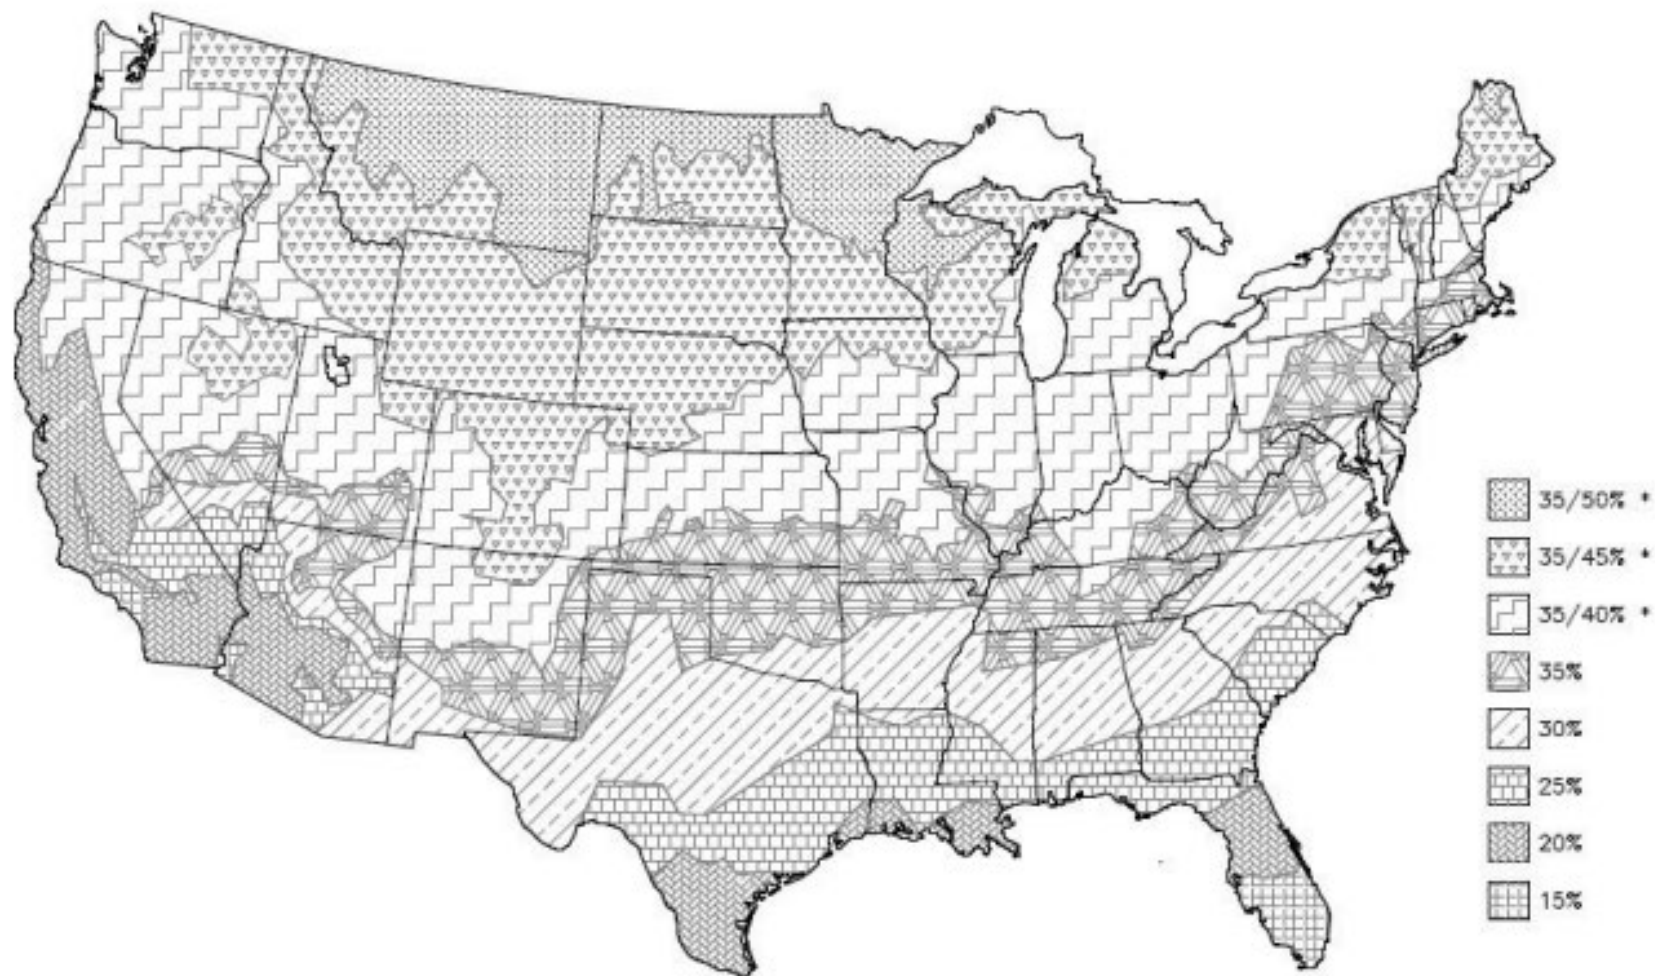


Basic Piping


SIM036 AND SIM060

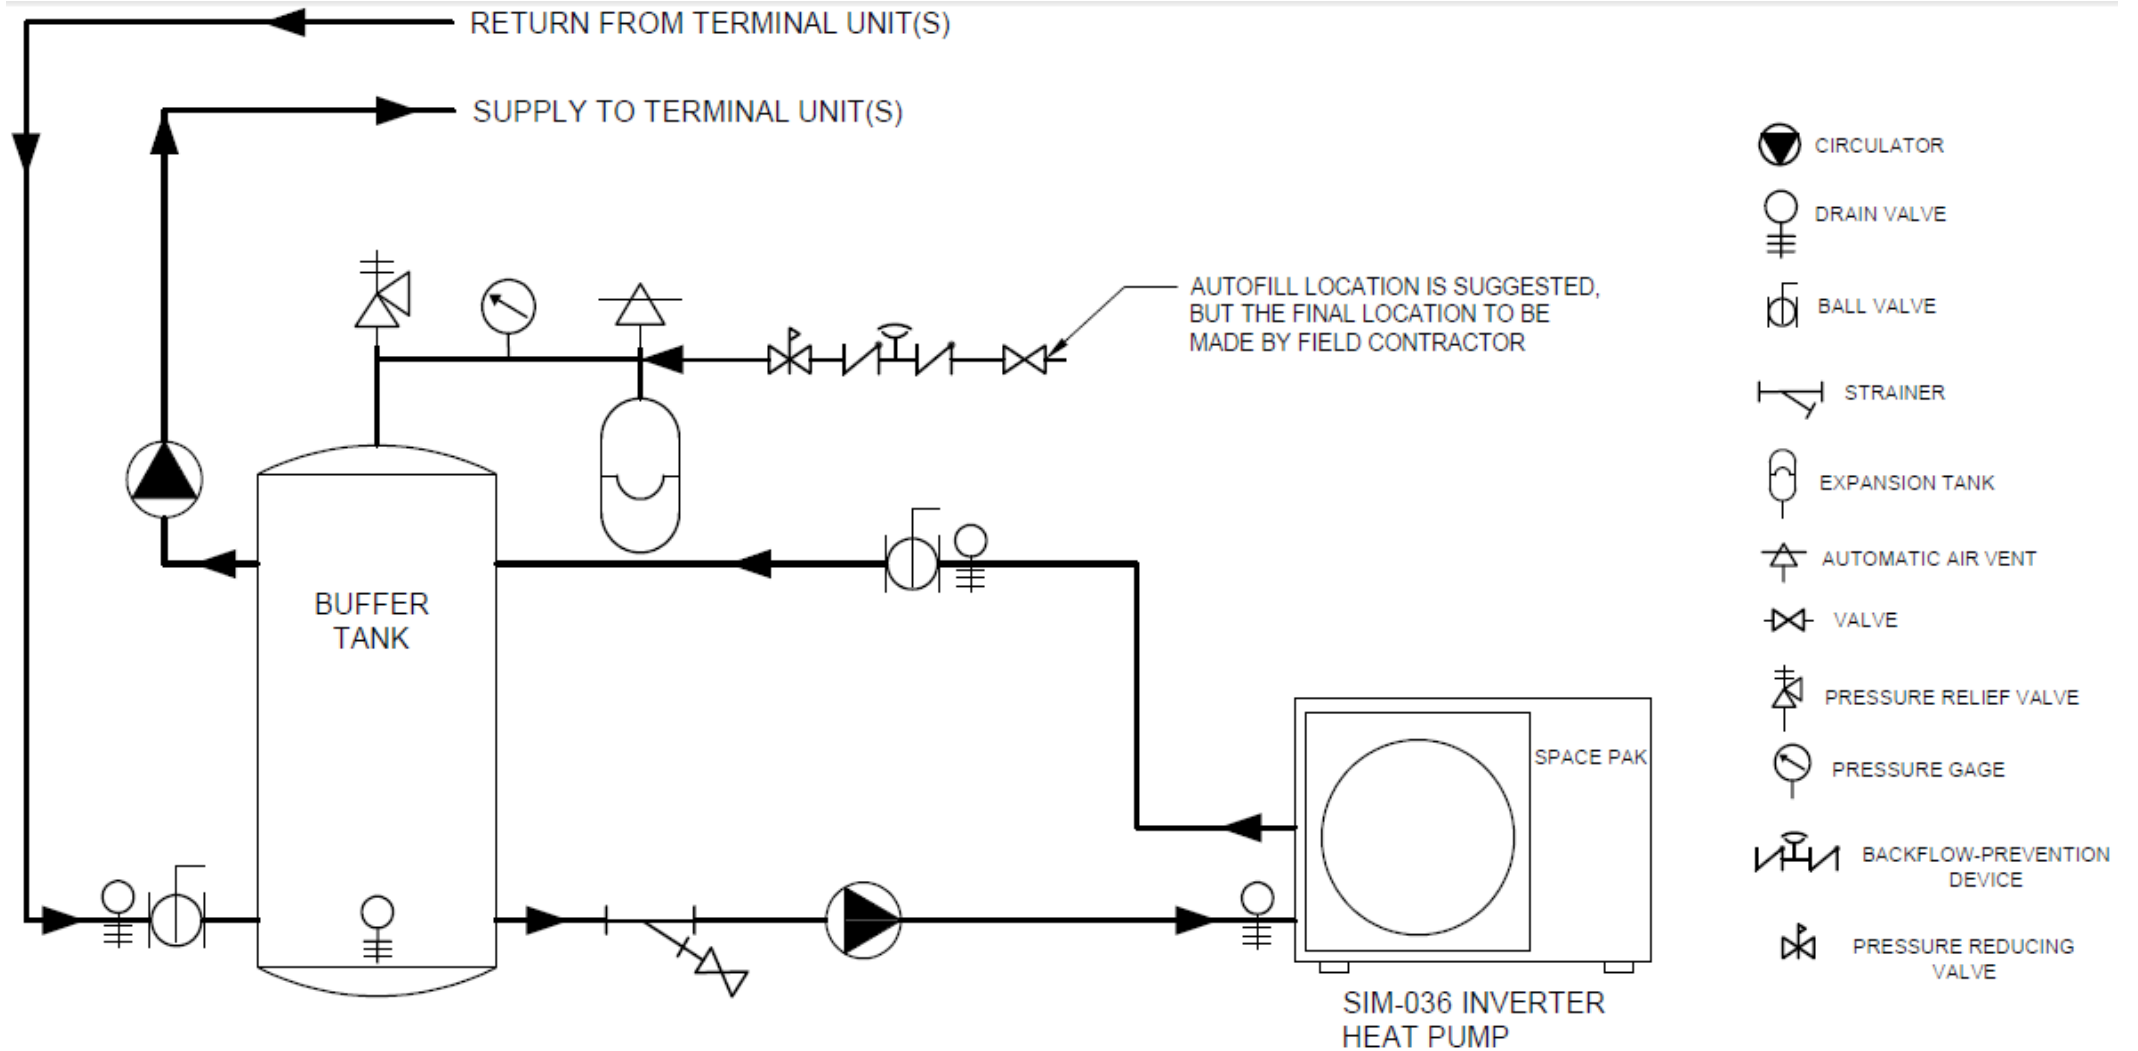

Outdoor Clearances

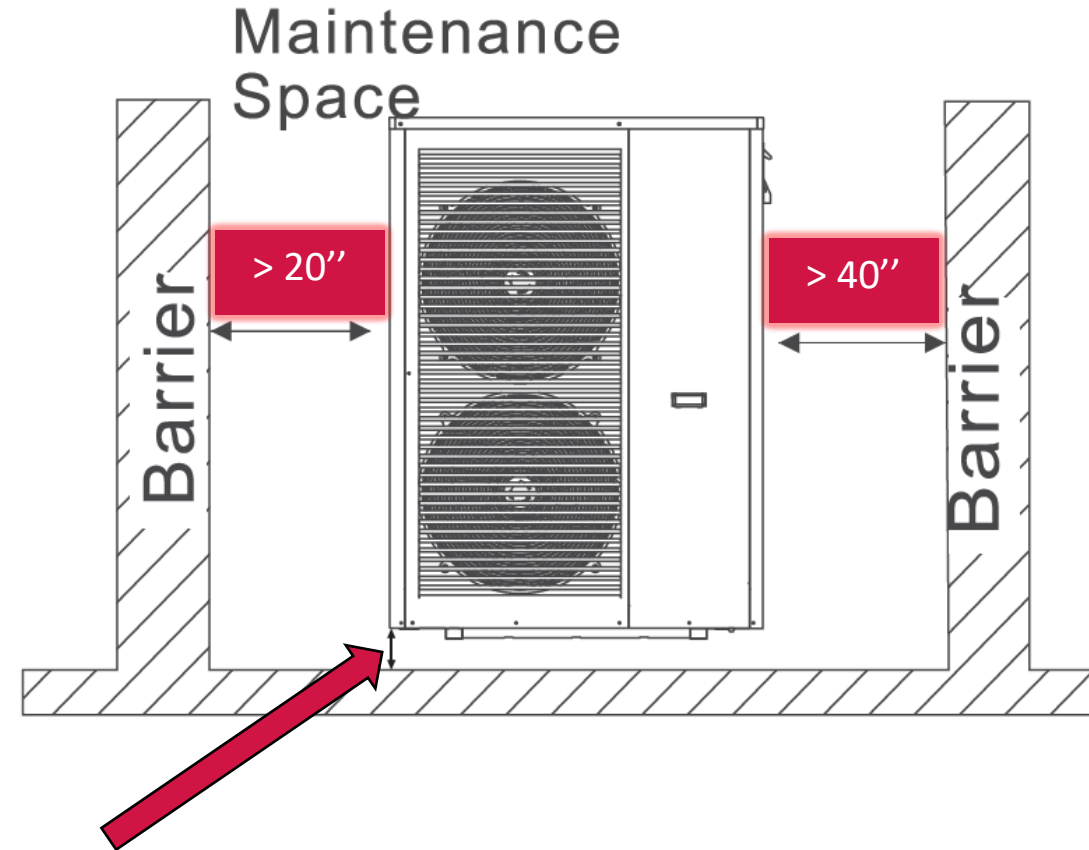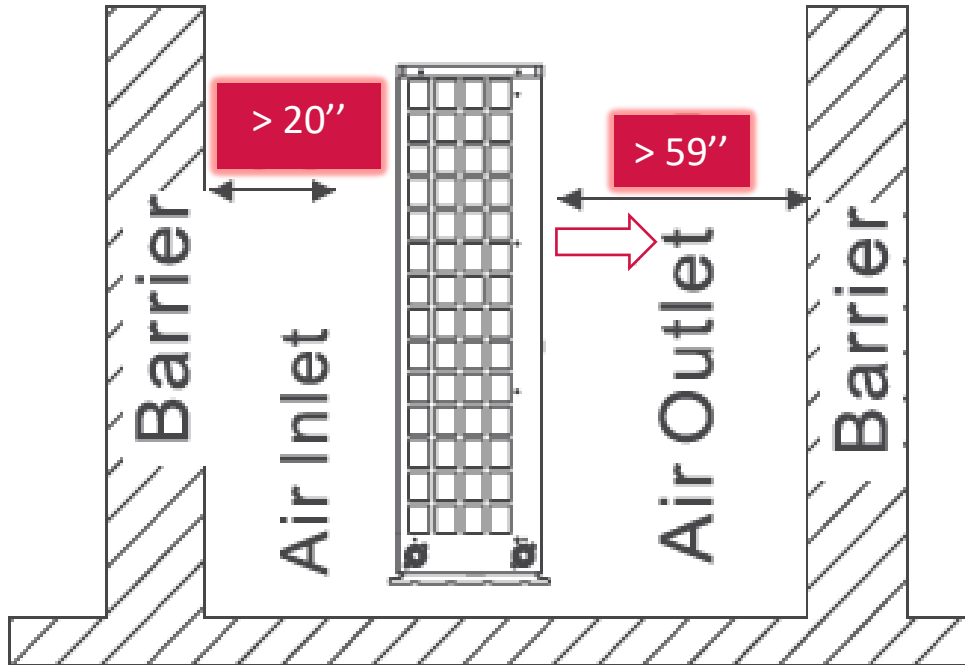

Note 1: The base of the unit should be located above winter snow level to allow proper drainage of condensate. The condensate should be provided a path to drain before refreezing in an area that could create an obstruction or hazardous conditions such as on a walkway.

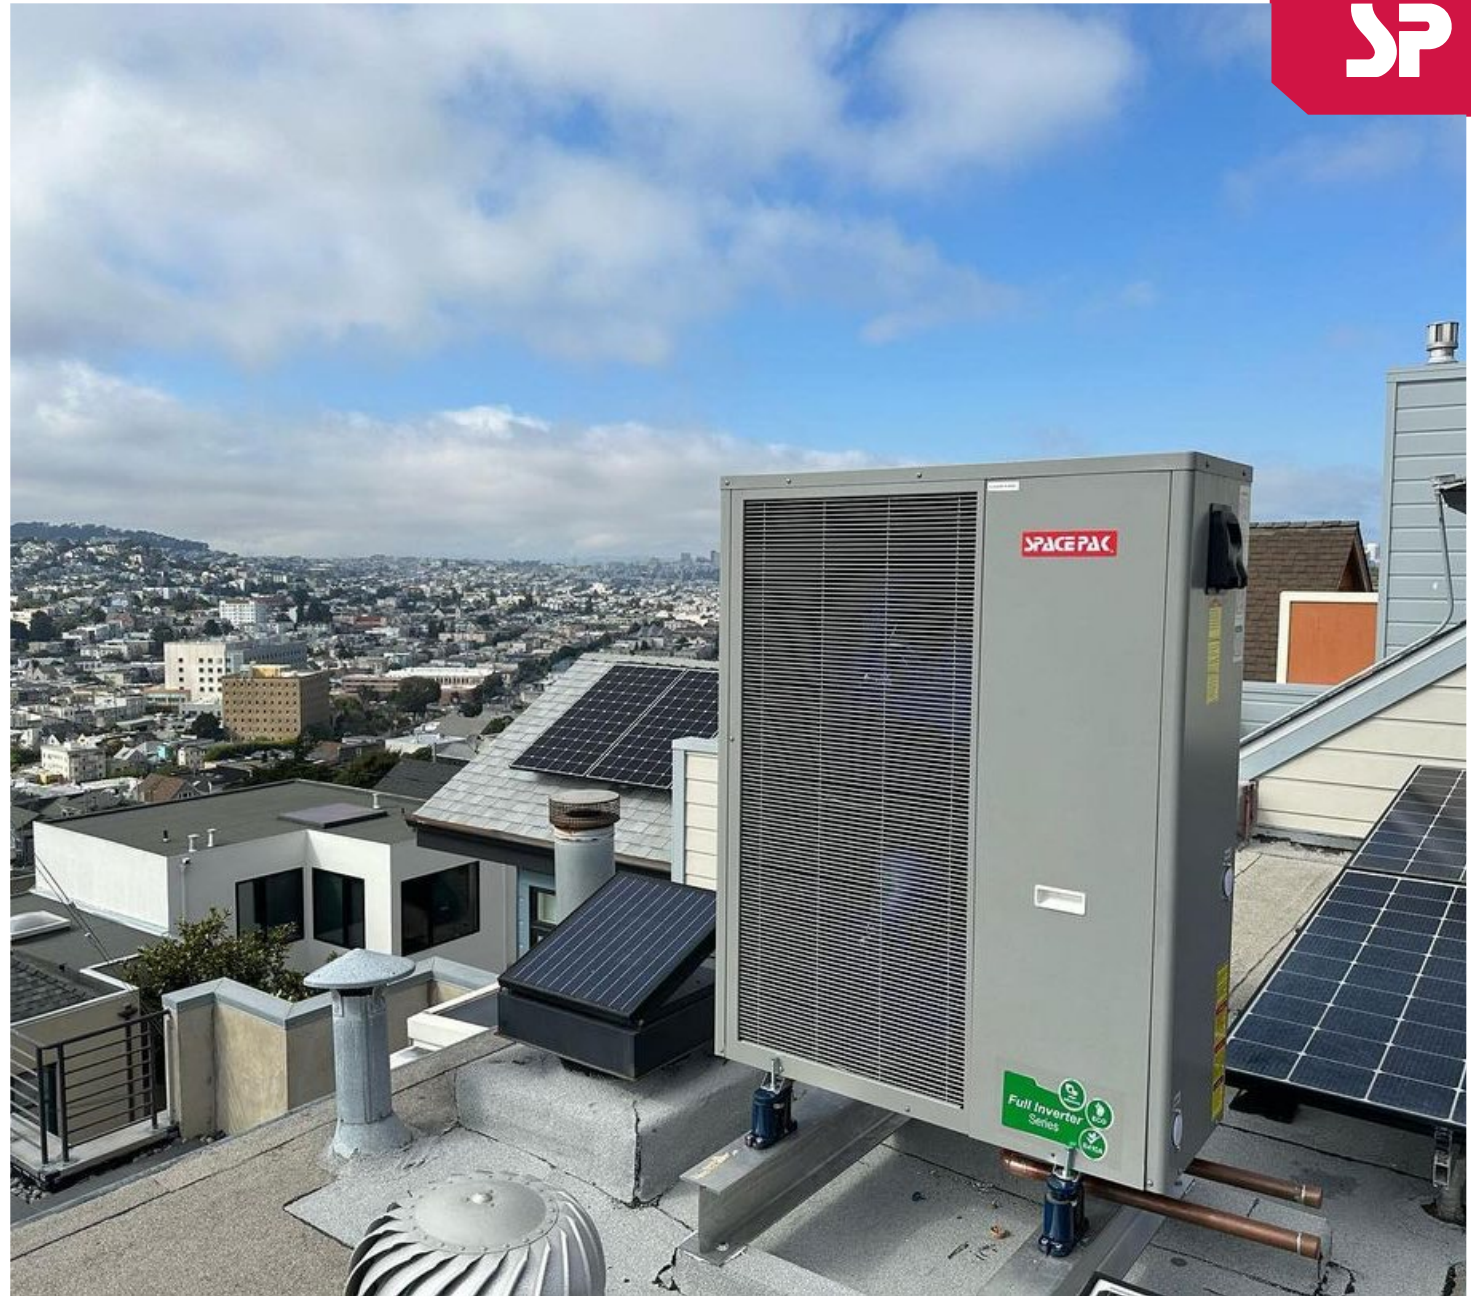





Primary Cooling Applications

Lincoln, NE
First Radiant Cooling Job in the State



Lennox, MA



LOW AMBIENT COOLING: Mestek Server Room Chiller Upgrade After 10 Years



Westfield, MA



LOW AMBIENT COOLING: Chiller for Western New England University Quantum Computer Lab

Springfield, MA





—
Questions?

Solstice Inverter Extreme (ILAHP)

COLD CLIMATE

AIR TO WATER HEAT PUMP

- Available in 4-ton Model
- Heating, cooling, domestic hot water
- Eco-friendly monobloc design
- 42-130°F Output Water Temperature Range
- Reliable Toshiba EVI Inverter Compressor
- Inverter Driven Fans & Fan Motors
- Controls on Supply Water Temperature
- Freeze Protection
- Low Amp Draw
- Ultra Quiet Operation
- Zero Ozone Depletion R410A



ILAHP48




ILAHP

Monobloc Touch Screen Control


SIM036, SIM060, ILAHP48

Advanced Intelligent Internal Control Platform

- User-friendly color touch screen
- Intelligent defrost
- Outdoor air reset
- Modbus compatible
- 24ga shielded 5 wire - can be remote mounted up to 600ft

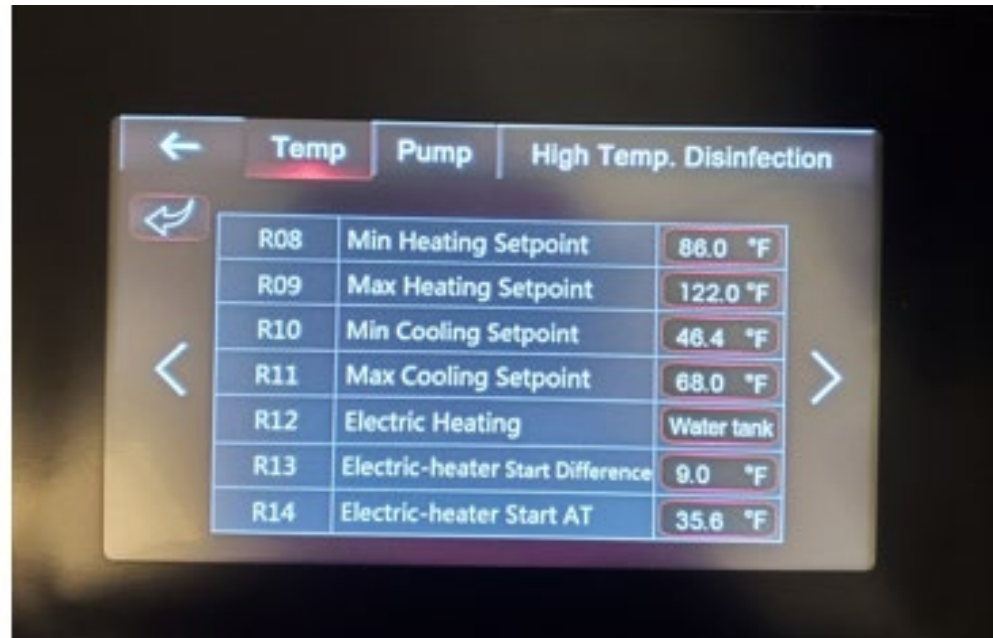

Monobloc Touch Screen Display Wiring Layout

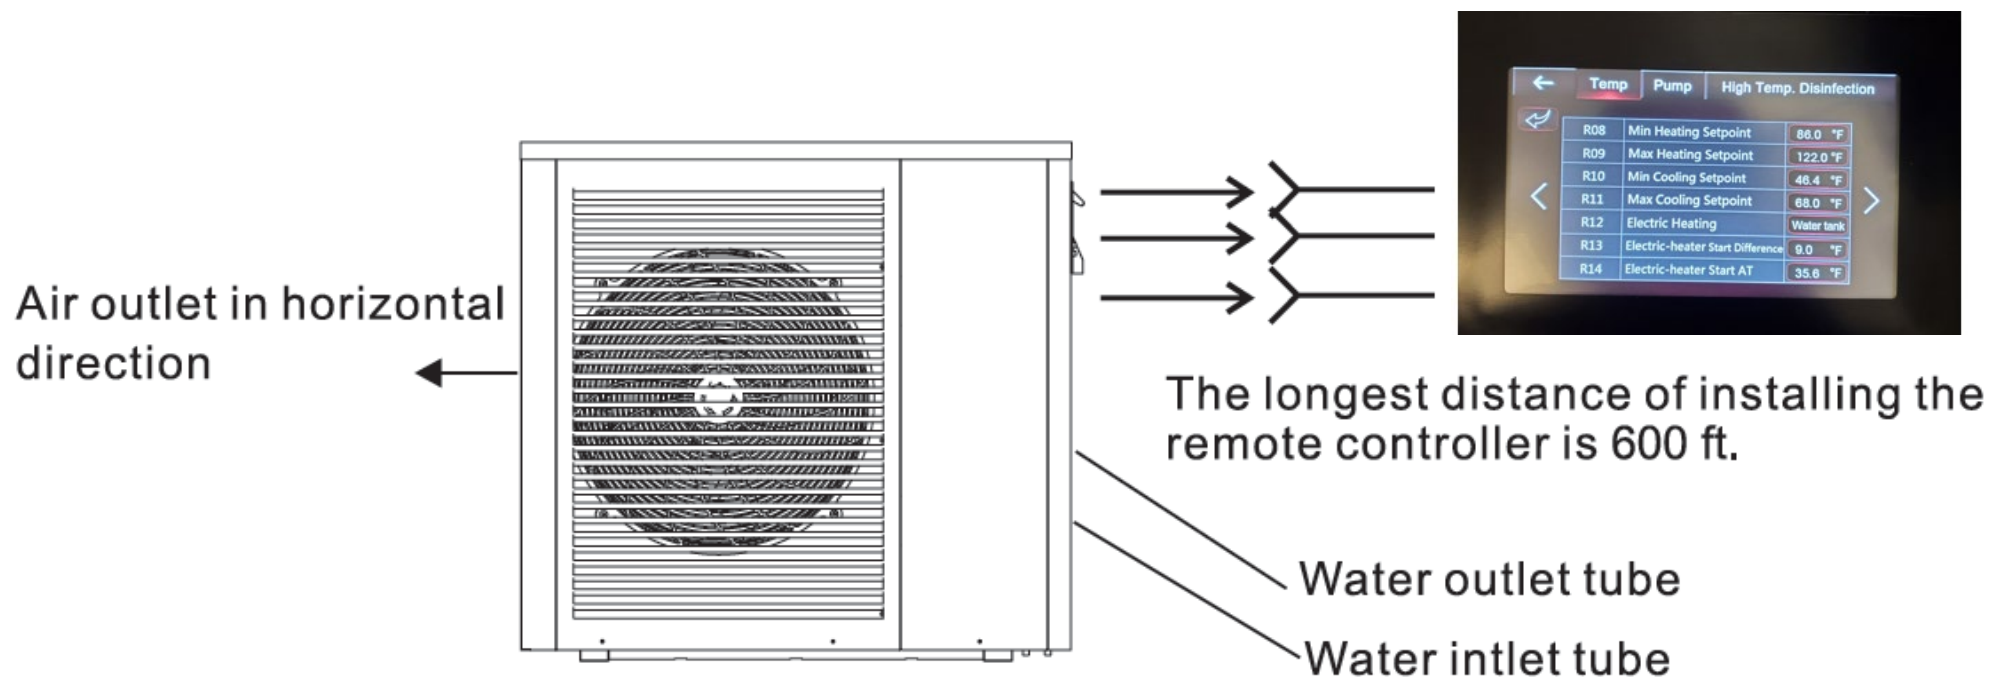


NOTE: A 65-foot 5 conductor shielded wire is supplied with the unit. In cases of longer runs, field supplied shielded wire can be used. However, the factory supplied Molex connectors will have to be attached at either end for proper installation.




		Units	ILAHP
Cooling	Capacity Range	BTU/hr	24,226-63,466
	Efficiency Range	EER	7.26-10.41
	Efficiency	IPLV	18.4
	Delivered Water Temp Range	°F	42-77
	Ambient Temp Range	°F	5-109
Heating	Capacity Range	BTU/hr	15,354-63,807
	Efficiency Range	COP	1.64-5.41
	Delivered Water Temp Range	°F	59-130
	Ambient Temp Range	°F	-22 - 109
CEC Data	Cooling Capacity/Efficiency*	BTU/hr/COP	45,424/8.59
	Heating Capacity/Efficiency**	BTU/hr/COP	53,214/2.78
	Heating Capacity/Efficiency***	BTU/hr/COP	36,903/1.82
Electrical	Power	V/Ph/Hz	230/1/60
Refrigerant	Type		R410a
Fan	Type		EC
Sound	Range	dBA	47-57
Hydronic	Rated Flow	GPM	12
	Max Water Temp	°F	130
	Piping Connections	inch	1-1/4 NPT
	Rated Pressure Drop @ Rated Flow	PSI (ft W.C.)	12.8 (29.5)
Compressor	Type		Rotary Inverter, EVI
	Speed Range	Hz	30-90
Dimensions	Net Dimensions (L x W x H)	inch	39 x 16 x 52
	Shipping Dimensions (L x W x H)	inch	42 x 17 x 53
	Net Weight/Shipping Weight	lbs.	349/388

Heating Performance @ 130°F Deliver Water


ILAHP, 130°F Delivered Water Temperature, BTU/hr, Heating

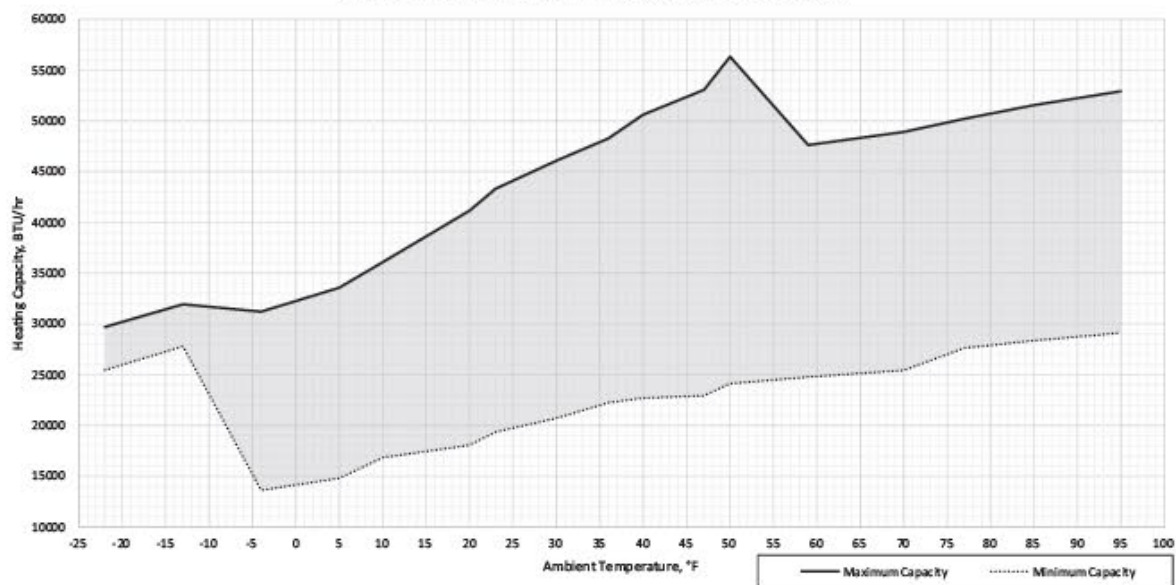

ILAHP, 130°F Delivered Water Temperature, COP, Heating

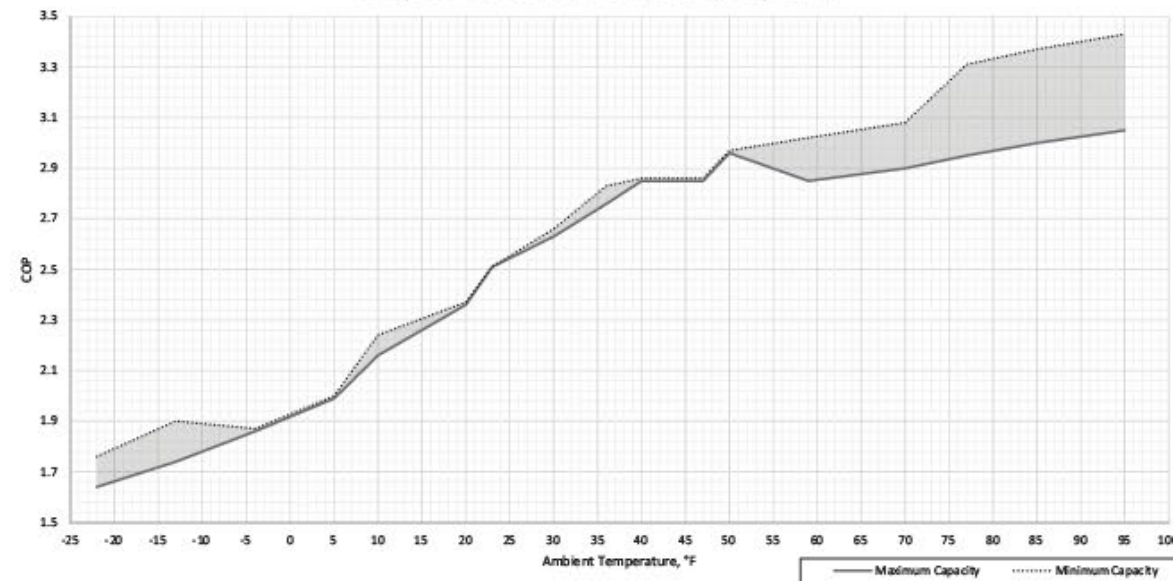

Basic Wiring

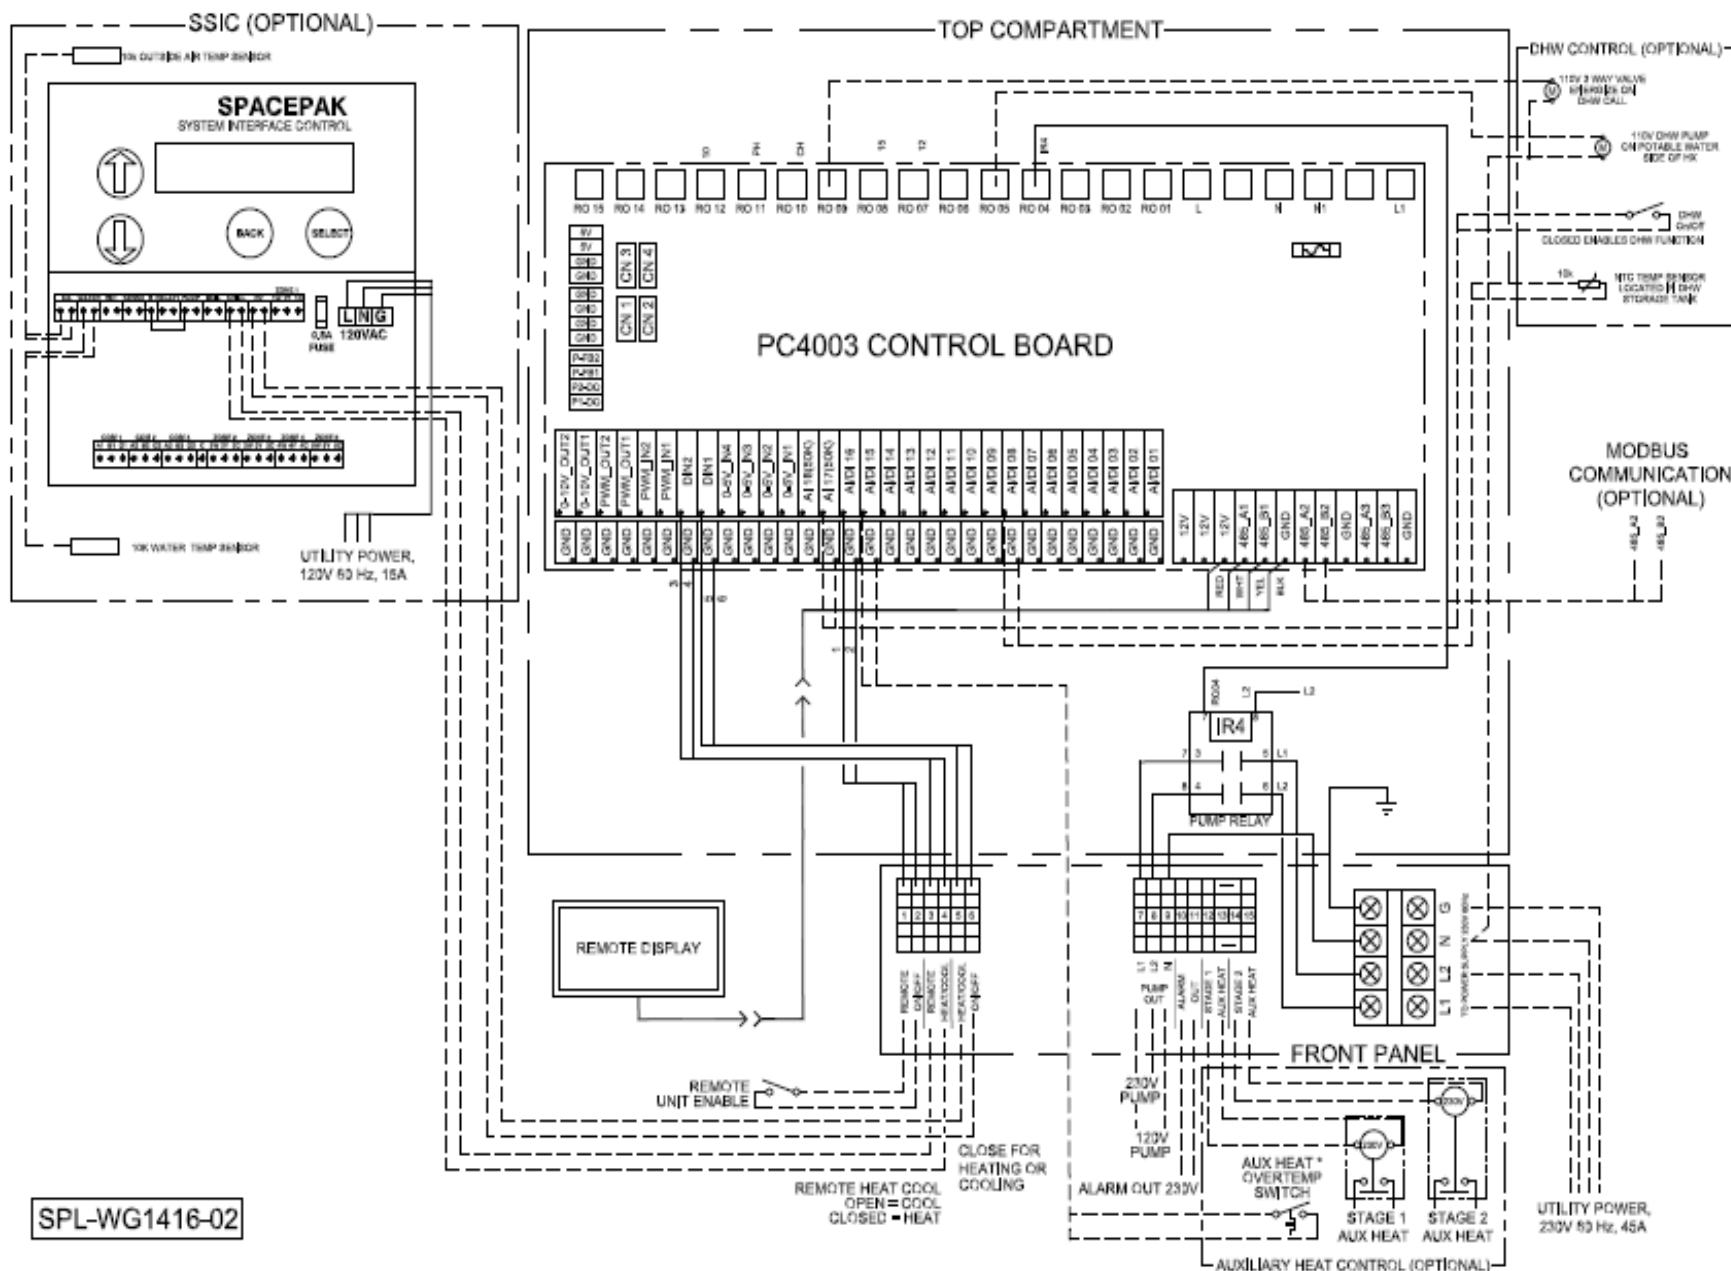


SPL-WG1416-02

Basic Wiring



The remote On/Off, Remote Heat/Cool, Heat/Cool On/Off, and DHW Enable inputs are for voltage-free relay contacts only. Any voltage introduced to the controls at these points will immediately destroy the primary unit control.

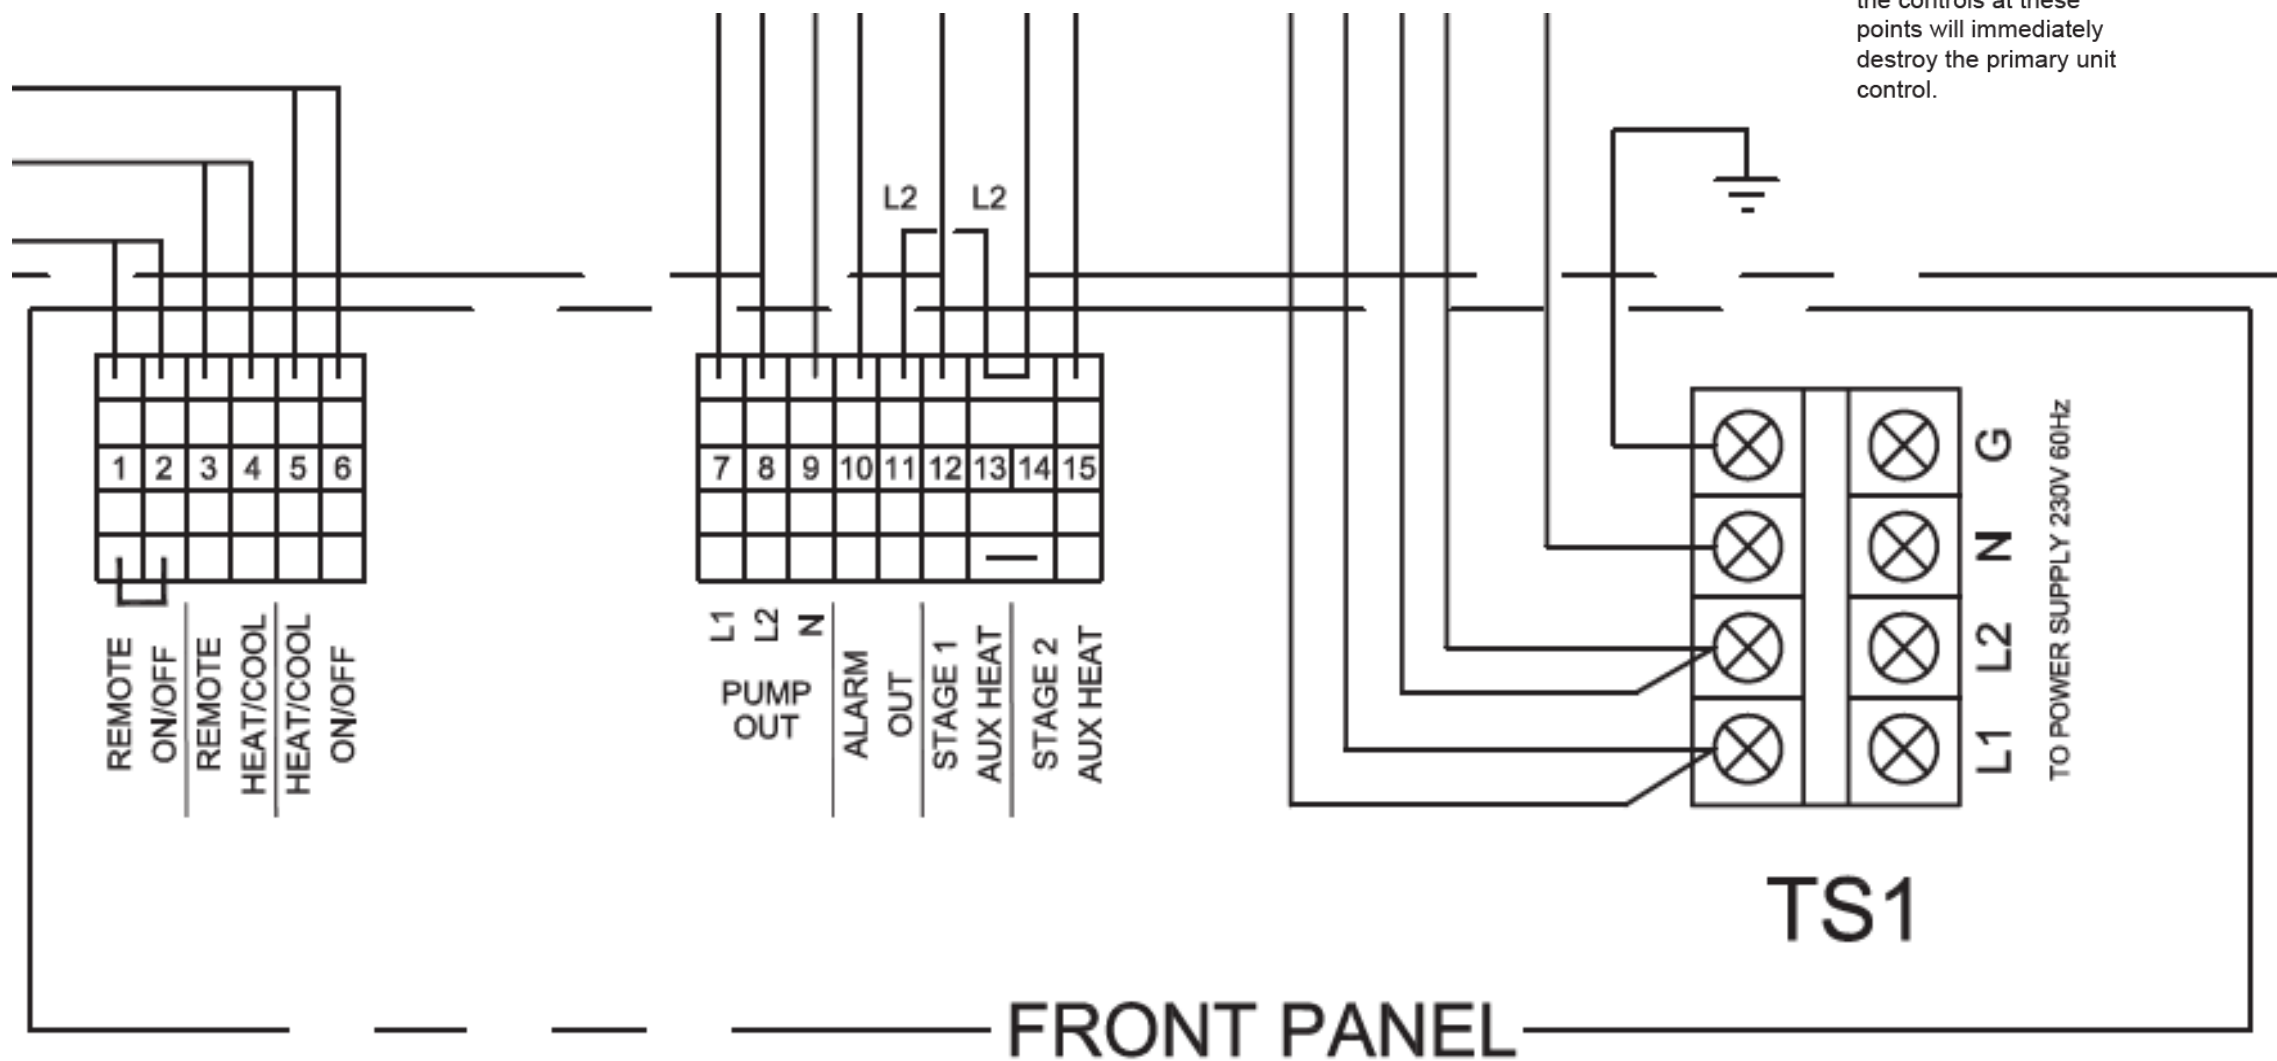

Glycol Protection!


Table 1 ILAHP Glycol Concentrations (10% Minimum, 50% Maximum)

Ethylene Glycol %	10	20	30	40	50
Min. Ambient Temp for Operation	23°F/-5°C	14°F/-10°C	2°F/-17°C	-13°F/-25°C	-36°F/-38°C
SpacePak Capacity Multiplier	0.98	0.96	0.93	0.91	0.89
Pressure Drop Multiplier (Cooling)	1.06	1.12	1.16	1.25	1.36
Pressure Drop Multiplier (Heating)	1.06	1.12	1.16	1.22	1.28
Minimum Expansion Volume / System Volume					
Heating and Cooling (Gallons)	1 gallon expansion per 15 gallons system volume				
Heating only, HP only (Gallons)	1 gallon expansion per 20 gallons system volume				
Heating Only, with Boiler (Gallons)	1 gallon expansion per 15 gallons system volume				
Propylene Glycol %	10	20	30	40	50
Min. Ambient Temp for Operation	26°F/-3°C	18°F/-8°C	8°F/-13°C	-7°F/-22°C	-29°F/-34°C
SpacePak Capacity Multiplier	0.99	0.98	0.96	0.93	0.88
Pressure Drop Multiplier (Cooling)	1.10	1.20	1.34	1.5	1.65
Pressure Drop Multiplier (Heating)	1.10	1.20	1.34	1.46	1.5
Minimum Expansion Volume / System Volume					
Heating and Cooling	1 gallon expansion per 15 gallons system volume				
Heating only, HP only	1 gallon expansion per 20 gallons system volume				
Heating only, with Boiler	1 gallon expansion per 15 gallons system volume				

Non use of propylene glycol will void warranty.

This information is provided as a general guideline only, and is not intended to cover all possible conditions. It is ultimately the responsibility of the installer to ensure that proper freeze protection is provided.

Antifreeze % Per Geographic Region

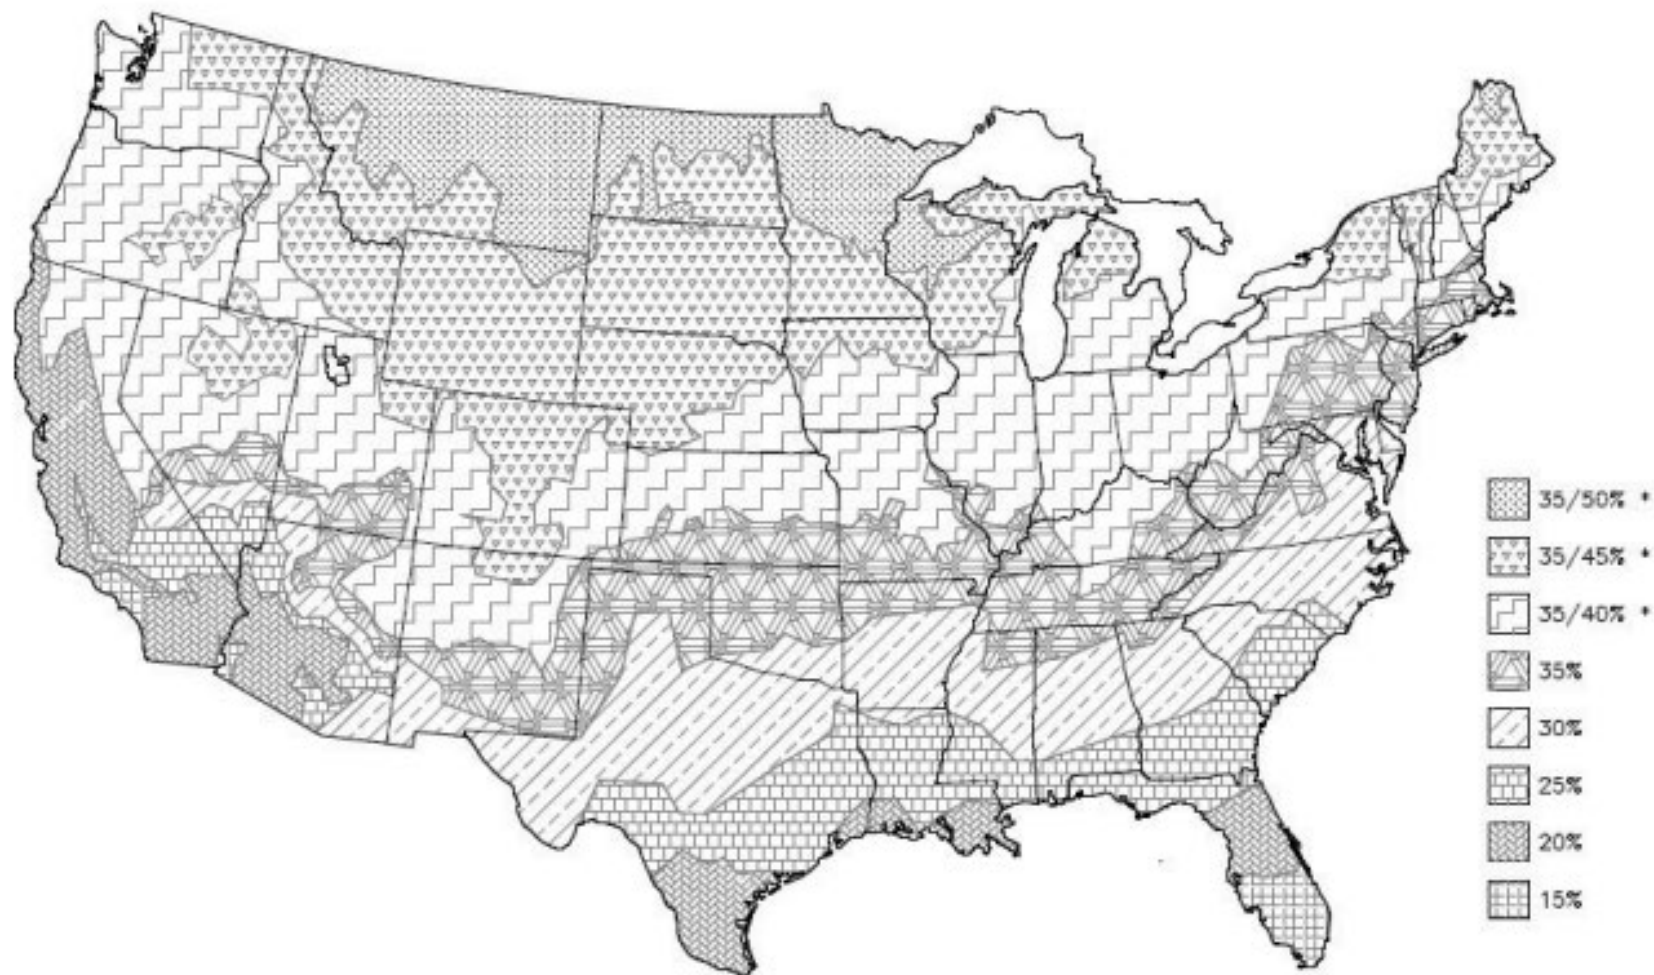

ILAHP Installations



Northern Cali



Cambridge, MA



Upstate NY,
Shipping Container Home



Hudson, NY

Radiant Heating Net Zero Venue



Basilica Hudson



—
Questions?

Solstice Inverter Split (SIS)

COLD CLIMATE

AIR TO WATER HEAT PUMP

- Available in 5-ton Model
- Heating & cooling
- Split Design Provides the Flexibility to Reduce the Use of Glycol in the Hydronic Loop
- SIS System Includes both Indoor and Outdoor Units, Refrigerant Line Set (35'), and Control Wire (50')
- Simple Indoor Piping Similar to Wall Hung Boilers
- 42-130°F Output Water Temperature Range
- Reliable Panasonic EVI Inverter Compressor
- Inverter Driven Fans & Fan Motors
- Controls on Supply Water Temperature
- Freeze Protection
- Low Amp Draw



SIS-060

Indoor Unit

Outdoor Unit



		Units	Outdoor	Indoor
Cooling	Capacity Range	BTU/hr	21,484-74,489	
	Efficiency Range	EER	7.12-18.05	
	Efficiency	IPLV	17.14	
	Delivered Water Temp Range	°F	41-68	
	Ambient Temp Range	°F	5-109	
Heating	Capacity Range	BTU/hr	10,412-76,023	
	Efficiency Range	COP	1.19-3.92	
	Delivered Water Temp Range	°F	60-140	
	Ambient Temp Range	°F	-22-90	
CEC Data	Cooling Capacity/Efficiency*	BTU/hr/COP	39,714/8.14	
	Heating Capacity/Efficiency**	BTU/hr/COP	55,499/2.9	
	Heating Capacity/Efficiency***	BTU/hr/COP	37,505/1.9	
Electrical	Power	V/Ph/Hz	230/1/60	
Refrigerant	Type		R410A	
Fan	Type		EC	N/A
Sound	Range	dBa	50	38
Hydronic	Rated Flow	GPM	12	
	Max Water Temp	°F	130	
	Piping Connections	inch	N/A	1"
	Rated Pressure Drop @ Rated Flow	PSI (ft W.C.)	N/A	10.7/24.7
Compressor	Type		Rotary Inverter, EVI	
	Speed Range	Hz	30-90	N/A
Dimensions	Net Dimensions (L x W x H)	inch	35x15x55	17x14x30
	Shipping Dimensions (L x W x H)	inch	37x17x55	33x21x17
	Net Weight/Shipping Weight	lbs.	293/337	132/158

Glycol Considerations (Split System)


Table 1 SIS Glycol Concentrations (10% Minimum, 35% Maximum)

Propylene Glycol (concentration by volume)	10%	20%	25%	30%	35%
Min. temp of burst protection	22°F/-5.6°C	11°F/-11.7°C	-1°F/-18.3°C	-18°F/-27.8°C	-46°F/-43.3°C
Capacity Multiplier	0.99	0.98	0.97	0.96	0.94
Pressure Drop Multiplier (Cooling)	1.1	1.2	1.27	1.34	1.42
Pressure Drop Multiplier (Heating)	1.1	1.2	1.27	1.34	1.4
Minimum Expansion Volume/System Volume					
Heating and Cooling	1 gallon expansion per 15 gallons system volume				
Heating only, HP Only	1 gallon expansion per 20 gallons system volume				
Heating Only, with Boiler	1 gallon expansion per 15 gallons system volume				

Non use of propylene glycol will void warranty.


This information is provided as a general guideline only, and is not intended to cover all possible conditions. It is ultimately the responsibility of the installer to ensure that proper freeze protection is provided.

Antifreeze % Per Geographic Region

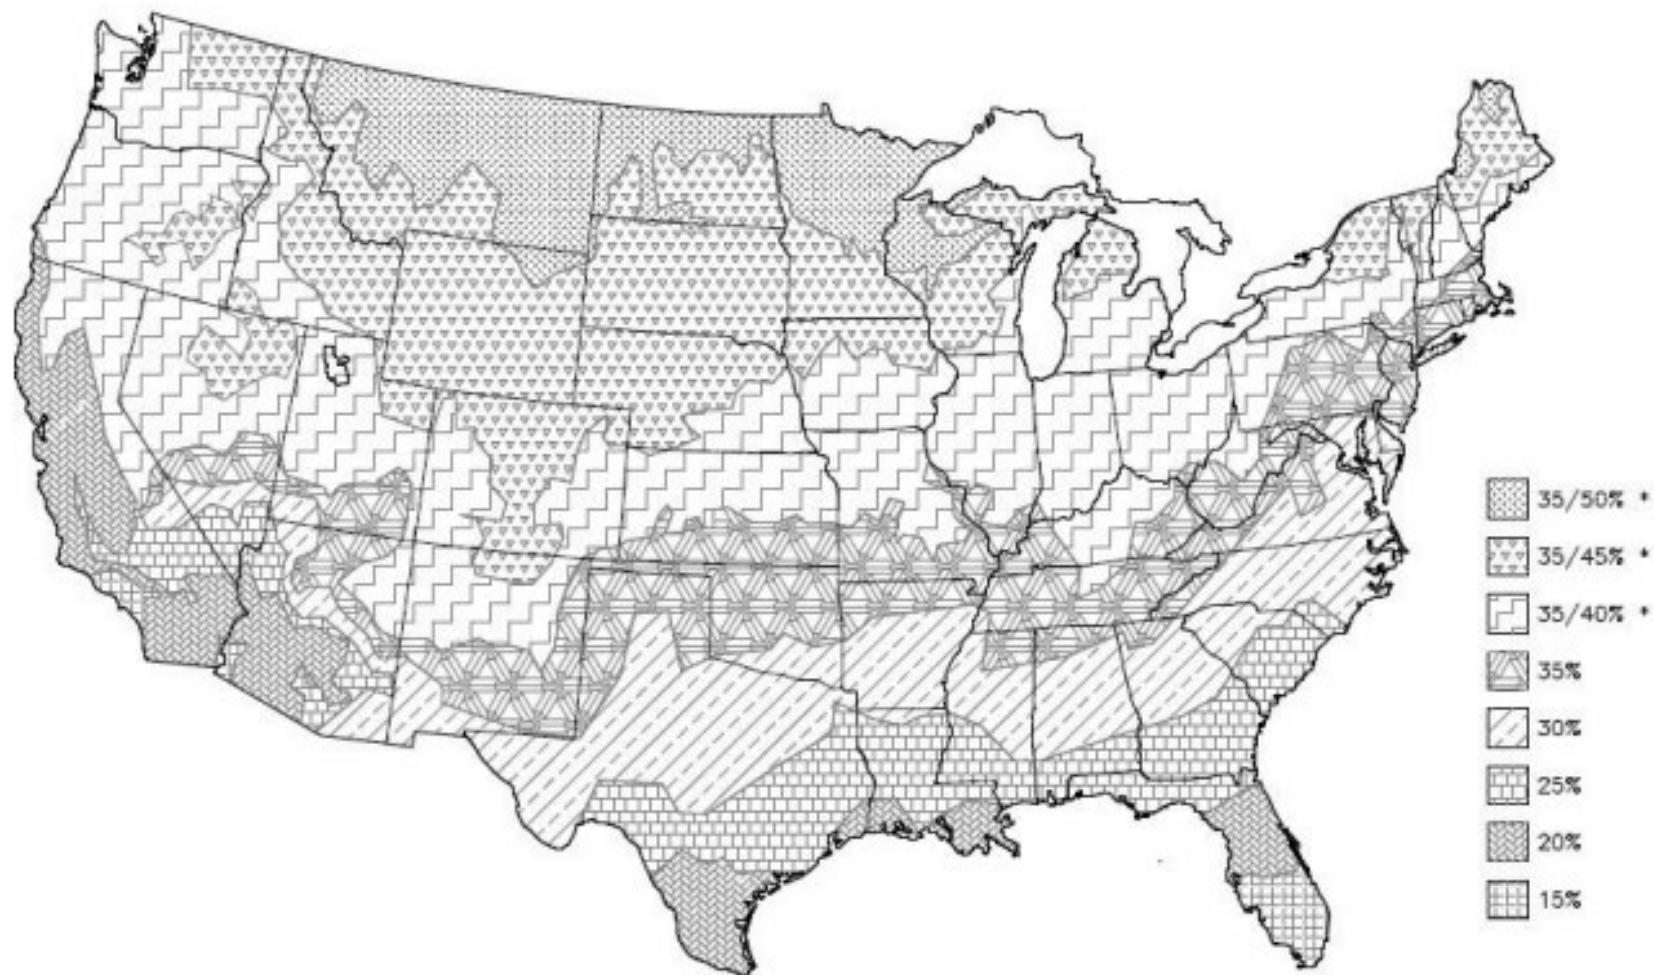

Basic Wiring


INDOOR MODULE

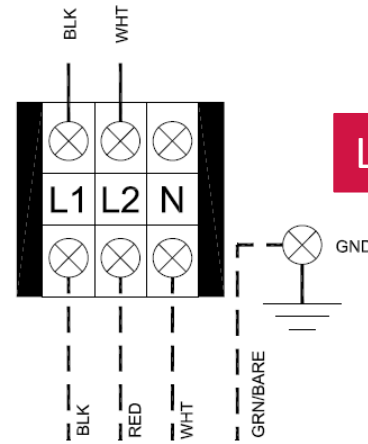

Line Voltage


MIN CIRCUIT AMPACITY 15A
MAX FUSE/BREAKER 15A

OUTDOOR MODULE

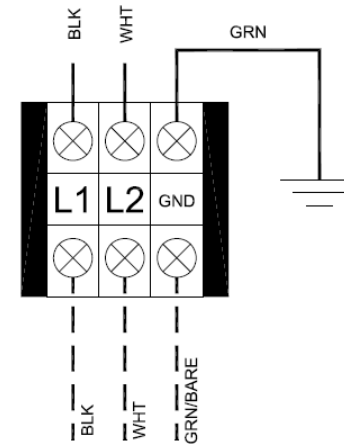


MIN CIRCUIT AMPACITY 40A
MAX FUSE/BREAKER 50A

INDOOR MODULE

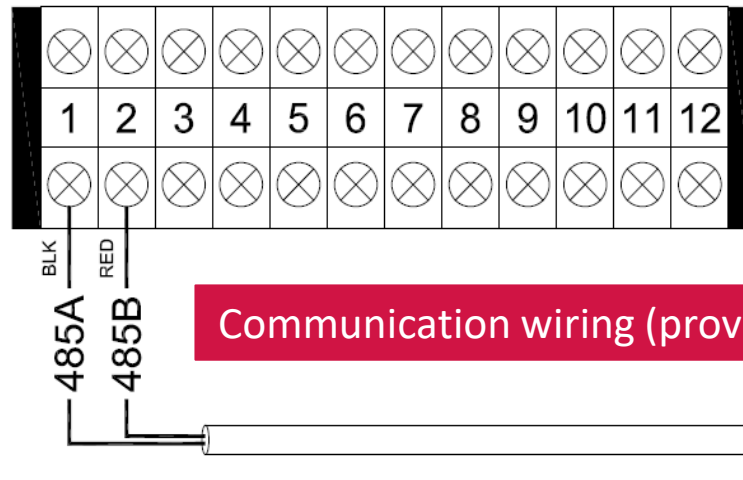


OUTDOOR MODULE

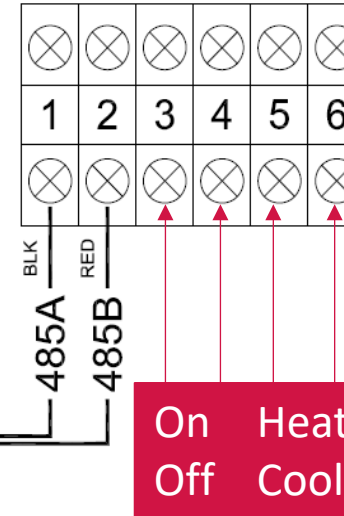


Indoor Wiring



Note: On installs that require the use of a buck and boost transformer the indoor unit can be wired 115V

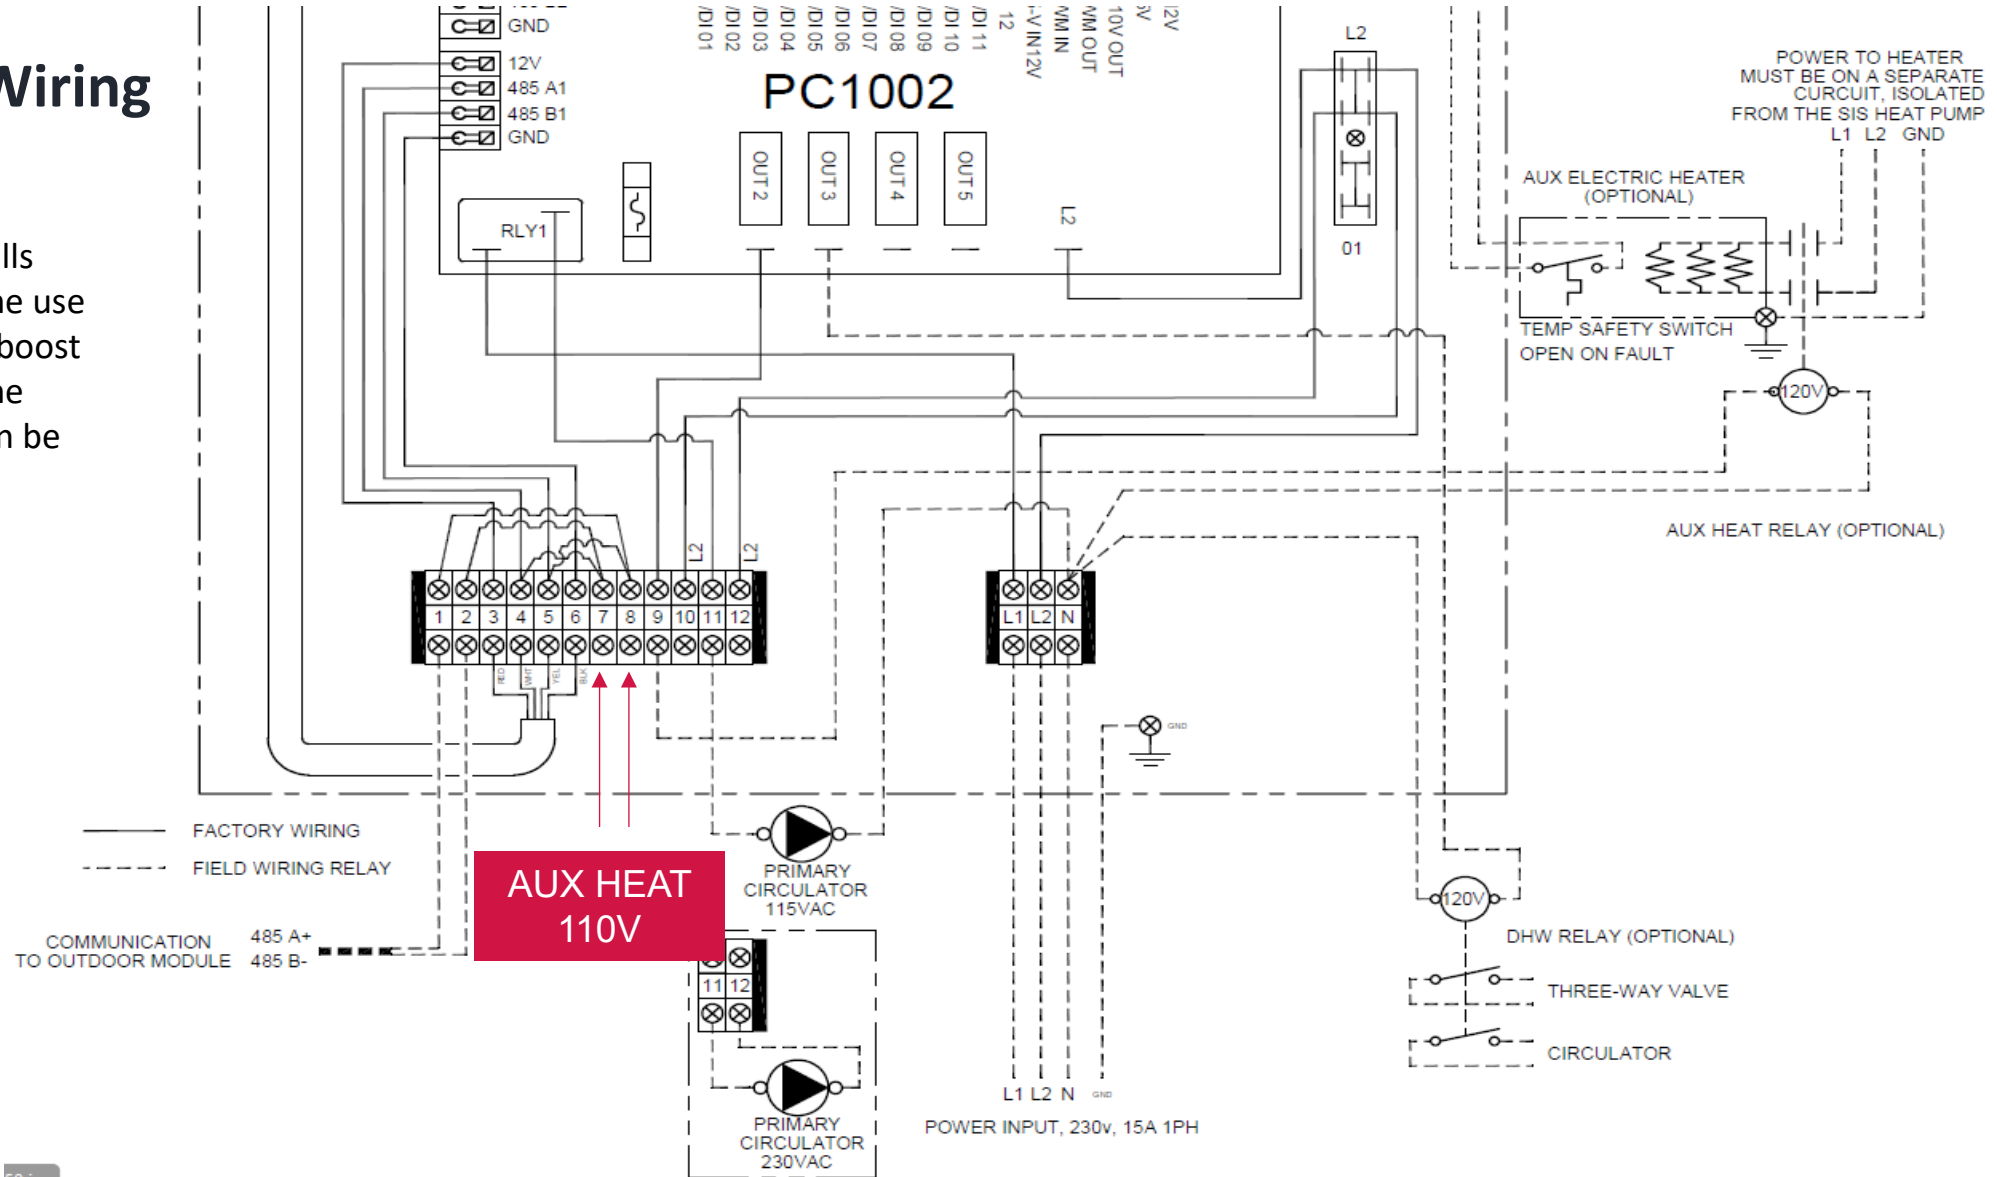


Basic Piping

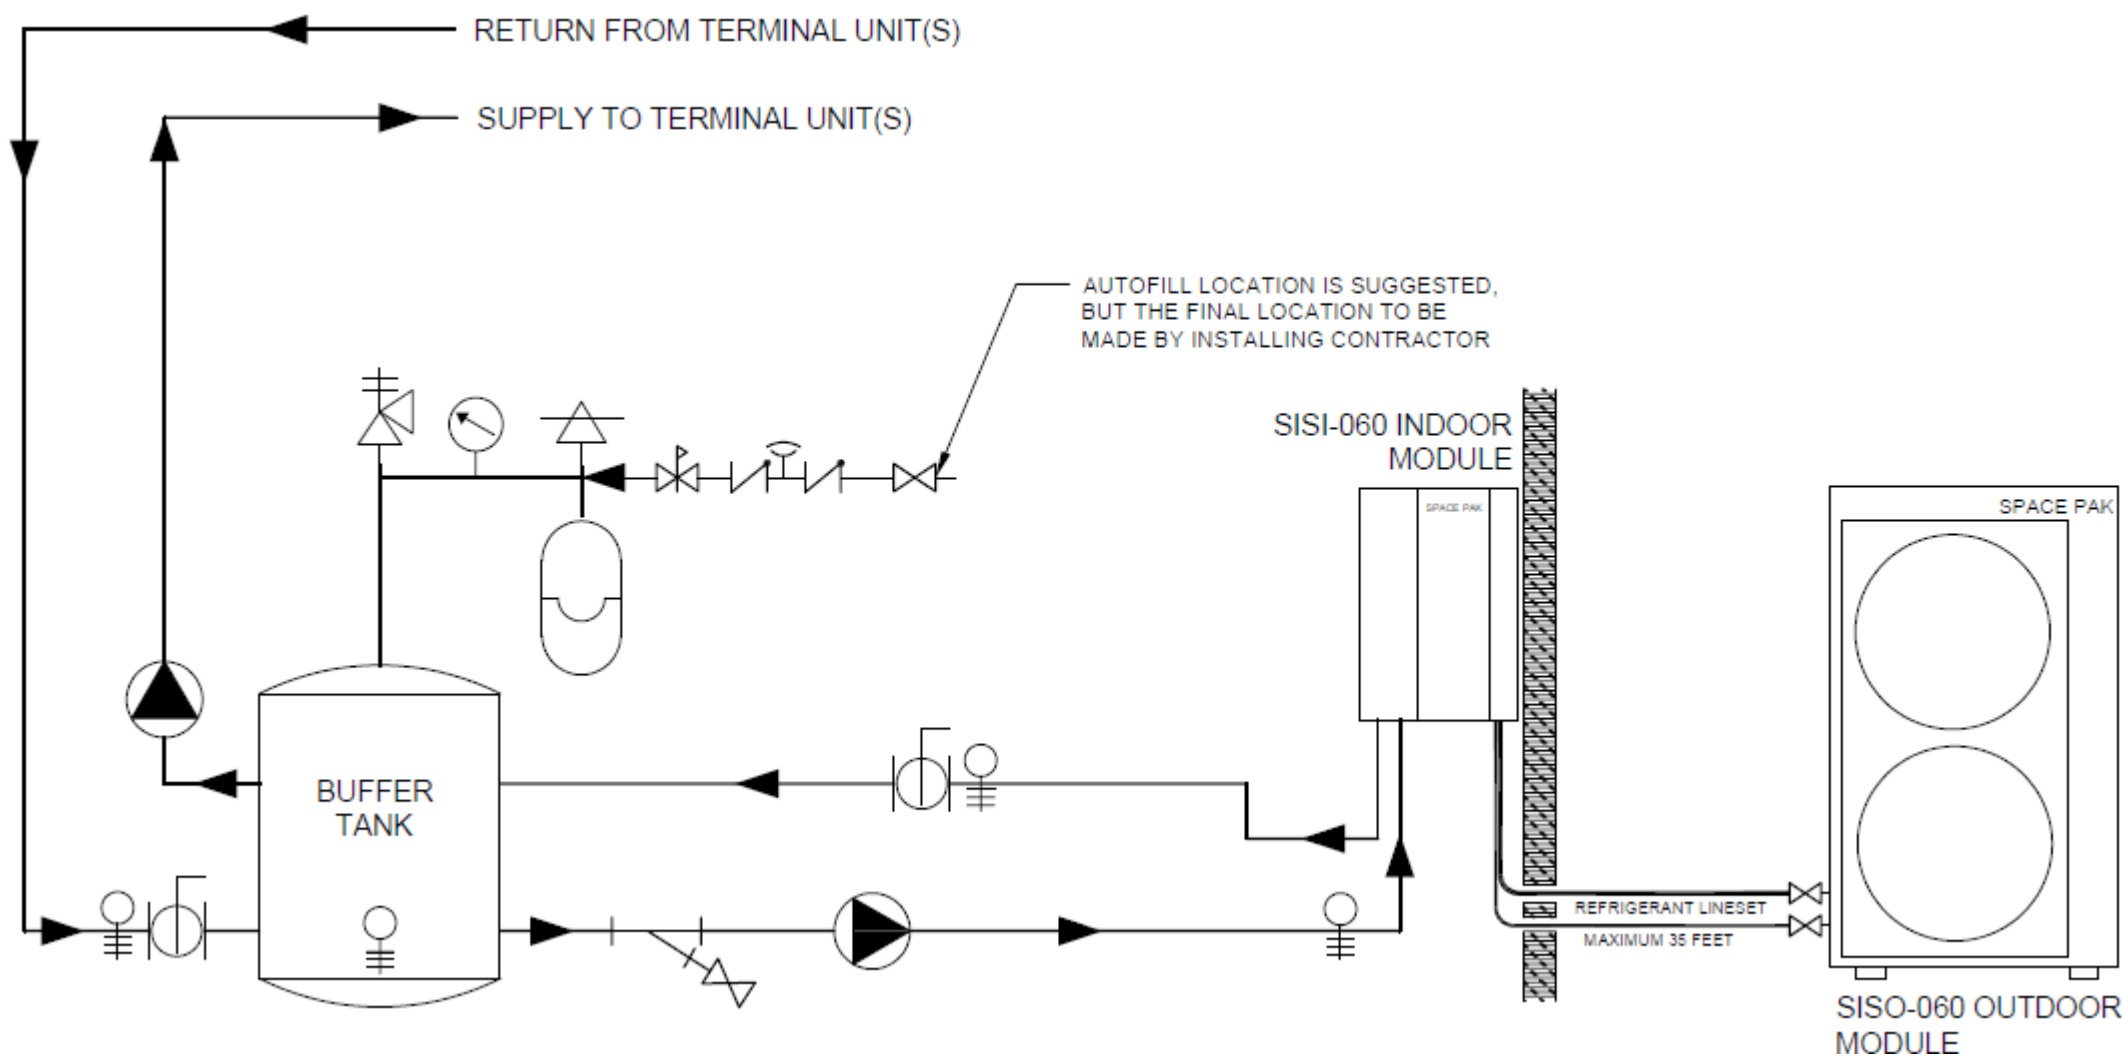

Outdoor Clearances

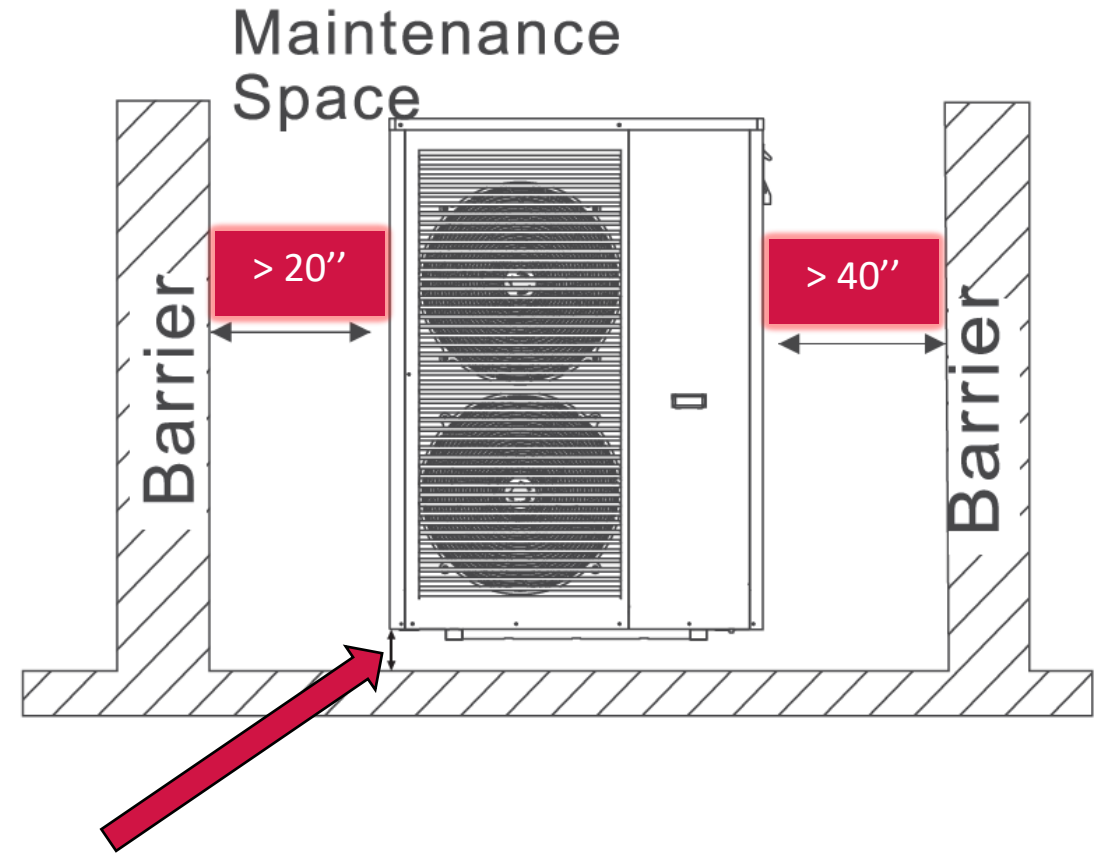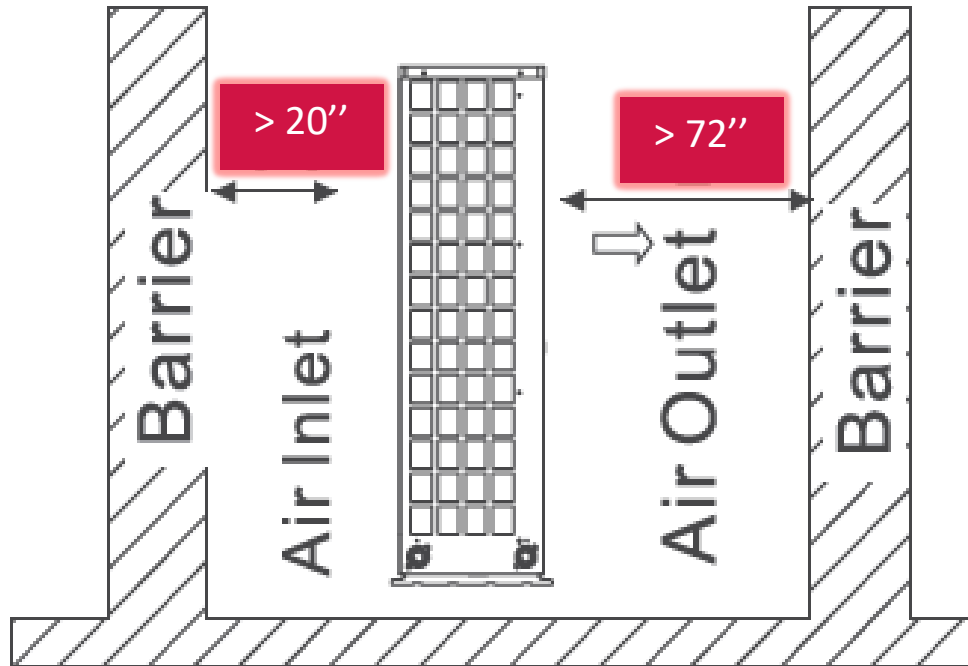

Note 1: The base of the unit should be located above winter snow level to allow proper drainage of condensate. The condensate should be provided a path to drain before refreezing in an area that could create an obstruction or hazardous conditions such as on a walkway.

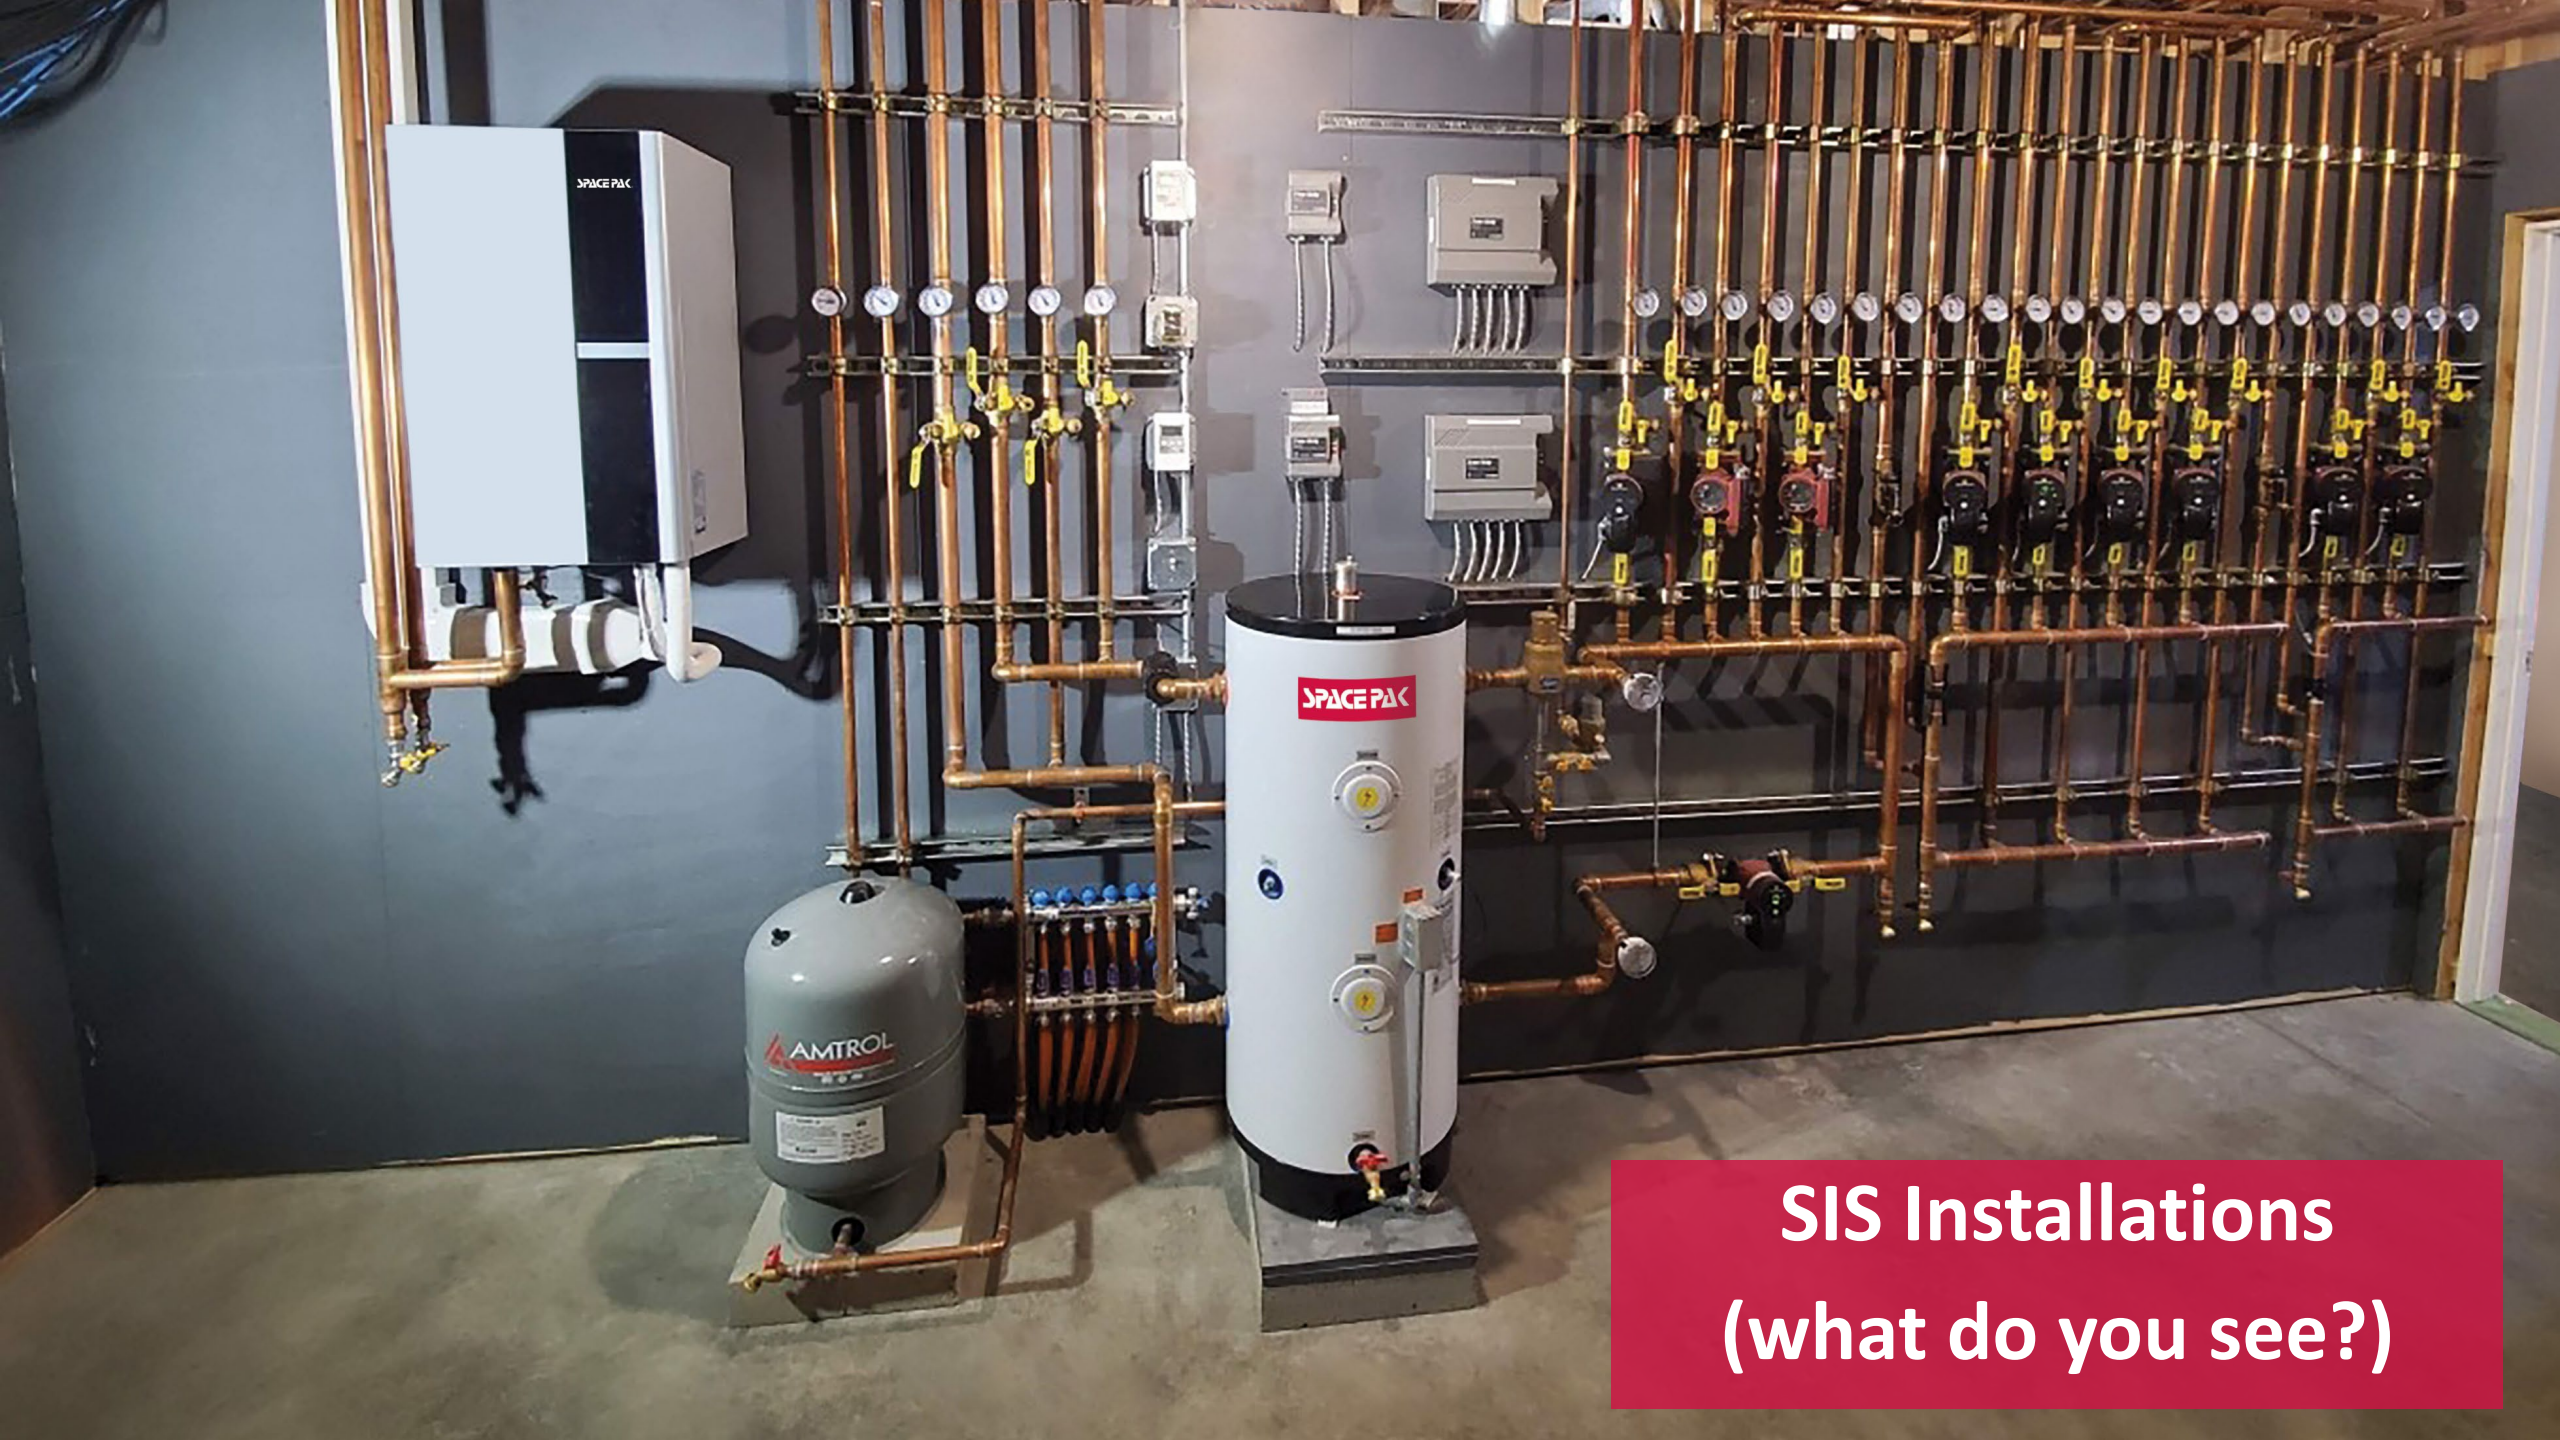

**SIS Installations
(what do you see?)**

SIS Installation at 10k ft Elevation in Colorado



Elevation Derate

Elevation above Sea Level


Feet	Meters
0	0
500	152
1000	305
2000	610
3000	914
4000	1219
5000	1524
6000	1829
7000	2134
8000	2438
9000	2743
10000	3048
11000	3353
12000	3658
13000	3962
14000	4267

Effect on Cooling

Capacity	EER or COP
1.00	1.00
1.00	0.99
0.99	0.98
0.98	0.95
0.97	0.93
0.96	0.90
0.95	0.88
0.95	0.86
0.94	0.84
0.93	0.82
0.92	0.80
0.91	0.78
0.90	0.76
0.89	0.74
0.89	0.72
0.88	0.70


Effect on Heating

Capacity	EER or COP
1.00	1.00
0.99	1.00
0.98	0.99
0.96	0.98
0.94	0.97
0.91	0.96
0.89	0.95
0.87	0.95
0.86	0.94
0.84	0.93
0.82	0.92
0.80	0.91
0.78	0.90
0.77	0.89
0.75	0.89
0.73	0.88

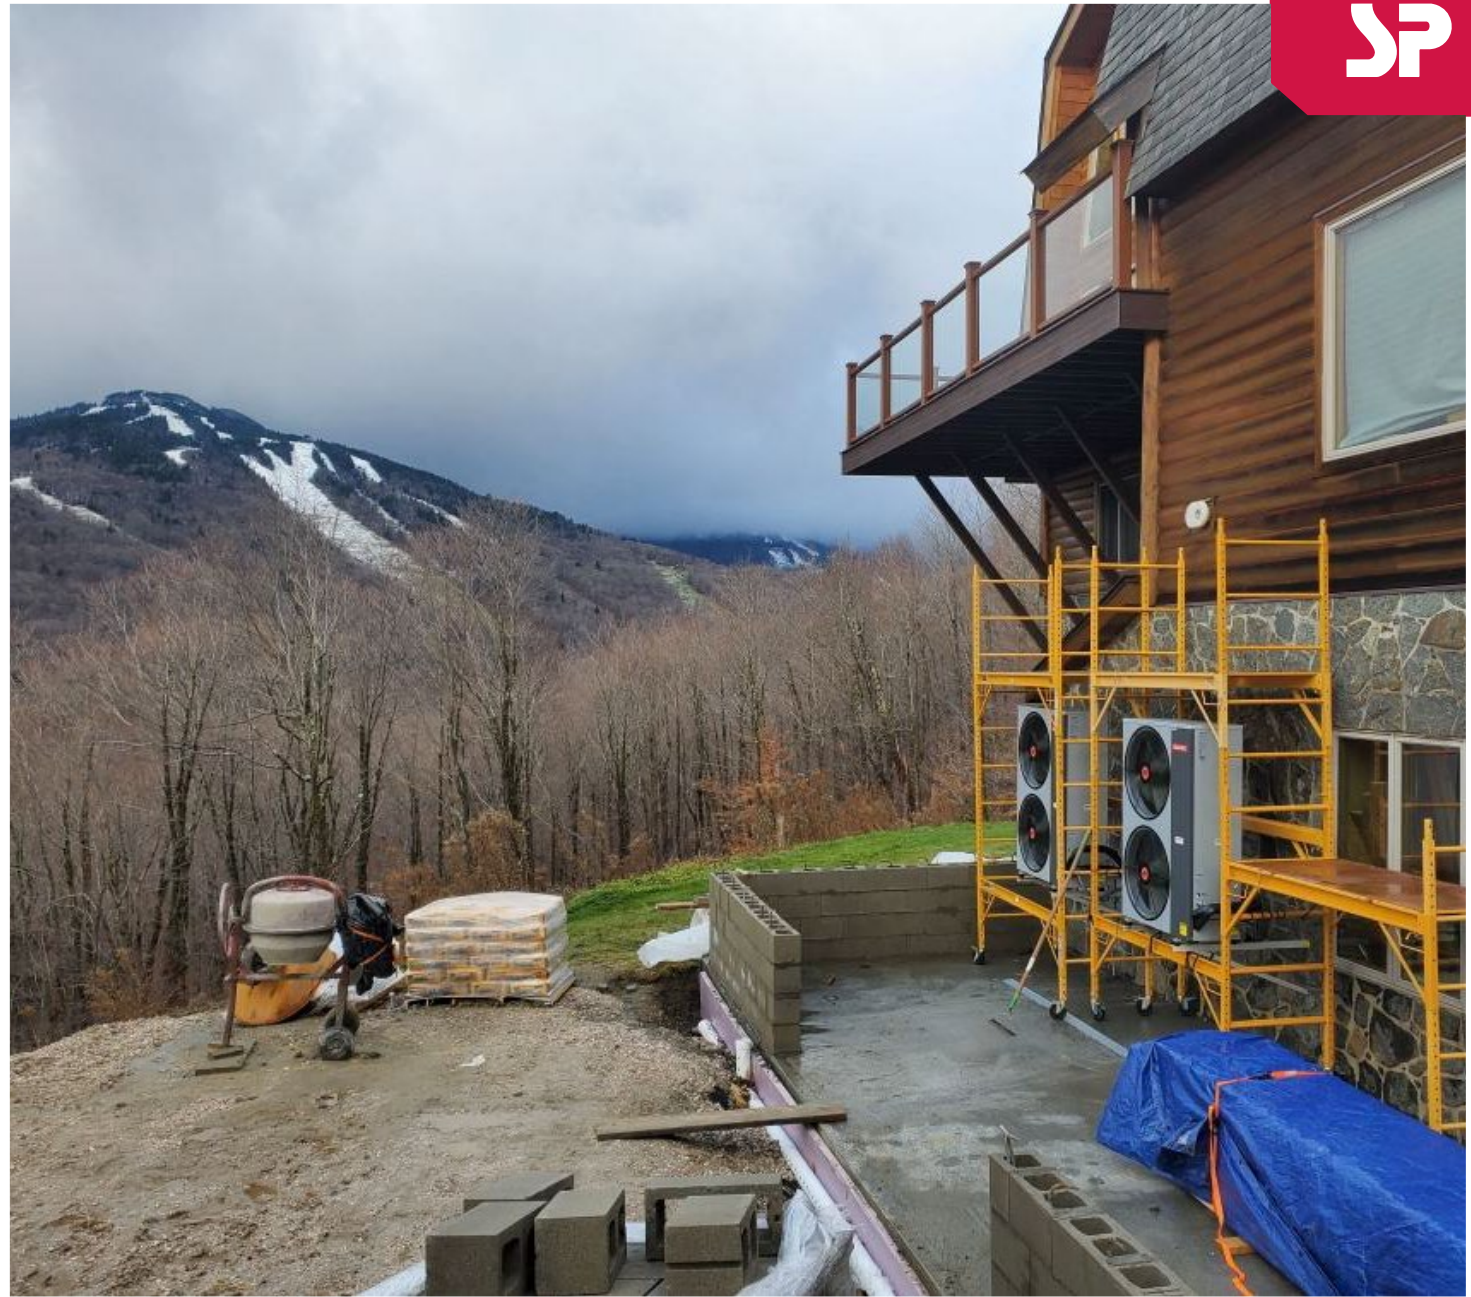

Washington State



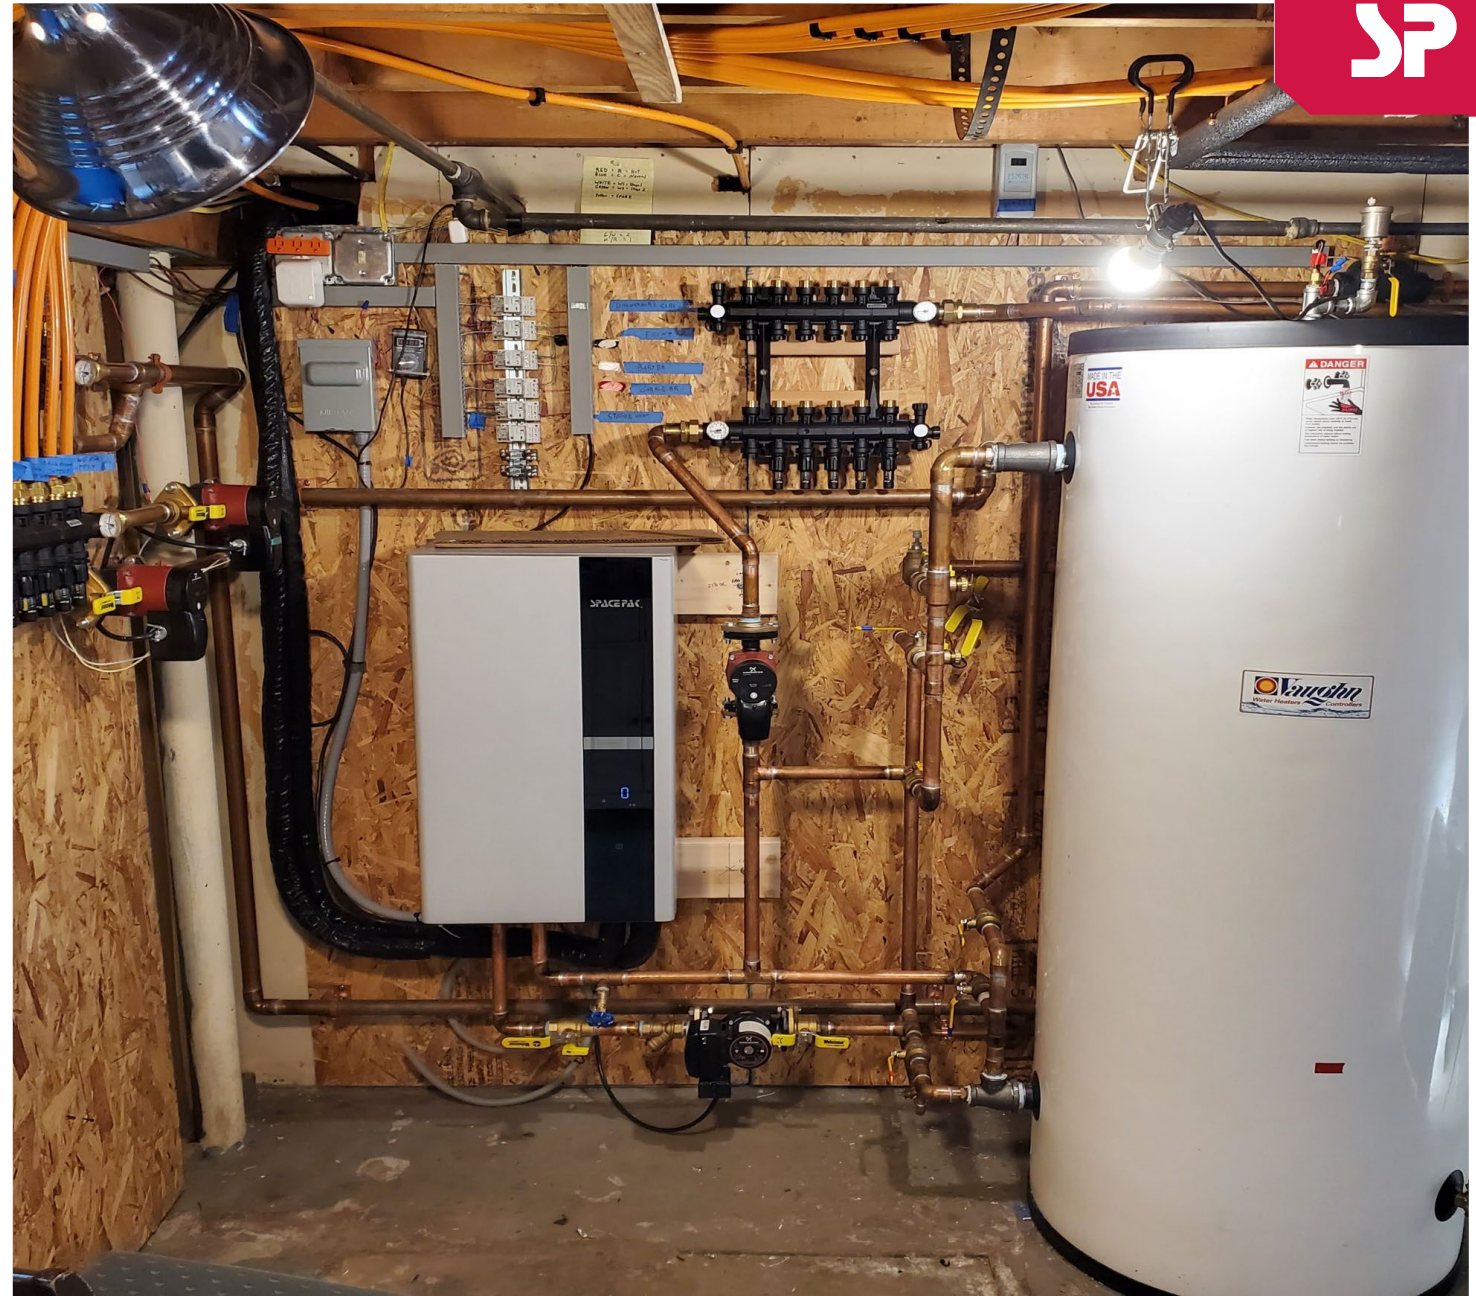

Commercial Air to Water Heat Pump

Cold Climate Air to Water Heat Pump

- Available in 18-ton Model
- Heating & cooling
- Eco-friendly monobloc design
- 42-140°F Output Water Temperature Range
- Reliable Hitachi EVI Inverter Compressor
- Inverter Driven Fans & Fan Motors
- BMS compatible
- Independent refrigerant circuits





		Units	HP0275
Cooling	Capacity Range	BTU/hr	74,003-353,225
	Efficiency Range	EER	7.88-18.68
	Efficiency	IPLV	17.1
	Delivered Water Temp Range	°F	41-86
	Ambient Temp Range	°F	5-131
Heating	Capacity Range	BTU/hr	52,543-541,382
	Efficiency Range	COP	1.46-7.64
	Delivered Water Temp Range	°F	59-140
	Ambient Temp Range	°F	-22-109.4
CEC Data	Cooling Capacity*/Efficiency	BTU/hr/EER	226,586/8.95
	Heating Capacity**/Efficiency	BTU/hr/COP	274,965/2.43
	Heating Capacity***/Efficiency	BTU/hr/COP	187,254/1.82
Electrical	Power	V/Ph/Hz	460/3/60
Refrigerant	Type		R410A
Fan	Power Input	W	550
	Type		DC
Sound (@3meters)	Range	dBa	54-67
Hydronic	Rated Flow	GPM	52.83
	Max Water Temp	°F	140
	Piping Connections	inch	2.5
	Rated Pressure Drop	PSI (ft W.C.)	10.15 (23.3)
Compressor	Type		INVERTER SCROLL, EVI
	Speed Range	Hz	30-120
Dimensions	Net Dimensions (L x W x H)	inch	85.4×45.3×83.9
	Shipping Dimensions (L x W x H)	inch	86.6×52.2×88.2
	Net Weight/Shipping Weight	lbs.	1,616/1,709

Commercial Cold Climate ATWHP

Ultra Low Ambient Temperature

- Special design for areas with low ambient temperatures
- High-performance heating at outdoor temperatures as low as -20°F

Flexible Installation

- Maximum water outlet temperature 140°F
- Low-temperature heating / Carbon reduction during shoulder seasons

Multi-Use

- Can be widely applied in hotels, hospitals, exhibition centers etc.
- Boiler system back up



Commercial Applications


Decarbonization & Electrification Solution

Widely applicable for heating & cooling in commercial and light commercial applications

- Hotels
- Schools
- Multi-family housing complexes




Switch to R32 Refrigerant

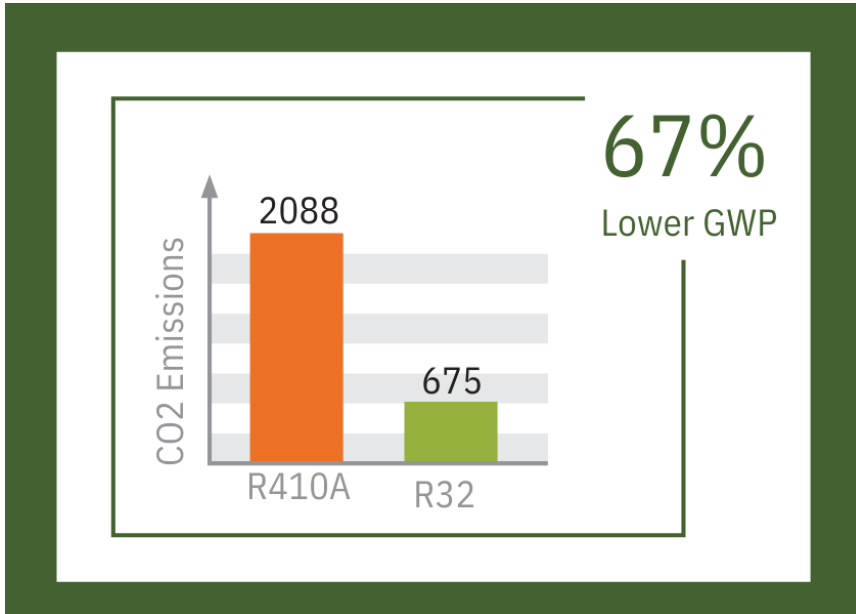

Meets the AIM Act Regulations

- Increased water temperatures
- Increased efficiencies
- Greater capacities in both heating and cooling modes
- Less total overall refrigerant volume

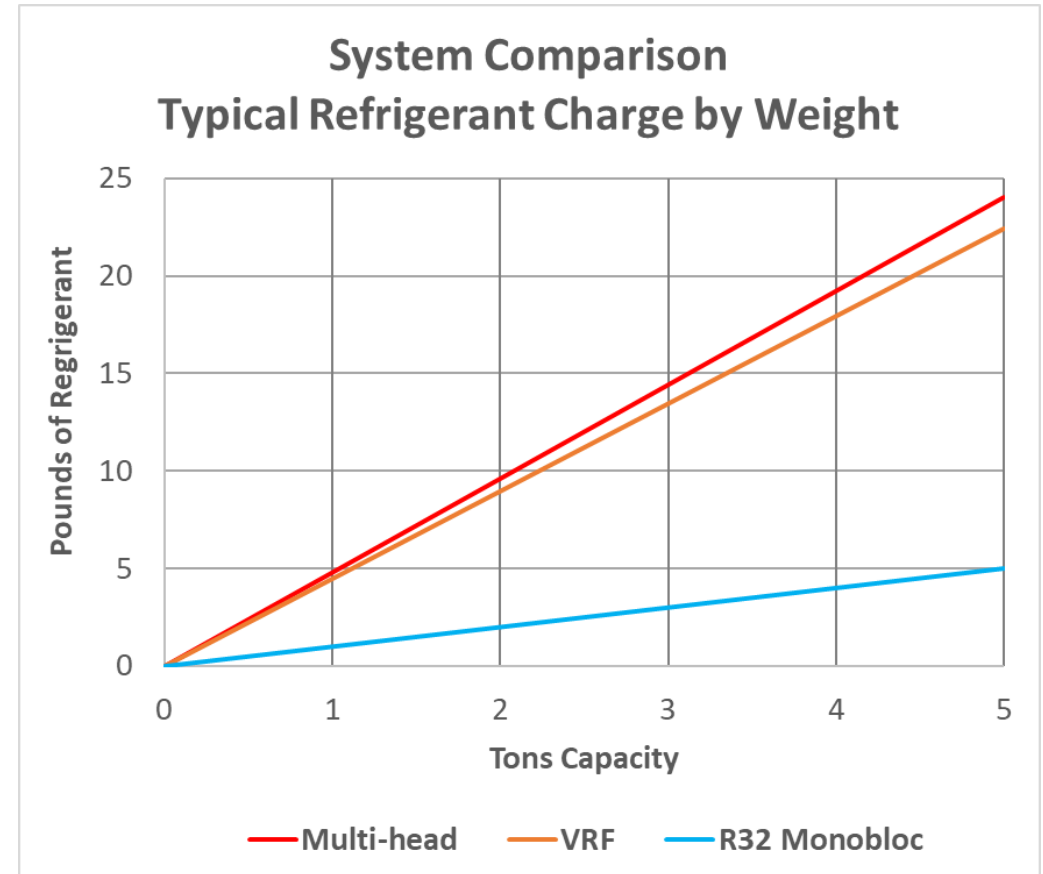

Monobloc = Future-Proof!

NEW

CC32

Solstice R32 Series (CC32)



COLD CLIMATE AIR TO WATER HEAT PUMP

- Available in 3 sizes
- Eco-friendly & future-proof monobloc design
- Heating, cooling, & domestic hot water
- High-performance heating operation down to -22°F (-30°C)
- Reliable water temperatures surpassing 140°F (54°C)
- Zero Ozone Depletion Potential (ODP = 0)
- Low Global Warming Potential (GWP = 675)
- Whisper-quiet operation! (CC32-18 = max 41dBA @ 1meter)

	CC32-18	CC32-40	CC32-60
Cooling Tons	1.5	3	4.3
Nominal BTUs/hr	22,827	41,219	70,461





		Units	CC32-18	CC32-40	CC32-60
Refrigerant	Type		R32		
	Factory Charge	lbs. (kg)	2.43 (1.1)	3.97 (1.8)	4.41 (2)
Fan	Quantity		1	1	2
	Power Input	W	150	170	75 (x2)
	Type		DC		
	Max Speed	RPM	600		
Sound (@1meters)	Maximum	dBA	41	43	46
Hydronic	Rated Flow	GPM	4.4	7.5	12.8
	Max Water Temp	°F (°C)	140 (60)		
	Piping Connections	inch (cm)	1 (2.54)		
	Rated Pressure Drop	PSI (ft W.C.)	2.9 (6.7)	4.4 (10.2)	6.5 (15)
Compressor	Type		Rotary		
	Speed Range	Hz	30-90		
	Brand		Panasonic		
	Quantity		1		
Dimensions	Net Dimensions (L x W x H)	inch (cm)	46 x 16 x 32 (117 x 41 x 80)	51 x 18 x 37 (129 x 46 x 93)	50 x 22 x 53 (125 x 54 x 133)
	Shipping Dimensions (L x W x H)	inch (cm)	54 x 22 x 39 (138 x 56 x 100)	59 x 24 x 46 (150 x 61 x 117)	58 x 26 x 60 (148 x 67 x 153)
	Net Weight	lbs. (kg)	200 (90)	292 (132)	459 (208)
	Shipping Weight	lbs. (kg)	304 (138)	391 (178)	535 (243)



		Units	CC32-18	CC32-40	CC32-60
Cooling	Capacity Range	BTU/hr (kW)	8,400 - 22,800 (2.5 - 6.7)	15,600 - 39,600 (4.6 - 11.6)	21,600 - 57,600 (6.3 - 16.9)
	Efficiency Range	EER	8.12 - 8.67	6.82 - 8.98	7.77 - 8.99
	Efficiency	IPLV	16.81	16.75	14.46
	Delivered Water Temp Range	°F (°C)	41 - 77 (5 - 25)		
	Ambient Temp Range	°F (°C)	50 - 109 (10 - 43)		
Heating	Capacity Range	BTU/hr (kW)	3,600 - 23,000 (1.1 - 6.7)	8,000 - 42,000 (2.3 - 12.3)	12,000 - 72,000 (3.5 - 21.1)
	Efficiency Range	COP	0.95 - 8.64	0.99 - 9.09	0.98 - 9
	Delivered Water Temp Range	°F (°C)	95-140		
	Ambient Temp Range	°F (°C)	-22 -110		
CEC Data	Cooling Capacity*	BTU/hr (kW)	17,183	35,120	52,001
	Cooling Efficiency*	EER	10.43	9.9	8.85
	Heating Capacity**	BTU/hr (kW)	18,919	35,424	62,760
	Heating Efficiency**	COP	3.07	2.9	3.13
	Heating Capacity***	BTU/hr (kW)	10,189	26,222	42,700
	Heating Efficiency***	COP	1.52	2.23	2.06
Electrical	Power	V/Ph/Hz	208-230/1/60		
	Fan Motor	A	0.8		2 x 0.8
	Compressor Motor	A	12.2	21	33.5
	MCA	A	17	28	44
	MOPD	A	25	45	70
	SCCR	kA	5kA		


CEC is the California Energy Commission. Data is tested in accordance with AHRI 550/590

*= 44°F LWT 54°F EWT @3.75 at CC32-18/6.17 at CC32-40/11.45 at CC32-60 GPM & 95°F DB Ambient

**= 120°F LWT 107°F EWT @4.4 at CC32-18/7.5 at CC32-40/12.8 at CC32-60 GPM & 47°F DB Ambient


***=120°F LWT 110°F EWT @4.4 at CC32-18/7.5 at CC32-40/12.8 at CC32-60 GPM & 17°F DB Ambient

Basic Wiring

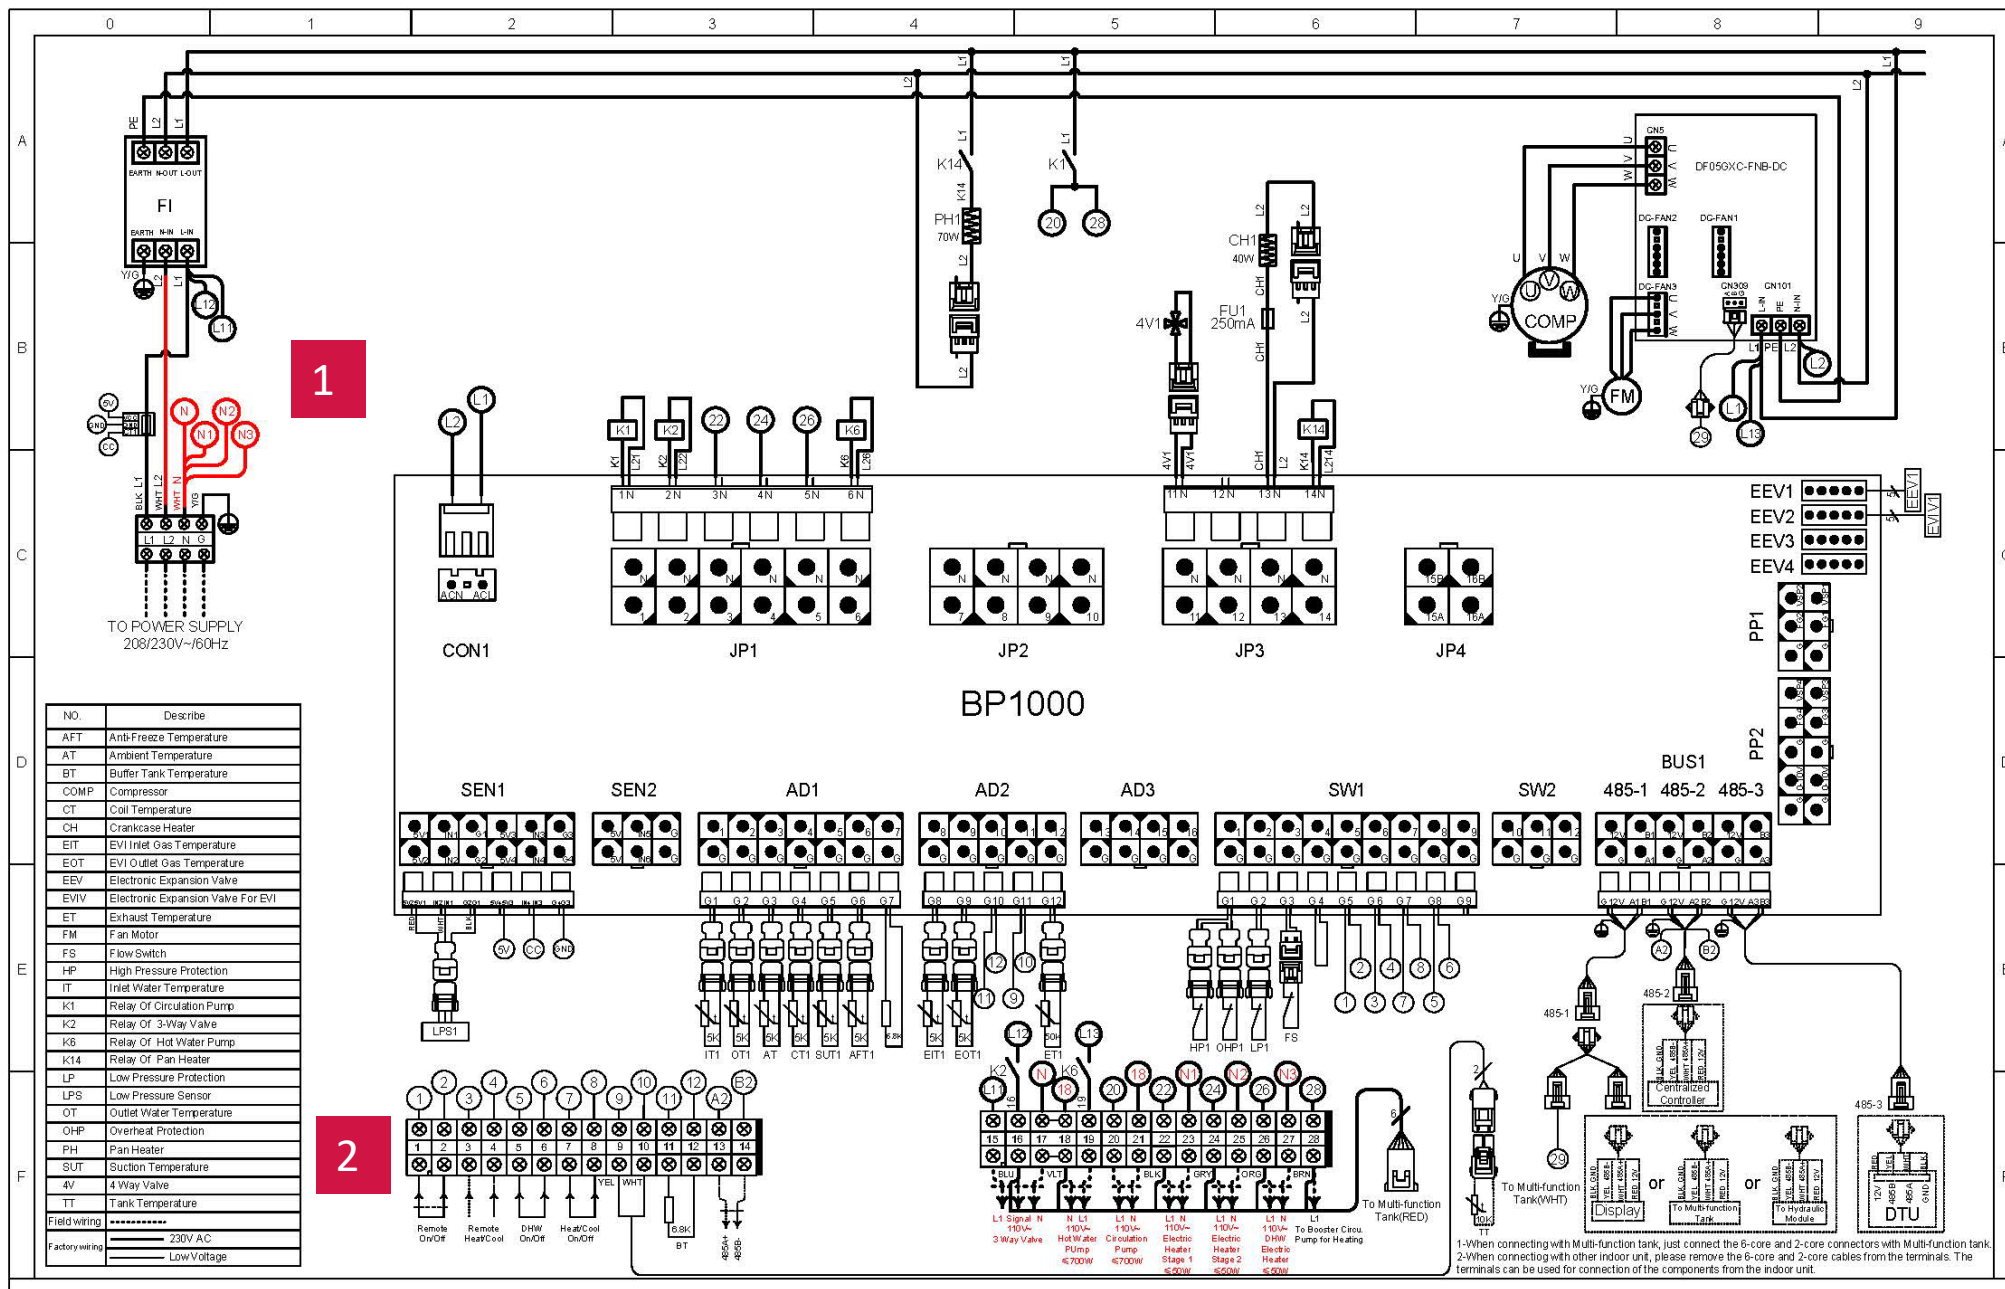

Basic Wiring

2

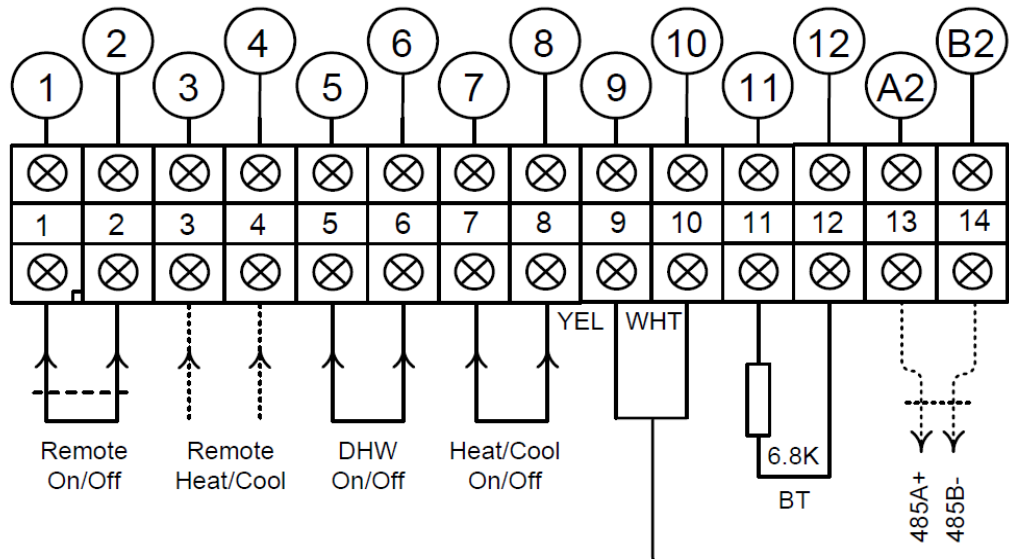


CAUTION

The remote On/Off, Remote Heat/Cool, Heat/Cool On/Off, and DHW Enable inputs are for voltage-free relay contacts only. Any voltage introduced to the controls at these points will immediately destroy the primary unit control.

No Voltage control wiring


1

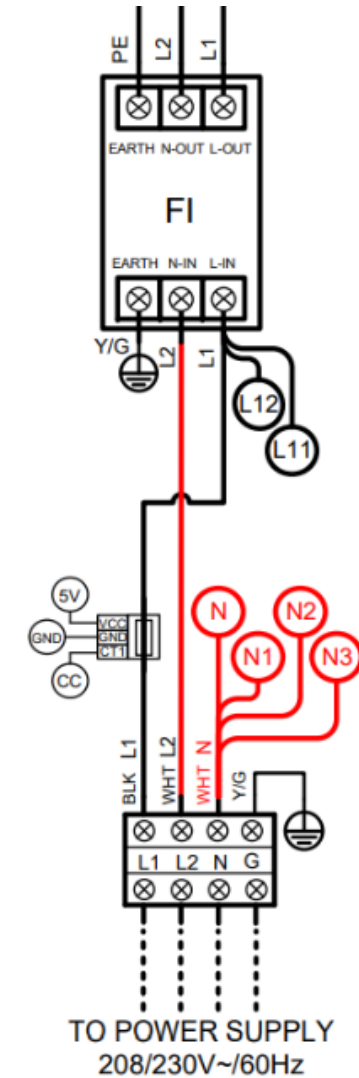

High Voltage control wiring

Note: 208volt


CC32 Monobloc Touch Screen Display Wiring Layout

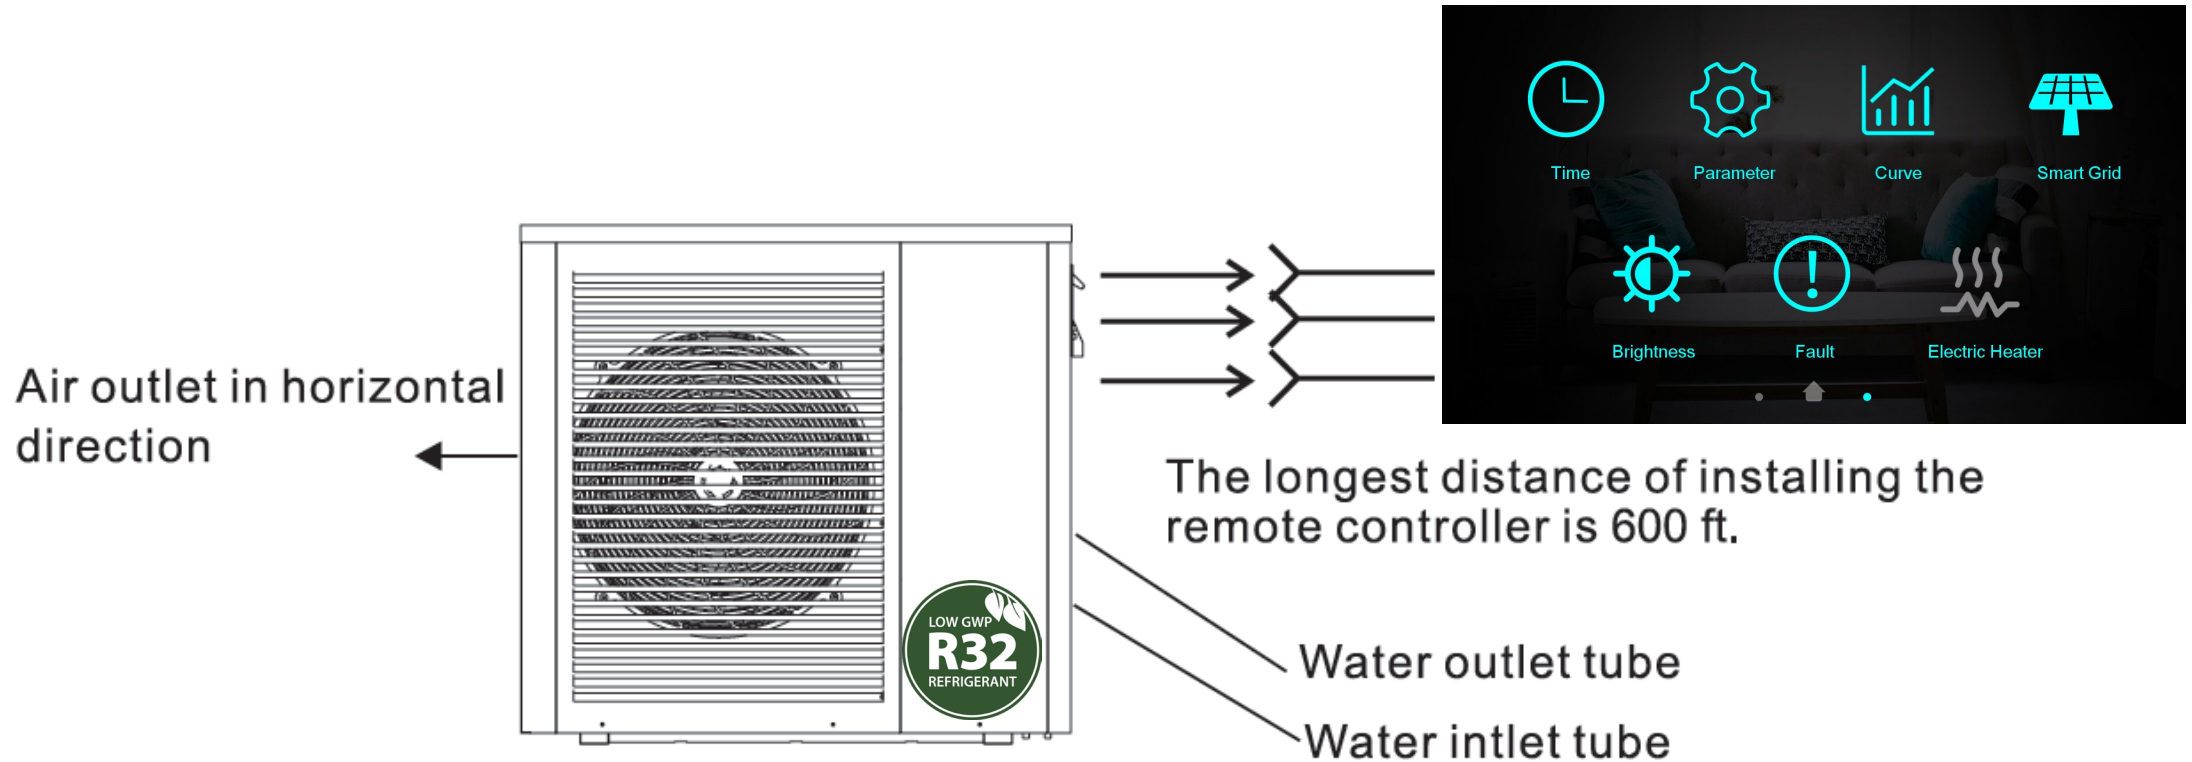


NOTE: A 65-foot 5 conductor shielded wire is supplied with the unit. In cases of longer runs, field supplied shielded wire can be used. However, the factory supplied Molex connectors will have to be attached at either end for proper installation.

CC32-18 Heating Performance @ 120°F Water

Heating Capacity, BTU/hr

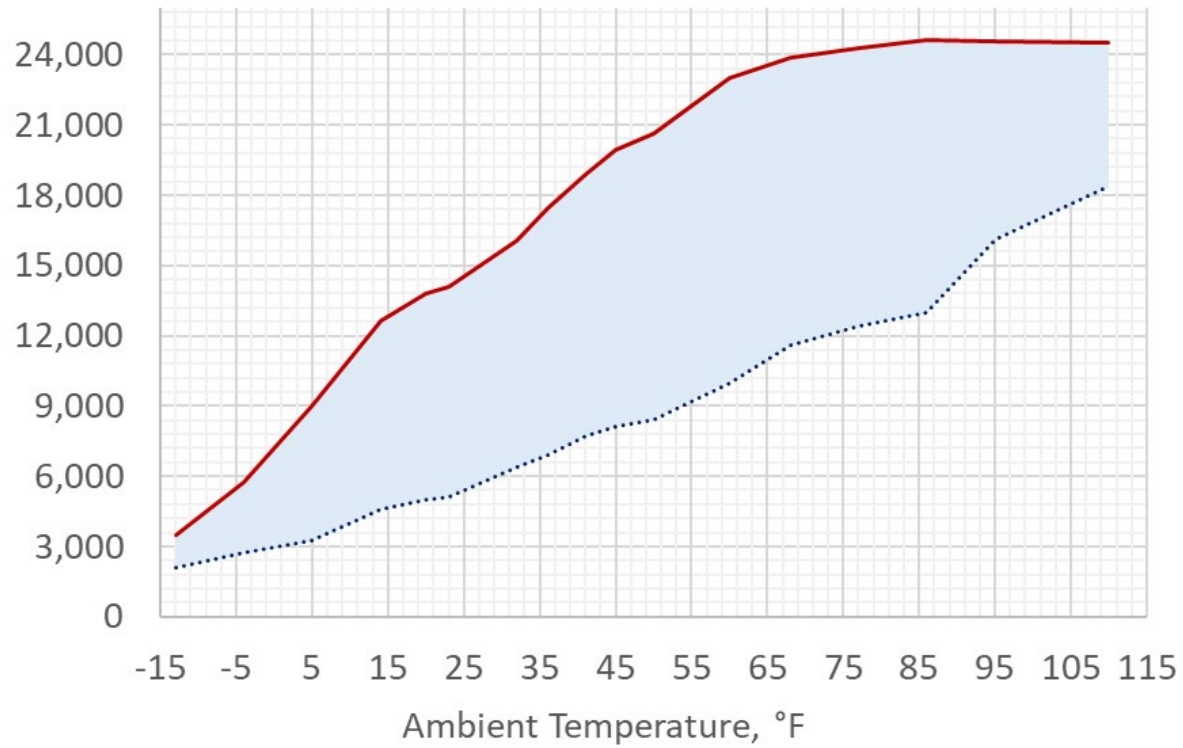


Heating Efficiency, COP

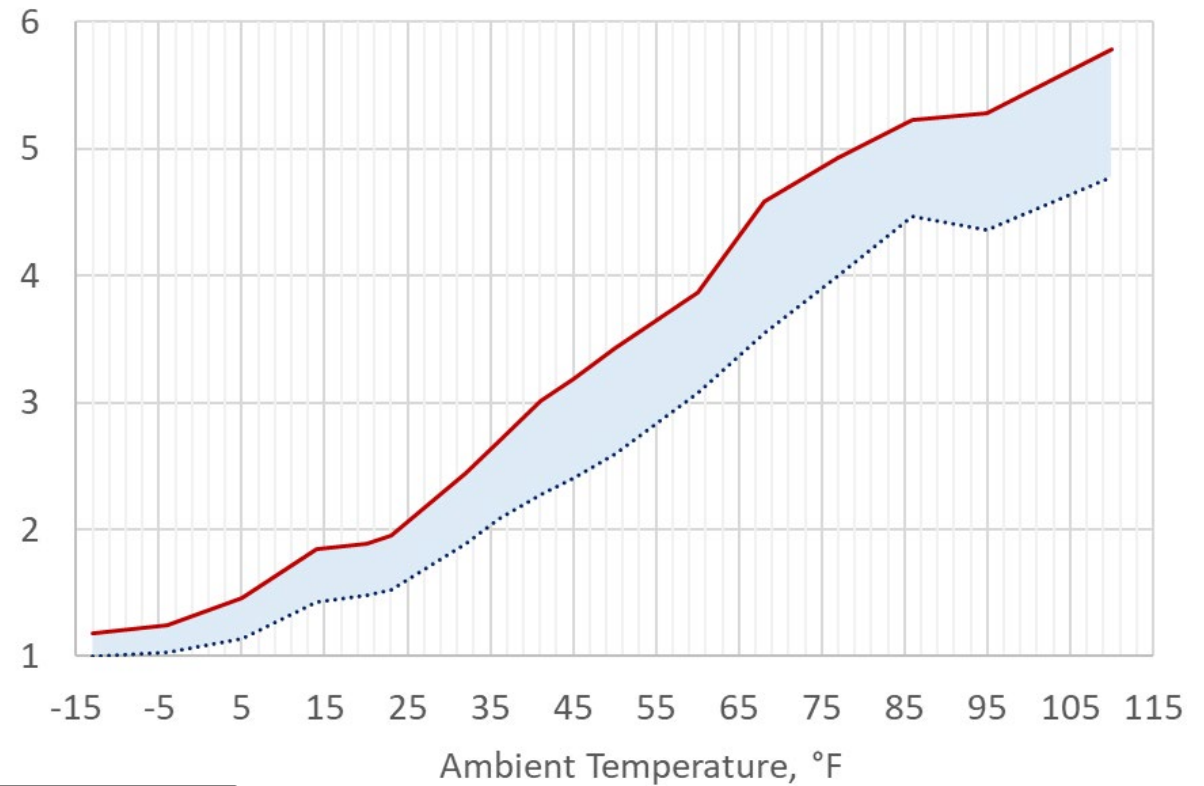


..... Minimum — Maximum

CC32-18 Cooling Performance @ 45°F Water

CC32-18, 45°F Delivered Water Temperature, BTU/hr,
Cooling

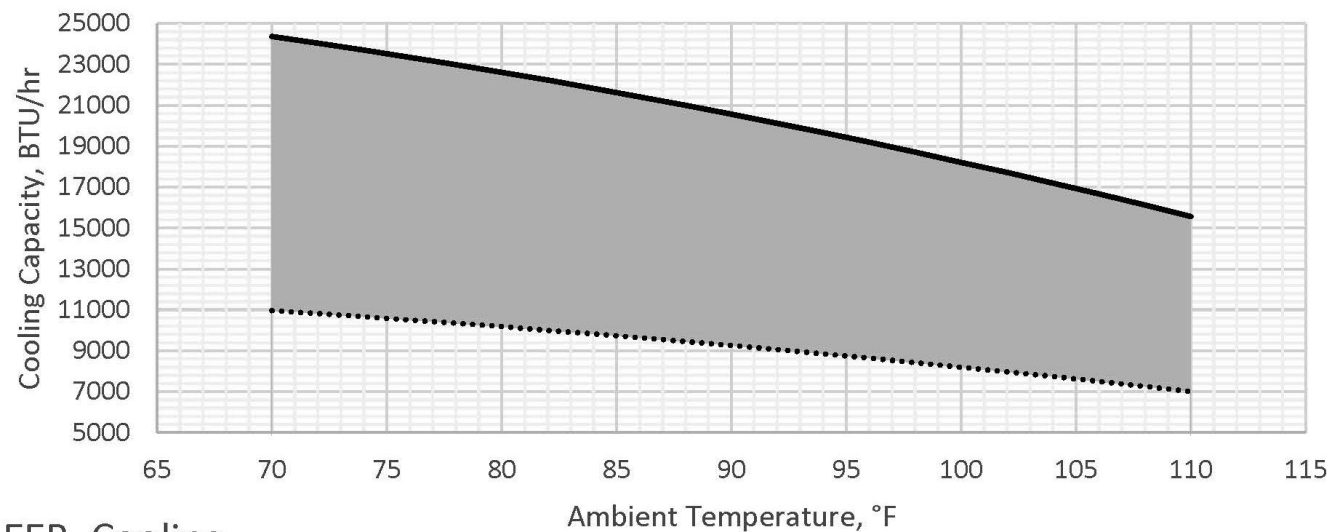


CC32-18, 45°F Delivered Water Temperature, EER, Cooling

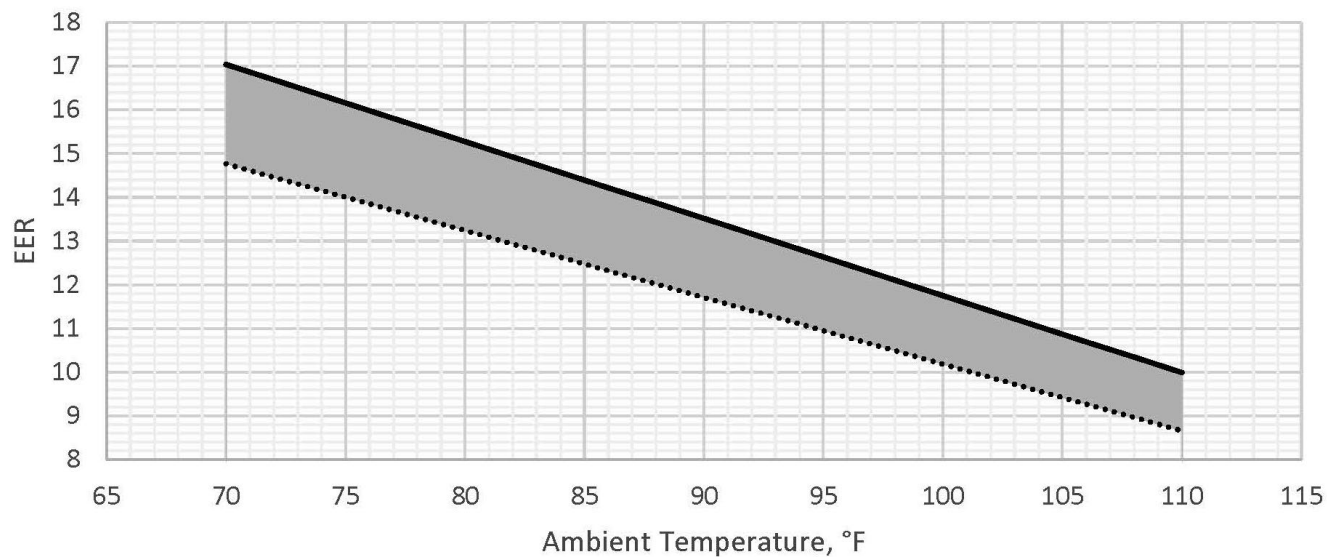


CC32-40 Heating Performance @ 120°F Water

Heating Capacity, BTU/hr

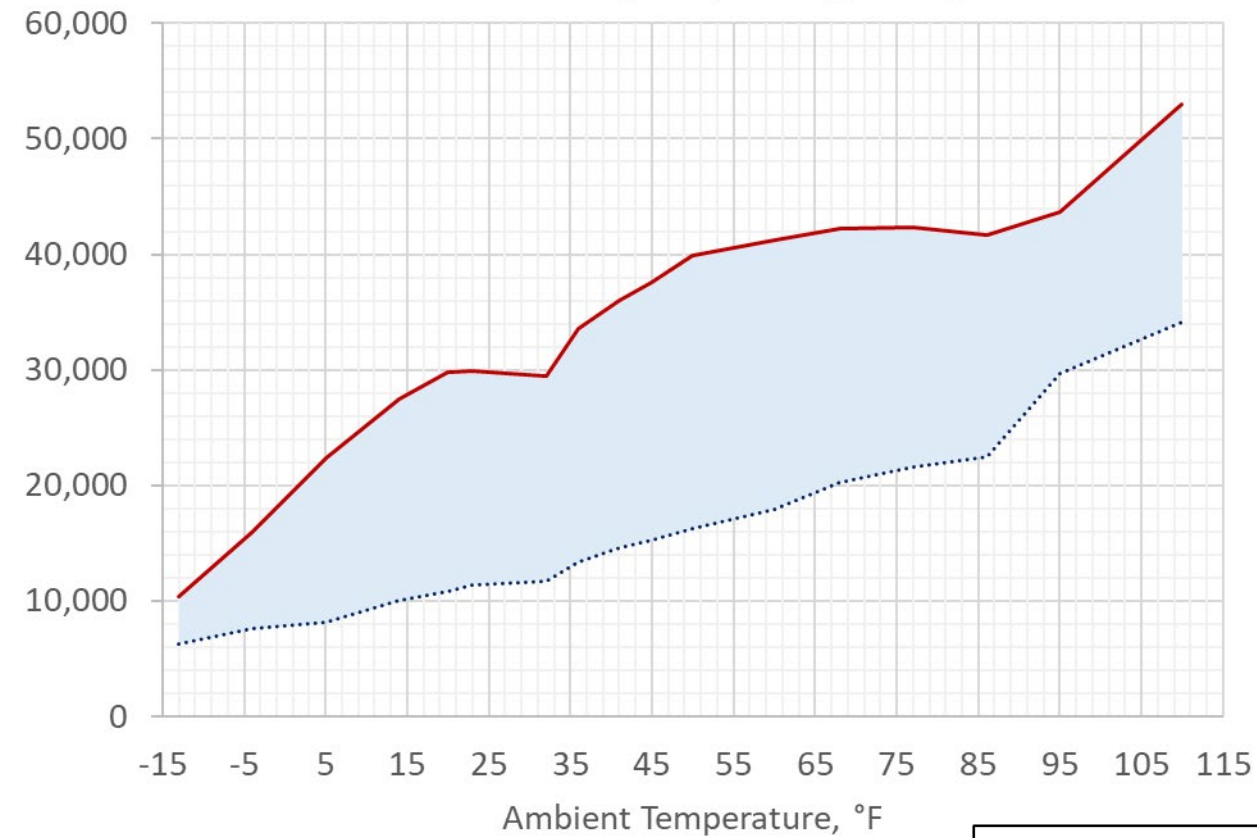

Heating Efficiency, COP

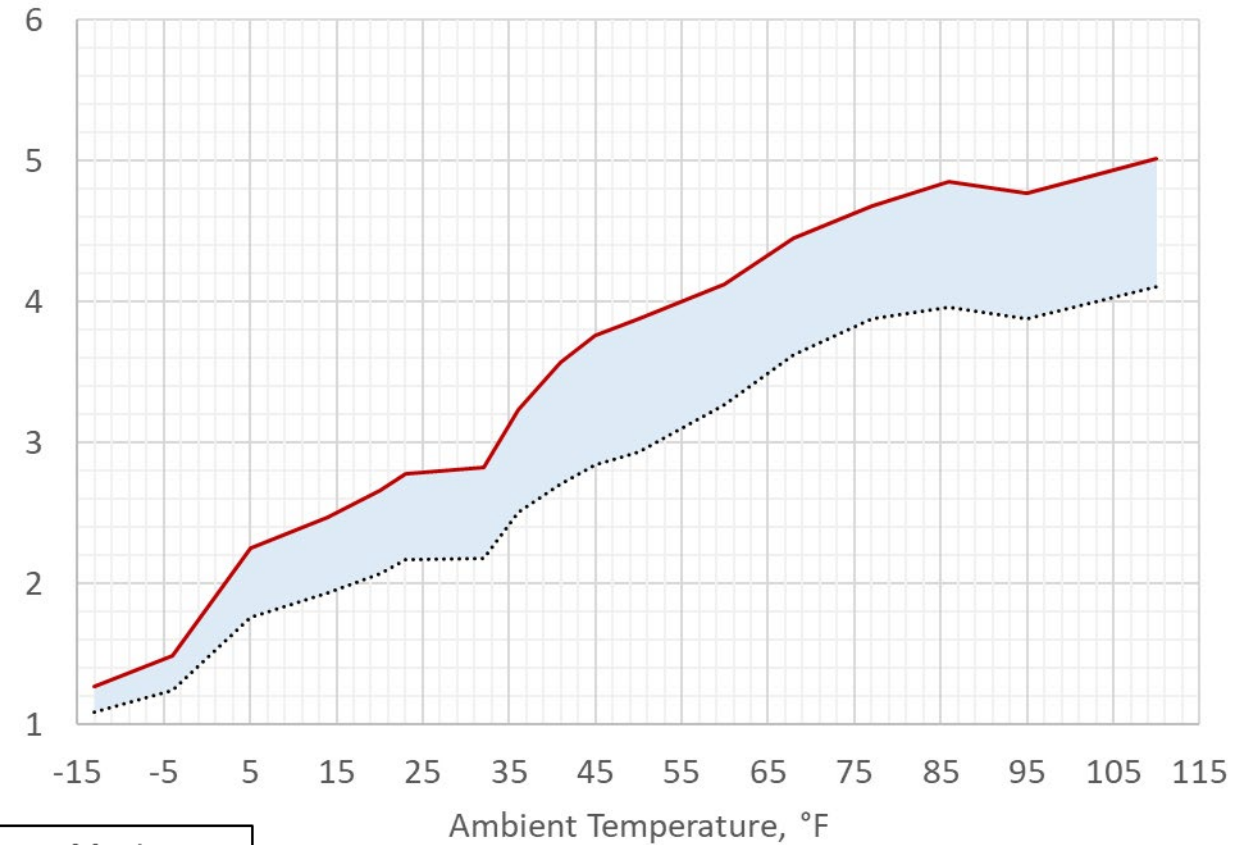


..... Minimum — Maximum

CC32


CC32-40 Cooling Performance @ 45°F Water



CC32-40, 45°F Delivered Water Temperature, BTU/hr, Cooling

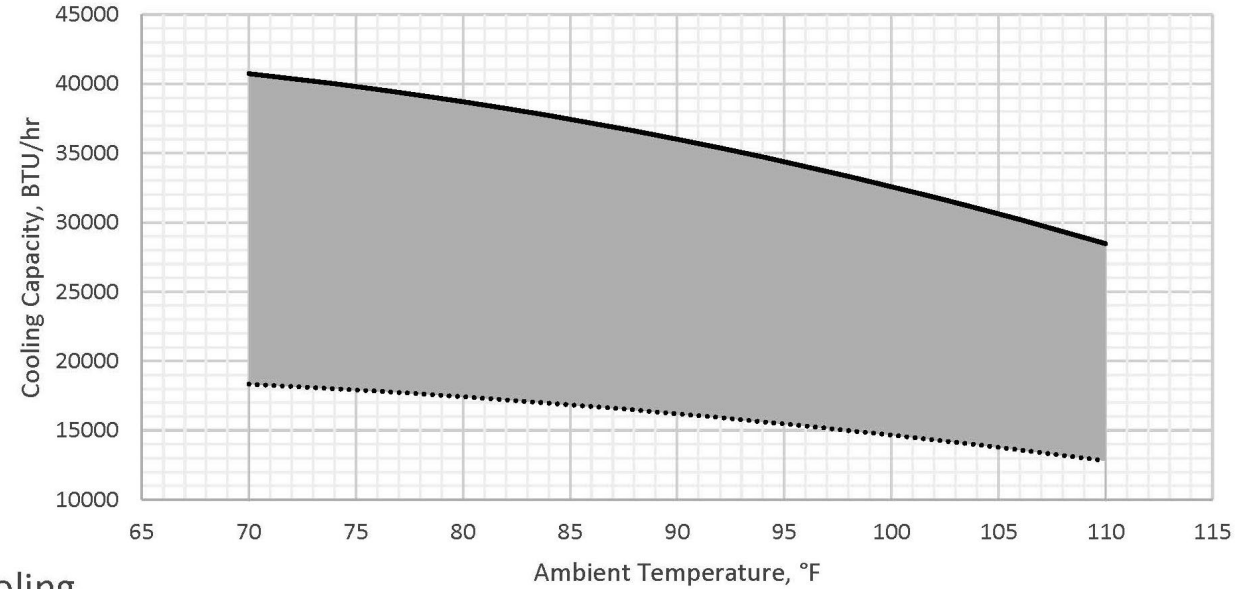


CC32-40, 45°F Delivered Water Temperature, EER, Cooling

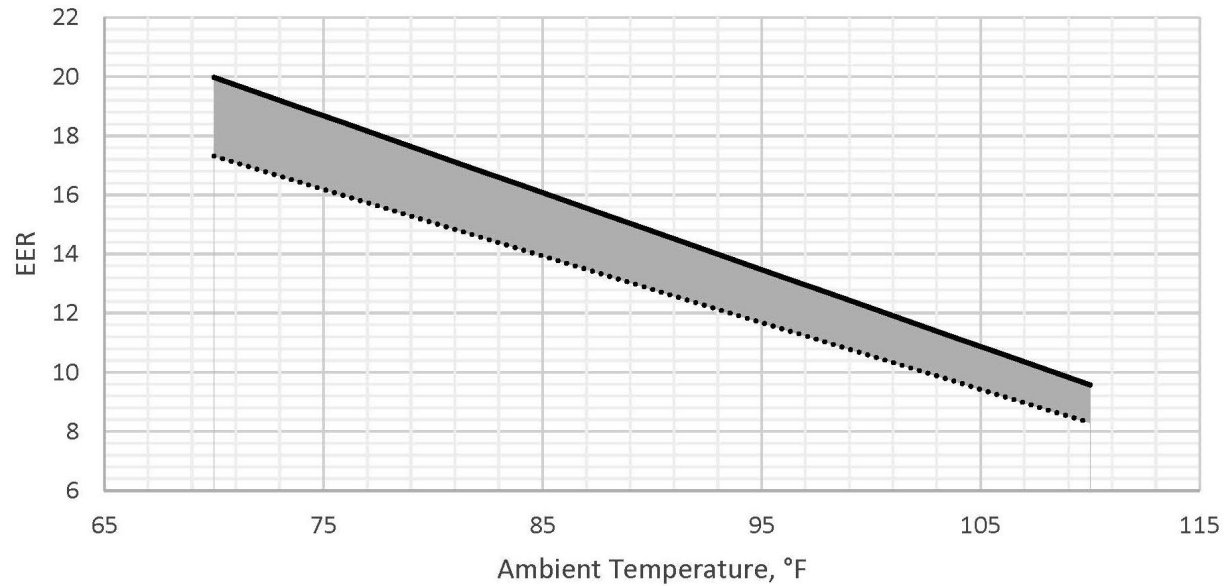


CC32-60 Heating Performance @ 120°F Water

Heating Capacity, BTU/hr

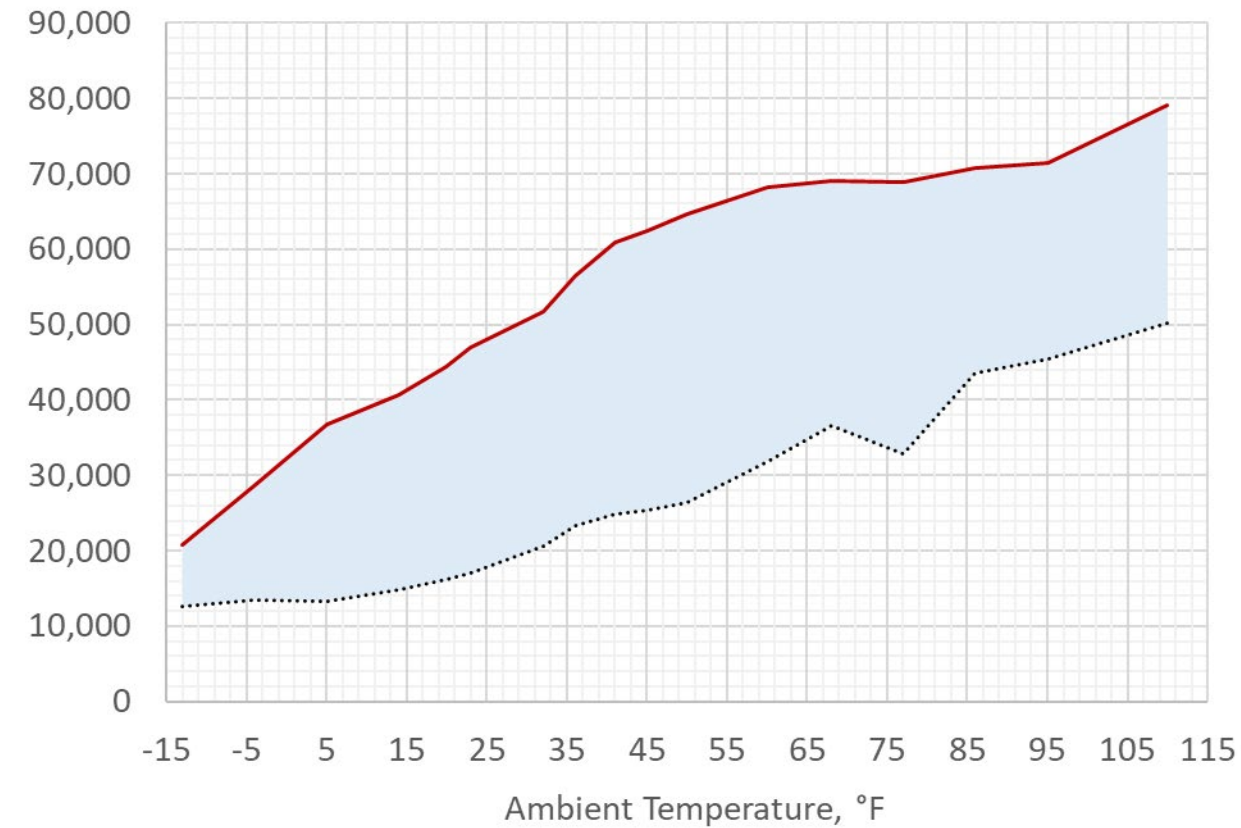

Heating Efficiency, COP

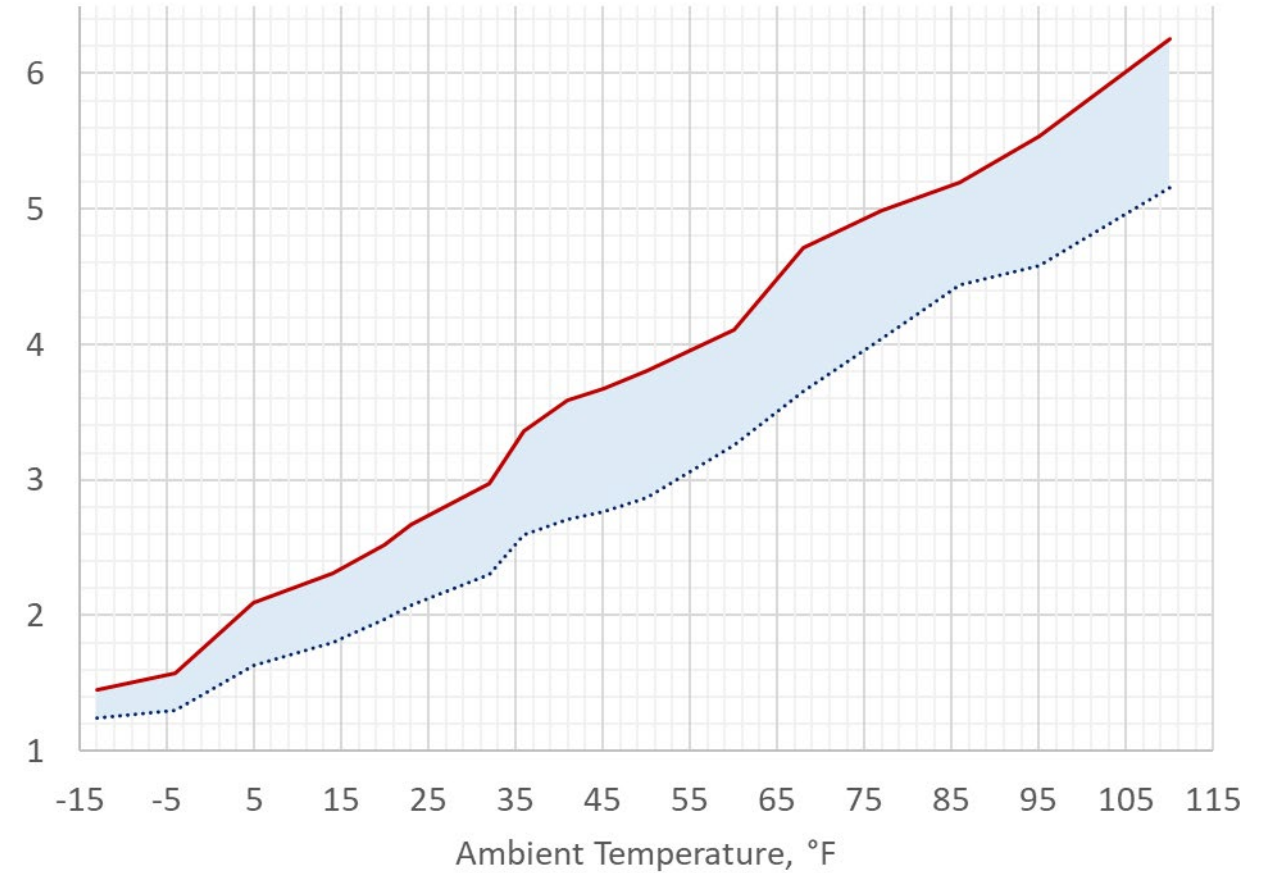


..... Minimum — Maximum

CC32


CC32-60 Cooling Performance @ 45°F Water



CC32-60, 45°F Delivered Water Temperature, BTU/hr, Cooling

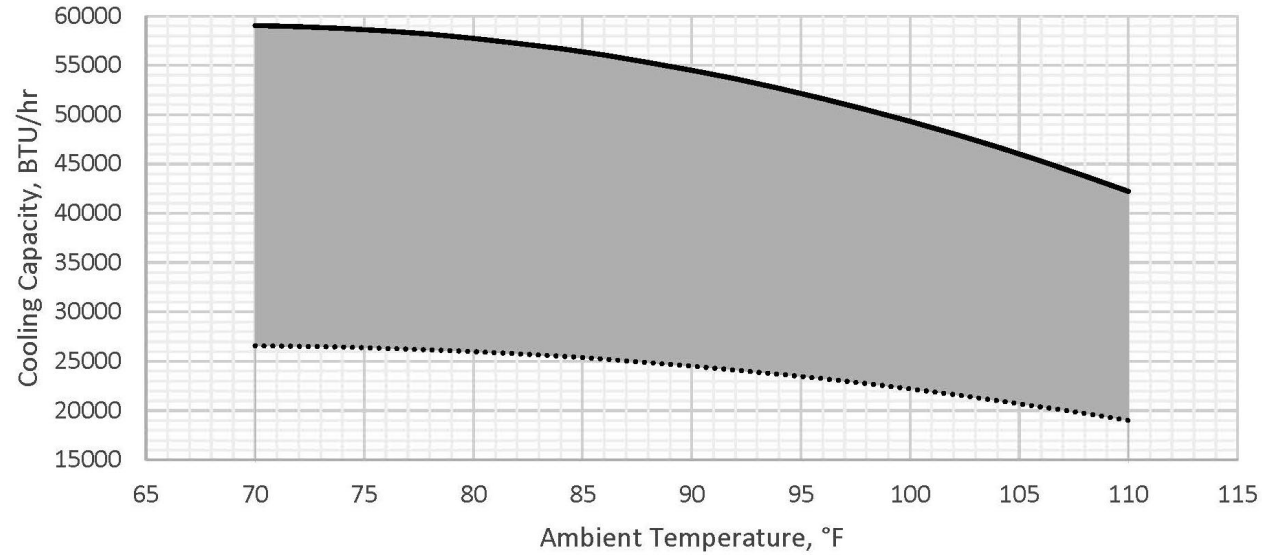


CC32-60, 45°F Delivered Water Temperature, EER, Cooling

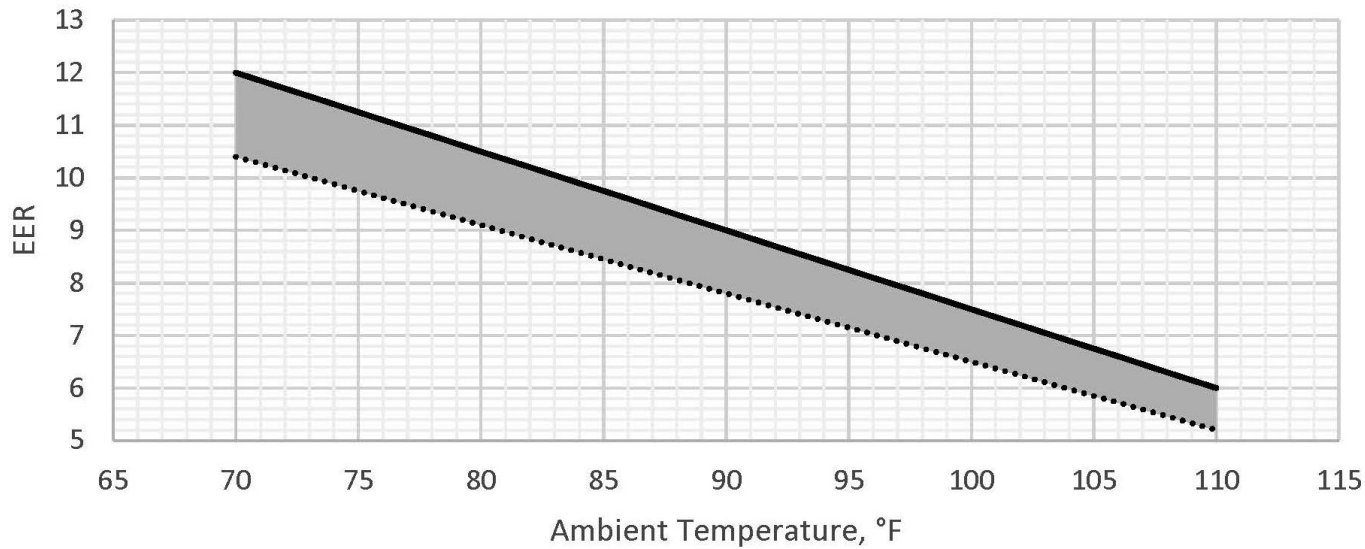





WarmLink App for Remote Monitoring, System Management & Support

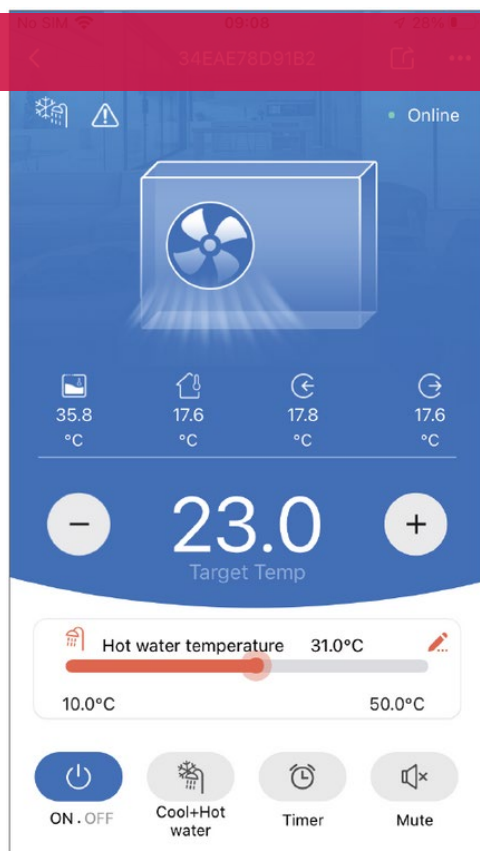


System Monitoring

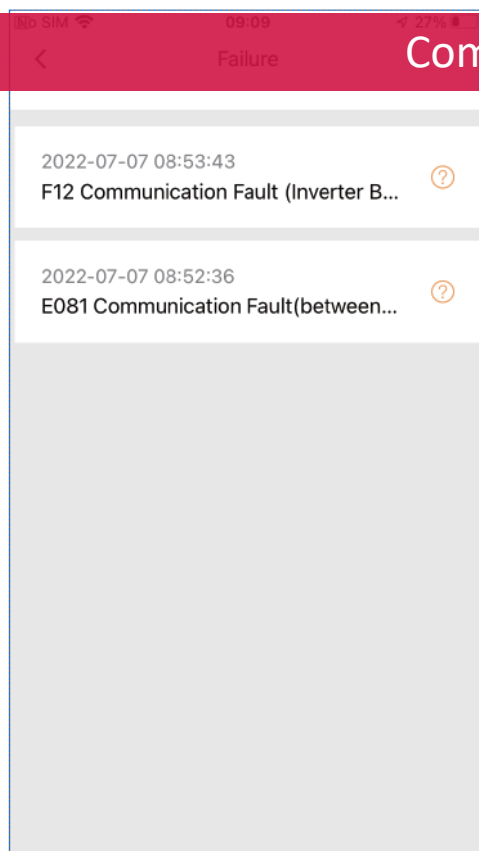

Fault Logging

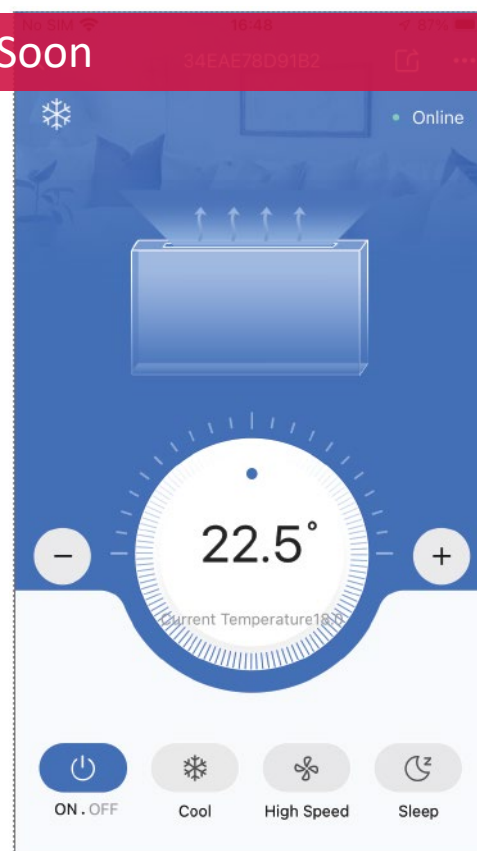

Device Management

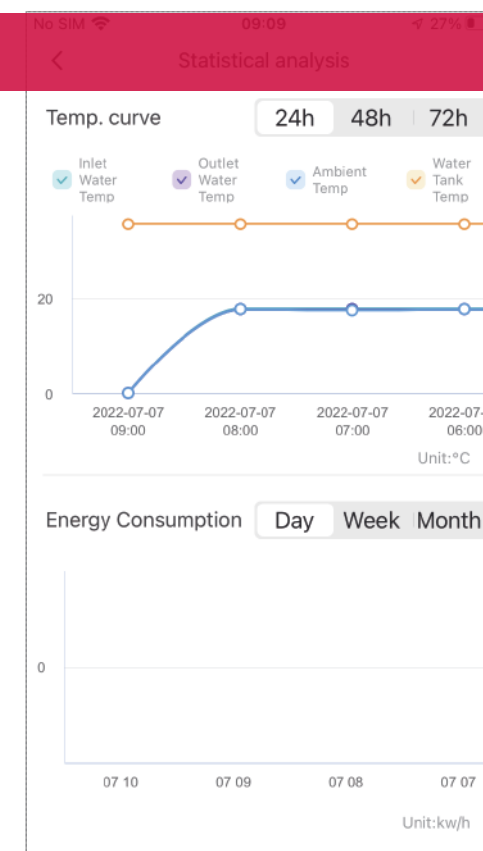

Temperature Curve Data

Washington State





High-Temperature Cold Climate Air to Water Heat Pump

We're Ready for the Future of R290 and Its Expanded Potential

R290 (propane) is globally recognized as an eco-friendly, natural refrigerant alternative that is ideal for self-contained refrigeration as well outdoor systems such as air to water monobloc heat pumps.

R290 shows great promise as a sustainable, safe, convenient, and cost-effective retrofit solution for decarbonizing the large number of homes heated by oil and gas boilers

Current International Standards already allow for the safe use of A3 refrigerants in similar outdoor equipment. The harmonization process of U.S. safety standards with these international standards and codes is already underway - and **hopefully** will forward through the approval process.



GWP = 3

ODP = 0



- R290 Charge = .85kg /1.87lb
- Delivered water temperatures up to 167°F
- Heating – Cooling – DHW
- Allows for direct replacement of Oil and Gas fired boilers
- Enviro-Safe Monobloc Design



SpacePak teased our future R290 unit at AHR Expo in January 2024!

The R290 Roadmap

- ASHRAE has issued a proposed addendum to increase the charge size of A3 refrigerants to **4.9kg (10.9 lbs)** in outdoor indirect systems (such as air-to-water monoblocs).
- This aims to mimic the allowed limits set by international standards and codes already in place globally.
- The ASHRAE committee has dedicated a working group set to do computational fluid dynamics and verification testing.
- If the ASHRAE proposal is approved – it would also require endorsements by UL and the EPA.



Source, March 2024: <https://naturalrefrigerants.com/ashrae-committee-chair-expects-2025-or-later-for-approval-of-higher-r290-charge-for-heat-pumps-in-u-s/>




—
Questions?

RETURN FROM TERMINAL UNIT(S)

SU

Emitters

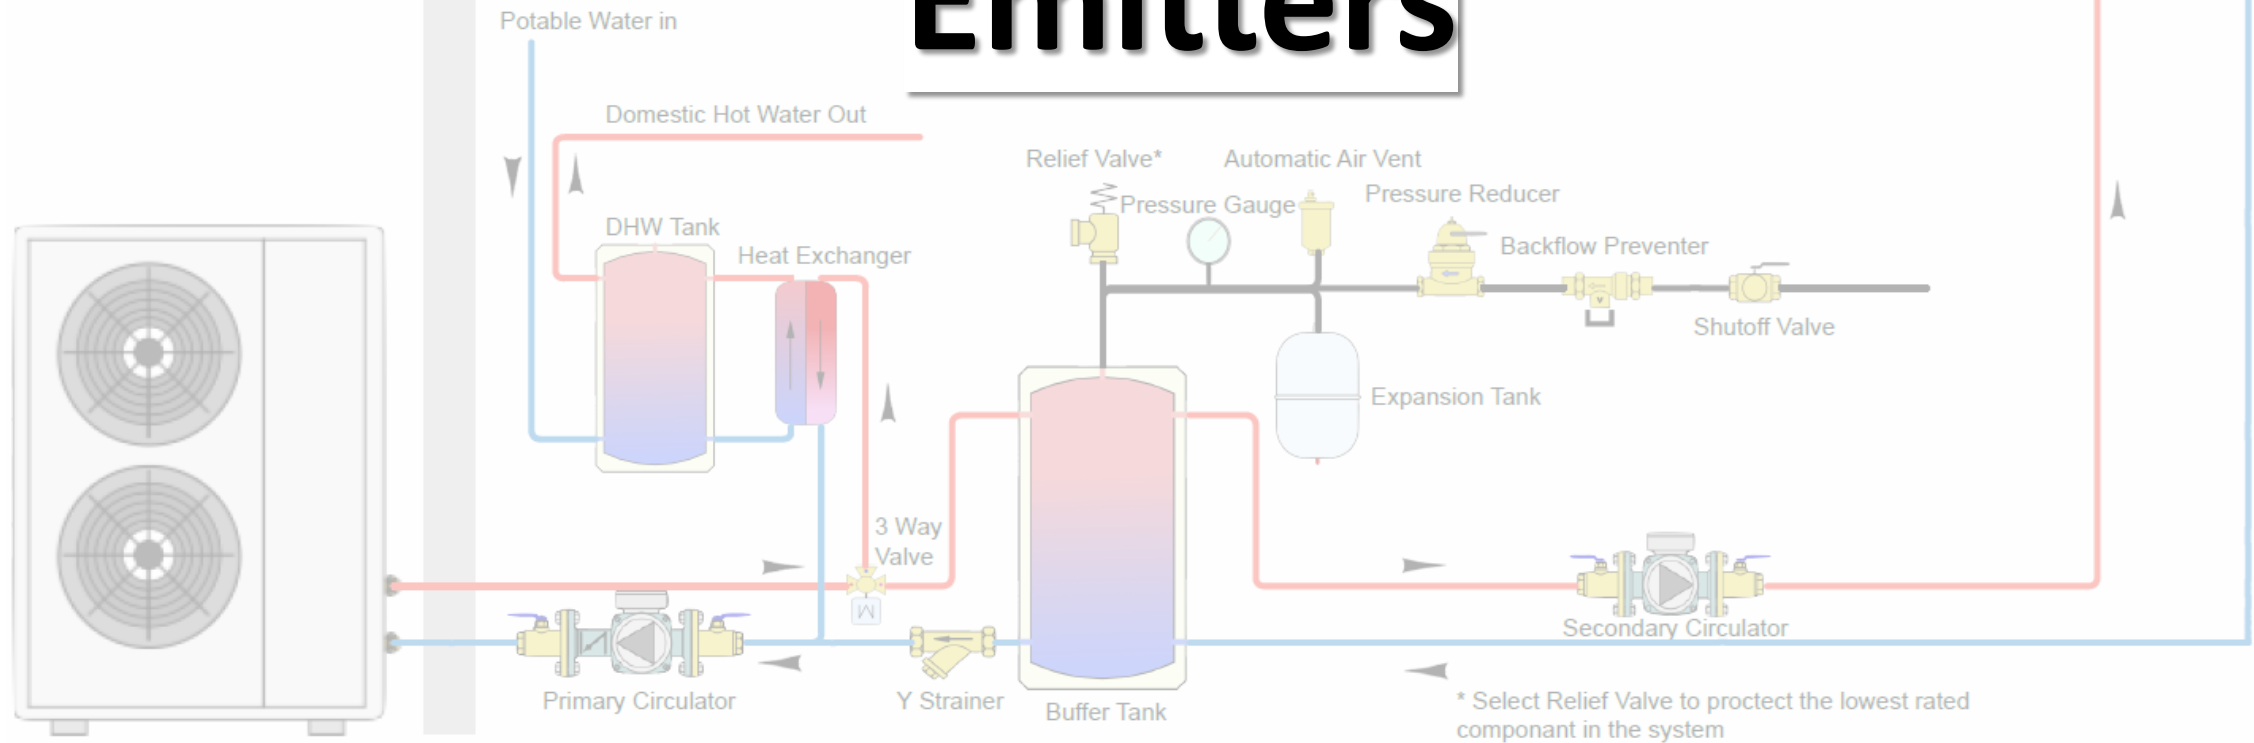



Additional Equipment

SSIC Integrated Heat Pump Control Platform


Hydronic Fan Coils

- HighWall
- ThinWall
- SDHV Air Handler

SS Buffer Tanks w Built-In Electric Backup

*Hybrid Domestic Hot Water Indirect Tank**

Distribution Example

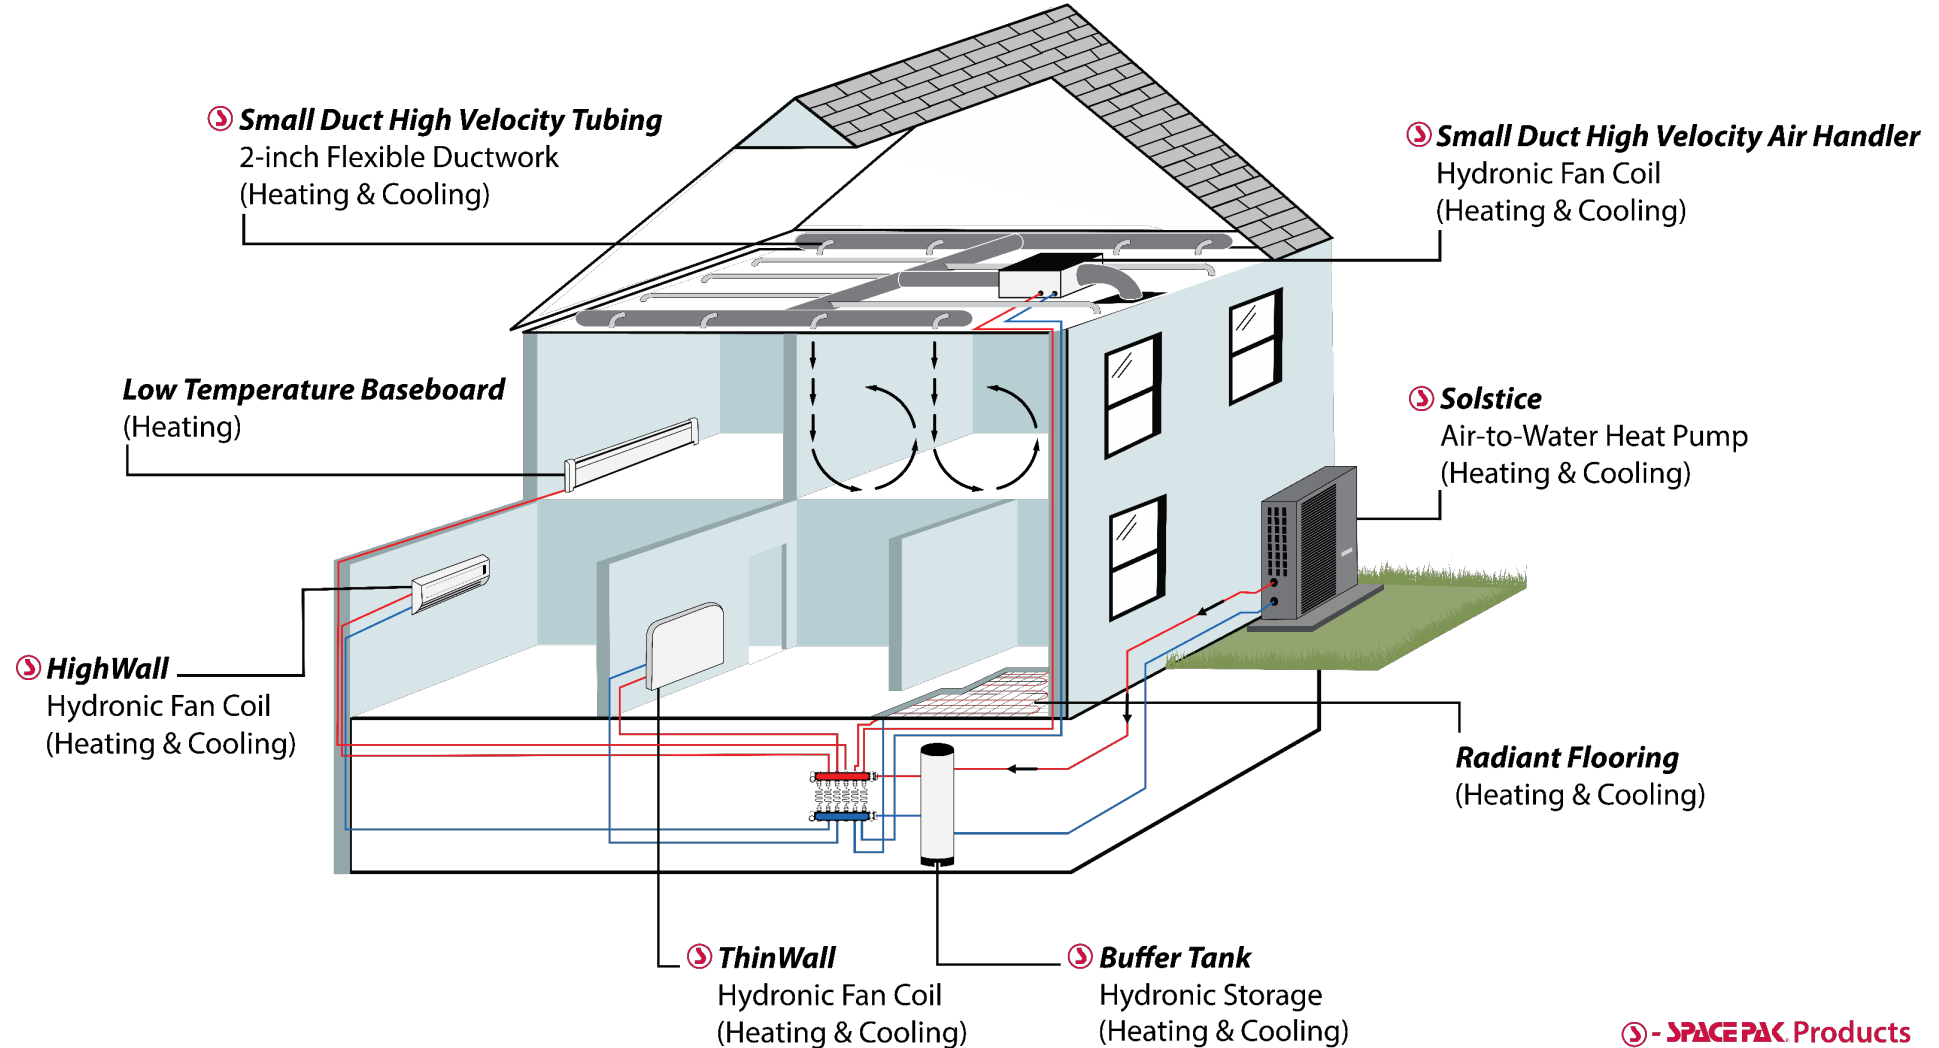

⑤ - **SPACEPAK** Products


Small Ducted Hydronic Air Handler (WCSP)

Heating & Cooling

- J+ Advanced Control with digital display
- High Efficiency EC Integrated Motor/Blower Assembly
- 230V Standard Configuration Optional 115V Conversion
- 6-Row Copper/Aluminum Evaporator Coil
- Industry Leading Corrosion Resistant Cabinet
- Primary Drain Pan w/Integrated Float Switch
- Anti-Vibration Foam Strips
- Condensate Trap
- Slide out Blower
- 24 V 50/60hz Transformer
- Sweat-Type Connections




Air Handler Location within the Small Duct High Velocity system

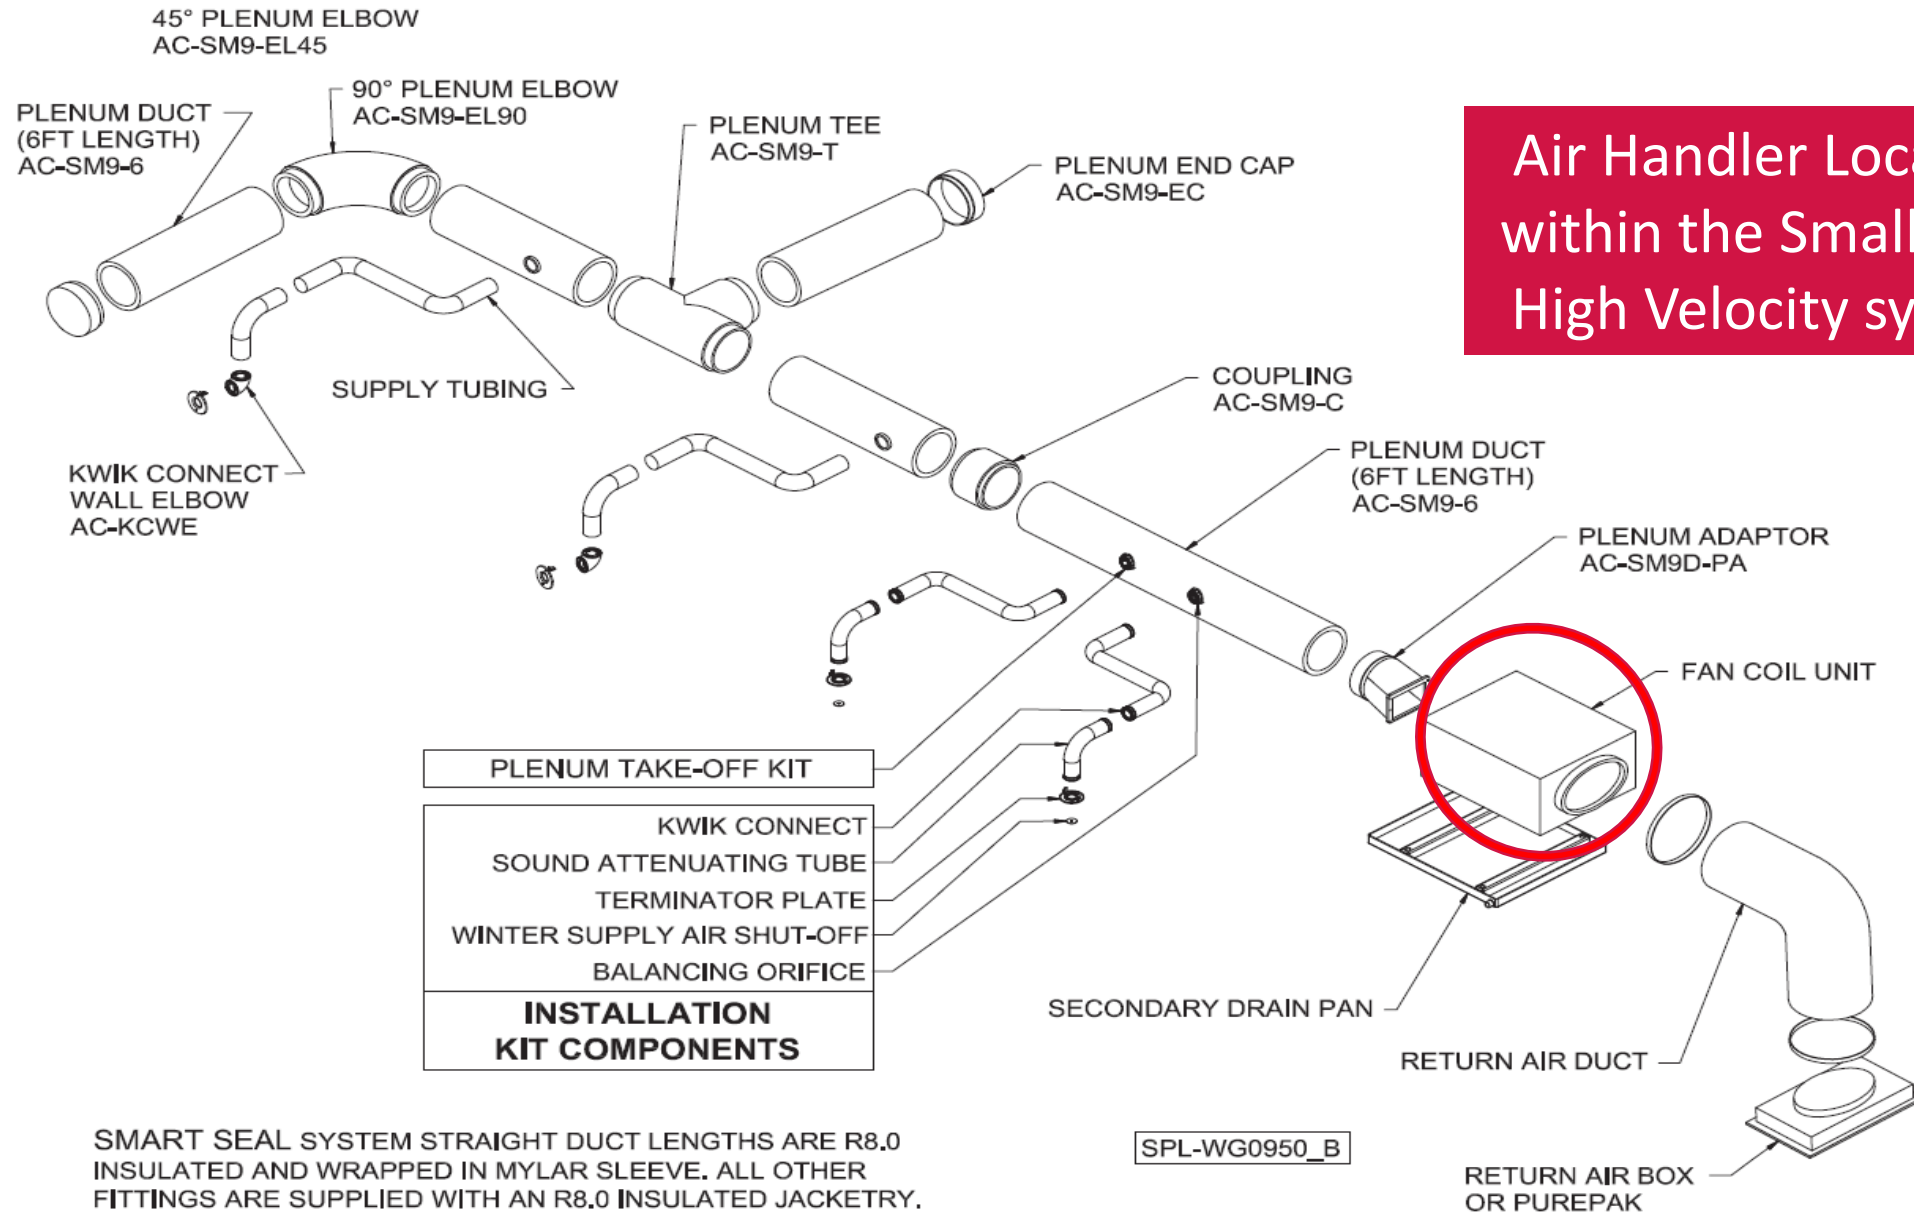

J Plus Control Board

- More features and benefits for the contractor
- Digital display screen
- Screen displays (operating mode, cfm, %speed, S.P.)
- Speed is controlled by a static pressure tap on the blower
- Simpler wiring with less components
- Infinite speed variation
- Easy load matching
- Temperature sensors allow for delayed fan operation
- IAQ FRIENDLY!!!!!!

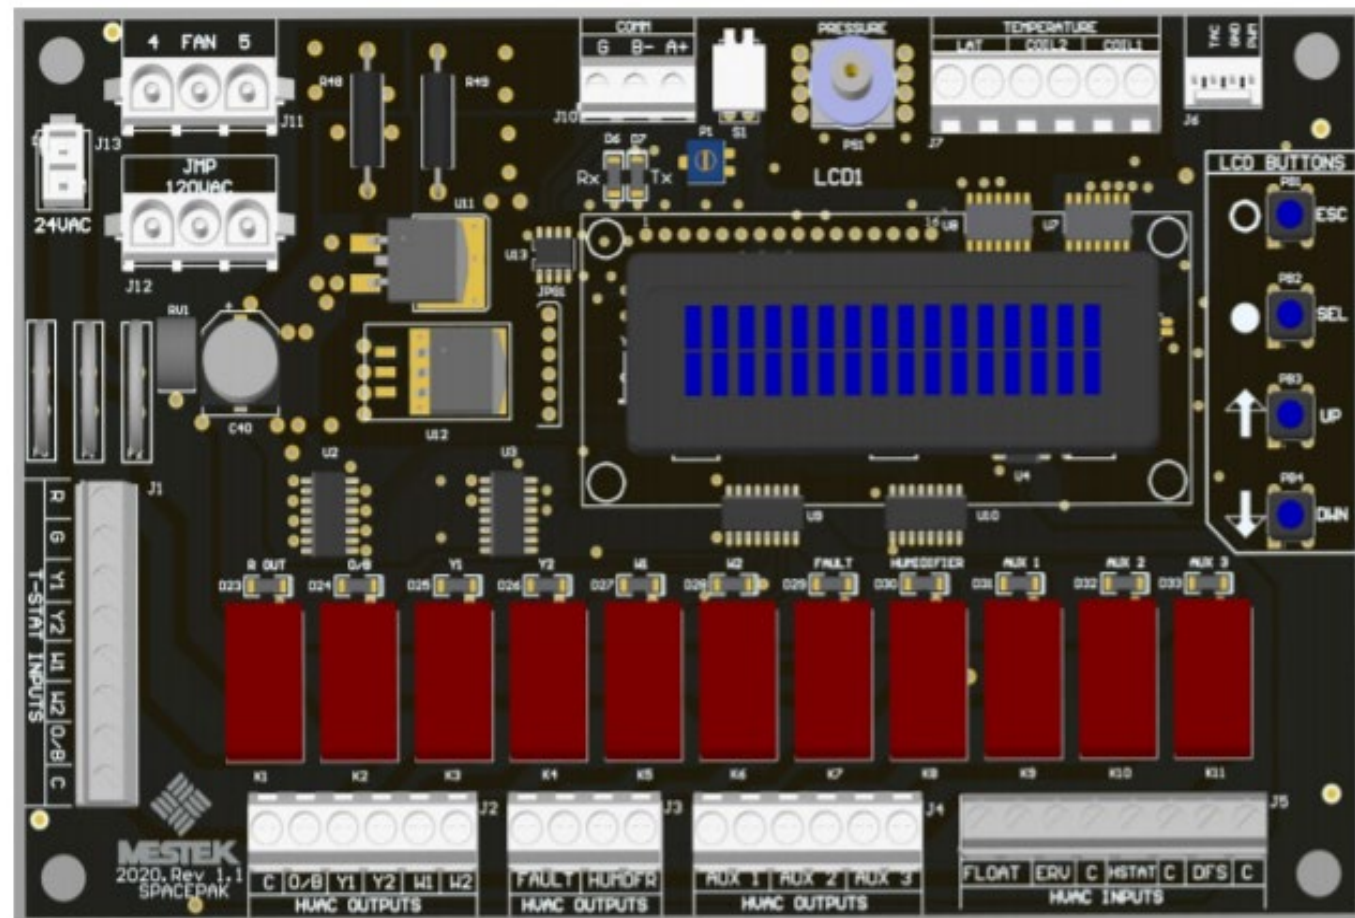

WCSP Specifications




Model	Nominal System Capacity		Std. CFM @ 1.2" W.C.	F.L. Amps (115V/230V)	Motor HP	Connections (CTS)	
	Nom. Tons	Cool MBH*				Water In Line	Water Out Line
WCSP-2430J/V	2	24	440	5.6/2.8	3/4	7/8"	7/8"
	2-1/2	30	550				
WCSP-3642J/V	3	36	660	7.6/4	3/4	7/8"	7/8"
	3-1/2	42	850				
WCSP-4860J/V	4	48	880	10.6/5.4	3/4	7/8"	7/8"
	5	60	1150				


* Capacities based on 45°F entering water temperature at 5 G.P.M.

WCSP Capacity/Pressure Drop


Hydronic Coil Pressure Drop Characteristics

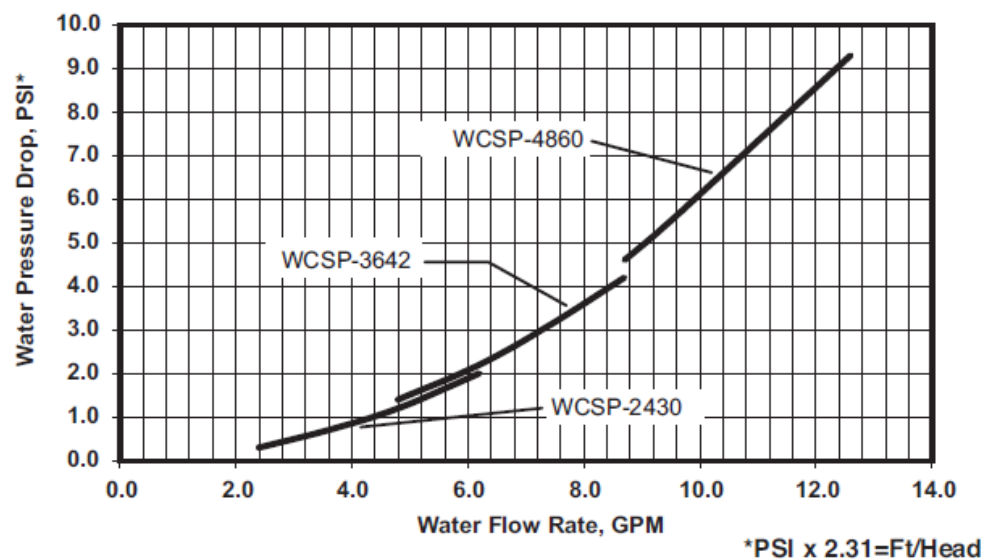


WCSP-2430 @ 550 cfm Cooling Capacity

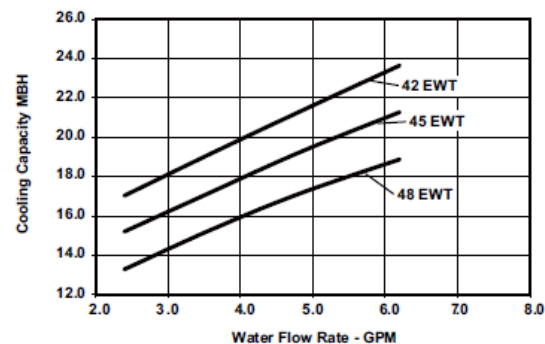


WCSP-2430 @ 550 cfm Heating Capacity

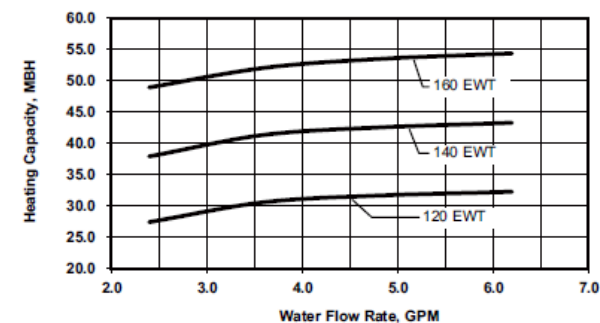


WCSP-3642 @ 850 cfm Cooling Capacity

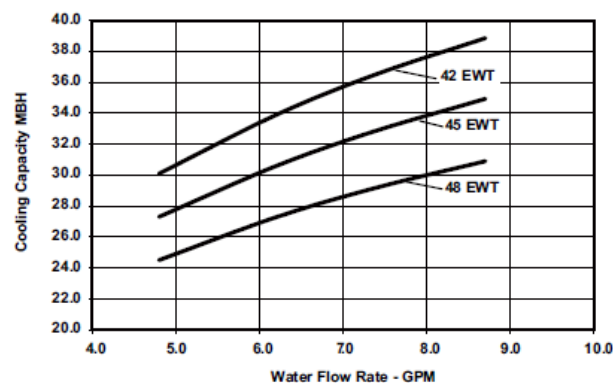


WCSP-3642 @ 850 cfm Heating Capacity

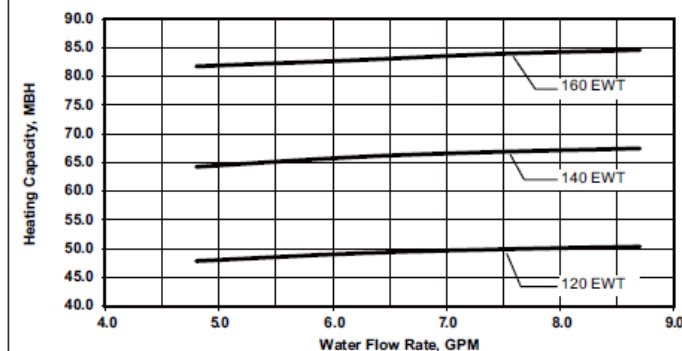

WCSP-4860 @ 1150 cfm Cooling Capacity

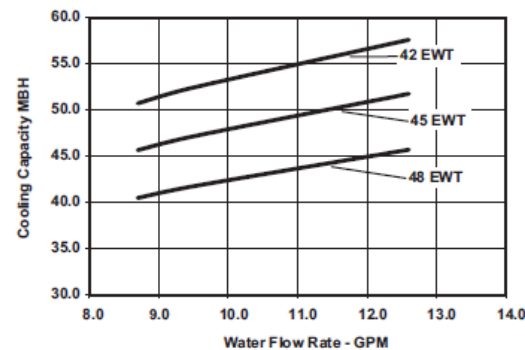


WCSP-4860 @ 1150 cfm Heating Capacity

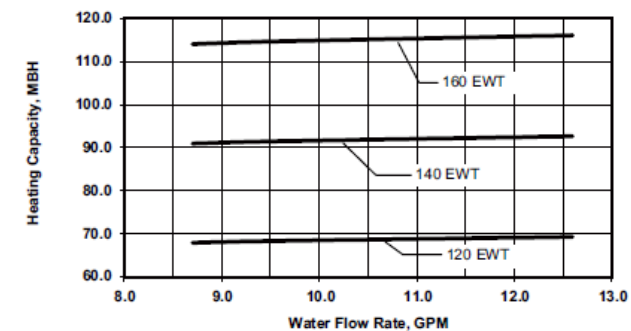

HighWall Hydronic Low Temperature Fan Coil (HW)

- Hydronic Based - No Refrigerant
- High Efficiency EC Motor with Step-Less Speed Modulation
- Auto-Swing Damper for Uniform Air Distribution
- Whisper Quiet Operation (33-58 dB)
- Stainless Steel Flexible Hose Connections
- Equipped with Condensate Drip Pans for Use in Chilled-Water Cooling Applications
- Can Operate with Water Temperatures as Low as 120°F for Heating and as High as 50°F for Cooling
- 8,100 - 25,700 BTU/h Heating Capacity
- 7,300 - 13,100 BTU/h Cooling Capacity
- 5-Year Warranty for Certified Contractors



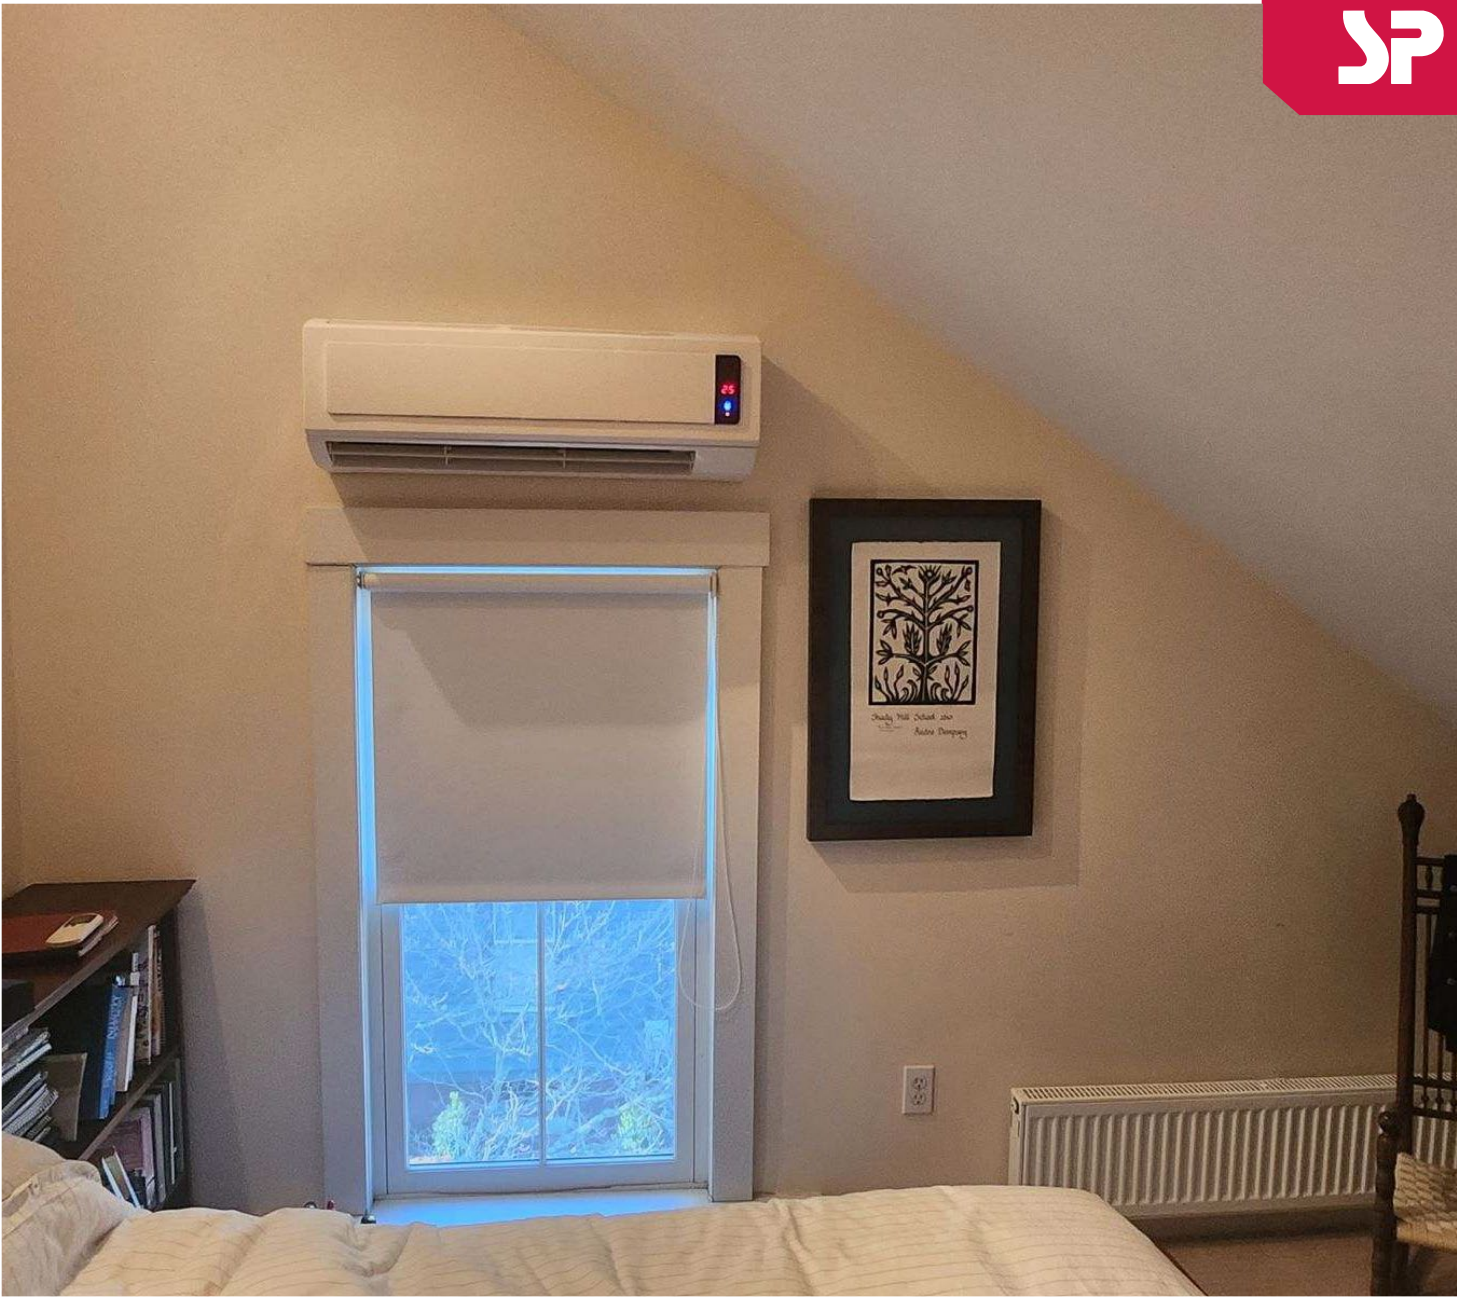

ThinWall Hydronic Low Temperature Fan Coil (HTW)

Heating & Cooling

- Hydronic Based - No Refrigerant
- Tempered Glass Front with Touch Screen Display
- Whisper Quiet, Modern Space-Saving Design
- Cross-Flow Blower Configuration with Integrated Air Guiding Technology
- ECM Blower
- Equipped with Condensate Drip Pans for Use in Chilled-Water Cooling Applications
- Can Operate with Water Temperatures as Low as 120°F for Heating and as High as 50°F for Cooling
- 8,700 - 32,000 BTU/h Heating Capacity
- 3,400 - 14,800 BTU/h Cooling Capacity
- 5-Year Warranty for Certified Contractors





STAND

Solstice Heat Pump Stand

Features

- Stabilizes and secures units
- 12" height off the ground
- 30.5" width X 38" depth
- 14-gauge square steel tubing
- 11-gauge steel cross rails
- Holds up to 400 lbs.
- 8 points of anti-vibration isolation
- (4) 50 Durometer rubber foot pads
- (4) anti-vibration isolation washers
- Powder coated
- All necessary hardware included



BUFFER TANKS

Stainless Steel Buffer Tanks with Built-in Electric Backup

- For Hot and Chilled Water
- Encouraged for Most Systems Using Solstice Heat Pumps
- Inner Tank 304 Stainless, Outer Galvanized Steel Jacket
- Polyurethane Resin Foam with R12 Insulation Valve
- Four-Port Open Tank Design
- Electric Elements Standard
- Standard 10-Year Warranty

119 Gal. Coming Soon!


Model		BT13-H	BT26-H	BT40-H	BT80-H
Height	Inches	29-1/6	45	60	64-1/8
Diameter	Inches	18-1/2	18-1/2	18-1/2	23-5/8
Capacity	US Gal.	13	26	40	80
Max Water Flow	GPM	36	36	36	48
Ship Weight	lbs.	40	84	104	130
Empty Weight	lbs.	38	77	97	125
Full Weight	lbs.	148	304	446	805
Min Circuit Ampacity	Amps	15	30	30	30

Note: 13 Gallon buffer has 1-3 kw element



Buffer Example

NOTE: Buffer tanks provide the location for hydraulic separation, the system can operate 12 GPM flow on heat pump side and 1 GPM on the system side

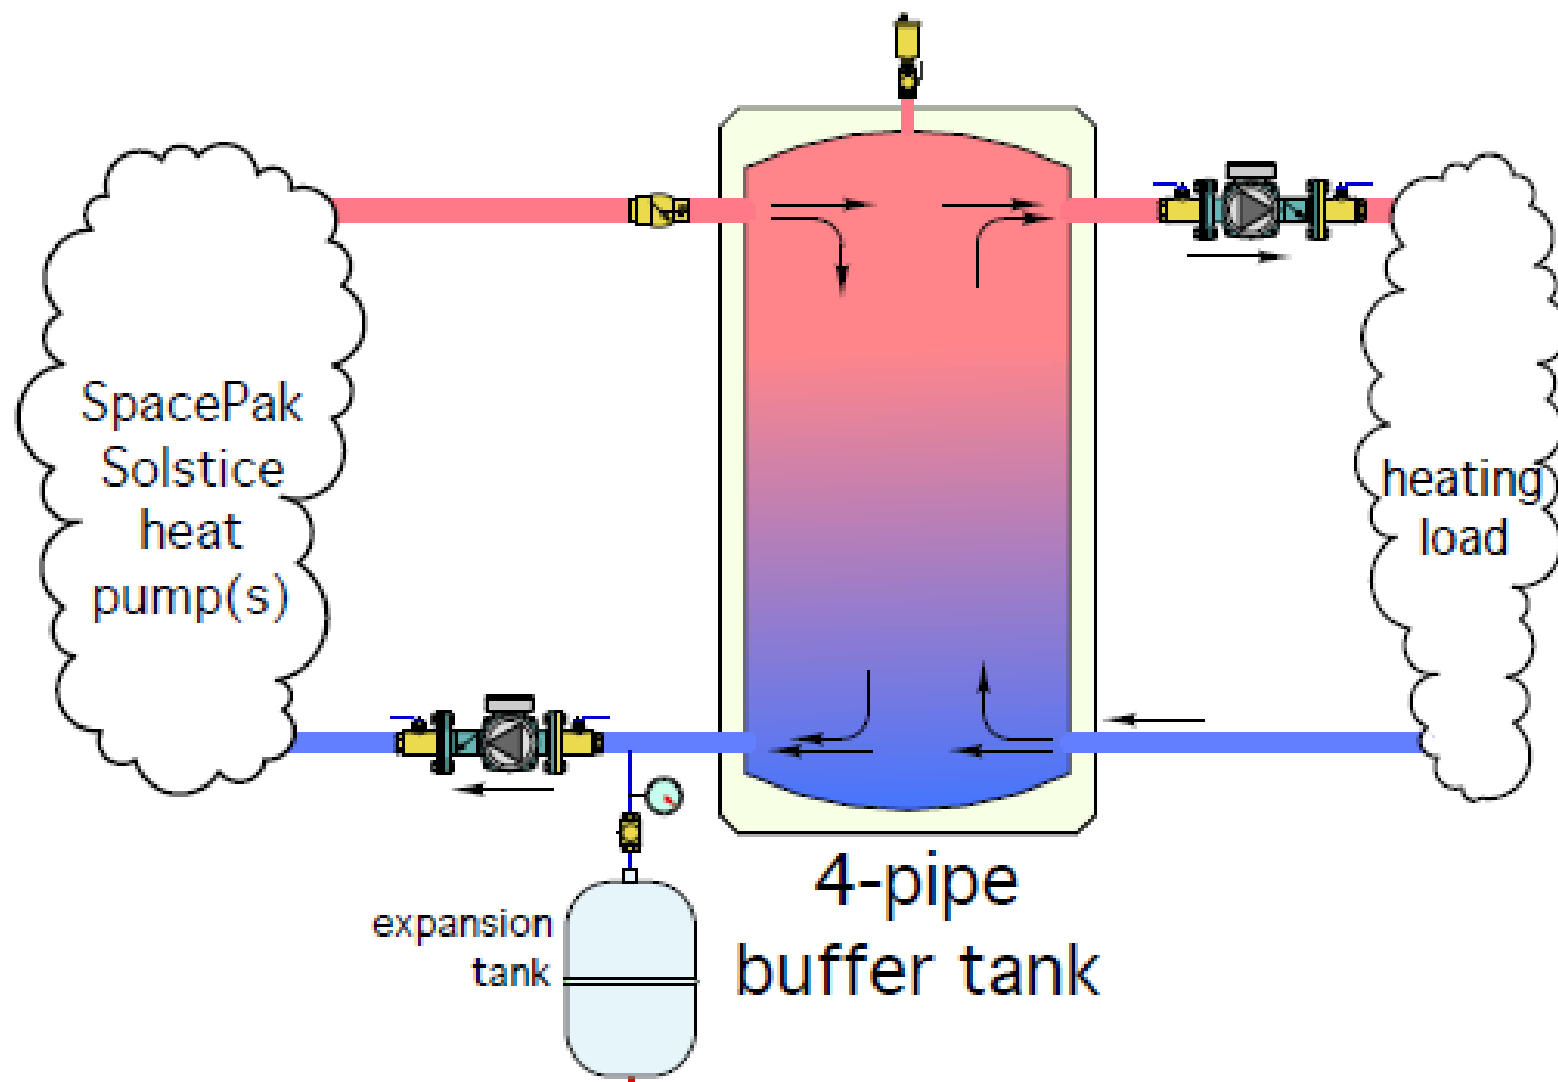



SYSTEM DESIGN

Sizing – Keep it Simple

Buffer/System Volume must be equal to or greater than 7.5 gallons per nominal ton of unit's capacity at its lowest turndown (Heating or Cooling - whichever is larger)

Example: If the unit's minimum turndown is 20k btu then the smallest buffer tank suggested would be our 13 Gallon 4 pipe Buffer Tank (BT13-H)

Note: Remember to consider the “systems” capacity. In a situation where there is a large volume (Cast Iron Radiators) you may want a larger buffer to accommodate a larger inrush of “load” and to prevent temperature swings.


Low-Temp Hybrid Hot Water Indirect Tank

Combination Space Heating + Possible 100% Domestic Hot Water

Combination **thermal storage buffer tank**


Low-temperature **space heating**

On-demand **domestic hot water** supply for up to 100% load coverage – with built-in **electric backup**

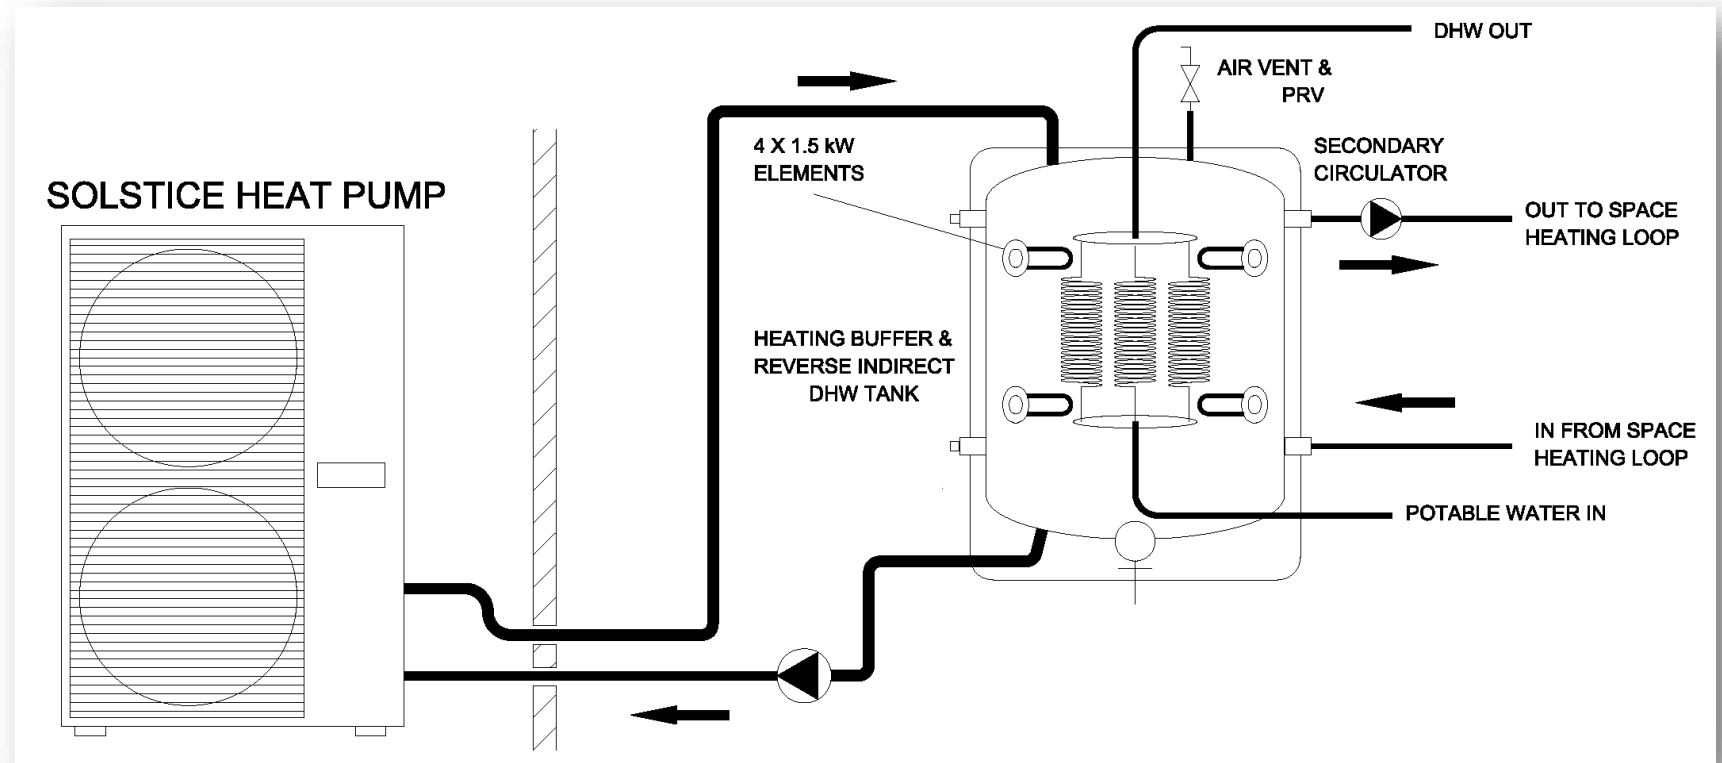

INSTALLATION, & LAYOUT



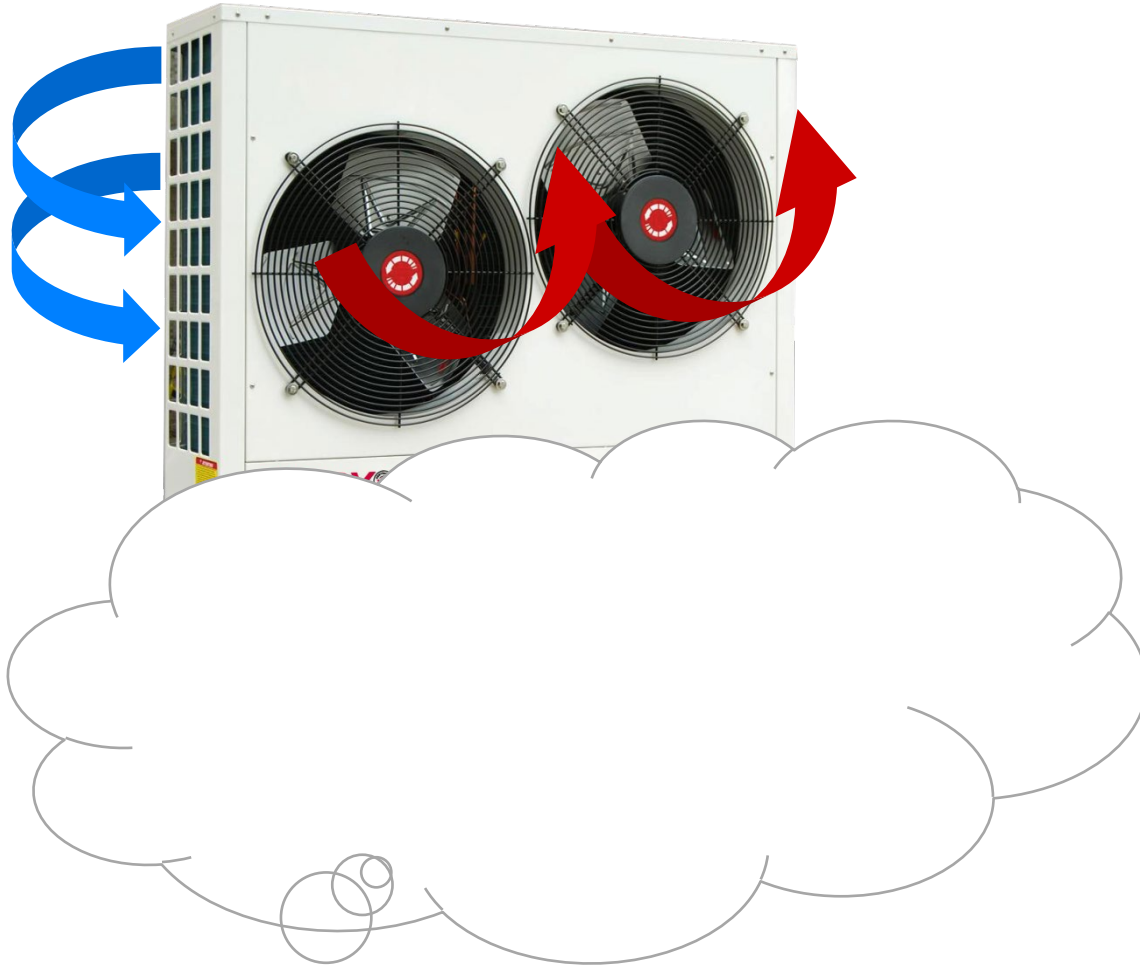

SYSTEM DESIGN

Horizontal Discharge


Standard on all Solstice models

Allows for installation under decks & other remote mounting options

Examples

Allowing for Design & Air Flow & Defrost



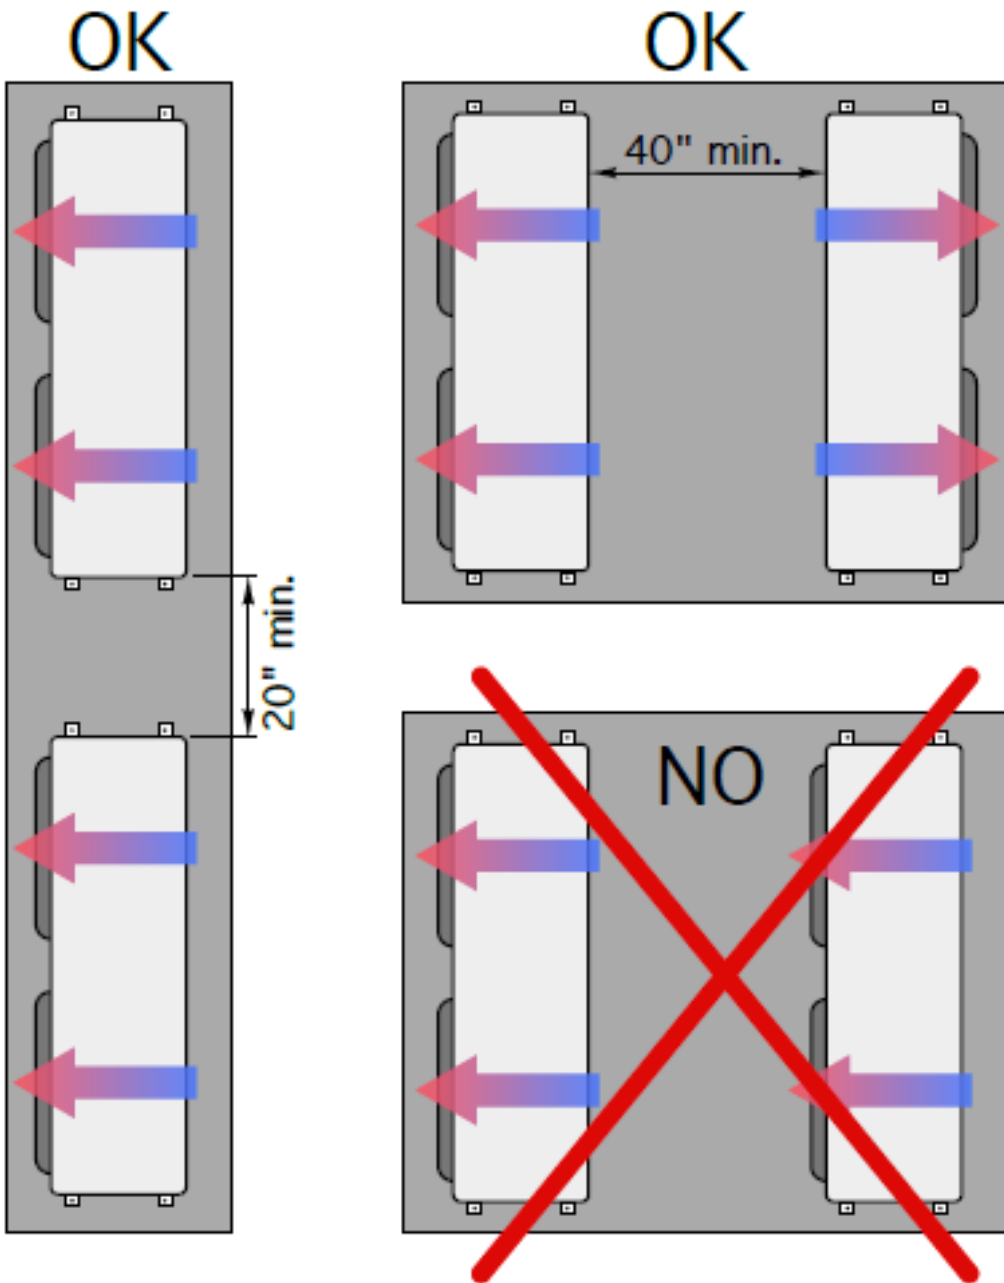

SYSTEM DESIGN

Airflow & Defrost Runoff

Be Mindful When Installing

- Airflow is crucial for system performance
- Assure foliage used to disguise does not cause any restrictions
- Be sure to locate away from any form of combustion exhaust

Potential for Air Flow AND Piping Complications




Multi-Unit Examples



The Basic System (the first step)

Be sure to size pump & pipe for required flow and output

NOTE: Buffer tanks provide the location for hydraulic separation, the system can operate 12 GPM flow on heat pump side and 1 GPM on the system side

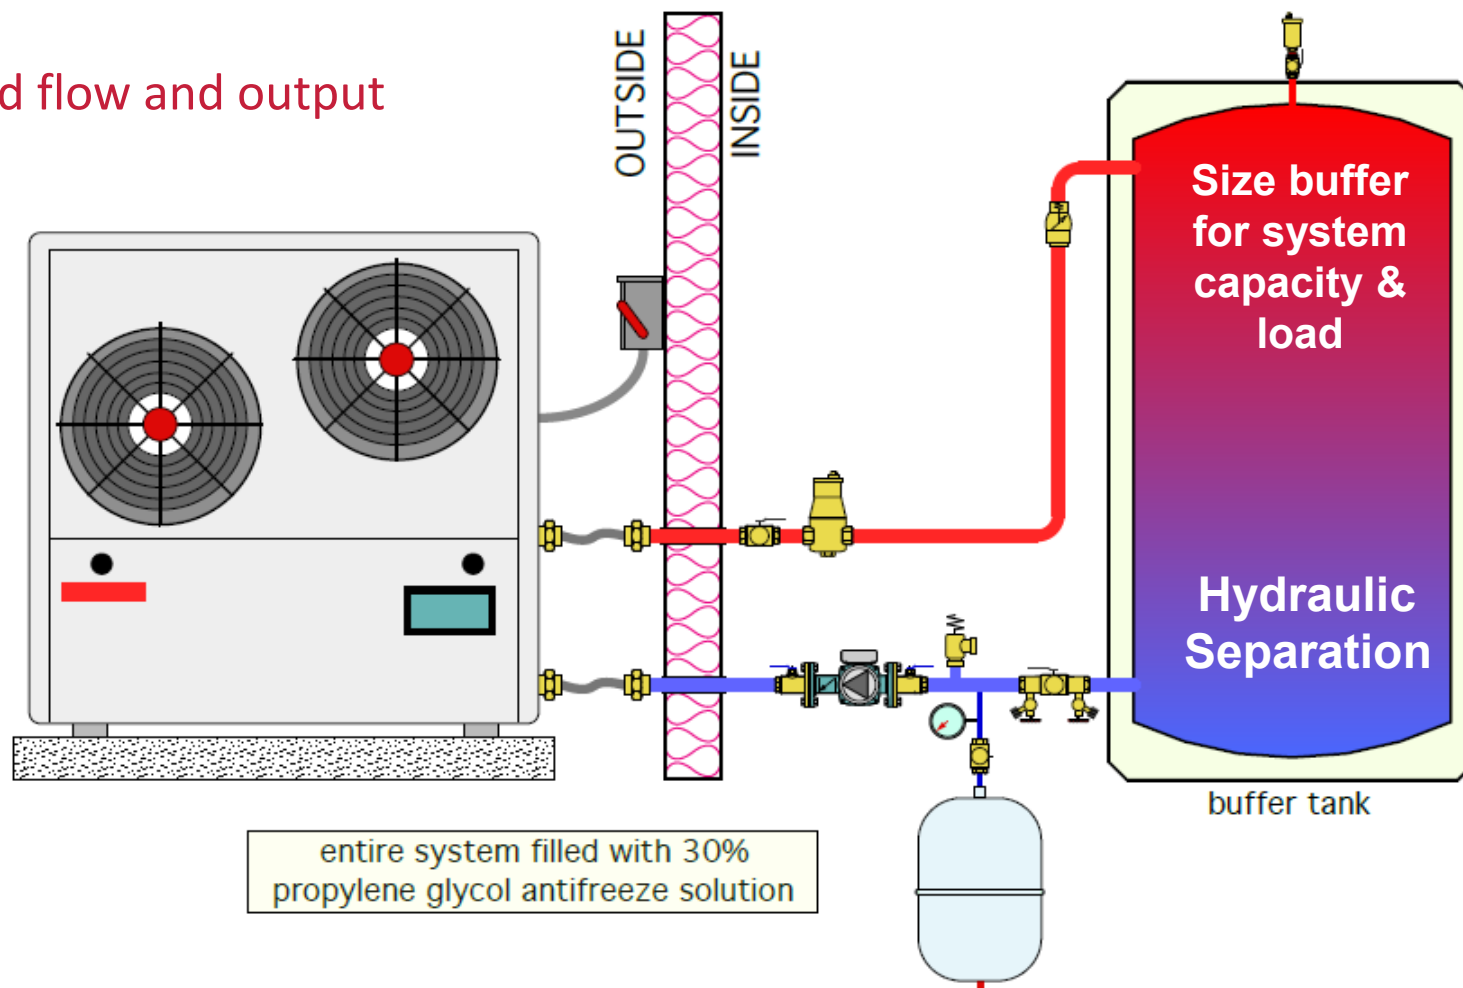



SYSTEM DESIGN

Sizing – Keep it Simple

Buffer/System Volume must be equal to or greater than 7.5 gallons per nominal ton of unit's capacity at its lowest turndown (Heating or Cooling - whichever is larger)

Example: If the unit's minimum turndown is 20k btu then the smallest buffer tank suggested would be our 13 Gallon 4 pipe Buffer Tank (BT13-H)

Note: Remember to consider the “systems” capacity. In a situation where there is a large volume (Cast Iron Radiators) you may want a larger buffer to accommodate a larger inrush of “load” and to prevent temperature swings.

Take everything into account when sizing piping system

Piping Pressure Losses*

	Pressure Drop, Ft water/100Ft			
Flow rate GPM	1"	1-1/4"	1-1/2"	2"
Pex Pipe				
10	13.4	5.2	2.4	0.6
11	15.9	6.2	2.8	0.7
12	18.5	7.2	3.2	0.9
14	24.4	9.4	4.2	1.2
Copper Pipe (Type L)				
10	7.1	2.6	1.1	0.3
11	8.4	3.1	1.3	0.3
12	9.9	3.6	1.5	0.4
14	13.2	4.8	2	0.5


*Remember to check the CV rating of your fittings and valves to make sure your getting the correct flow through the equipment.




—
Questions?

RETURN FROM TERMINAL UNIT(S)


Piping Diagrams

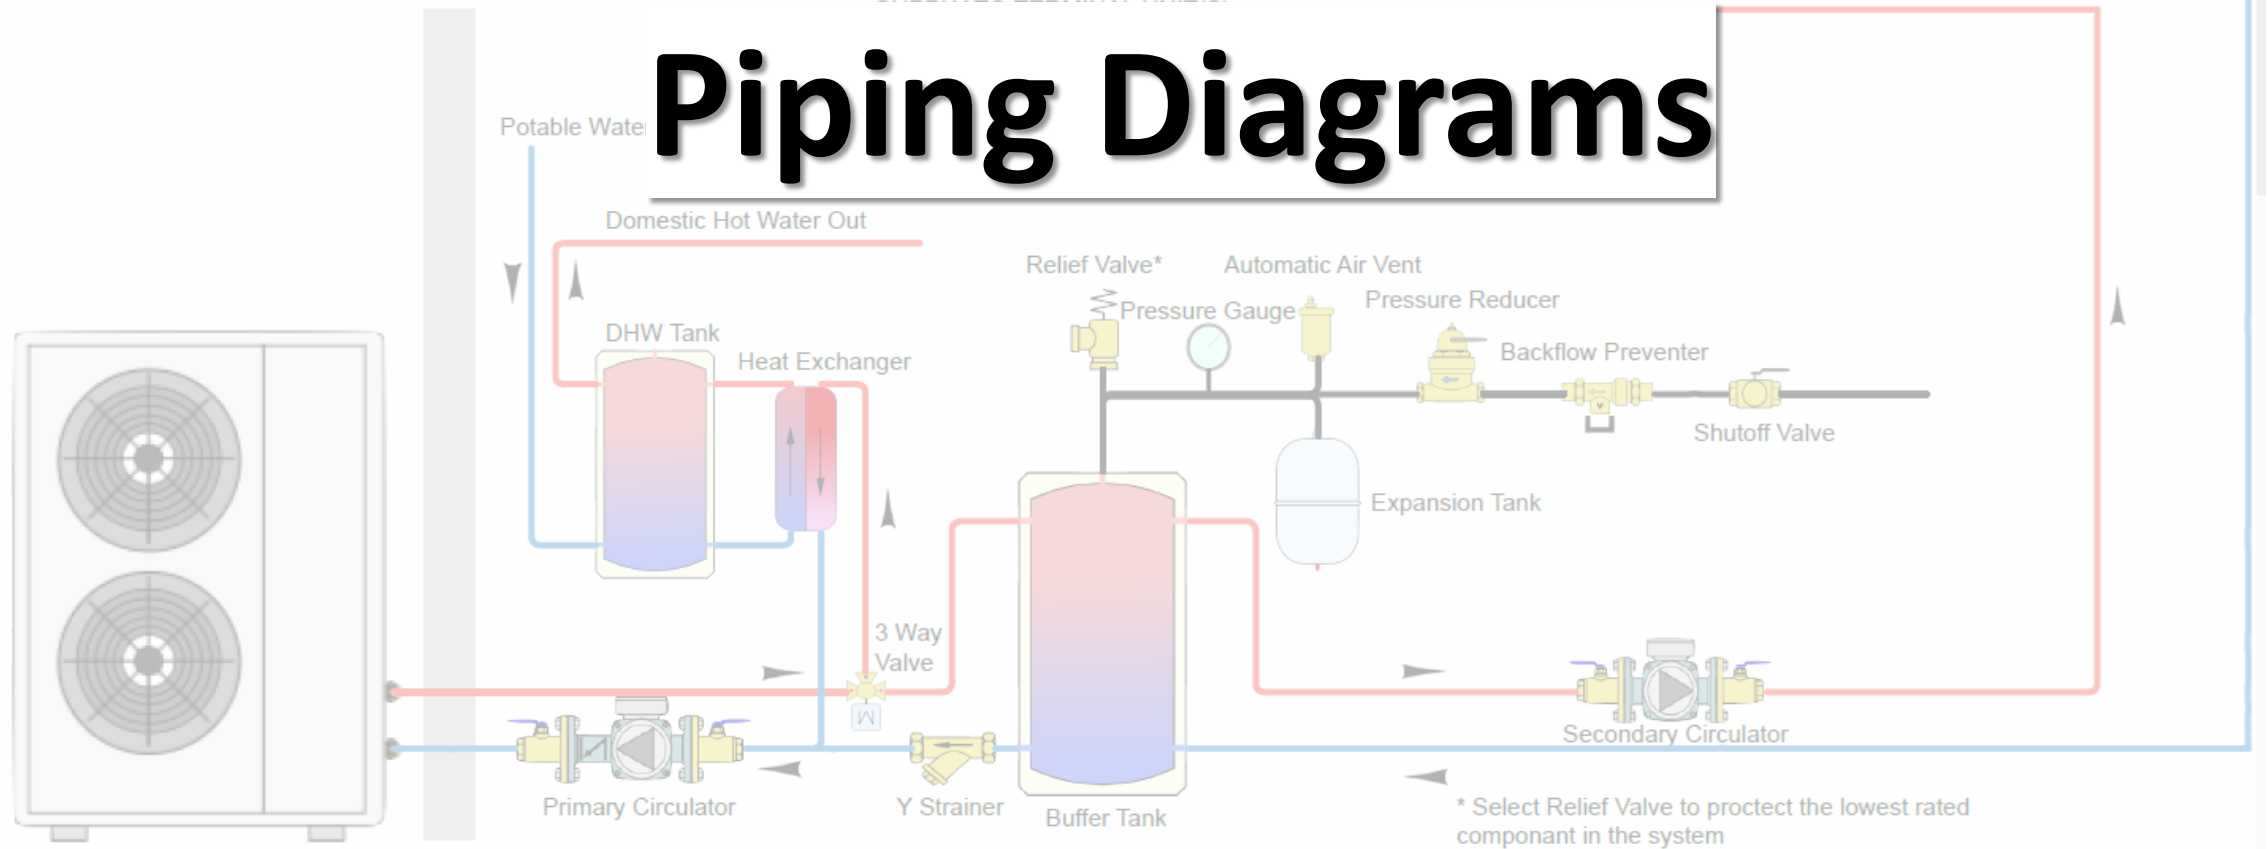

Basic Heat Pump Installation Monobloc

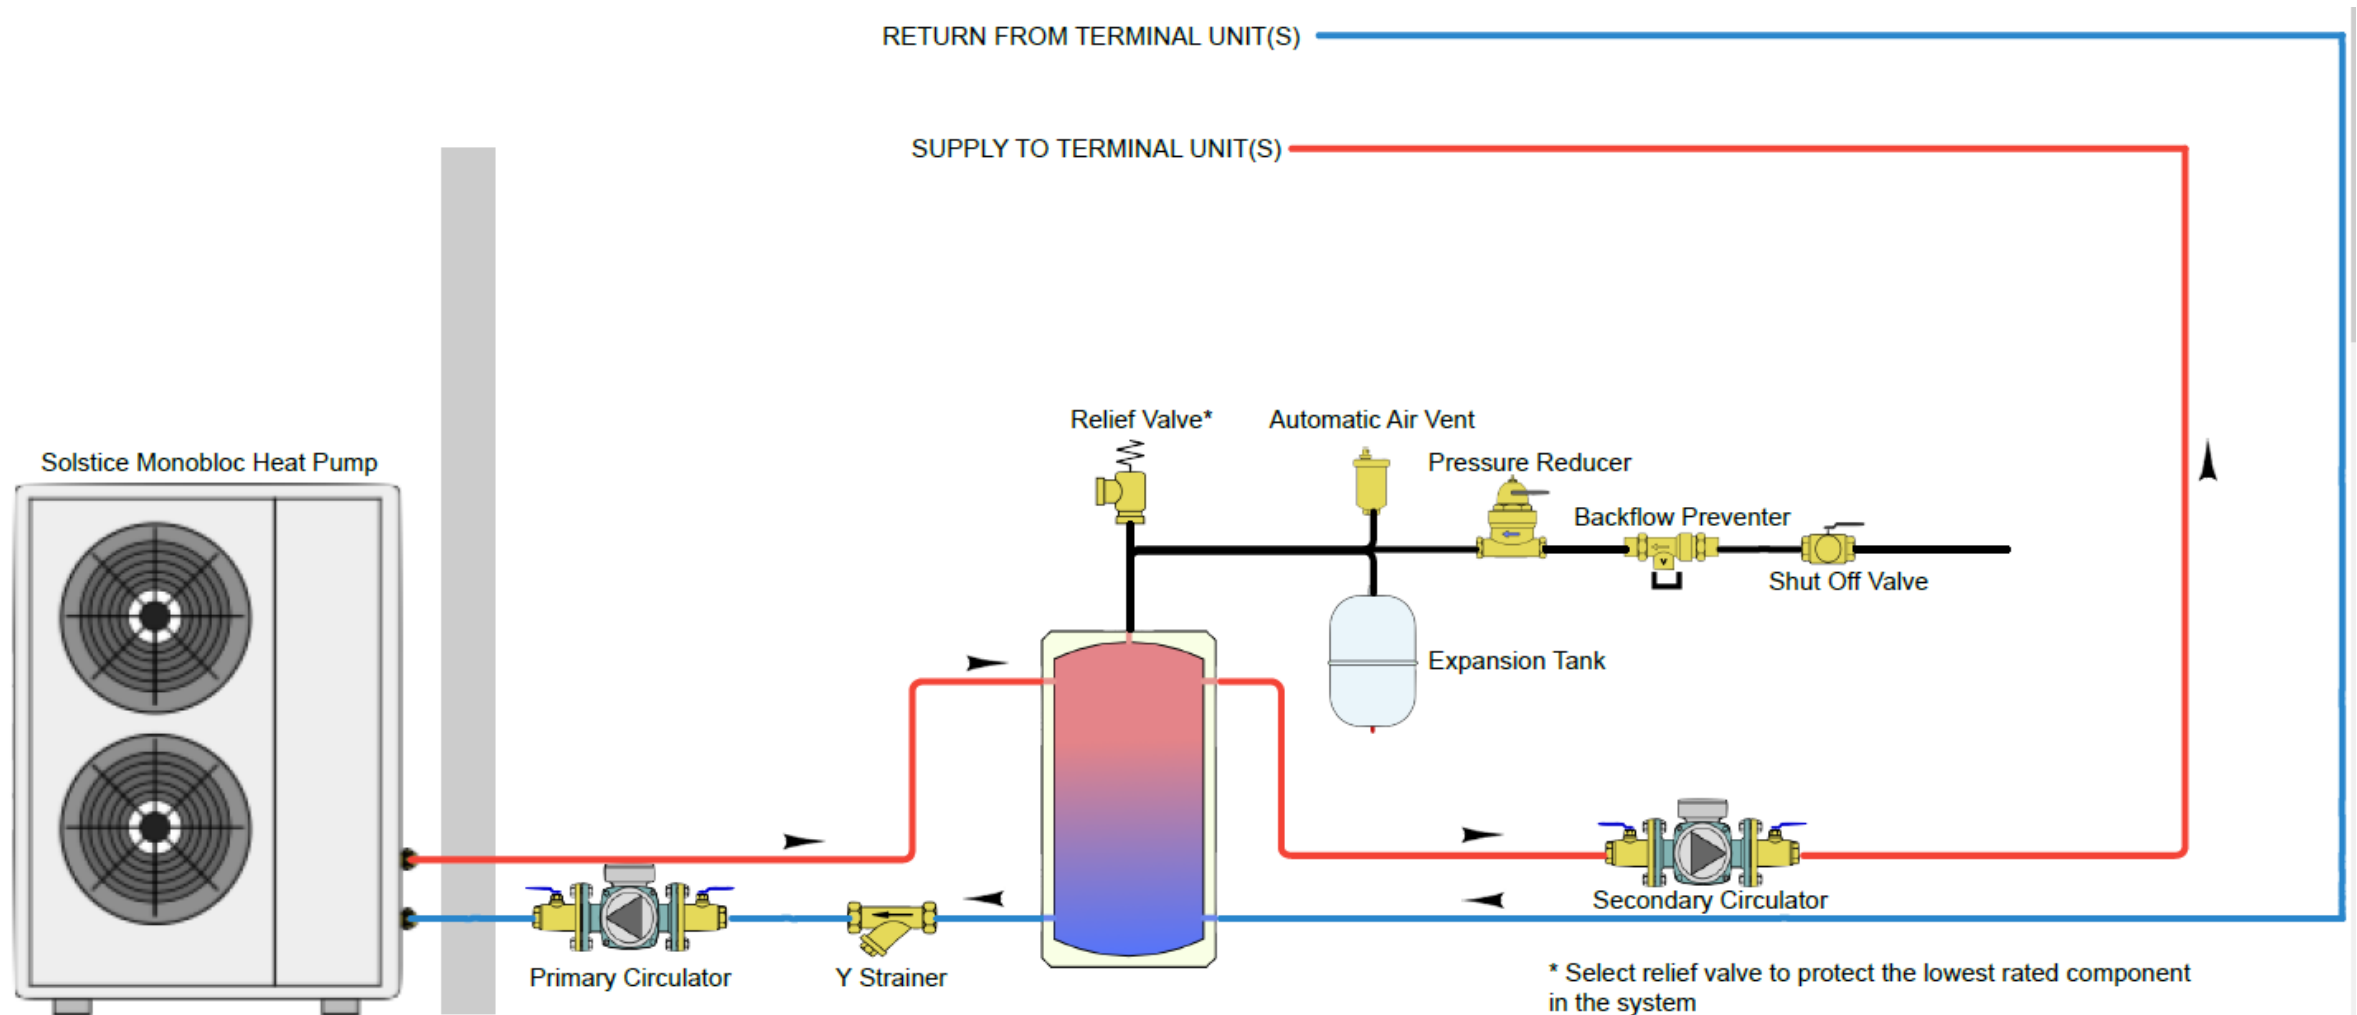


Heat Pump With Backup Heat (Oil/Electric/Propane)

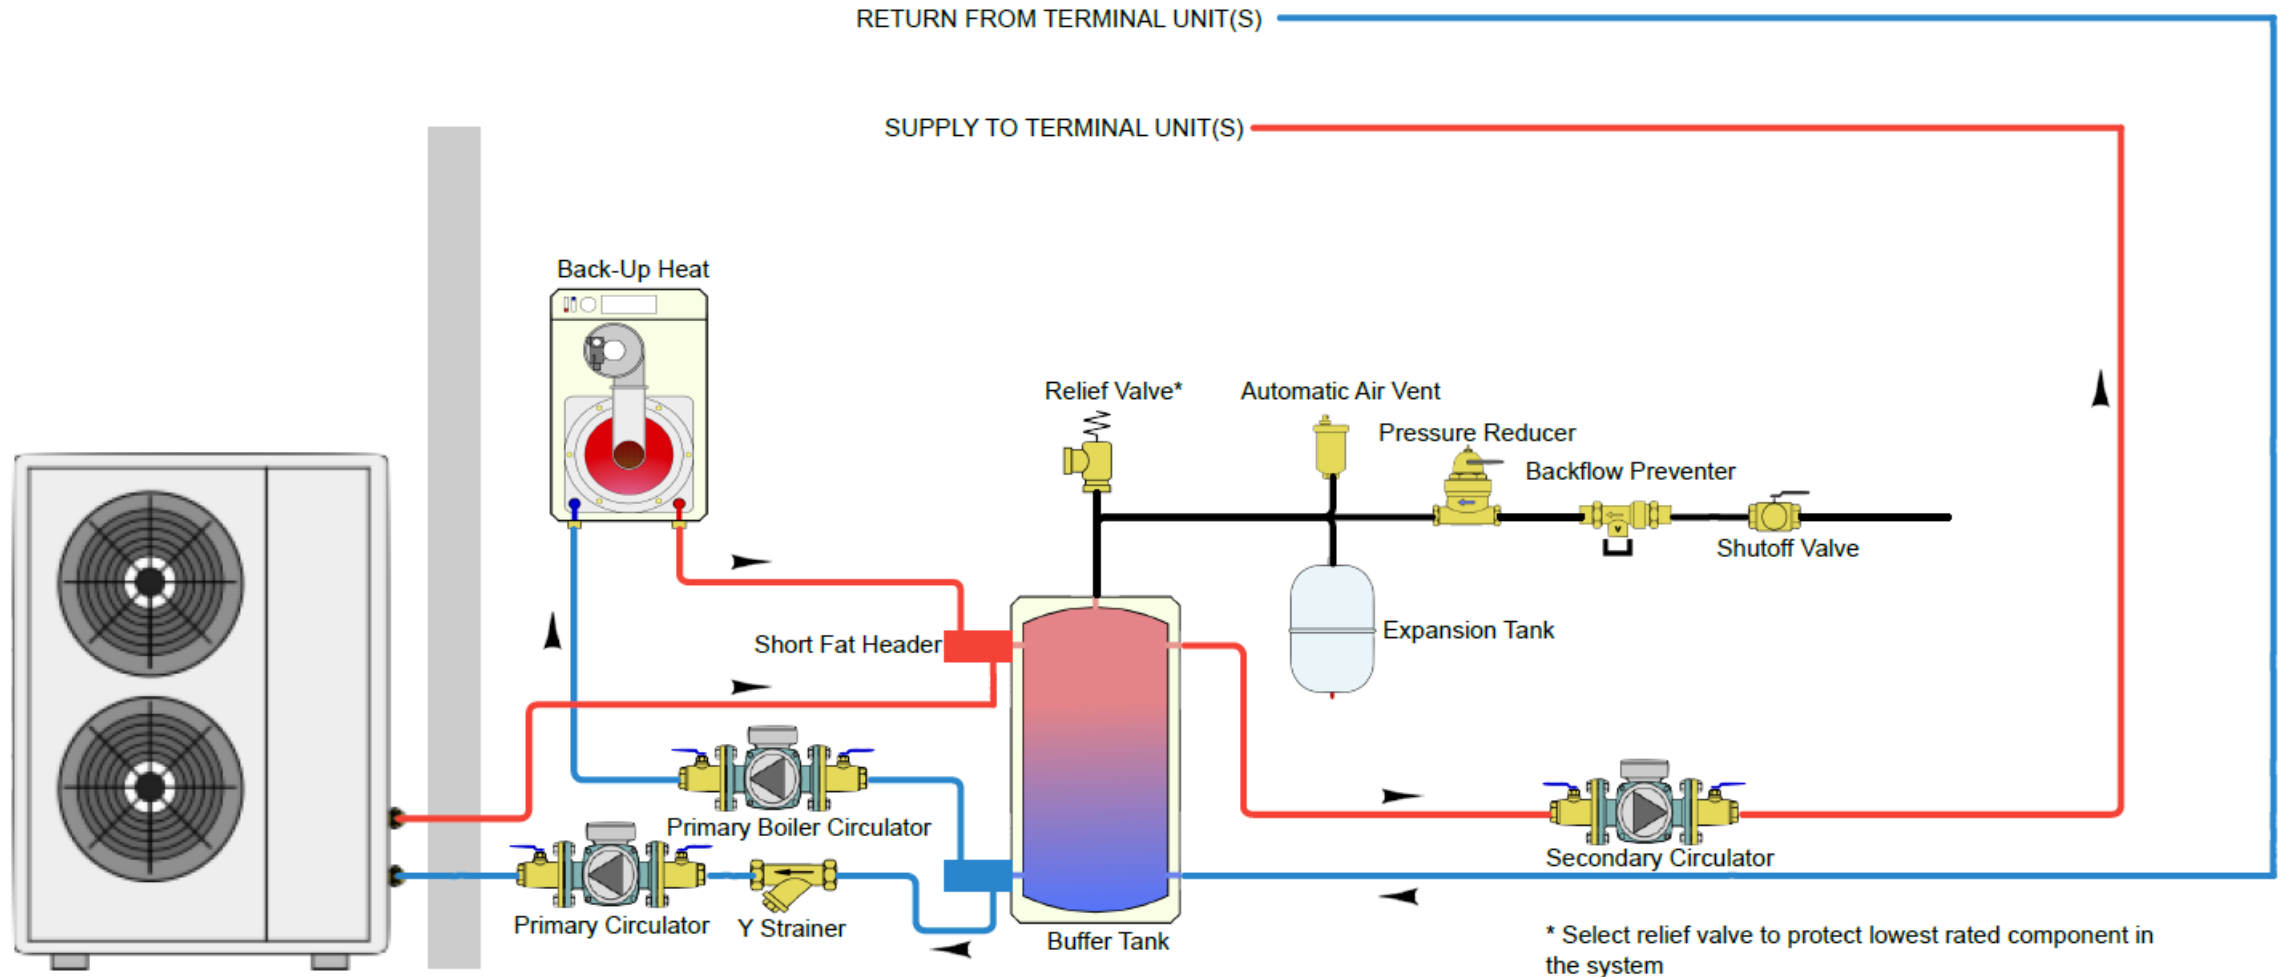

Heating + Cooling


- 3 HEAT PUMPS
- 1 PUMP
- 1 BUFFER TANK

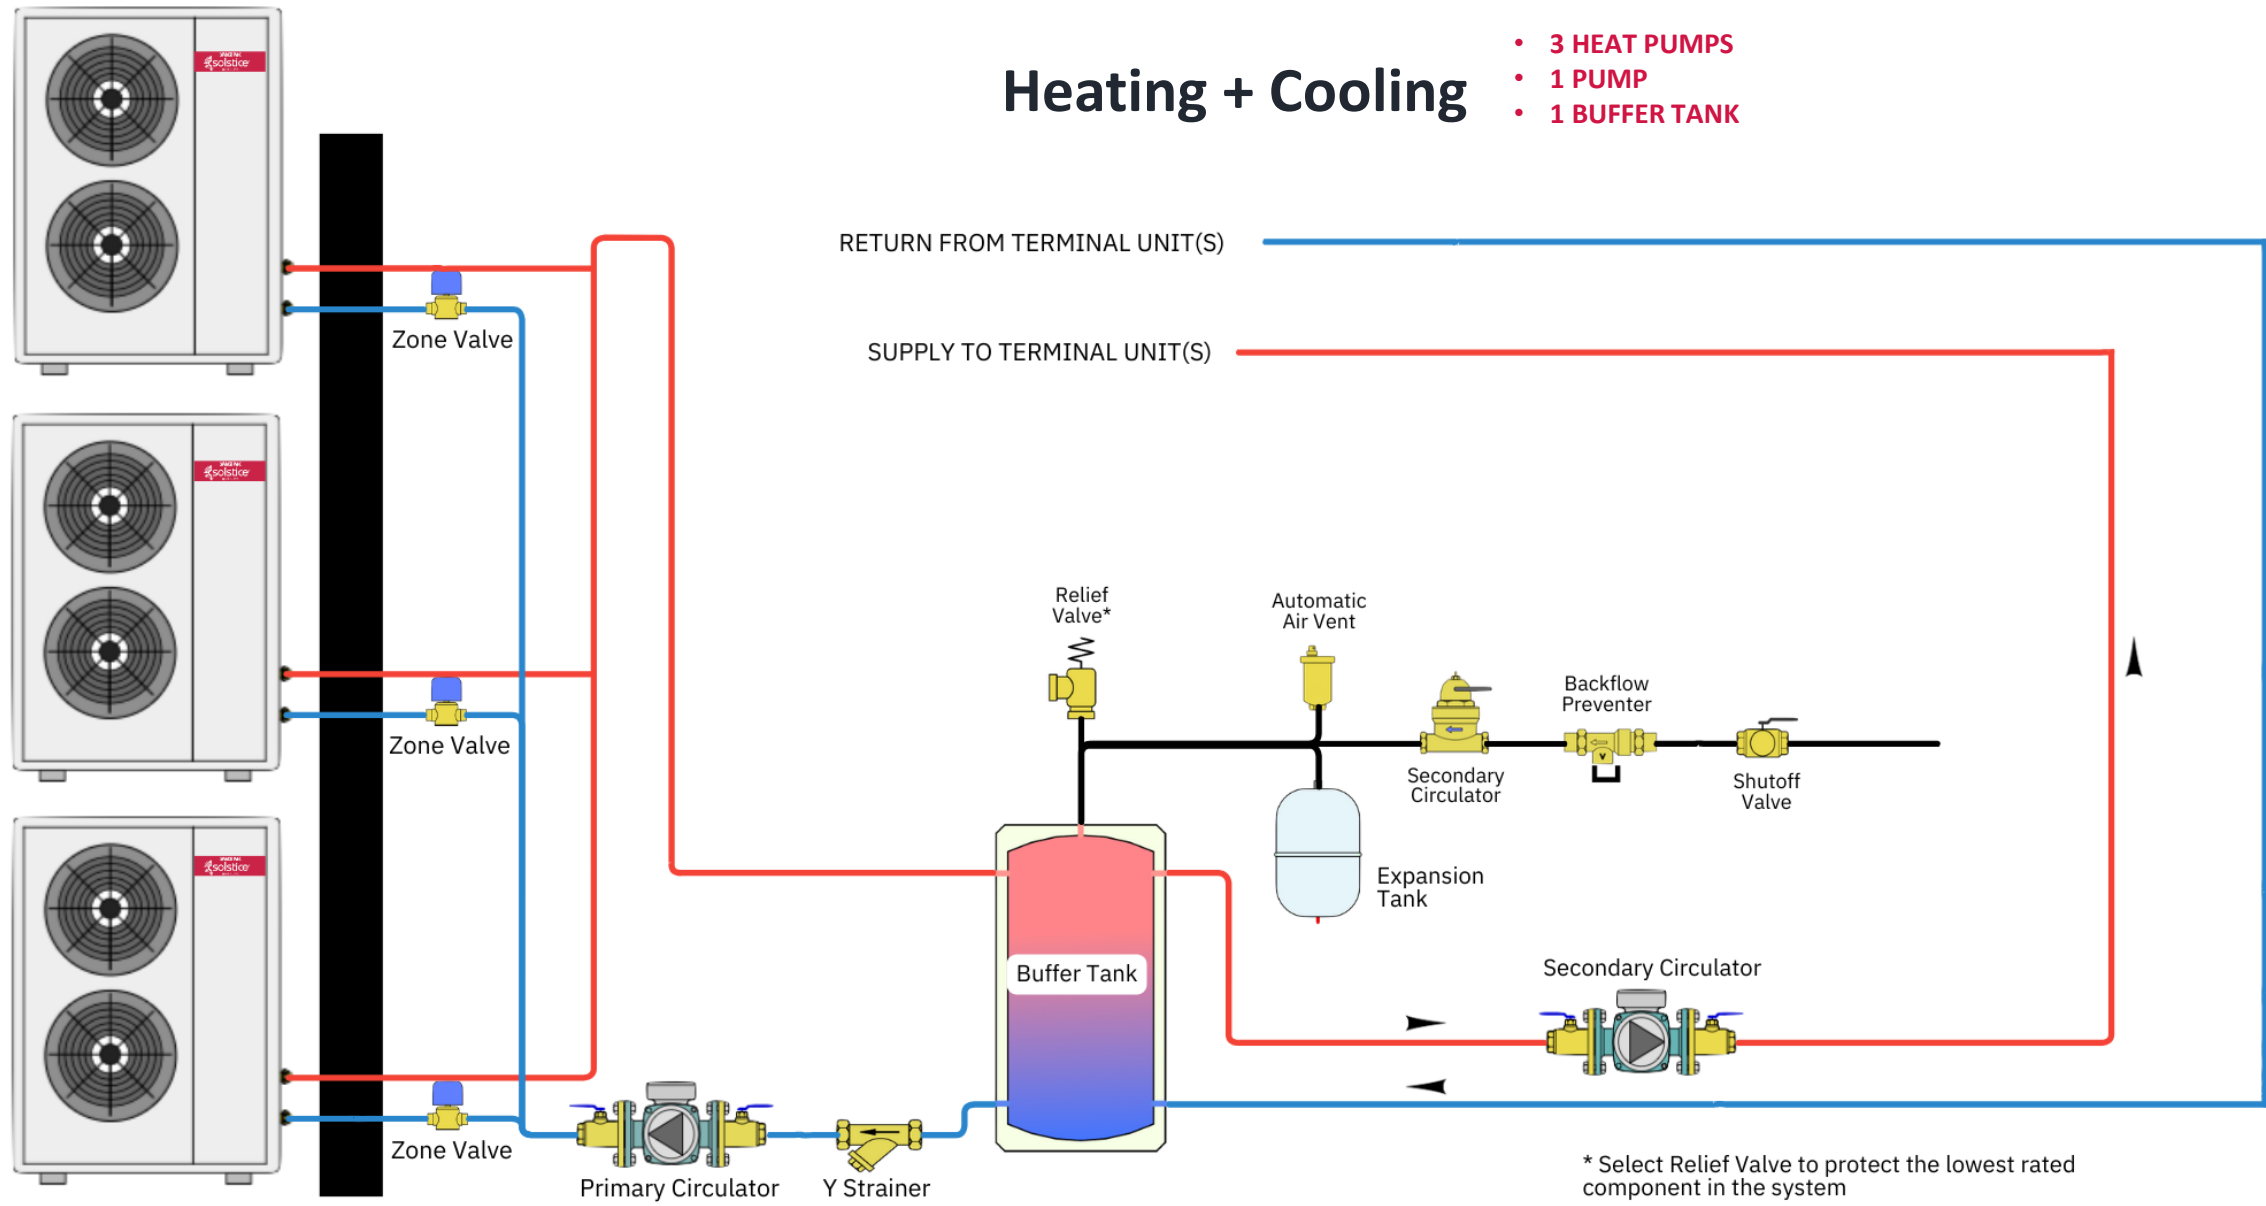

* Select Relief Valve to protect the lowest rated component in the system

Heating + Cooling

- 3 HEAT PUMPS
- 3 PUMPS
- 1 BUFFER TANK

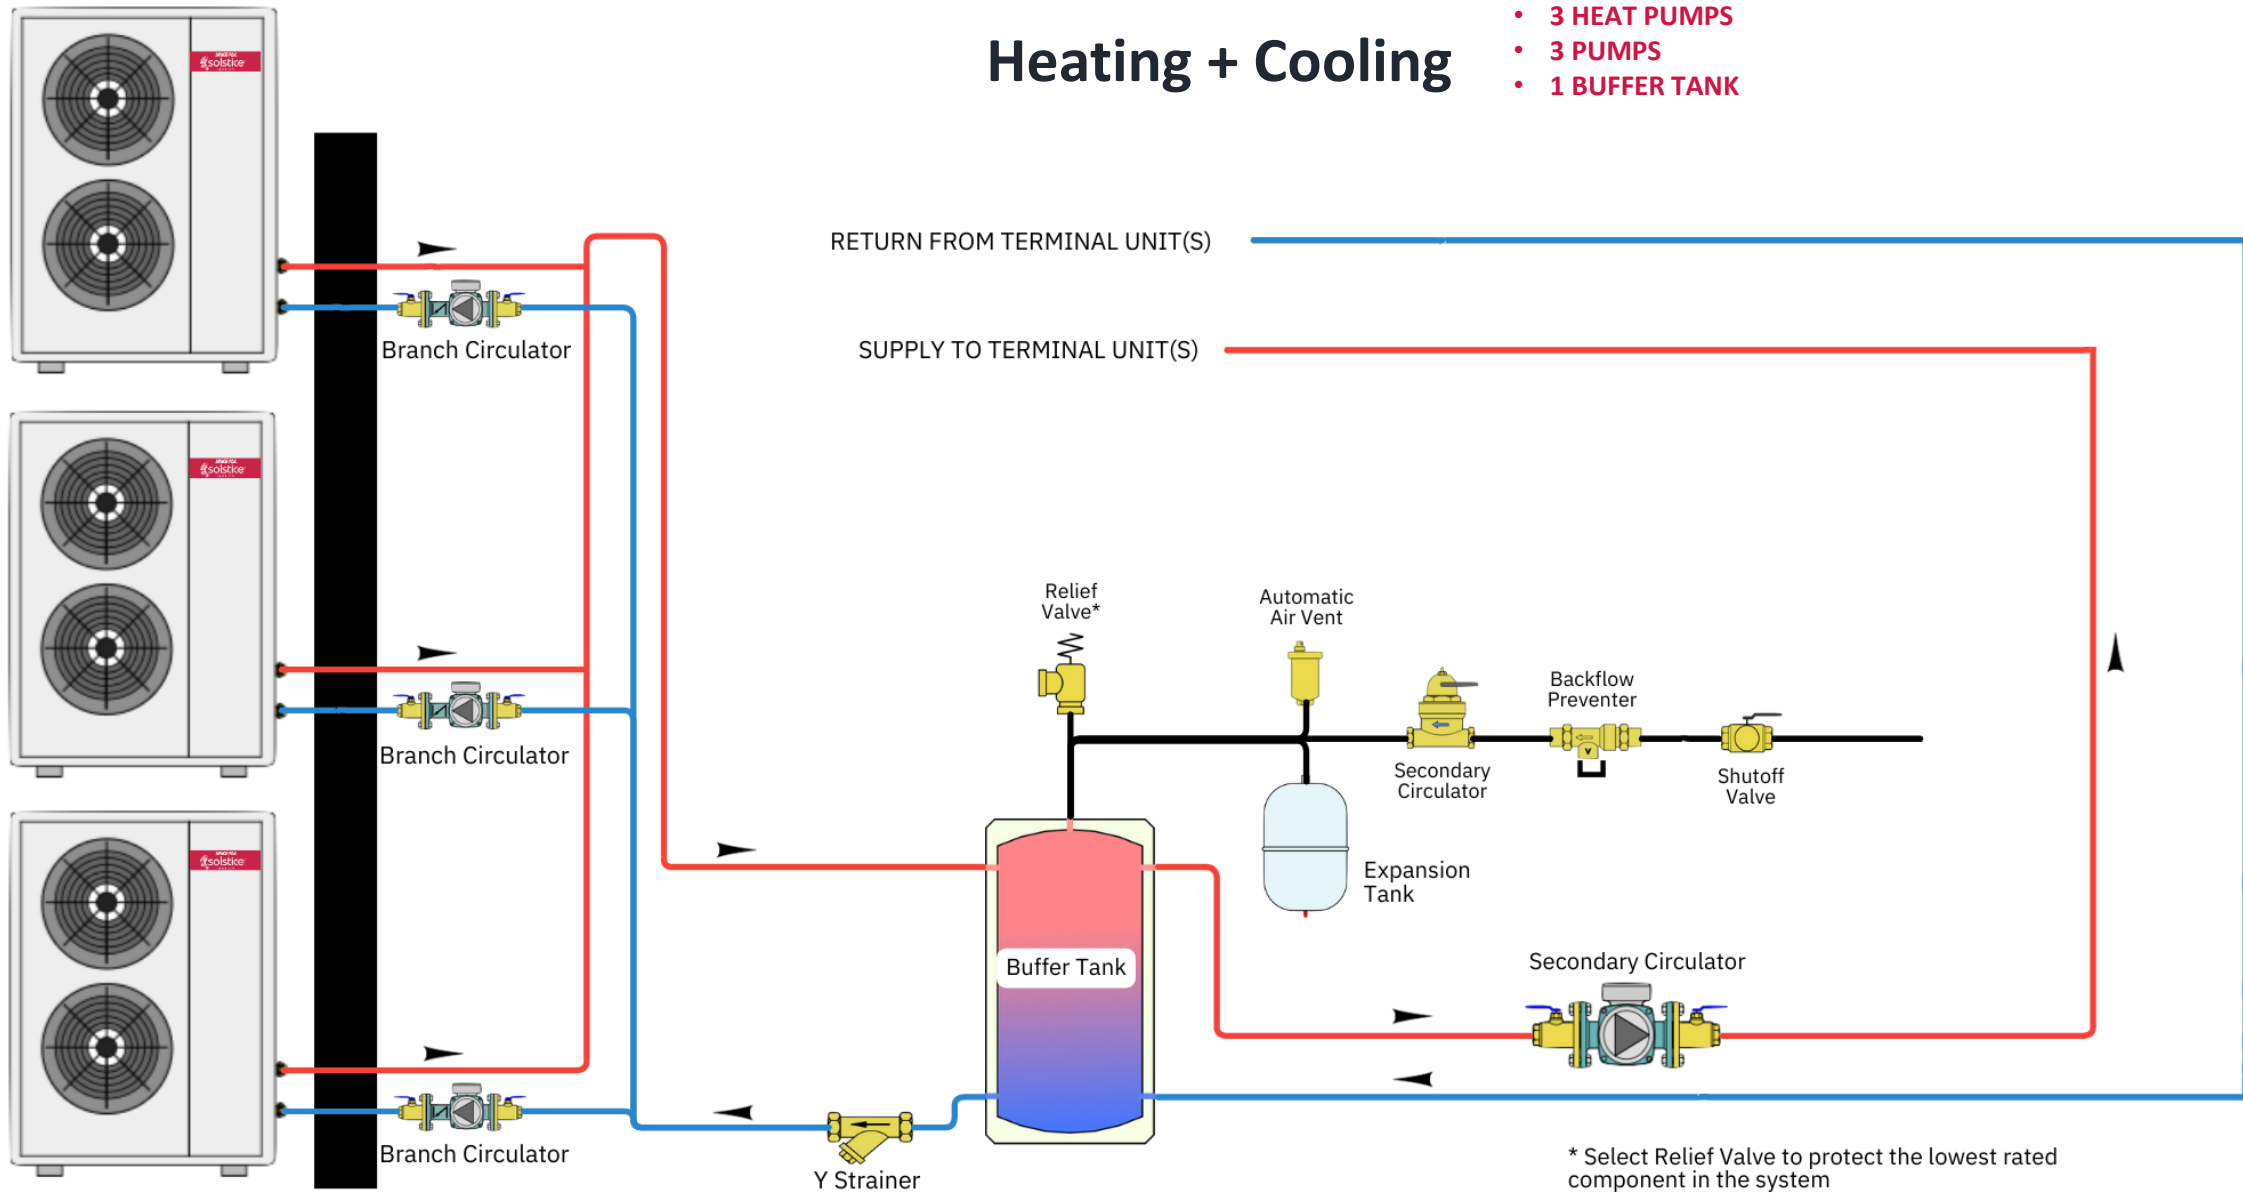

Solstice Monobloc Air to Water Heat Pumps

* Select Relief Valve to protect the lowest rated component in the system

Heating + Cooling + Domestic Hot Water

- 1 HEAT PUMP
- 1 BUFFER TANK
- 1 DHW TANK

RETURN FROM TERMINAL UNIT(S)

SUPPLY TO TERMINAL UNIT(S)

DHW out

Potable water in

Relief Valve*

Pressure Gauge

Automatic Air Vent

Backflow Preventer

Secondary Circulator

Shutoff Valve


Expansion Tank

Secondary Circulator

3 Way Valve

Y Strainer

Primary Circulator

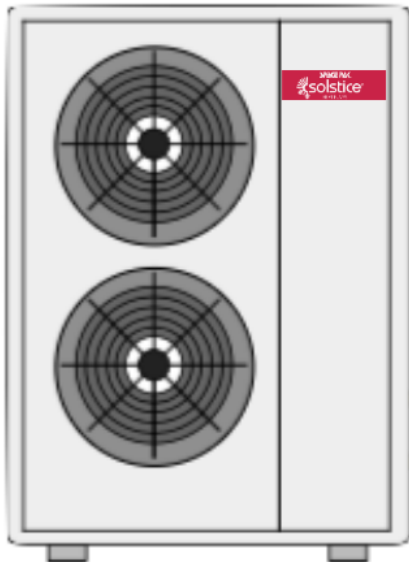


Solstice Monobloc Air to Water Heat Pump

* Select Relief Valve to protect the lowest rated component in the system

Heating + Cooling (Reverse Return)


- 3 HEAT PUMPS
- 3 PUMPS
- 2 BUFFER TANKS

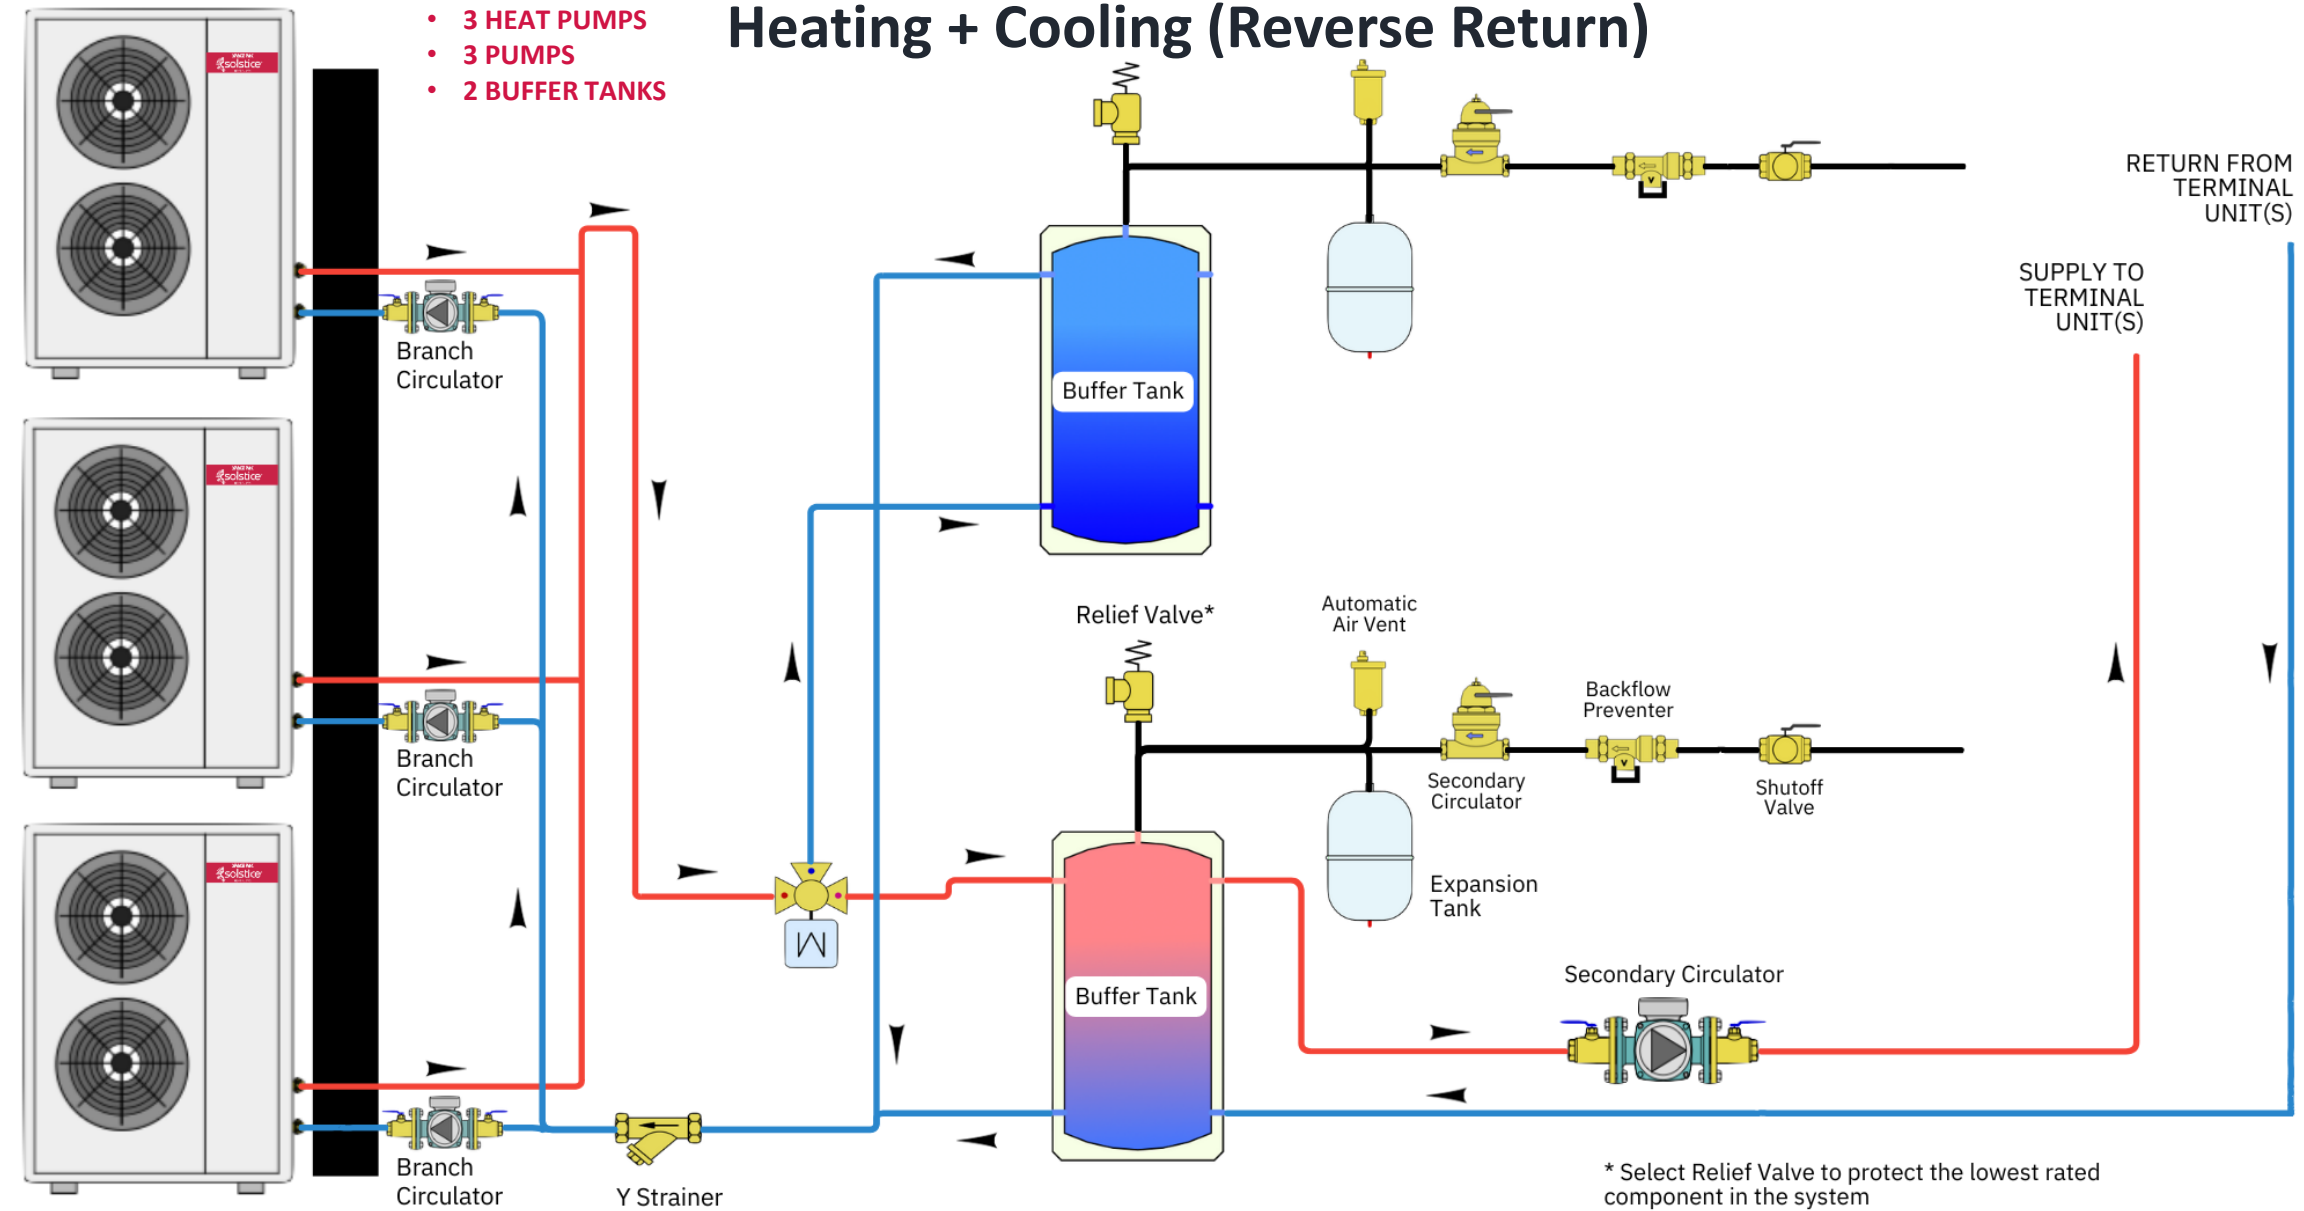


Solstice Monobloc Air to Water Heat Pumps

* Select Relief Valve to protect the lowest rated component in the system



Basic Split System

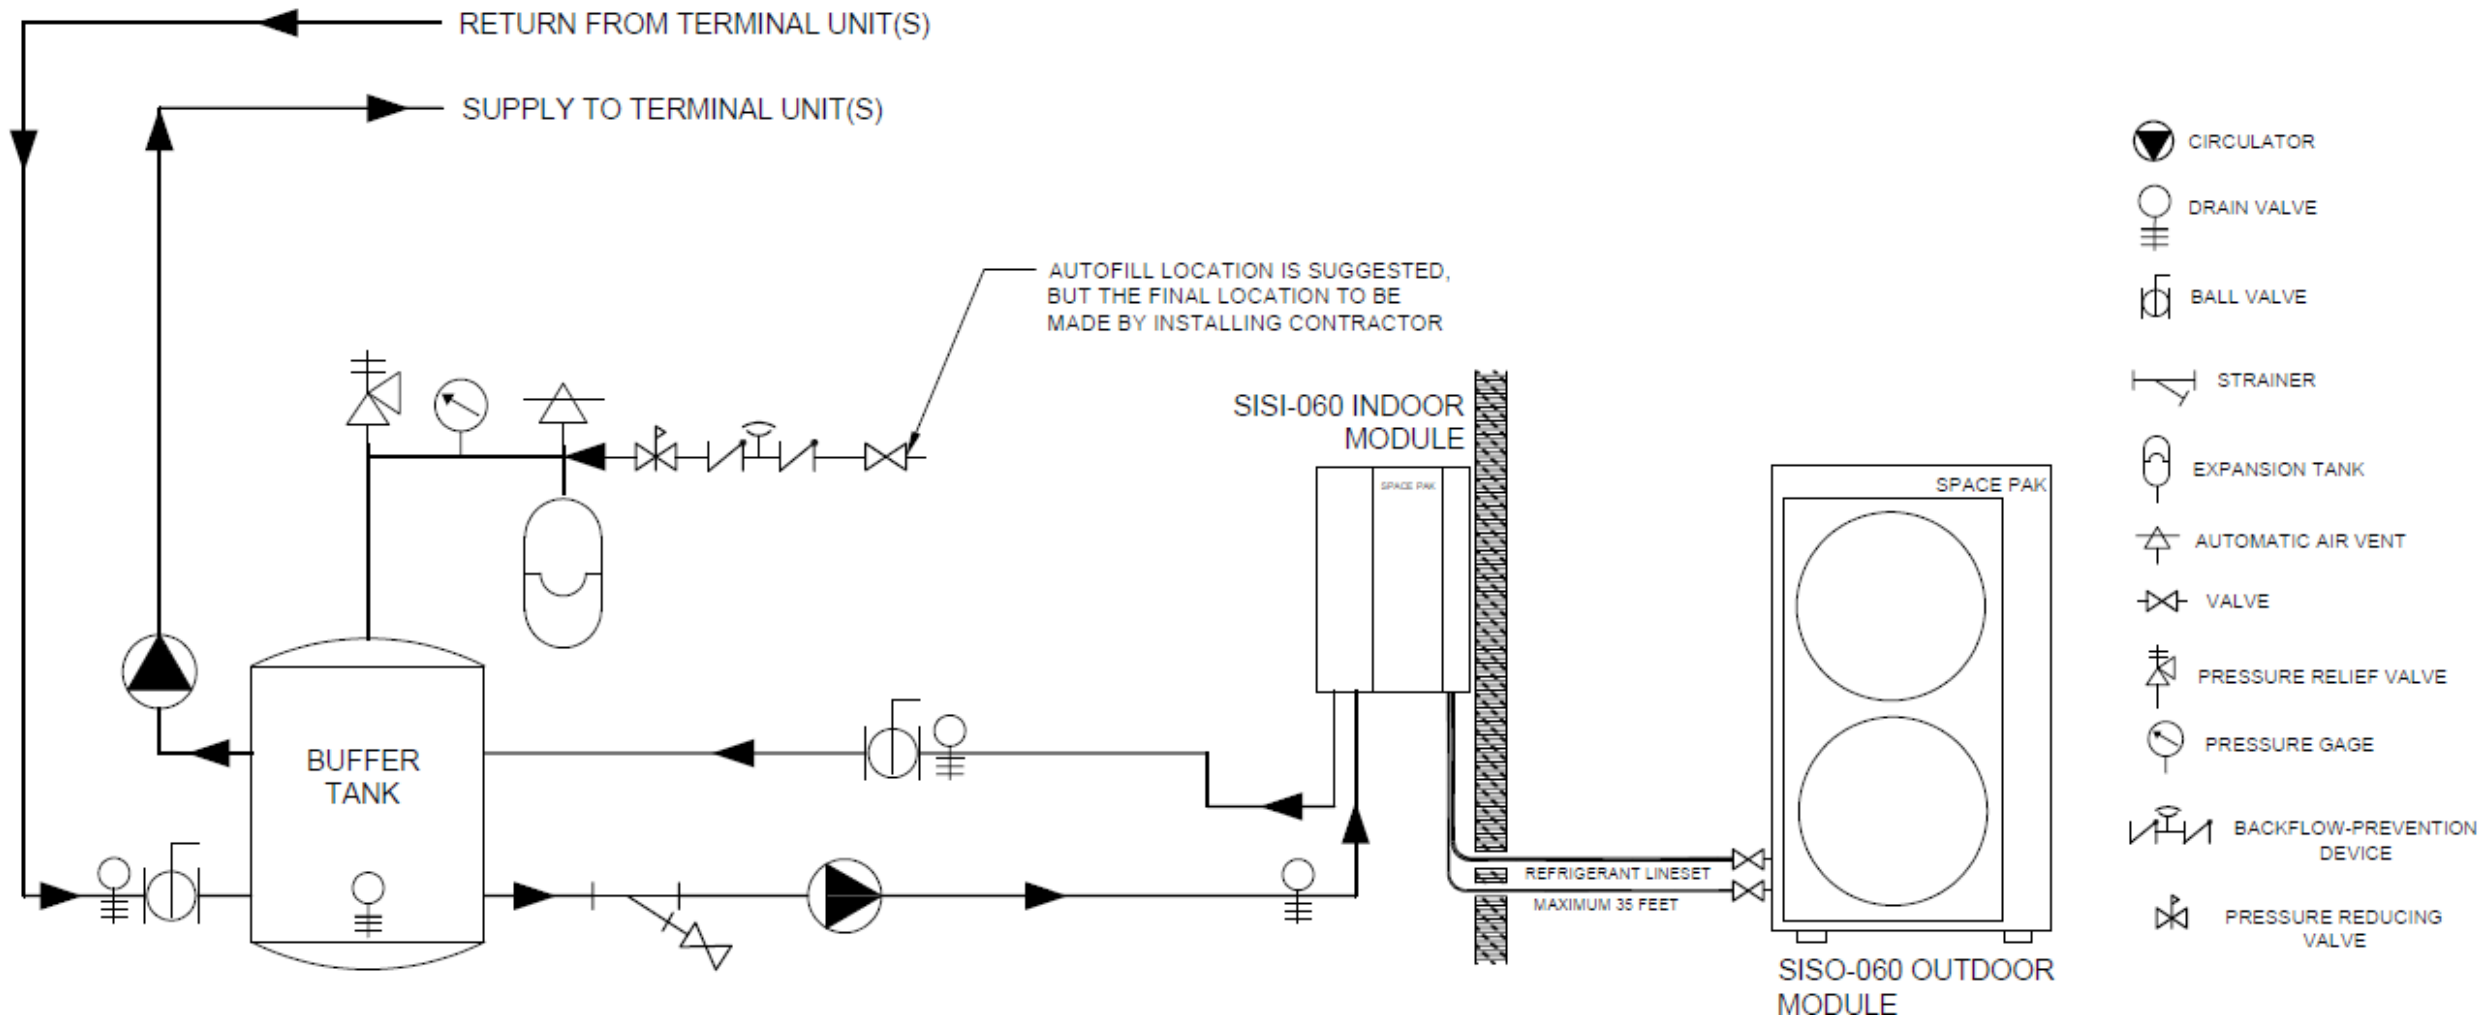


Split System with Boiler Backup

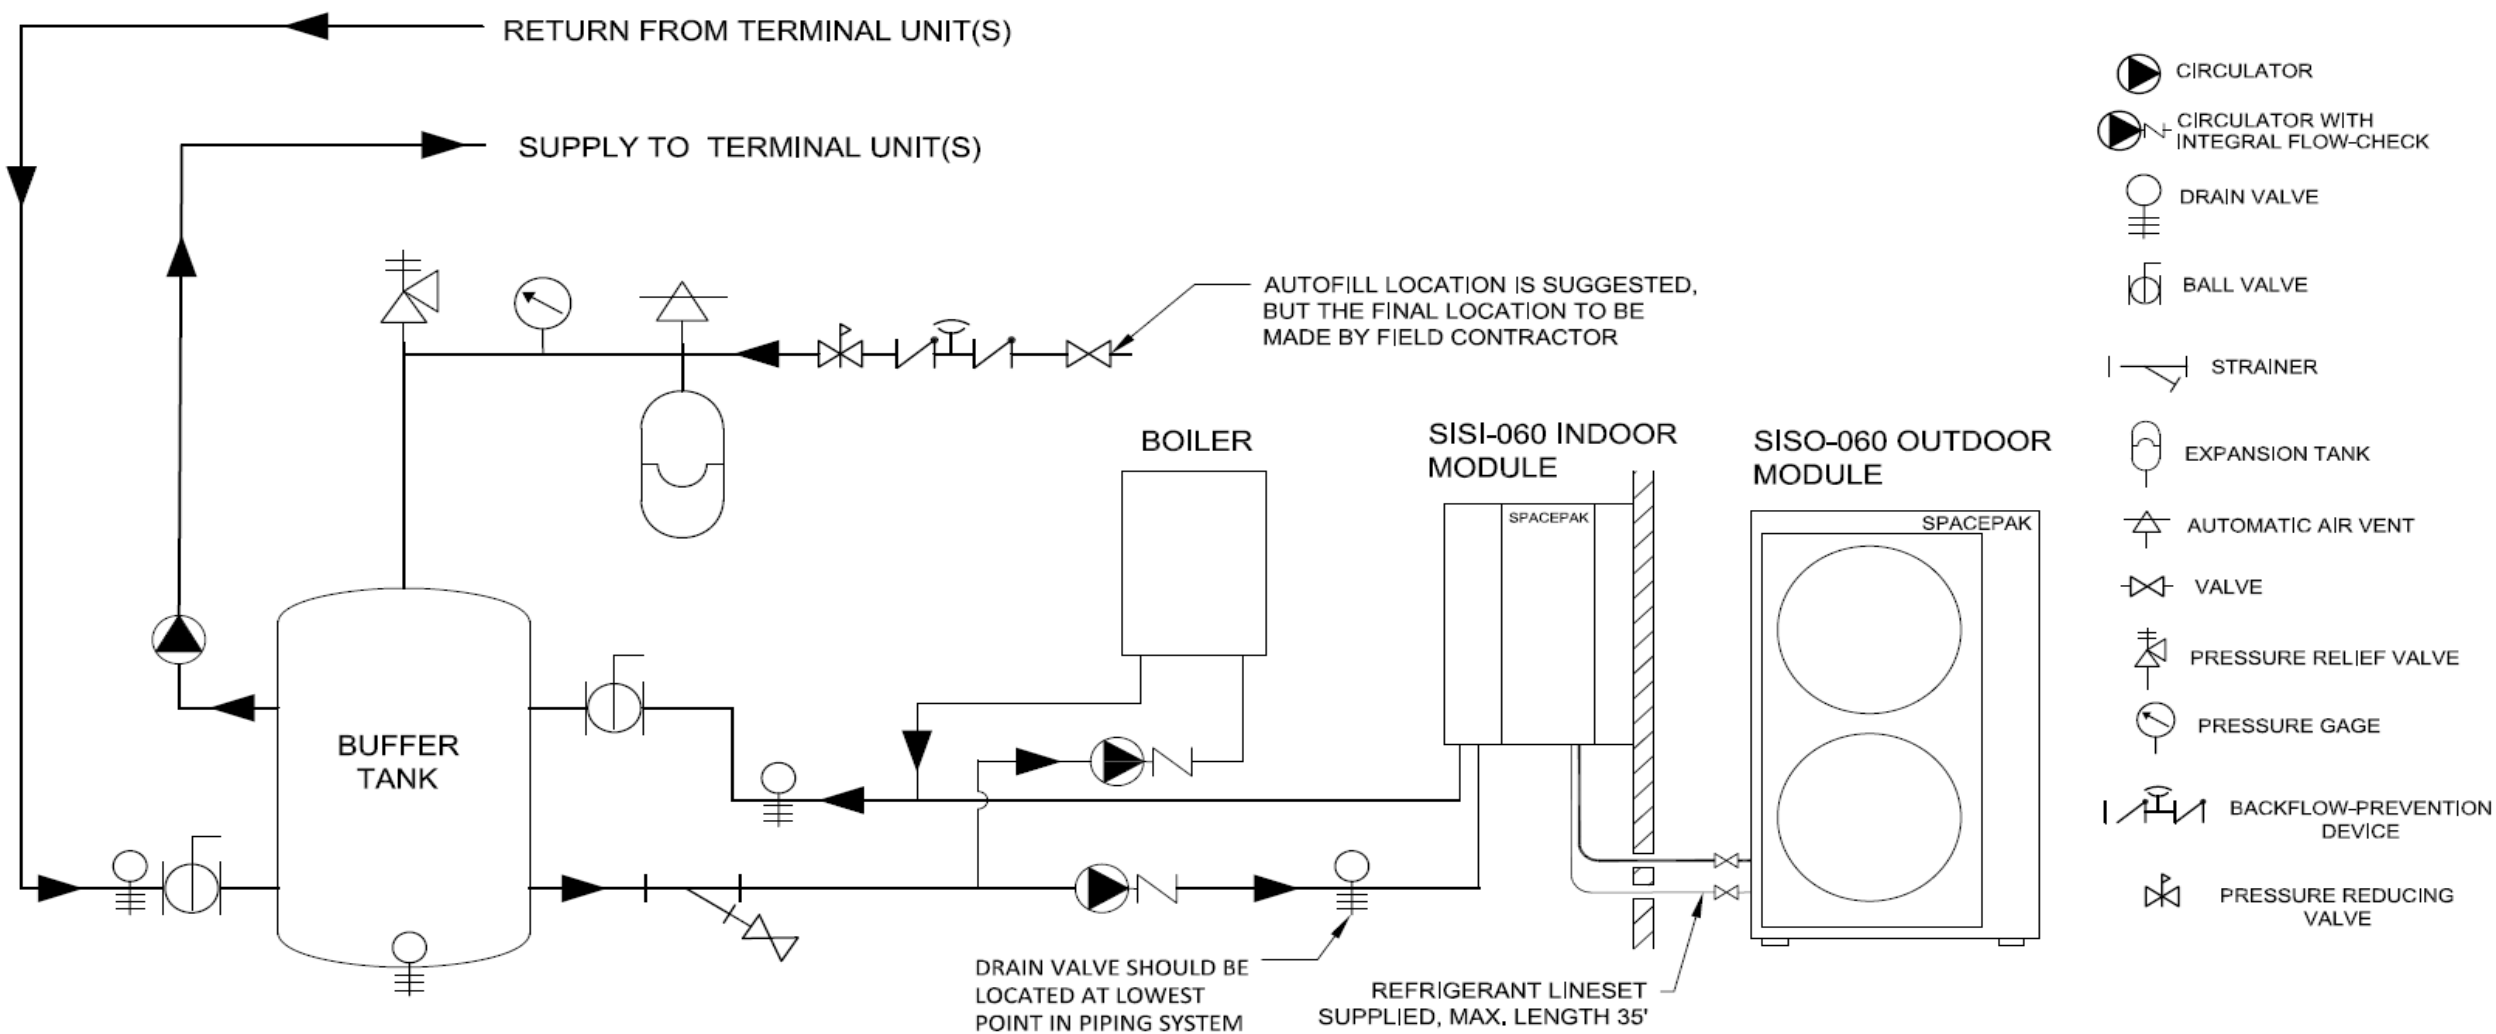


Basic Plumbing Options

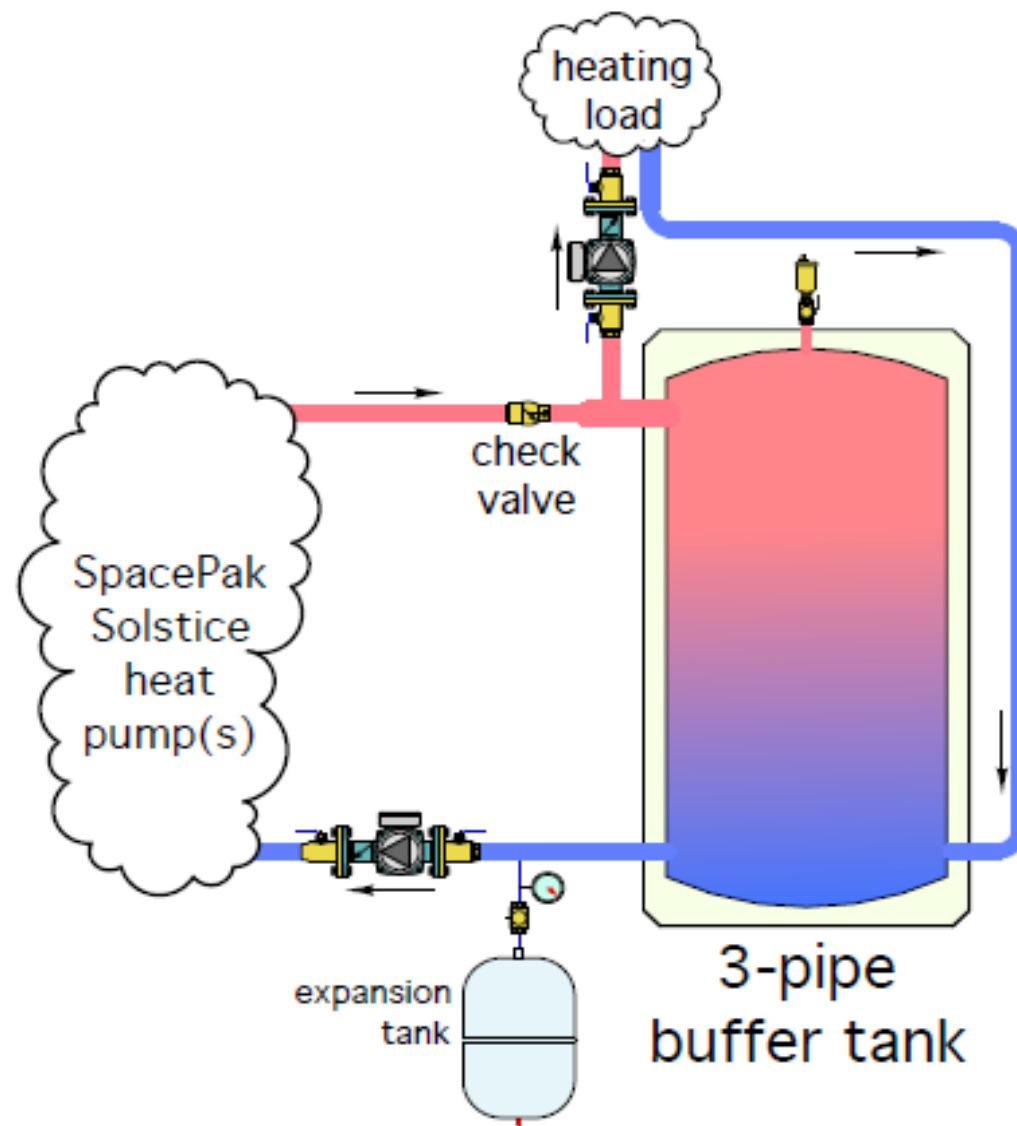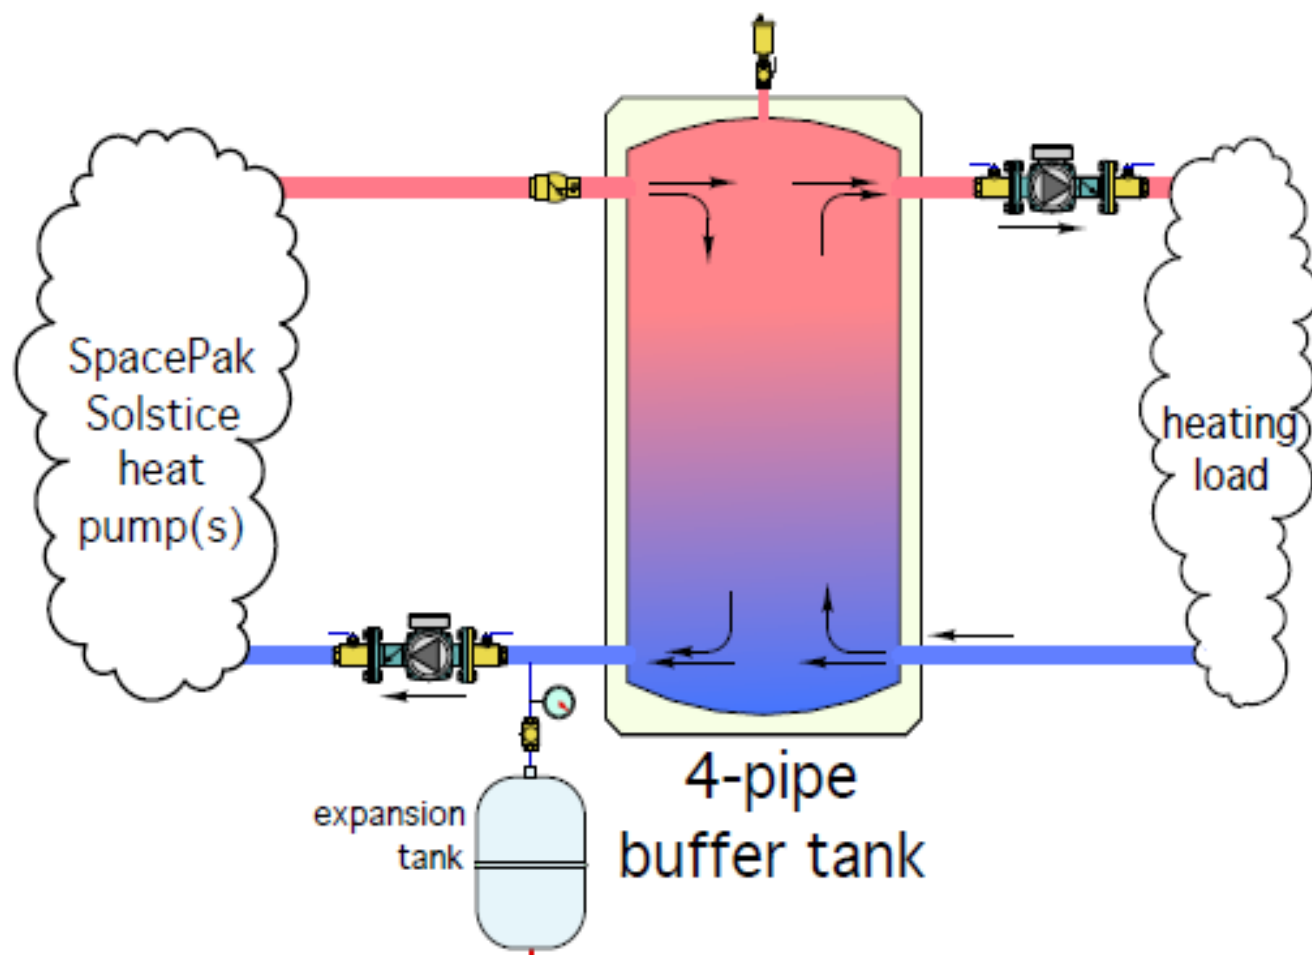


Heat Pump with Thermostatic Valve Application

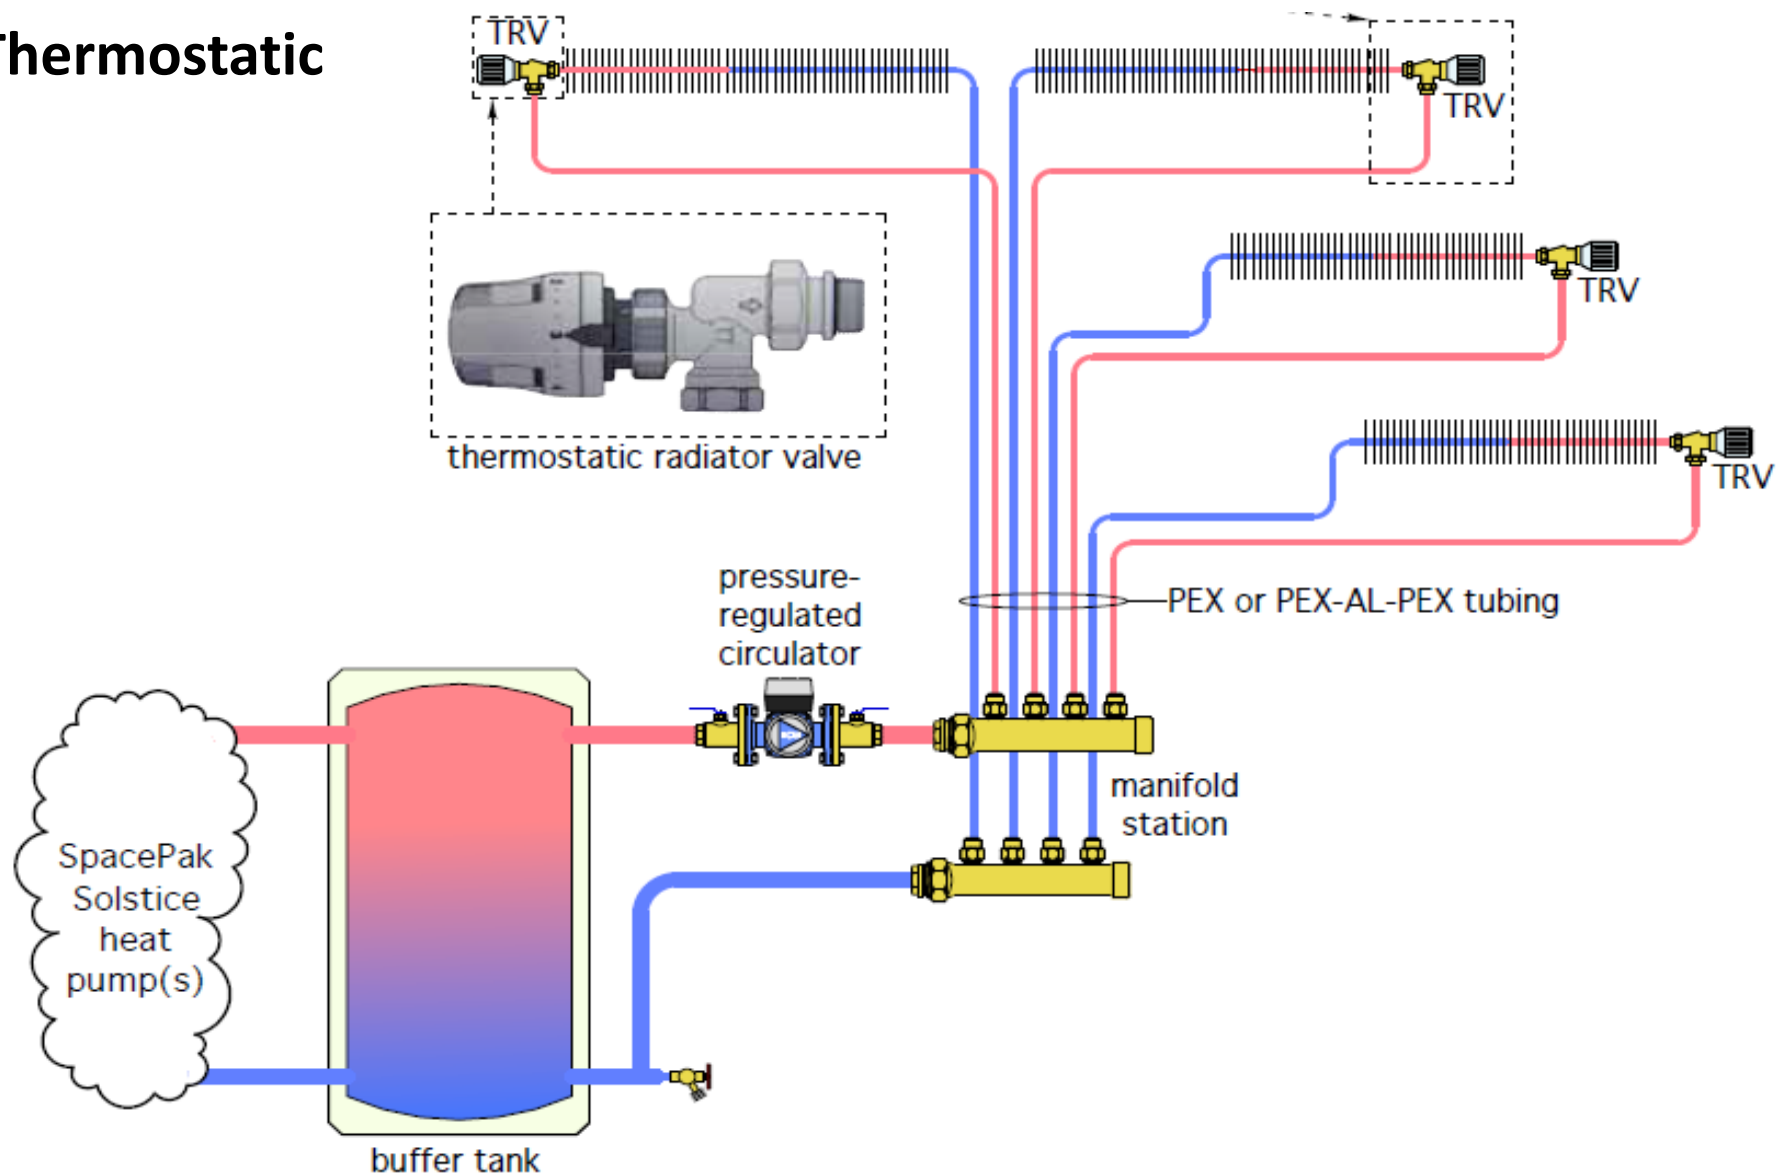

Panel Radiators

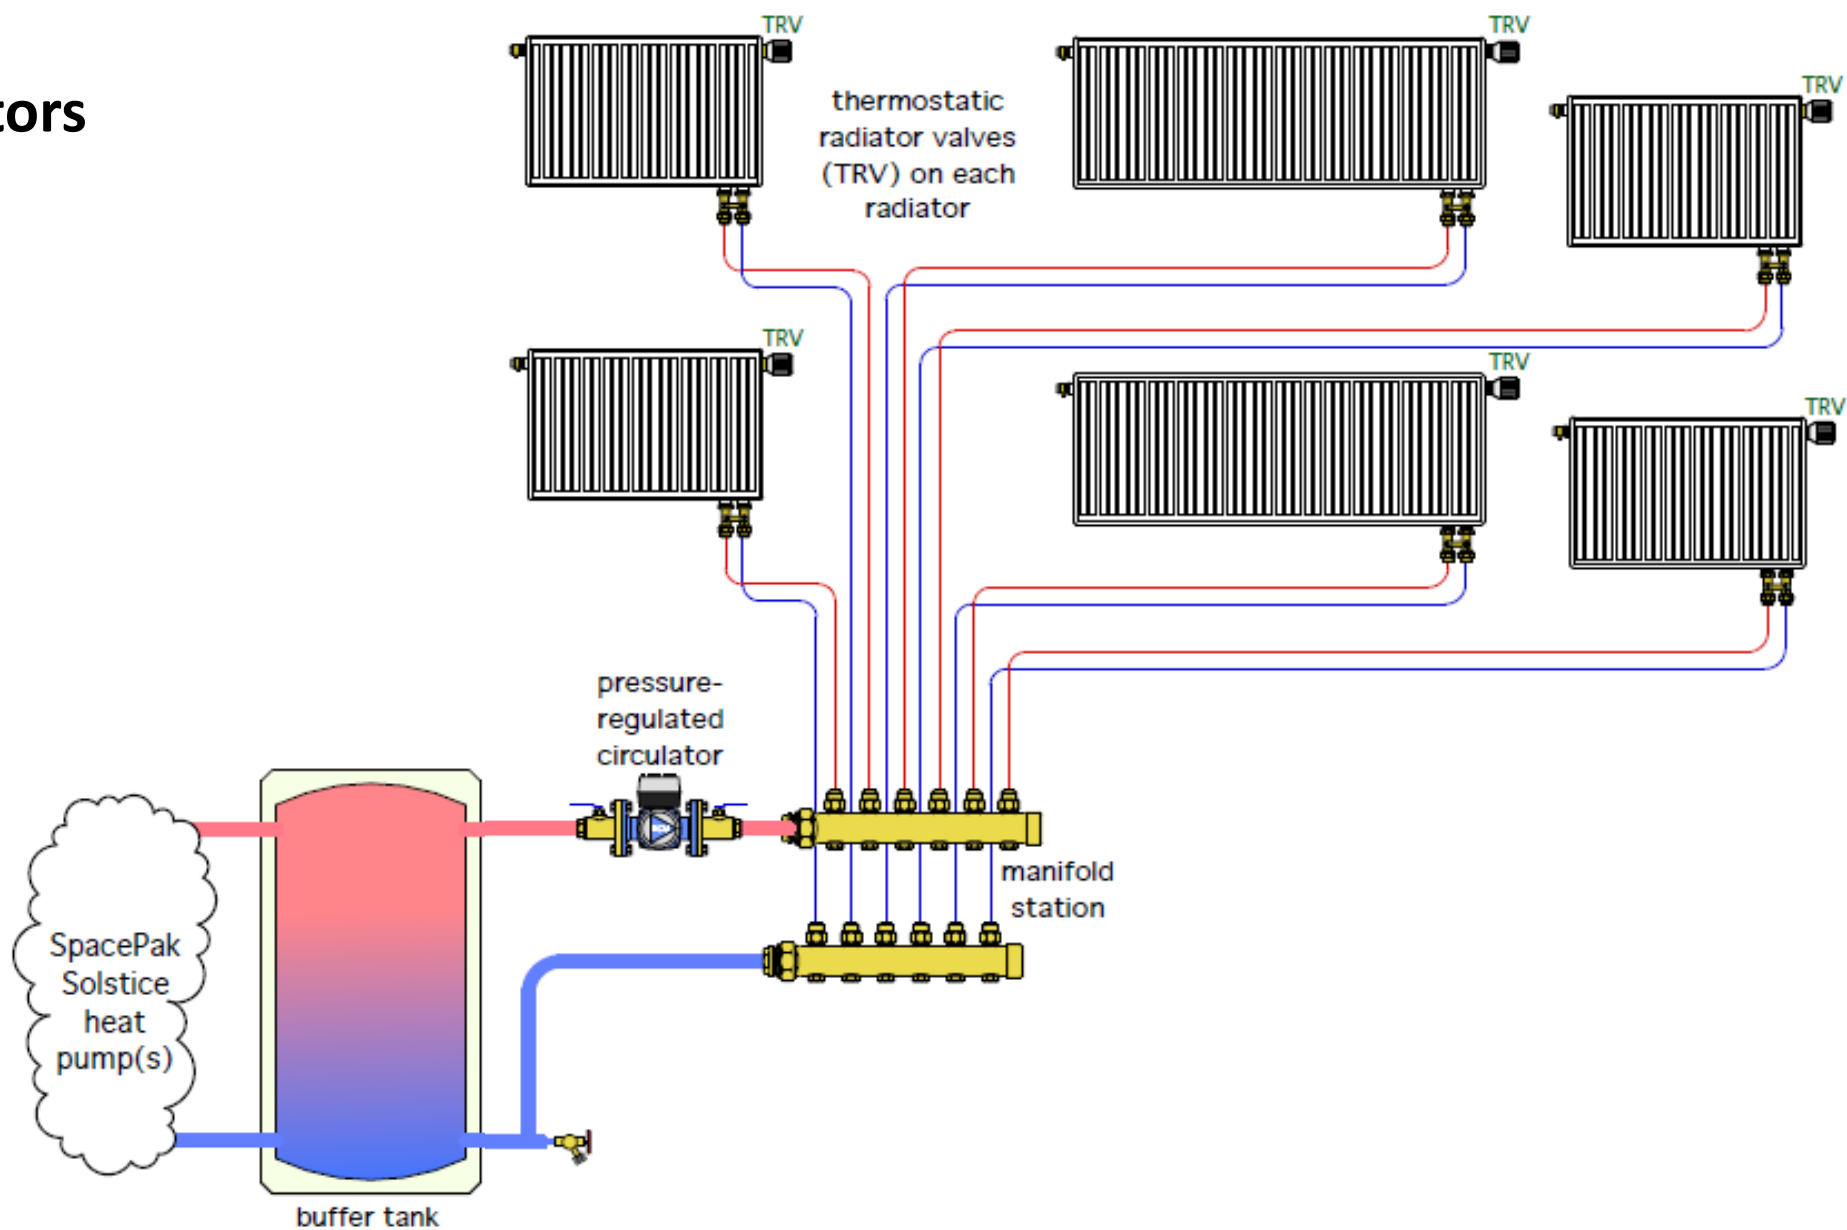


Zoned Radiant Applications

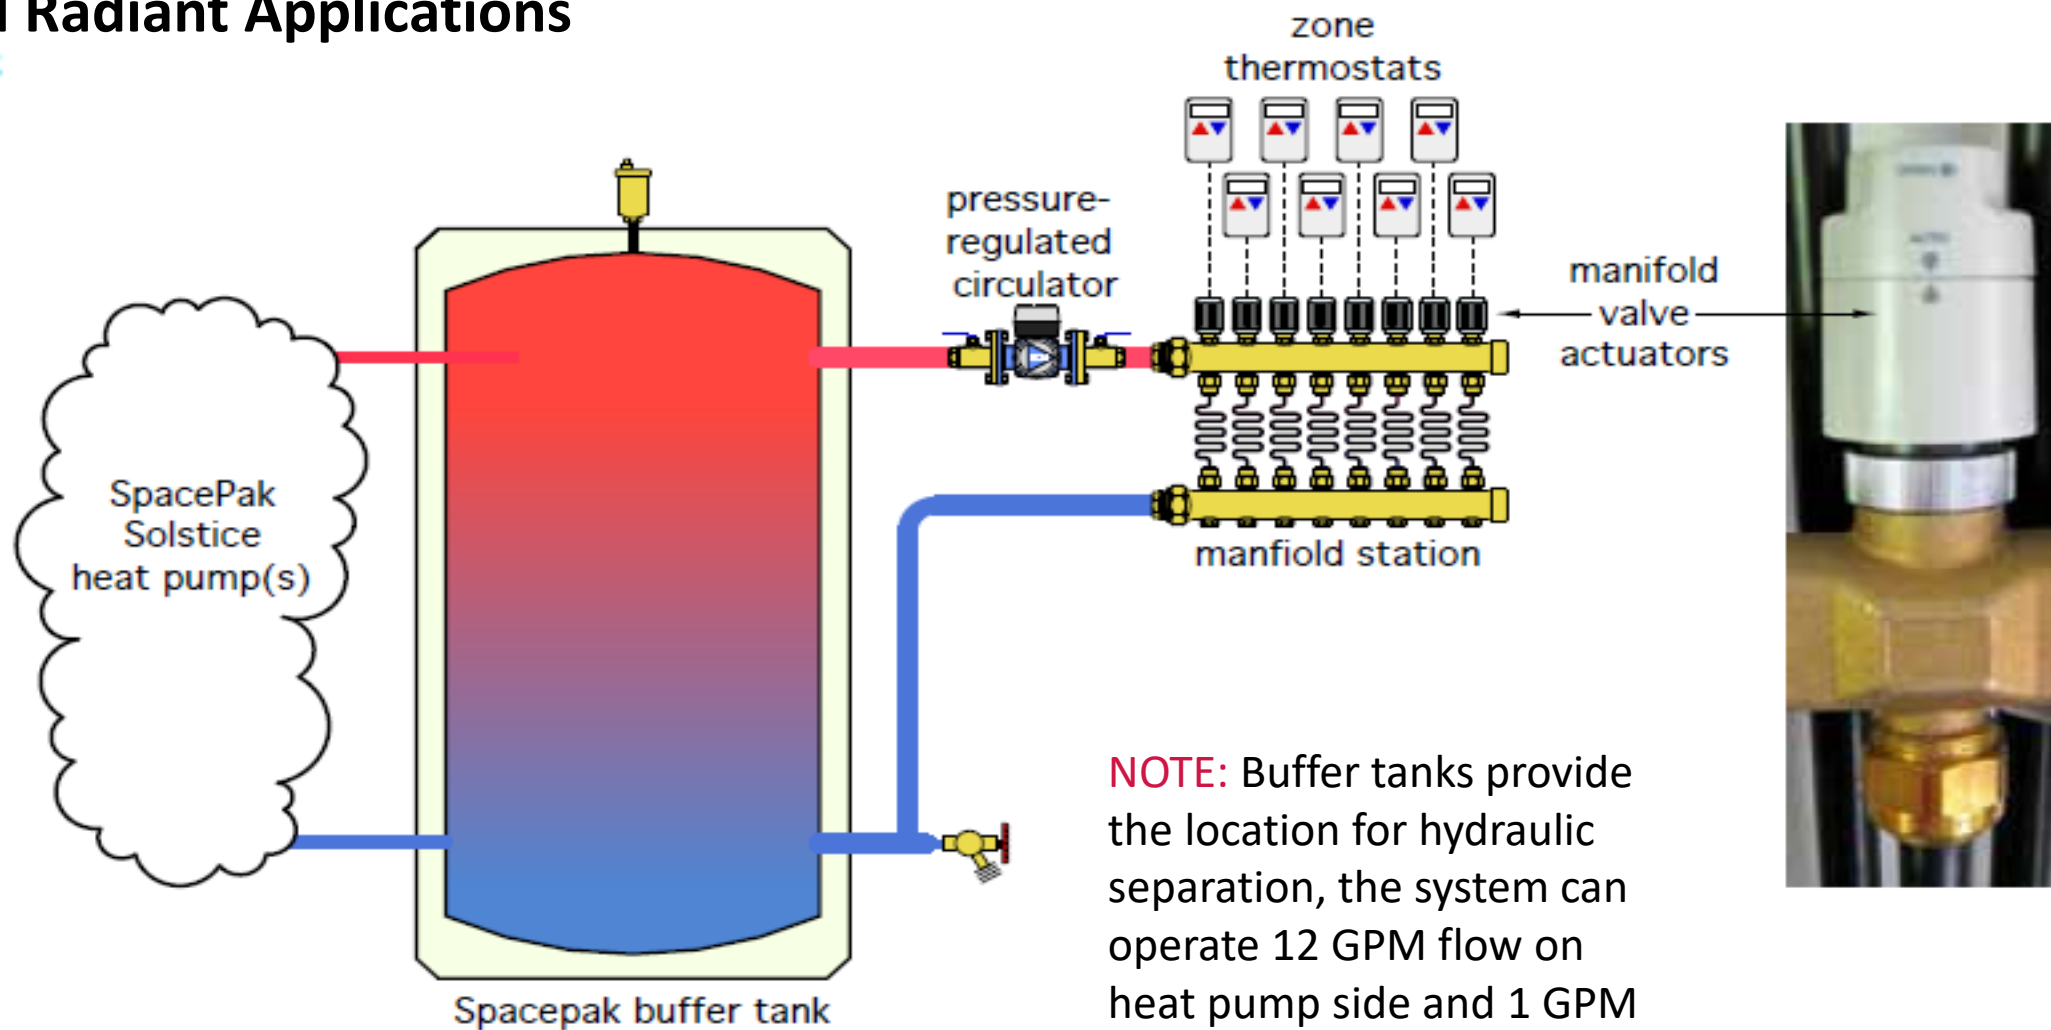


NOTE: Buffer tanks provide the location for hydraulic separation, the system can operate 12 GPM flow on heat pump side and 1 GPM on the system side.


Radiant Heating with HW Reset

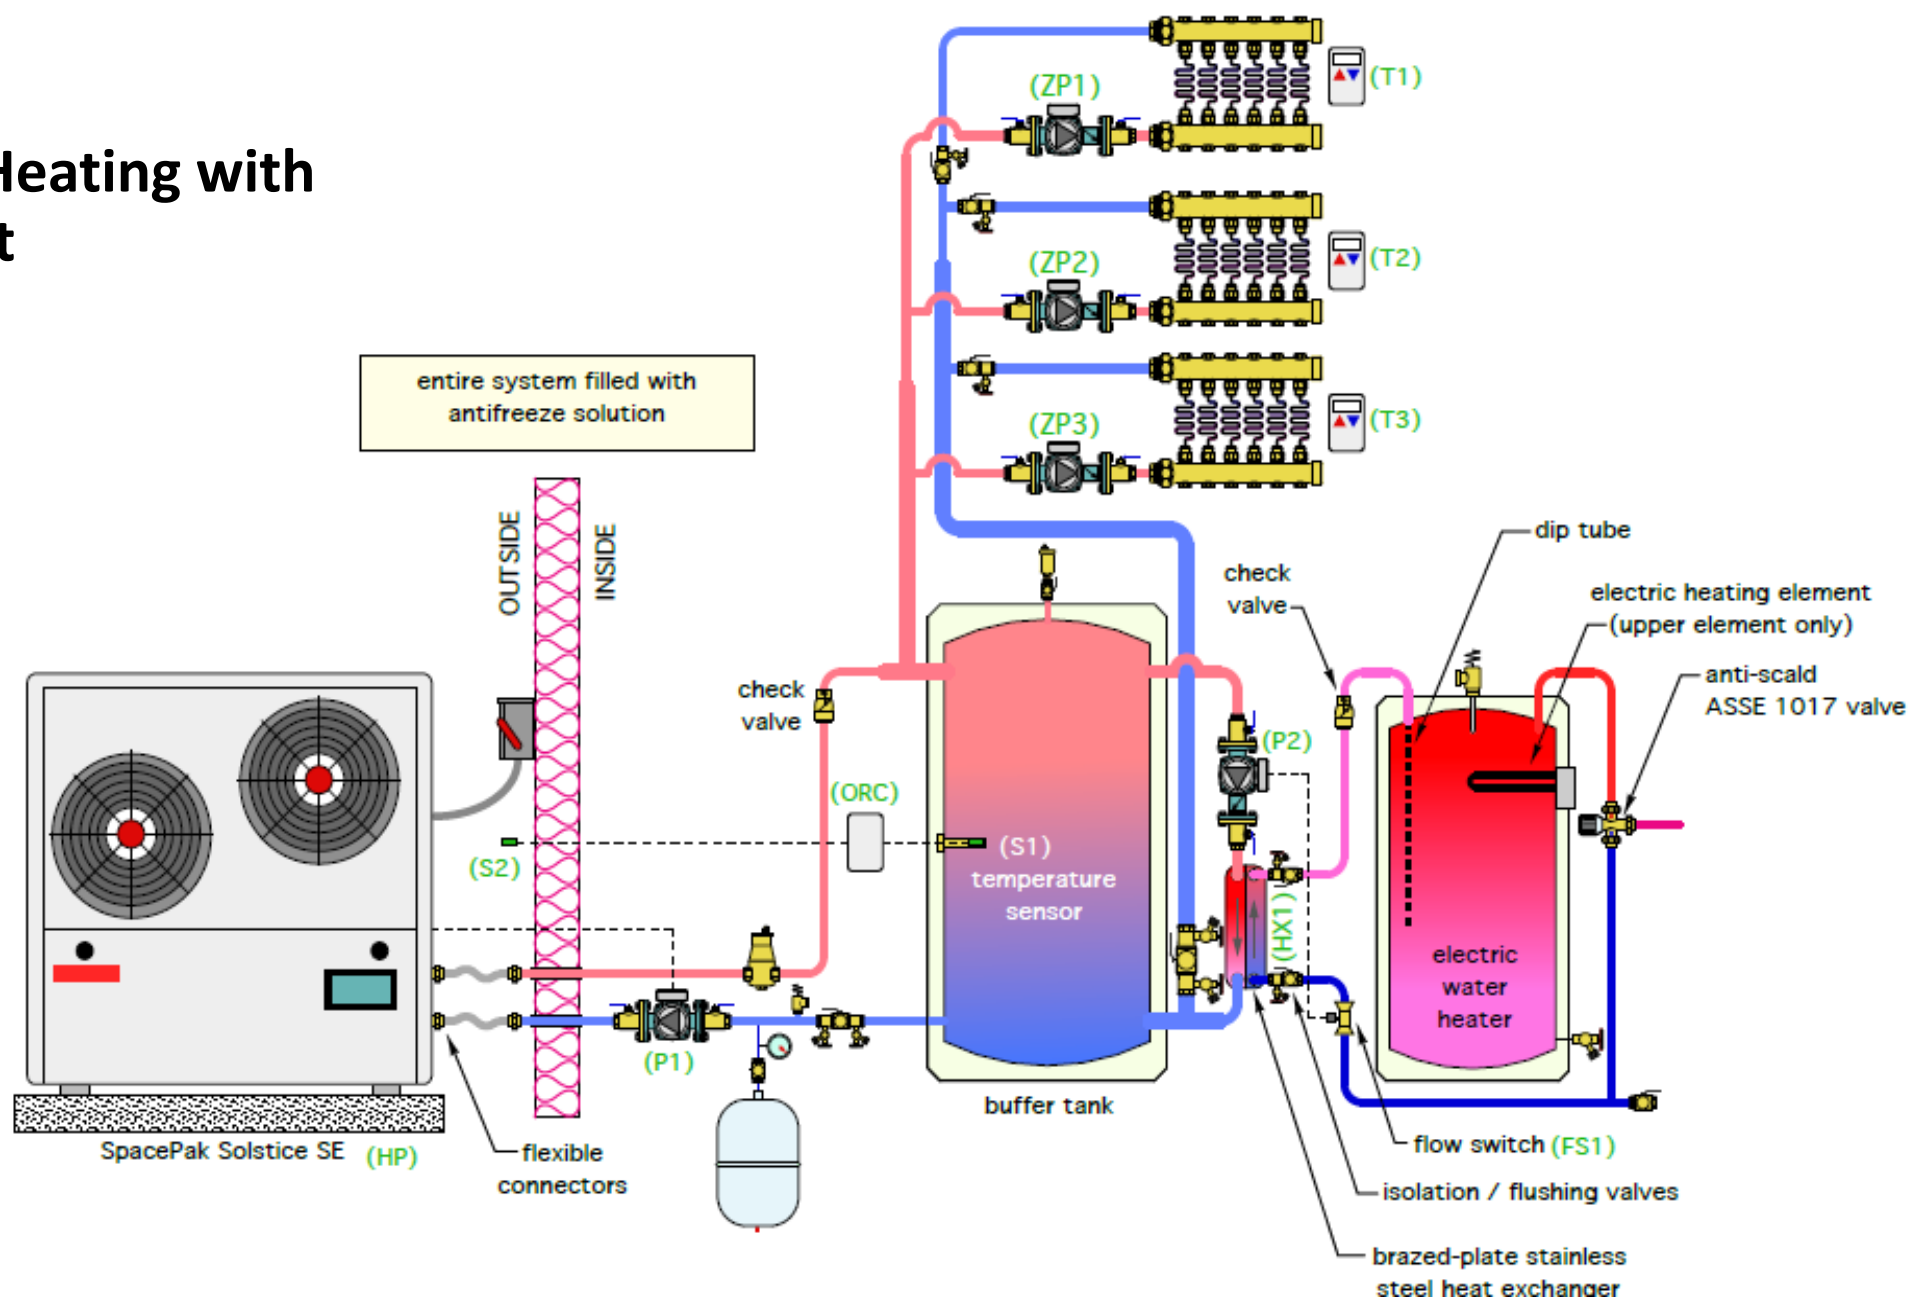

Radiant Heating & Cooling with HW Preheat and 2 Buffer Tanks

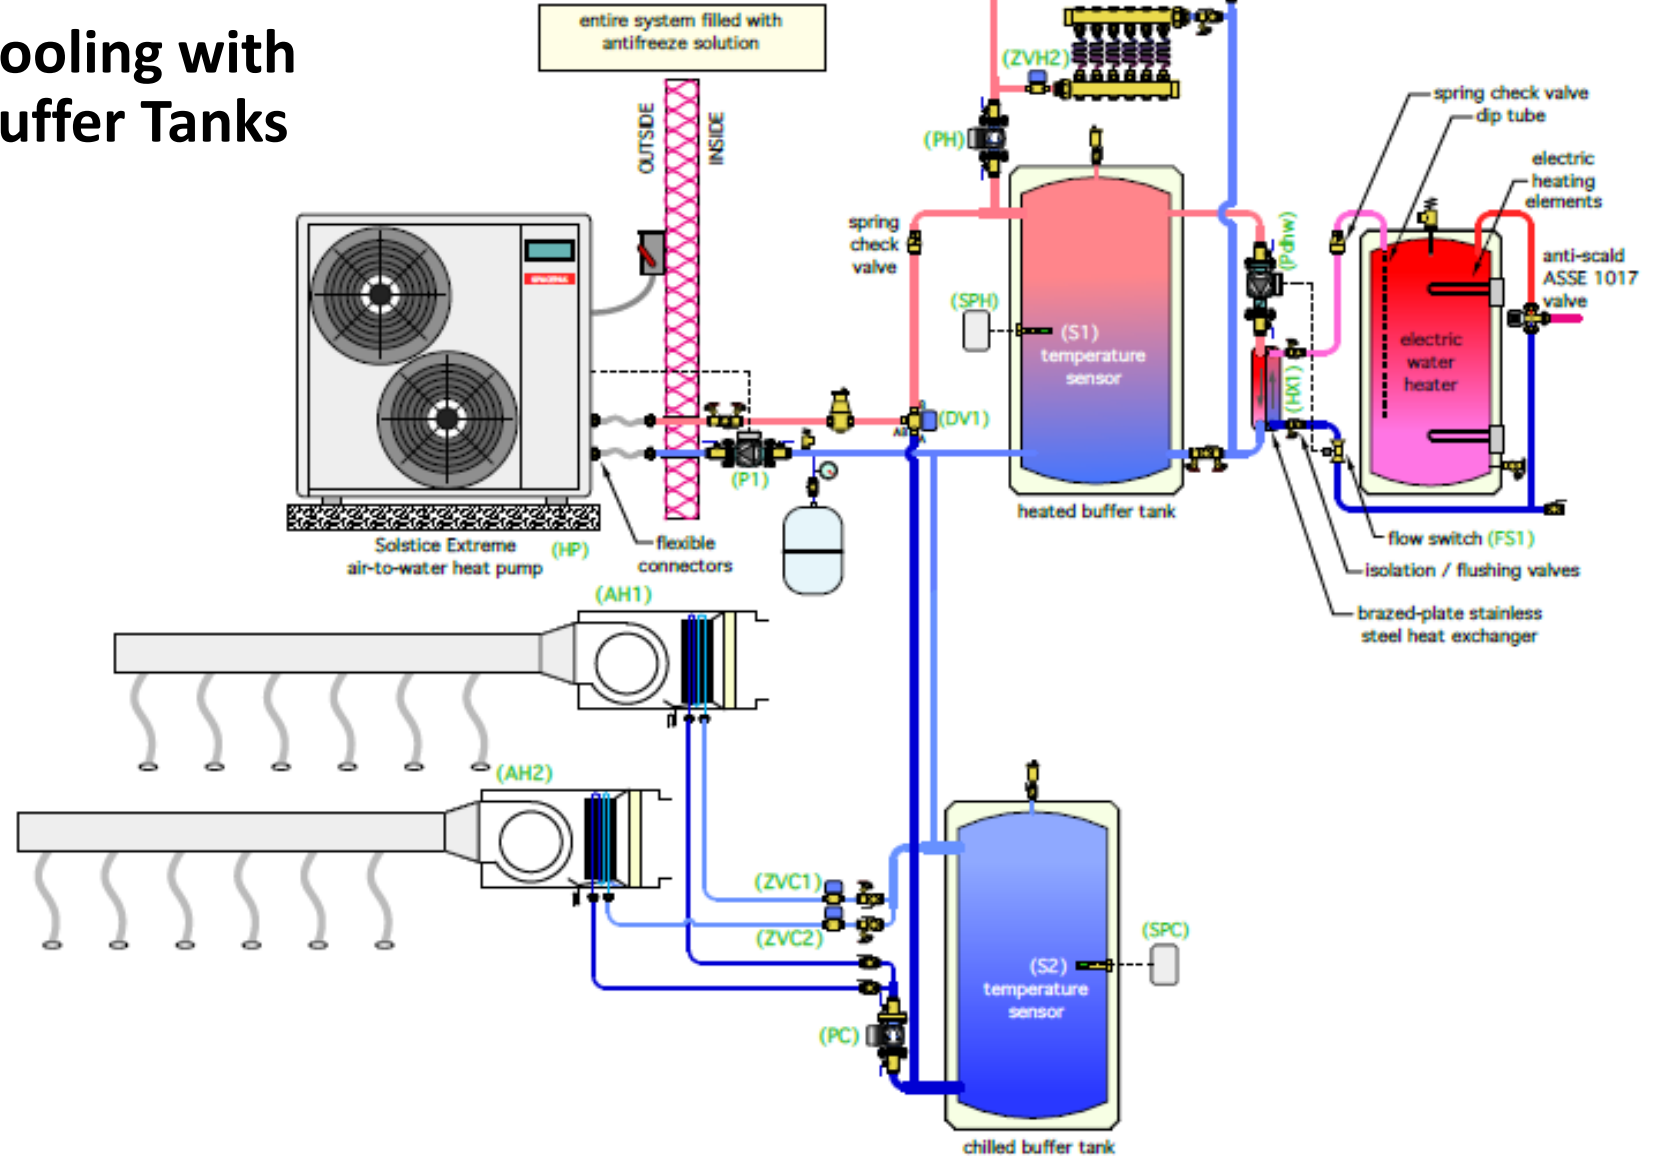

Heating & Cooling with Boiler and HW Preheat

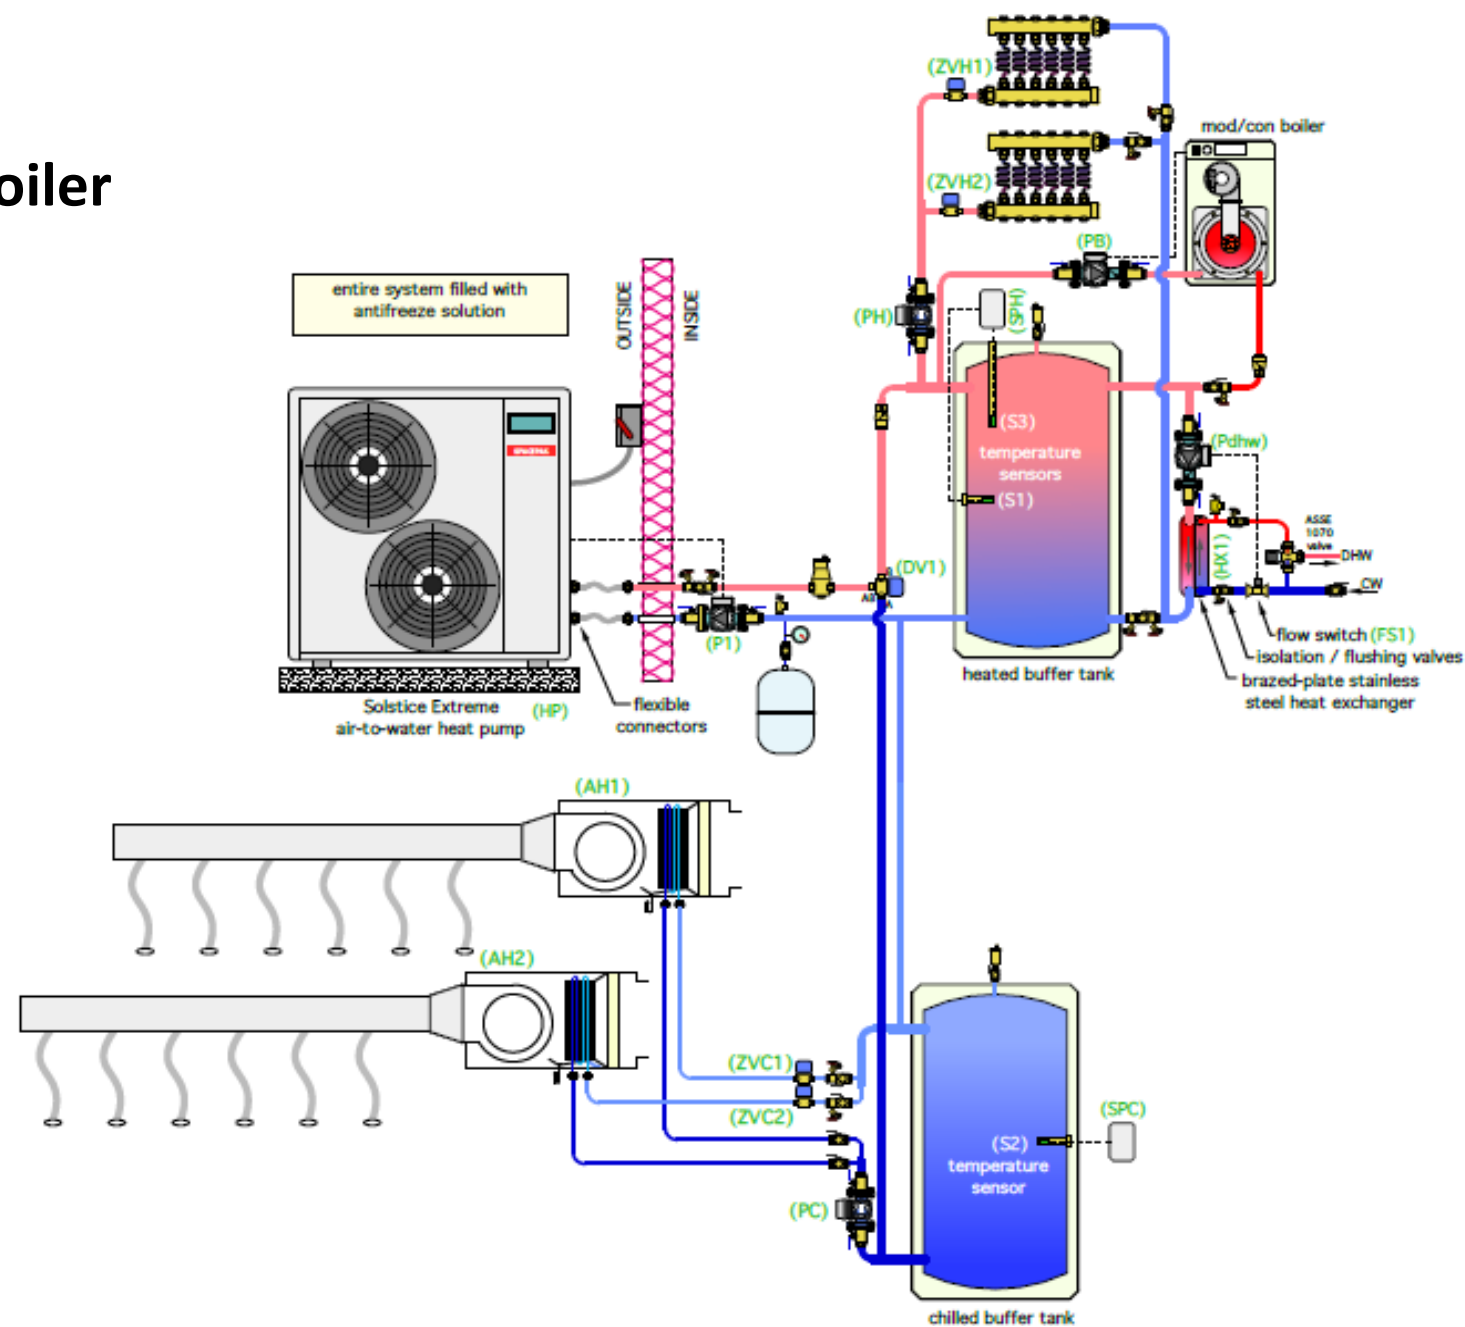

PLEASE DON'T...






—
Questions?

Plate Exchanger Considerations

- Be sure to size heat exchanger properly
- Cold water applications react differently than hot
- If not sized properly short cycling **WILL** occur
- Buffer tank target temperatures are subject to and limited by the exchanger and its capacity
- Cold water temperature differentials can be affected more than in heating applications

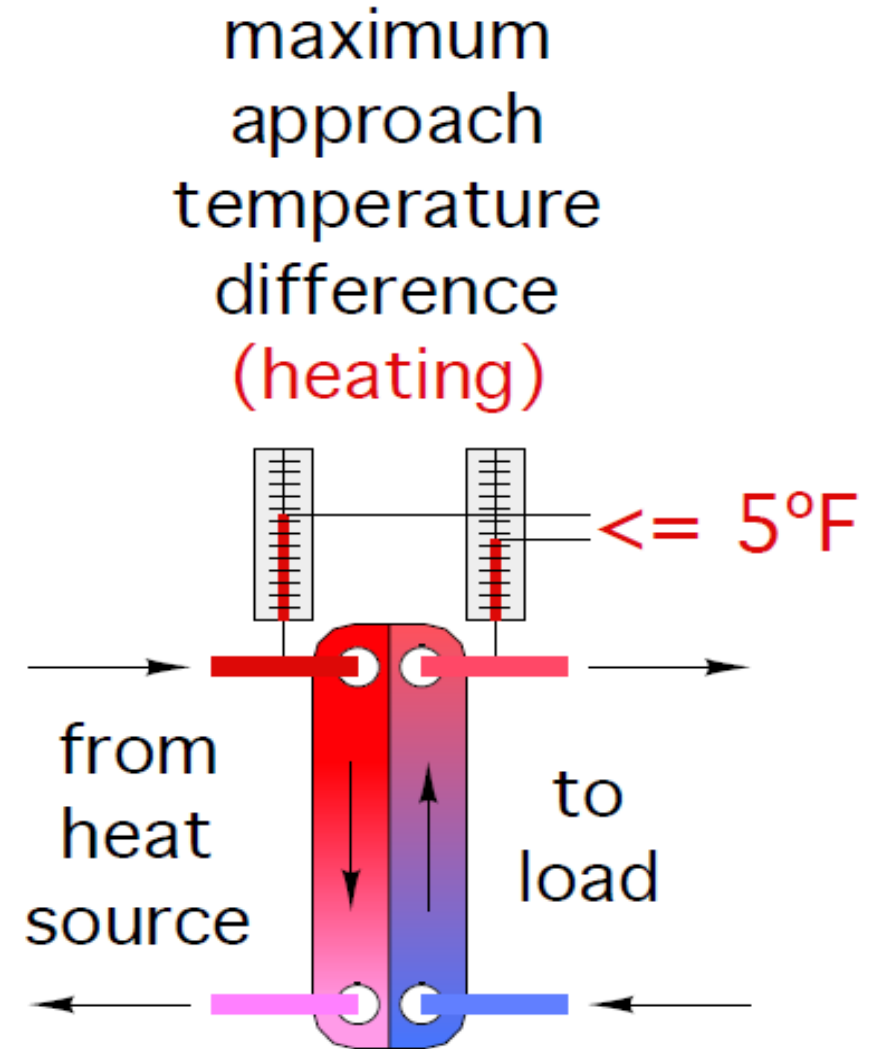

Heat Pump with Plate Heat Exchanger


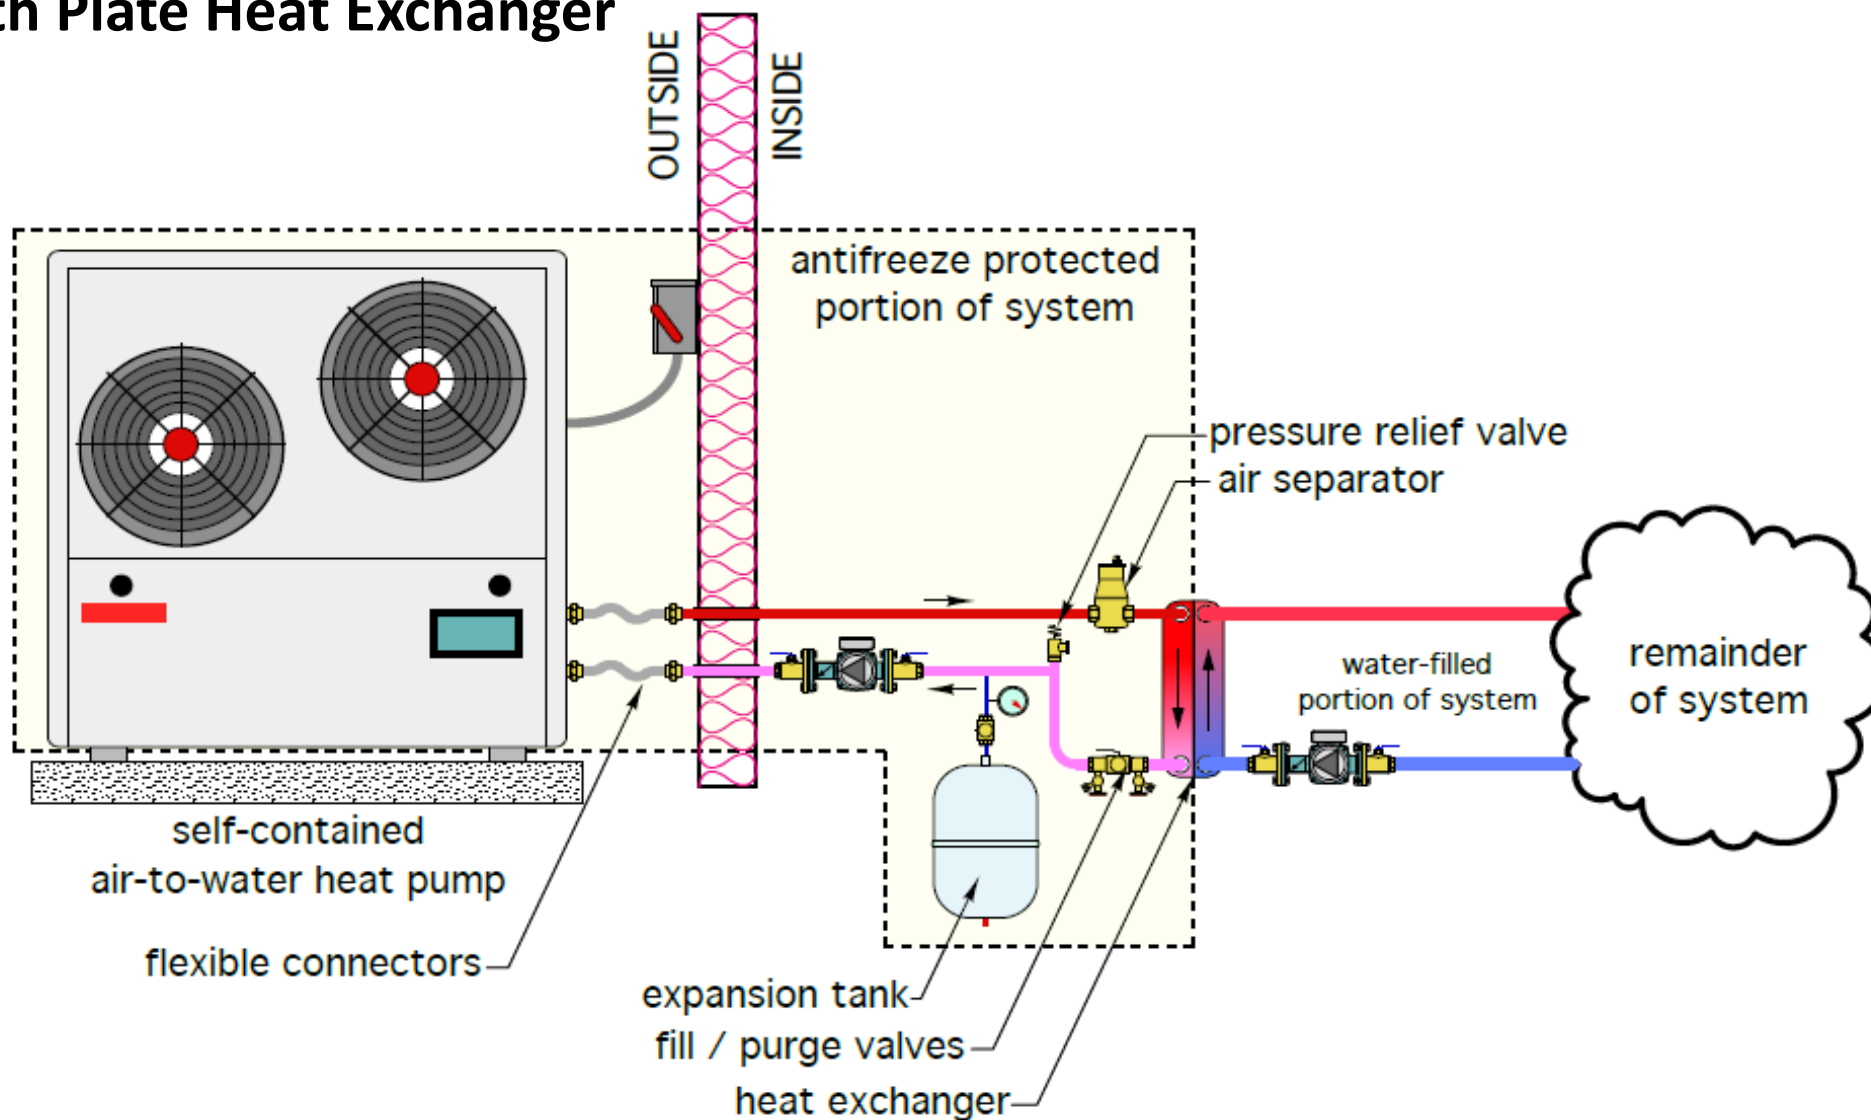


Plate Exchanger Application (900 gallons of storage)



Insulate-Insulate-Insulate

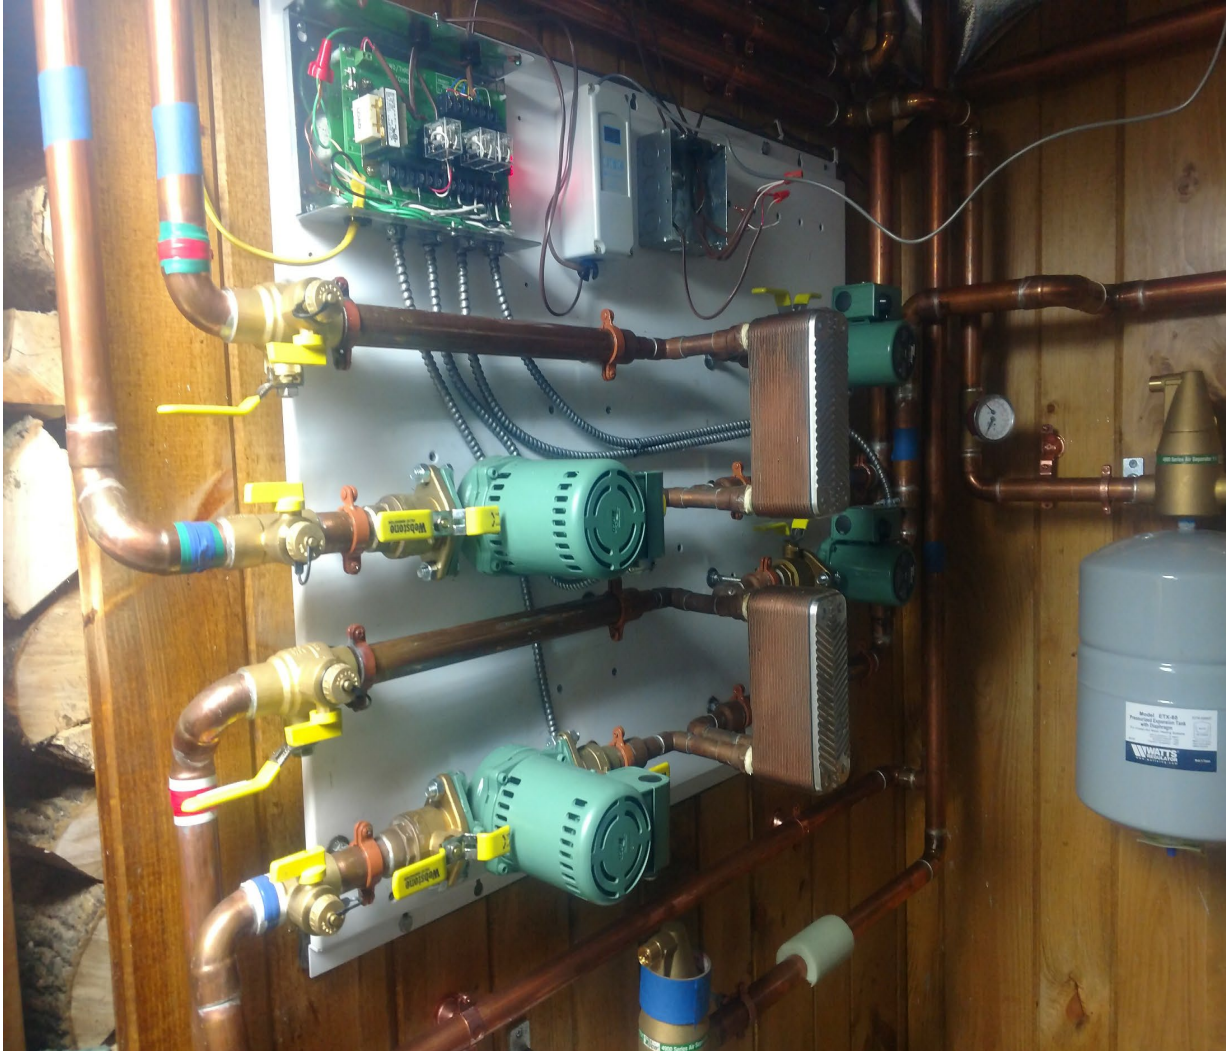


Chilled water WILL
result in condensation!



RETURN FROM TERMINAL UNIT(S)

SL

Controls

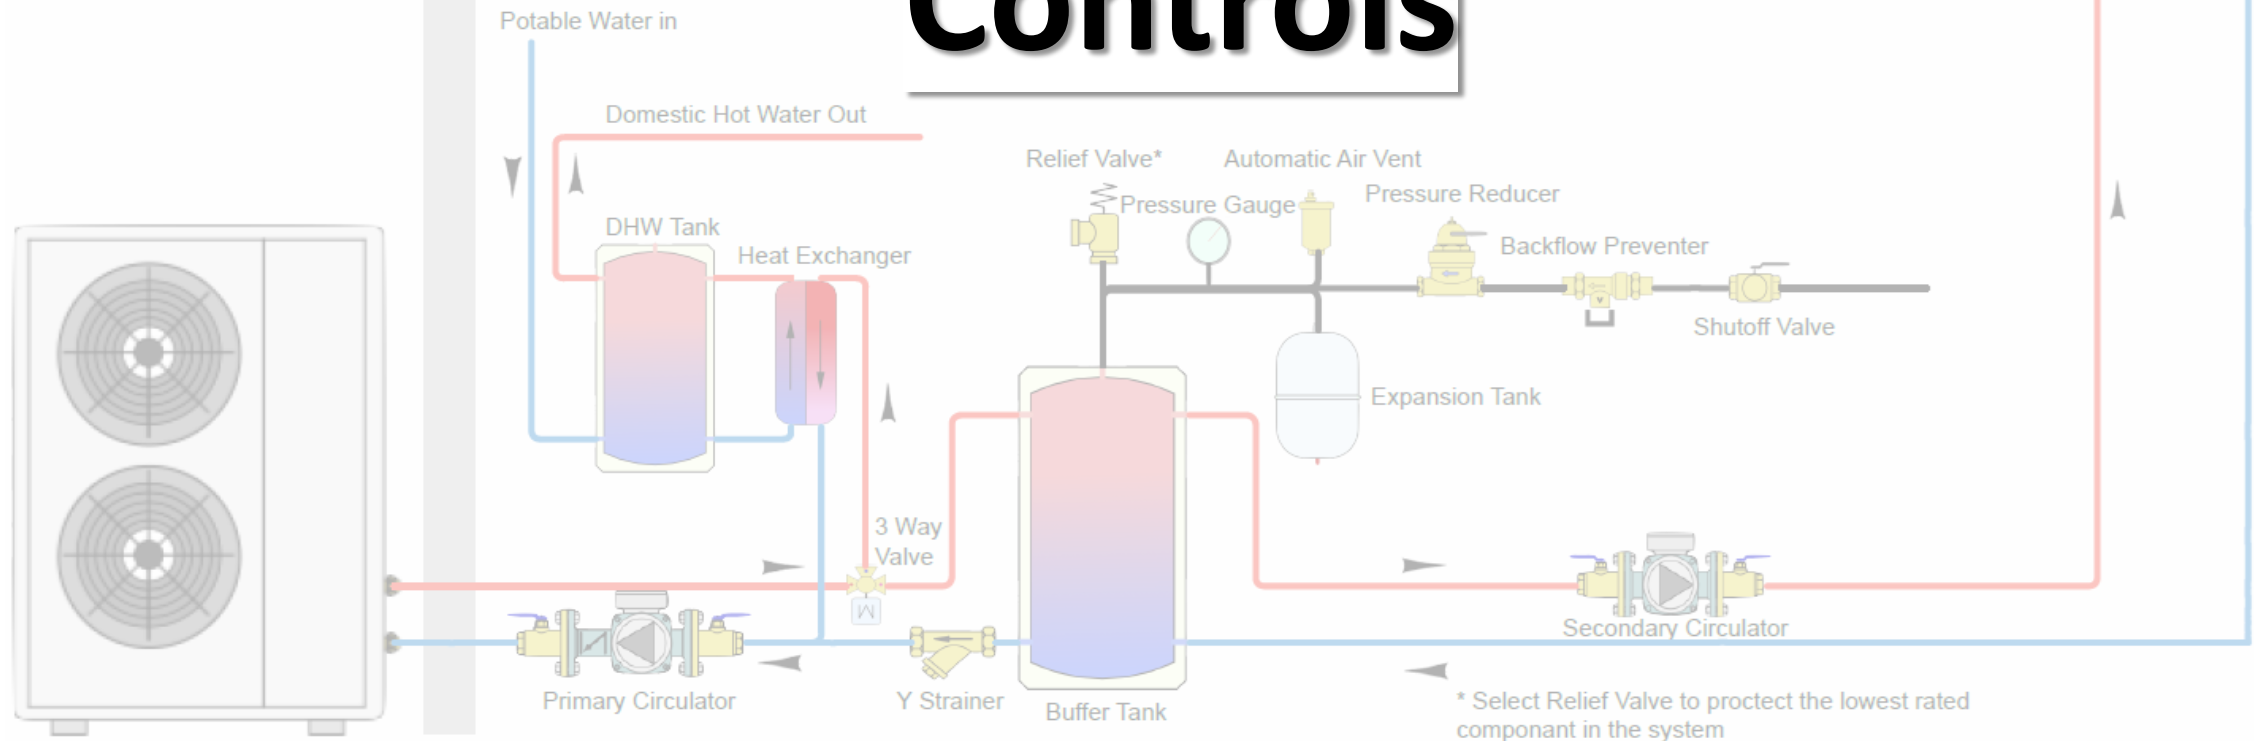

SpacePak System Interface Control (SSIC)

The SpacePak SSIC System Interface Control takes inputs from up to five air handlers and outputs the system signals to the chiller, boiler and heat pump. Air Handlers receive their calls from their respective thermostats and outputs a heating or cooling call to the SSIC. Based on these demands, the SSIC determines how to operate the system.

Standard Features


- Outdoor Air Temperature Sensor
- Water Temperature Sensor
- Buffer Tank Sensor




SSIC Standard Features

- Basic Modes Include- Boiler Only, Chiller Only, Outdoor Temp Switch over, boiler help and staging and outdoor reset
- Normal Zone Controlled Mode- Used when there is not a need to maintain a buffer tank temperature
- Buffer Tank Priority- Maintain a constant heating or cooling setpoint within the buffer based on outside temperature
- Buffer Tank Setpoint Curve- Maintain a varied buffer setpoint based on outside air temperature (coming soon)
- Boiler Help Mode- Based on the buffer tank set point, OAT and differentials the boiler can be called on during a heating cycle to assist the Heat Pump in reaching buffer setpoint under above average loads.
- Accepts individual (24V) calls from Air handlers (or terminal units when properly equipped) for proper operation during times where outside temperatures do not require the buffer to maintain a specific temperature
- Auxiliary Pump relay – For use when a Primary system pump is needed ex. zone valve system
- Buffer tank Bypass function- for use when the oppositely maintained tank temperature is needed for a short amount of time
- Unit Staging and rotation (20 systems)
- Multiple tanks maintained (Hot and Cold) (Cold and DHW) (Hot and Hotter)



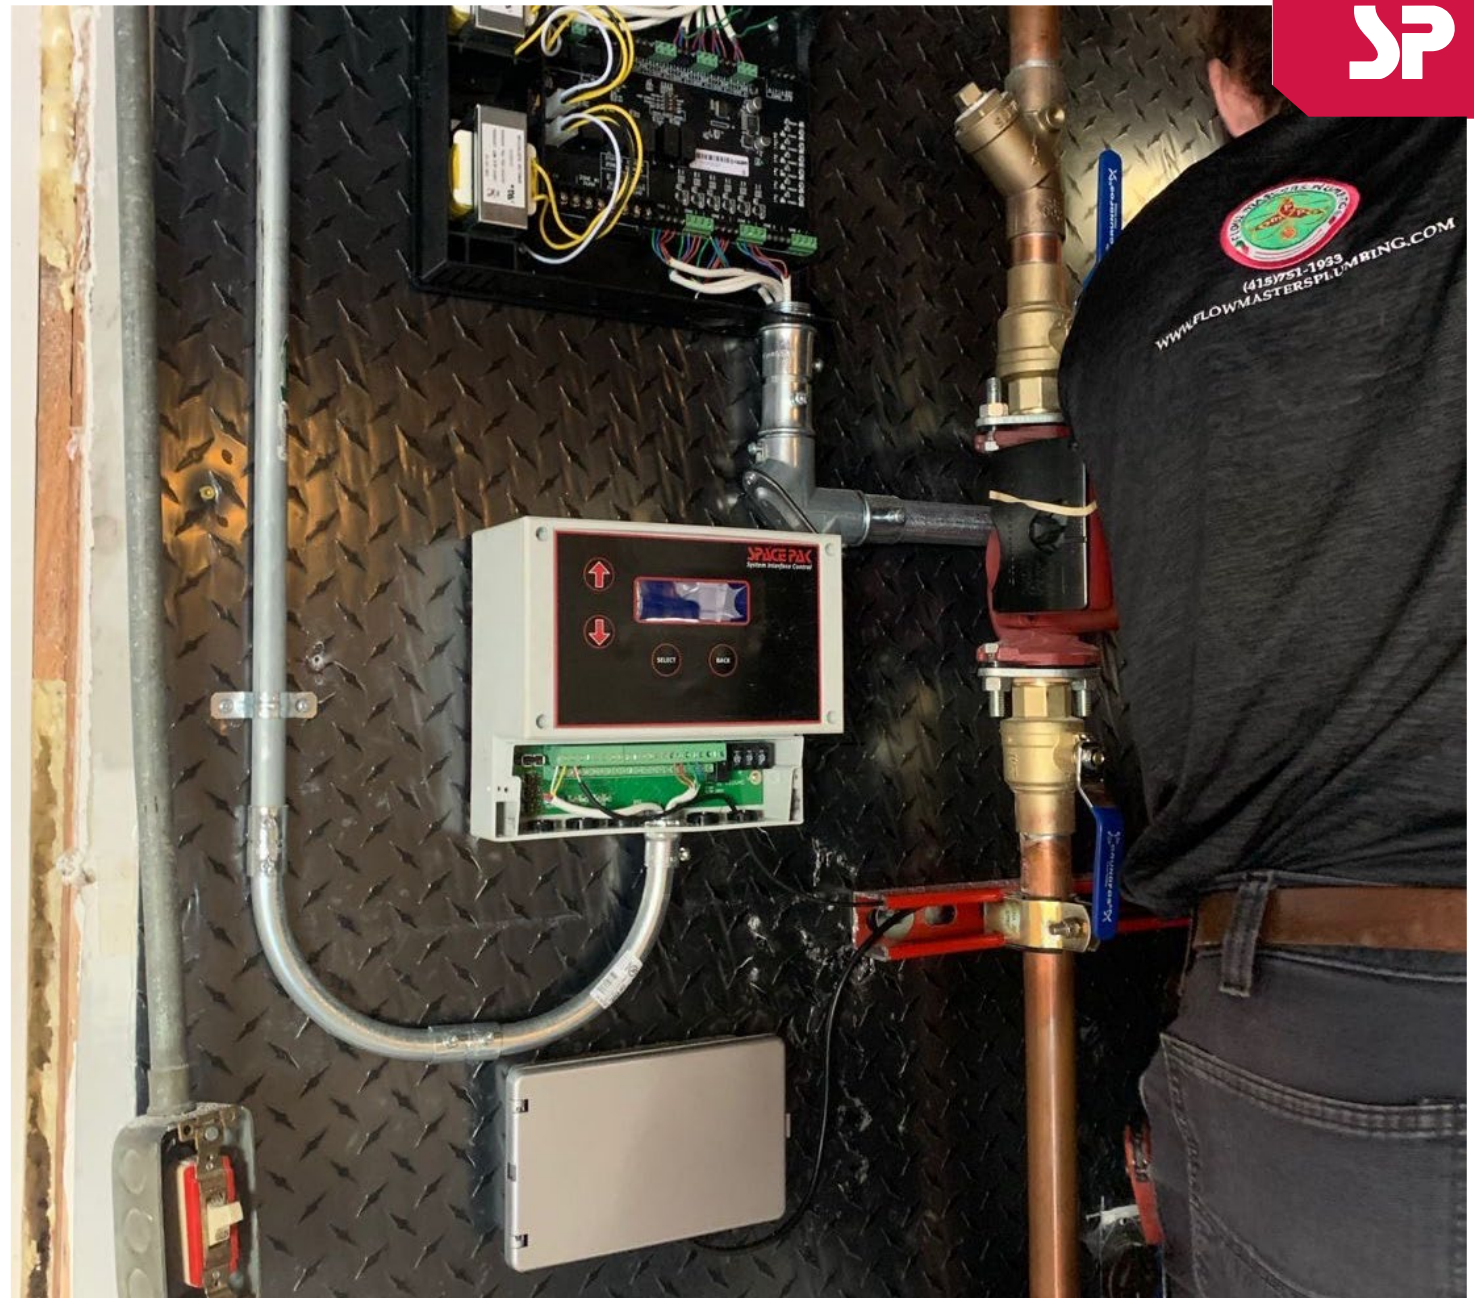


SSIC Wiring Callouts

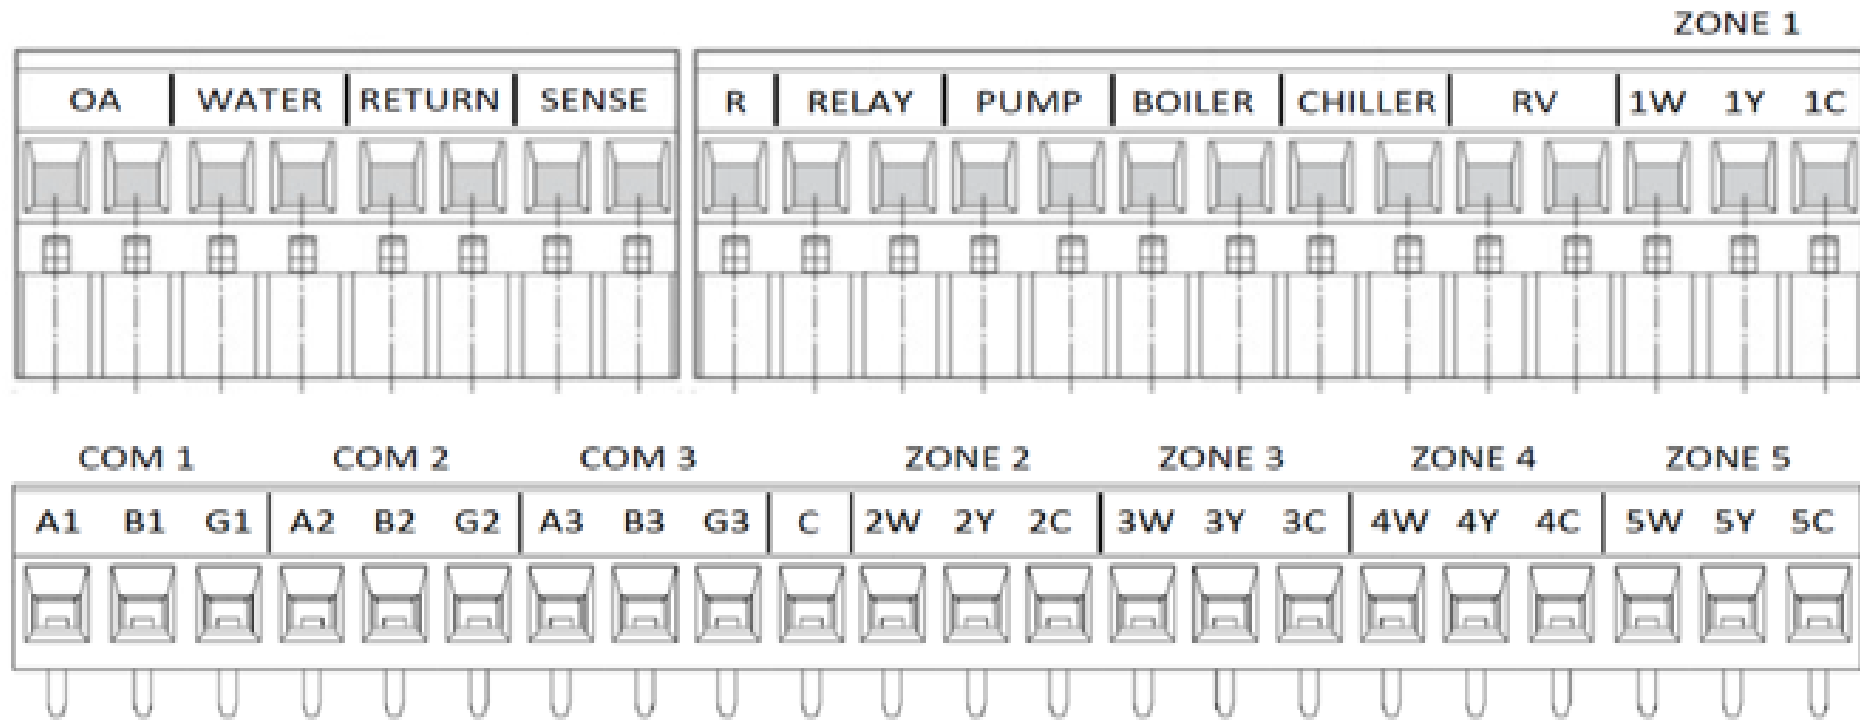


OA	Outdoor Air Temperature Sensor	ZONE X	Connection from Zone X (1-5) Air Handler
WATER	Water Temperature Sensor	XW	24VAC Heating Signal from Air Handler
RETURN	Return Temperature Sensor	XY	24VAC Cooling Signal from Air Handler
SENSE	Misc. Temperature Sensor (N/A*)	XC	Ground from Air Handler
R	24VAC	COM X	Connections for Future Models (N/A*)
RELAY	Misc. Relay for Future Models (N/A*)	C	24VAC Return
PUMP	Dry Contact Relay to activate the Pump		
BOILER	Dry Contact Relay to activate the Boiler		
CHILLER	Dry Contact Relay to activate the Chiller's enable		
RV	Dry Contact Relay to activate Chiller's Reversing Valve		

SSIC Wiring

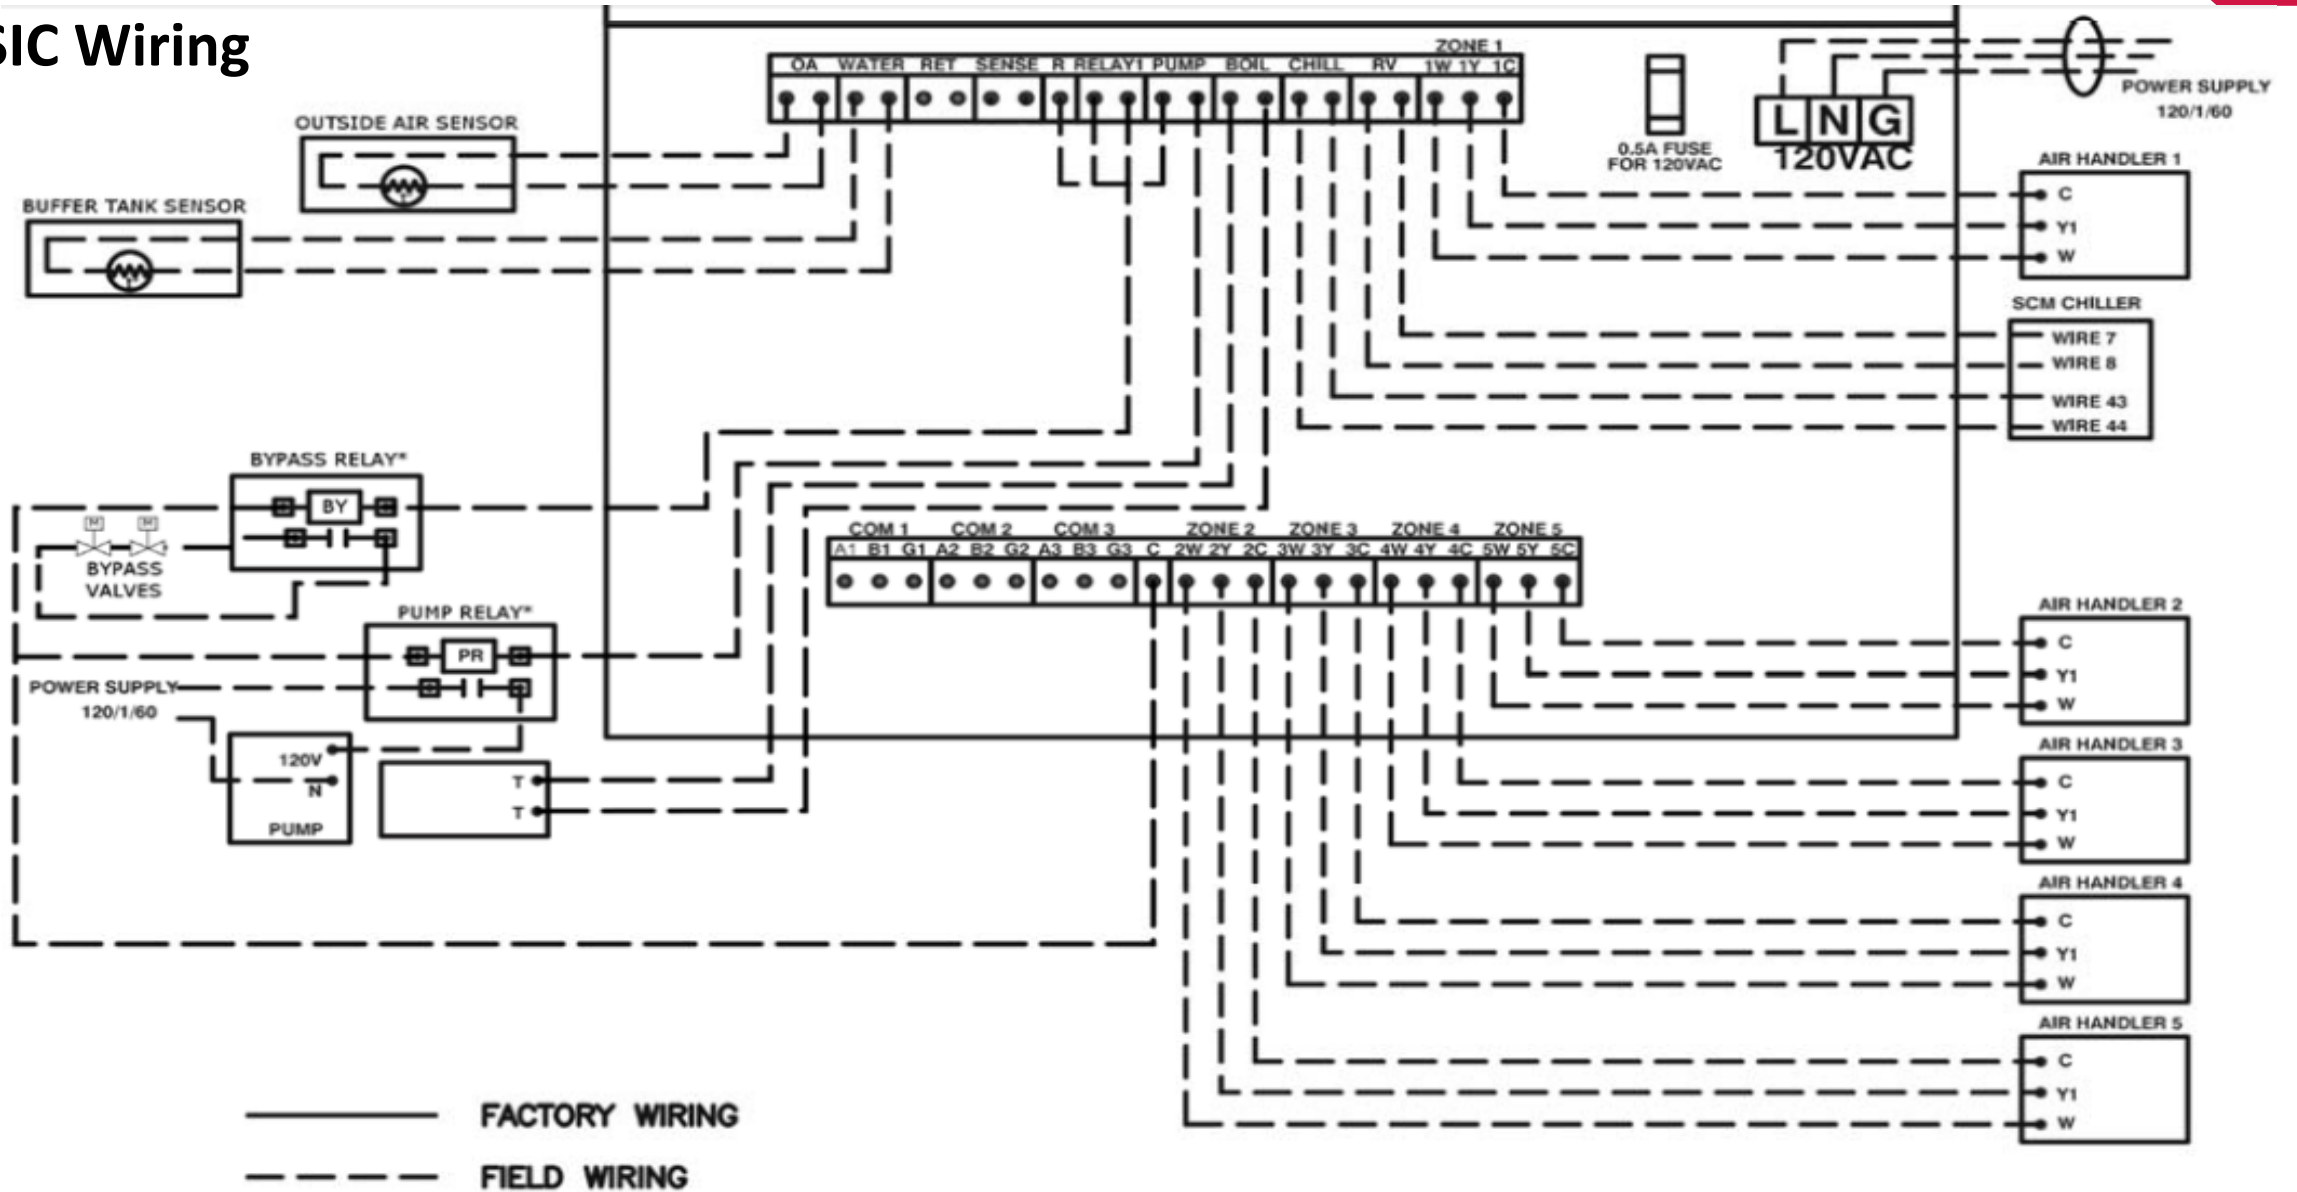

SSIC Wiring

SIM-036A4 FIELD CONNECTION DIAGRAM

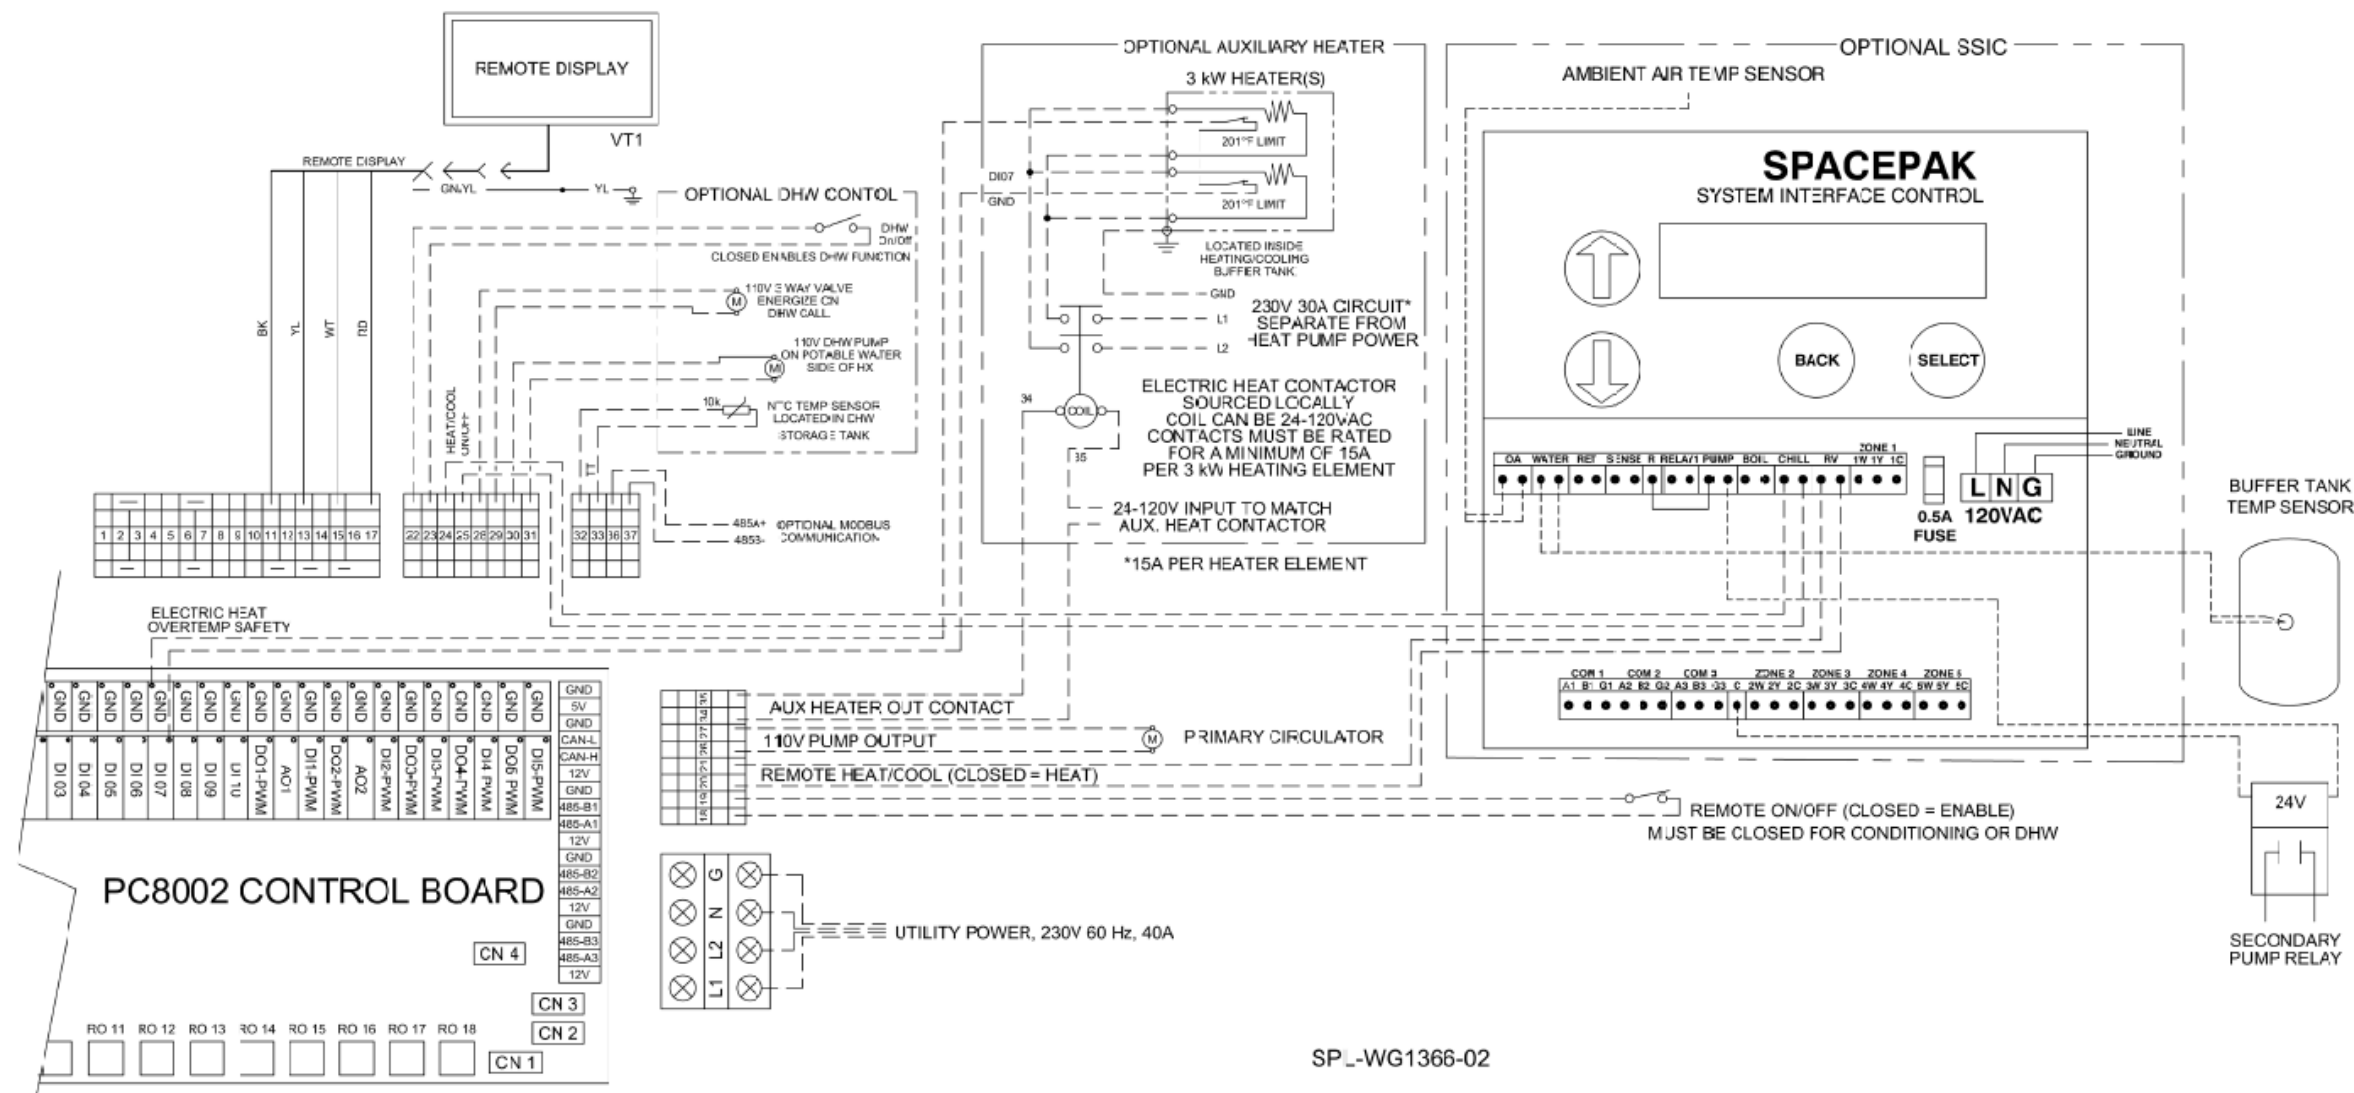

SP_L-WG1366-02

Certified Installer **Company** Registration

For licensed installing contractors
seeking certification /website listing

Only Submit One Form Per Company!

To scan QR code
open the camera on your phone
and point at the code

Link also provided in chat



Registration

Pre-Sale Application Support Team

PreSaleSupport@SpacePak.com

Available to Representatives, Wholesalers and Contractors, etc.

- System application support
- Equipment selection
- Load calculation and rough material list


Any questions regarding equipment already shipped should be directed to

TechnicalService@SpacePak.com (413) 564 – 5530



More questions?

www.SpacePak.com/RepLocator

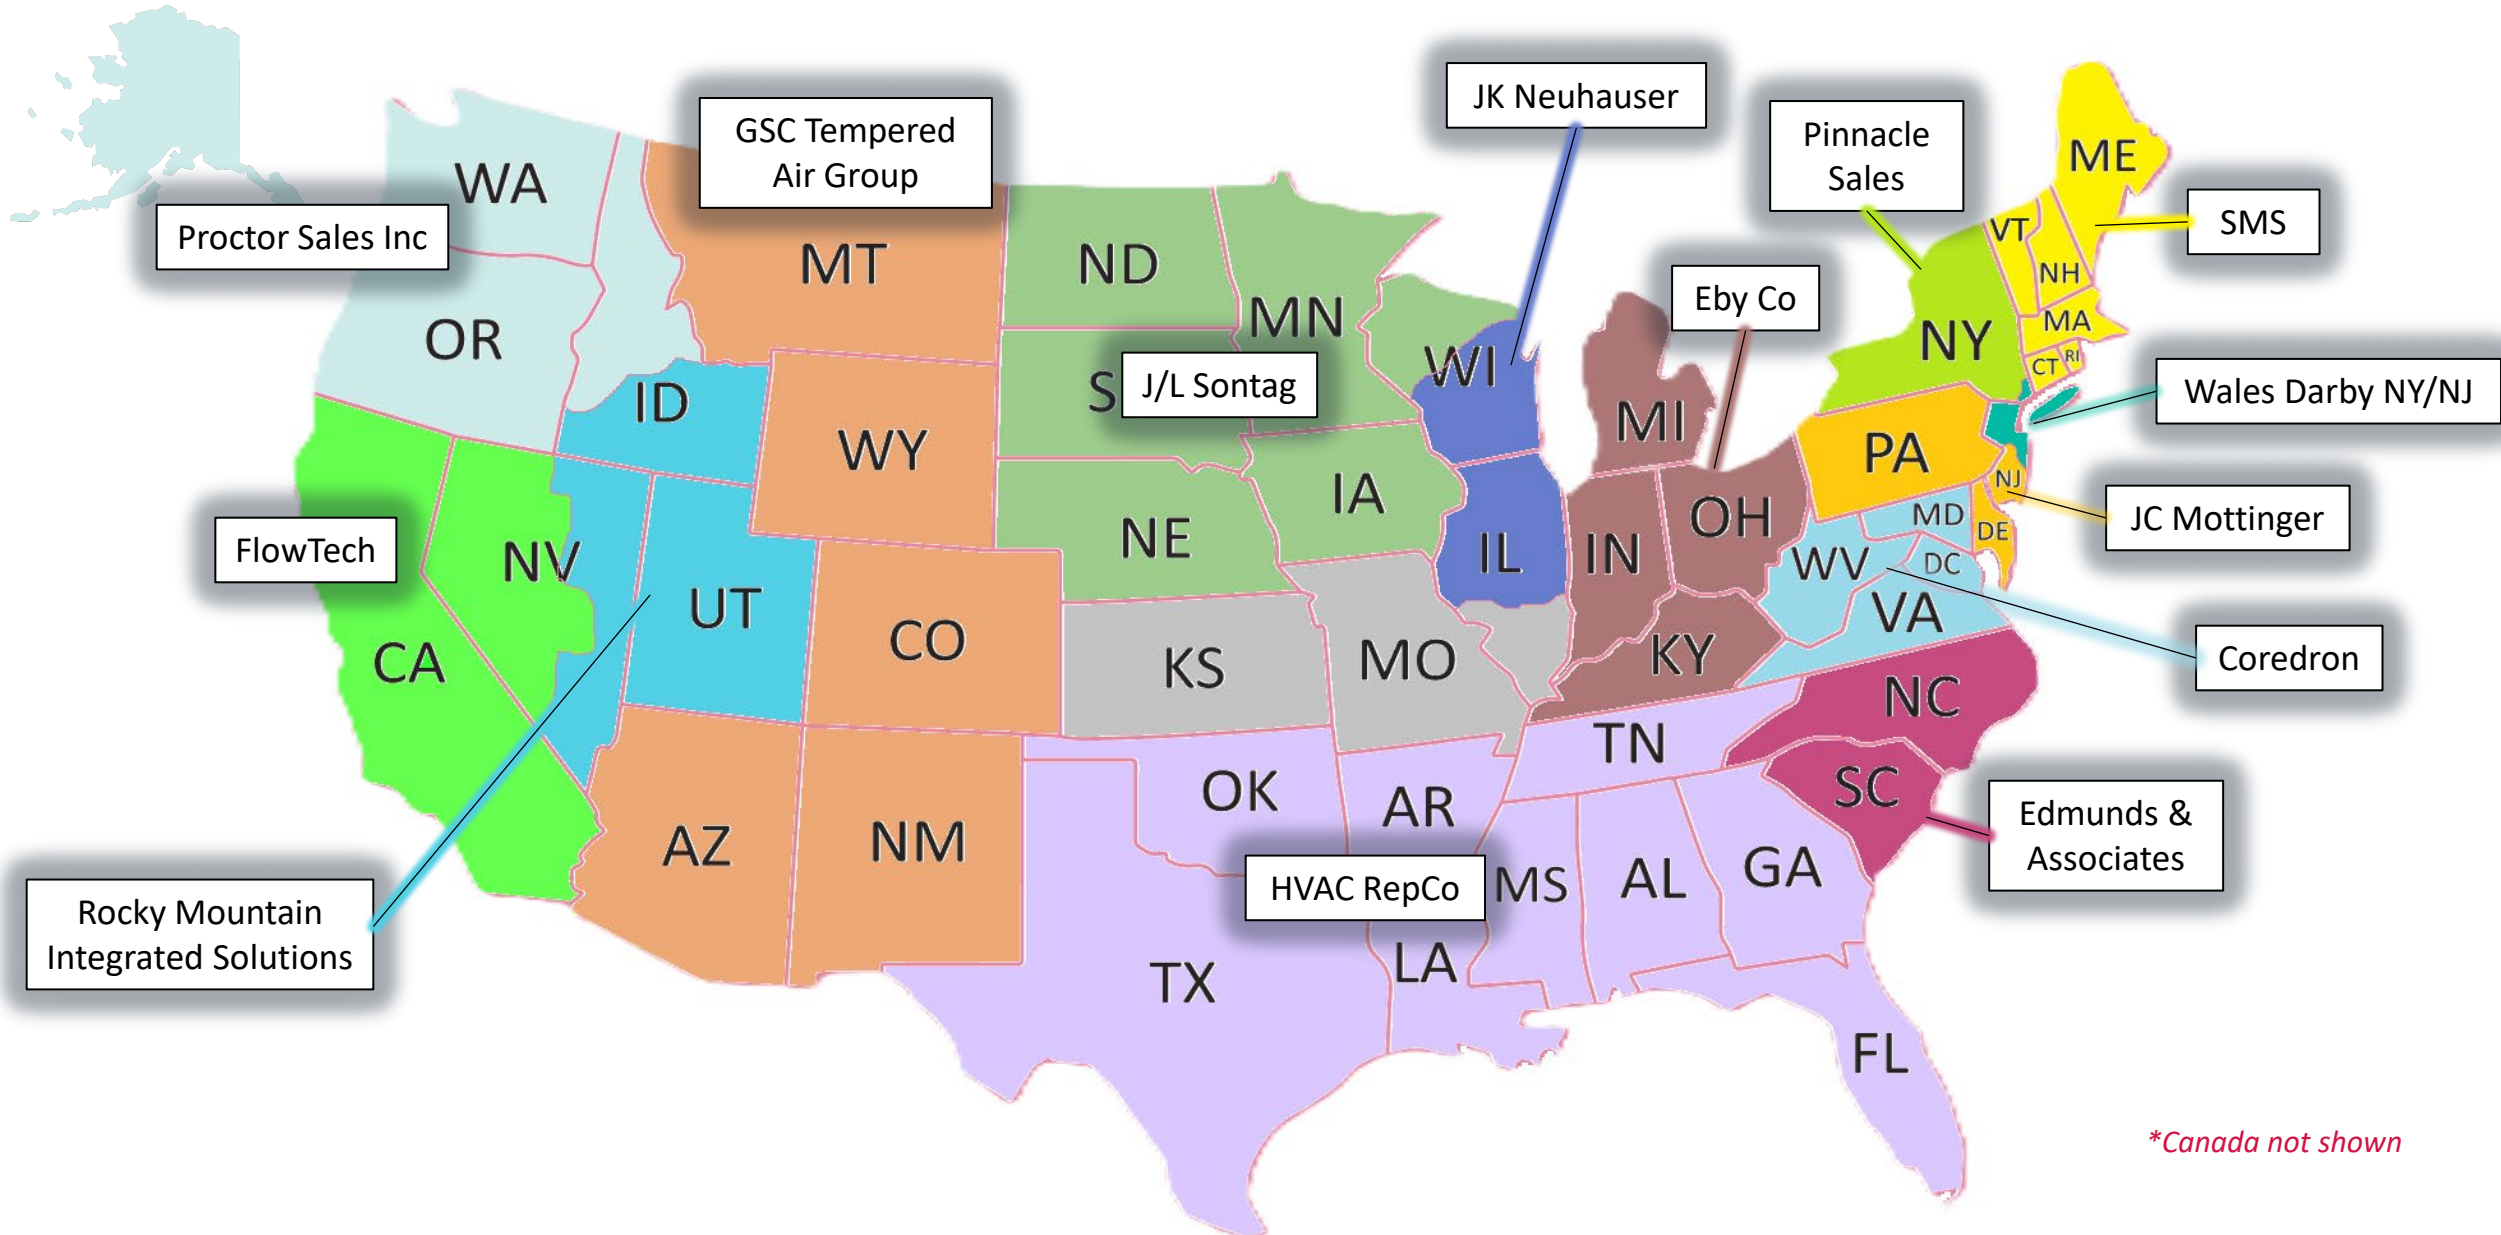

*Canada not shown

Small Duct High Velocity Webinar Training

OCT 3, 2024

12 – 3 pm Eastern Time

Visit <https://www.spacepak.com/Training>

- Register for trainings
- Sign up for training alerts
- Access webinar archives
- And more



Post-Webinar Resources

24 hours from now -

you will receive an email that contains links and downloads for:

- [A recording of today's webinar](#)
- [PDF copy of today's presentation](#)
- [Project Design Form](#)
- [SpacePak High-Res Logos](#)
- [Contact information](#)
- [Links to product documentation resources](#)
- And more

**Please take our post-webinar survey when
you sign off today!**



Let's Connect



#spacepak #hydronics
#airtowaterheatpumps

@spacepaksystem
@thespacepakjim

let's connect