

September 18, 2025



Installer Certification Training

Small Duct High Velocity Air Distribution System

SPACE PAK®

Meet Your Representative

Rep Name Here

Rep info here


Mestek, Inc



- Established 1946 in Westfield, MA
- Privately owned
- Over 45 companies involved in the HVAC, Architectural, & Metal Forming Machinery & fabrication industries
- Began with founder John Reed and original Fin Tube Radiation in 1946 as Sterling Radiator Company
- 1975 Reed National
- 1986 merger becomes Mestek
- SpacePak joins Mestek family in 1991



Mestek Today

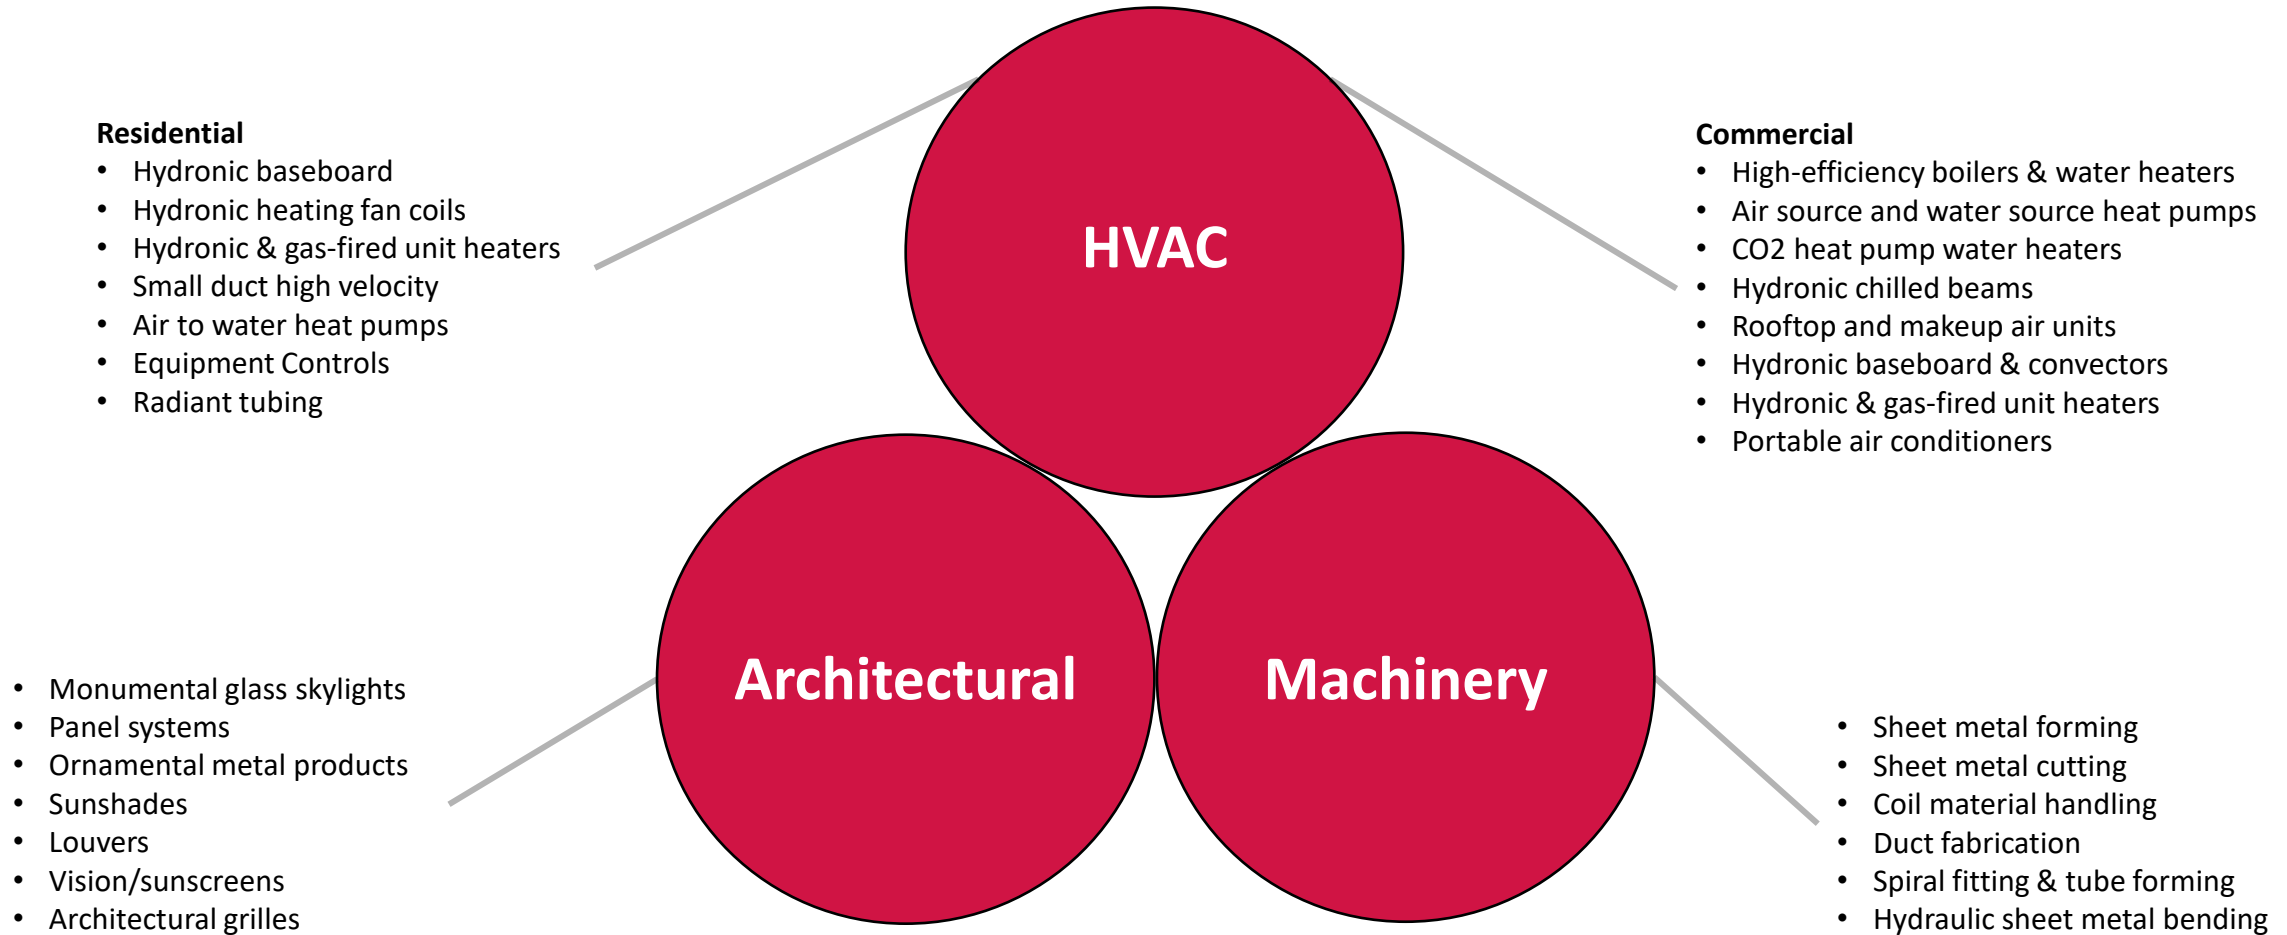

Architectural

- Monumental glass skylights
- Panel systems
- Ornamental metal products
- Sunshades
- Louvers
- Vision/sunscreens
- Architectural grilles



Machinery

- Sheet metal forming
- Sheet metal cutting
- Coil material handling
- Duct fabrication
- Spiral fitting & tube forming
- Hydraulic sheet metal bending




HVAC (Residential & Commercial)

- Hydronic fin-tub baseboard & convectors
- High-efficiency commercial boilers & water heaters
- Hydronic & gas-fired unit heaters
- Air source and water source heat pumps
- CO2 heat pump water heaters
- Hydronic chilled beams
- Rooftop and makeup air units
- Portable air conditioners
- System control technology





MESTEK, INC.

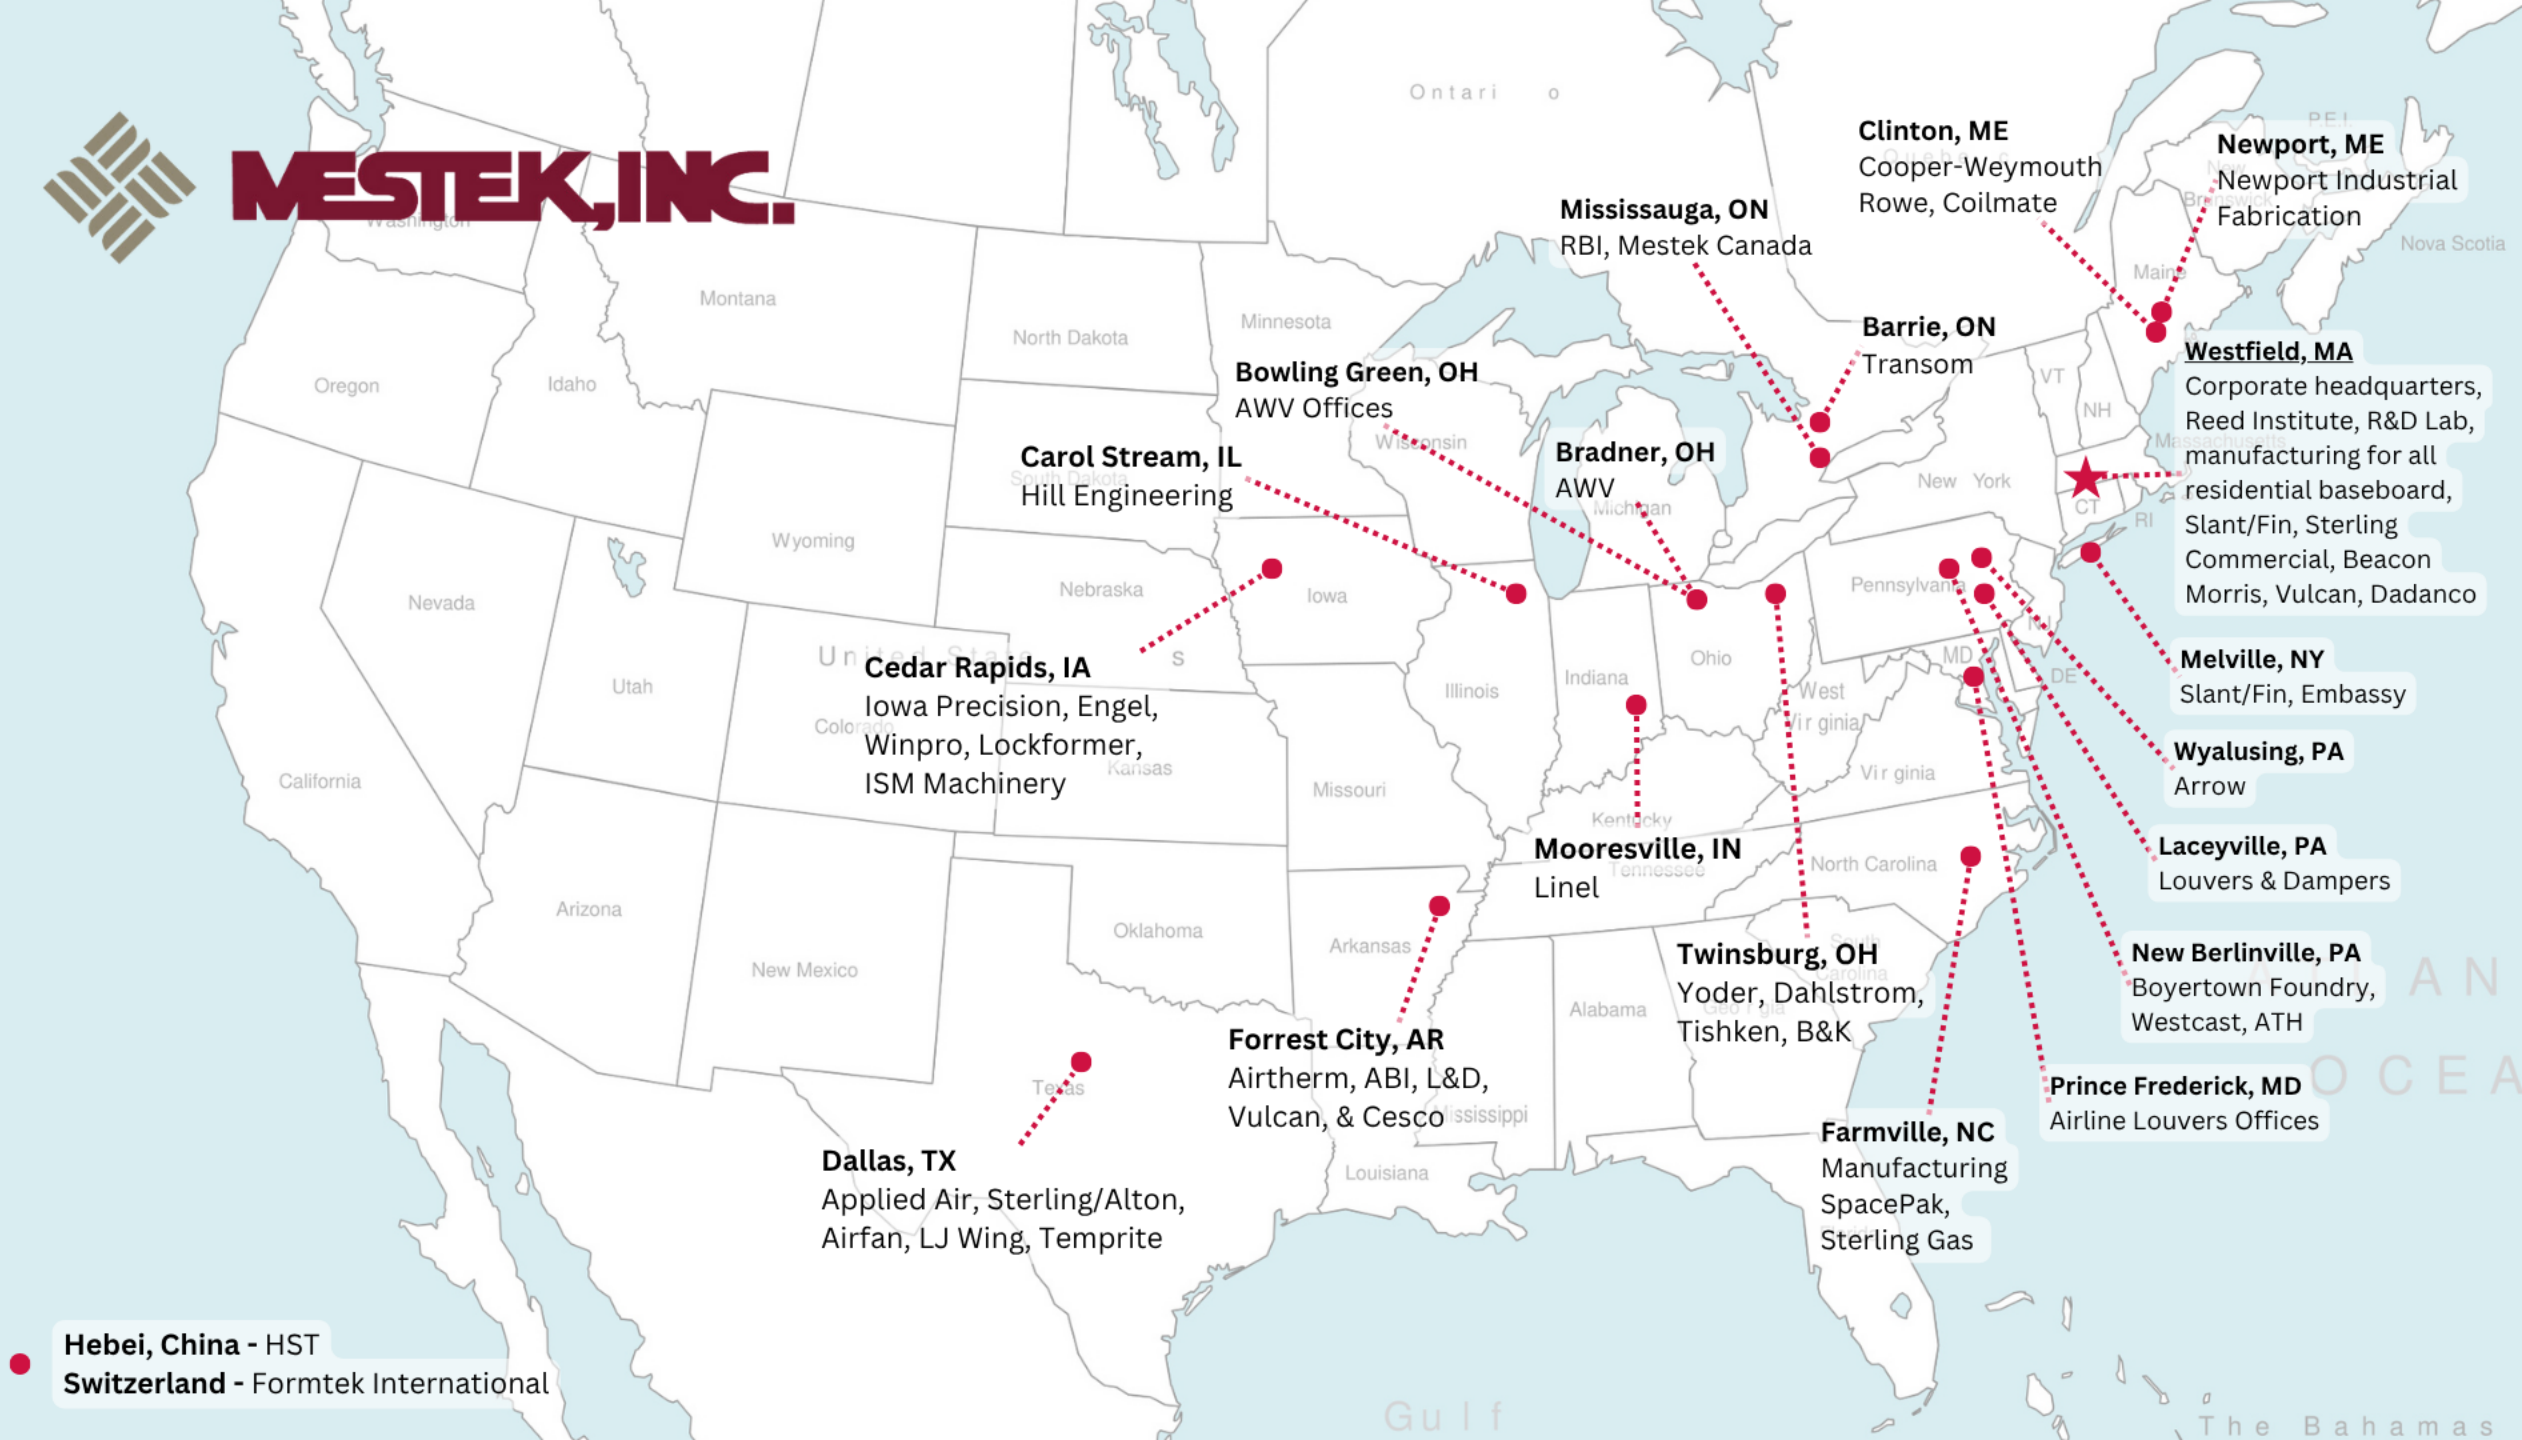

Westfield, MA - Mestek Home Base



CORPORATE HEADQUARTER OFFICES

- Product & Engineering
- Sales & Marketing
- Executive Level Management
- Customer & Technical Service
- Accounting & Finance
- Human Resources & Legal
- IT & Technology



RESEARCH & DEVELOPMENT LAB

- New product development
- Product testing
- Performance testing



MANUFACTURING

- All residential baseboard lines
- Beacon Morris unit kickspace heaters
- Sterling Commercial
- Dadanco
- Vulcan
- MTI Controls



TRAINING CENTER & LIVE-FIRE SHOWROOM

- SpacePak
- Commercial Boilers
- Commercial Heat Pumps
- Show room

MESTEK: Manufacturing in Westfield, MA



Meet the Team



Jim Bashford
National sales and
Training manager




Jared Stearns
Product Manager,
P.E.



Allyson Moauro
Product Management
Assistant



Eric Rainey
Application Engineer /
Inside Sales

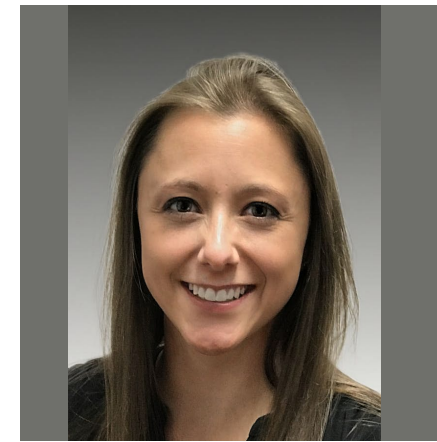

Meagan Harrington
Marketing Manager

MESTEK: SpacePak Manufacturing in Farmville, NC




Local Representative Support


For all local field support, including:

- Pricing
- Availability
- Project questions


Look up your local SpacePak Rep!

www.spacepak.com/relocator

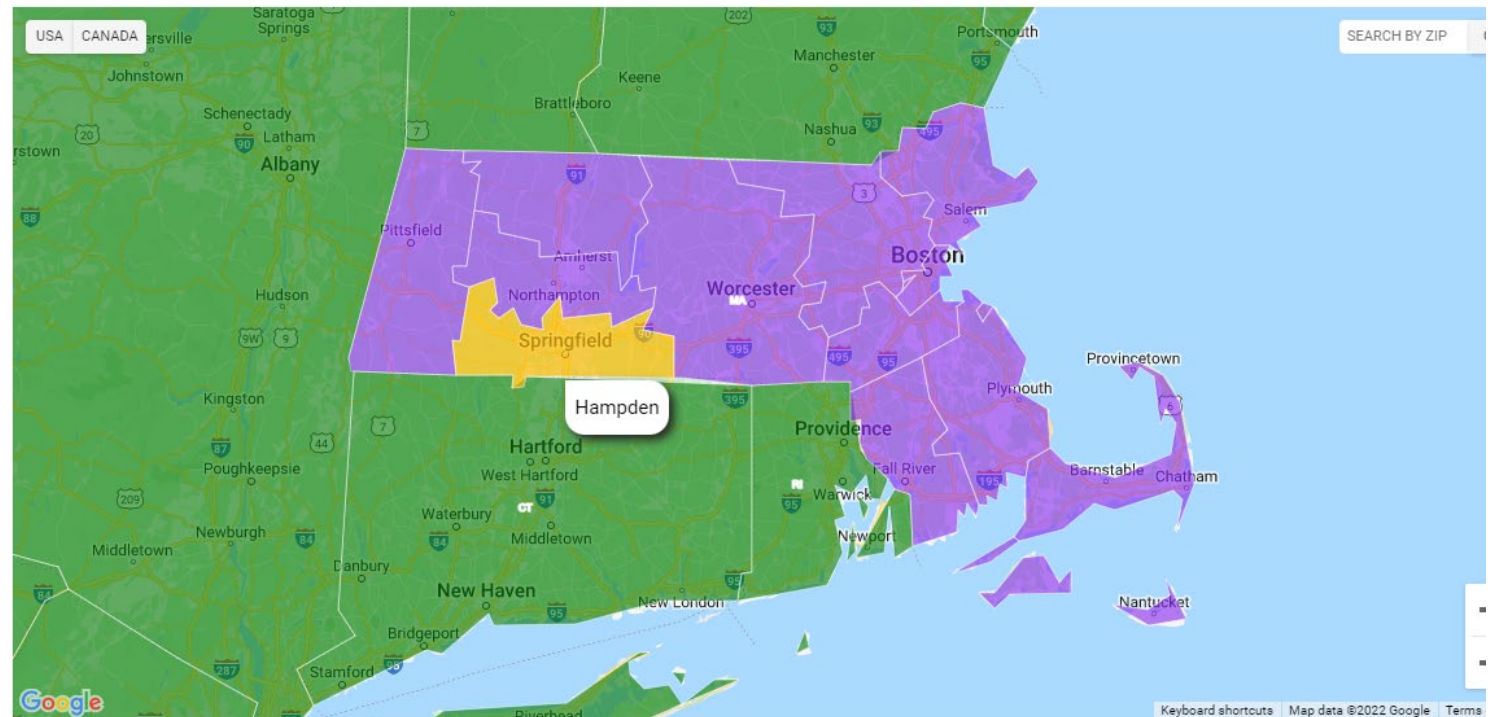

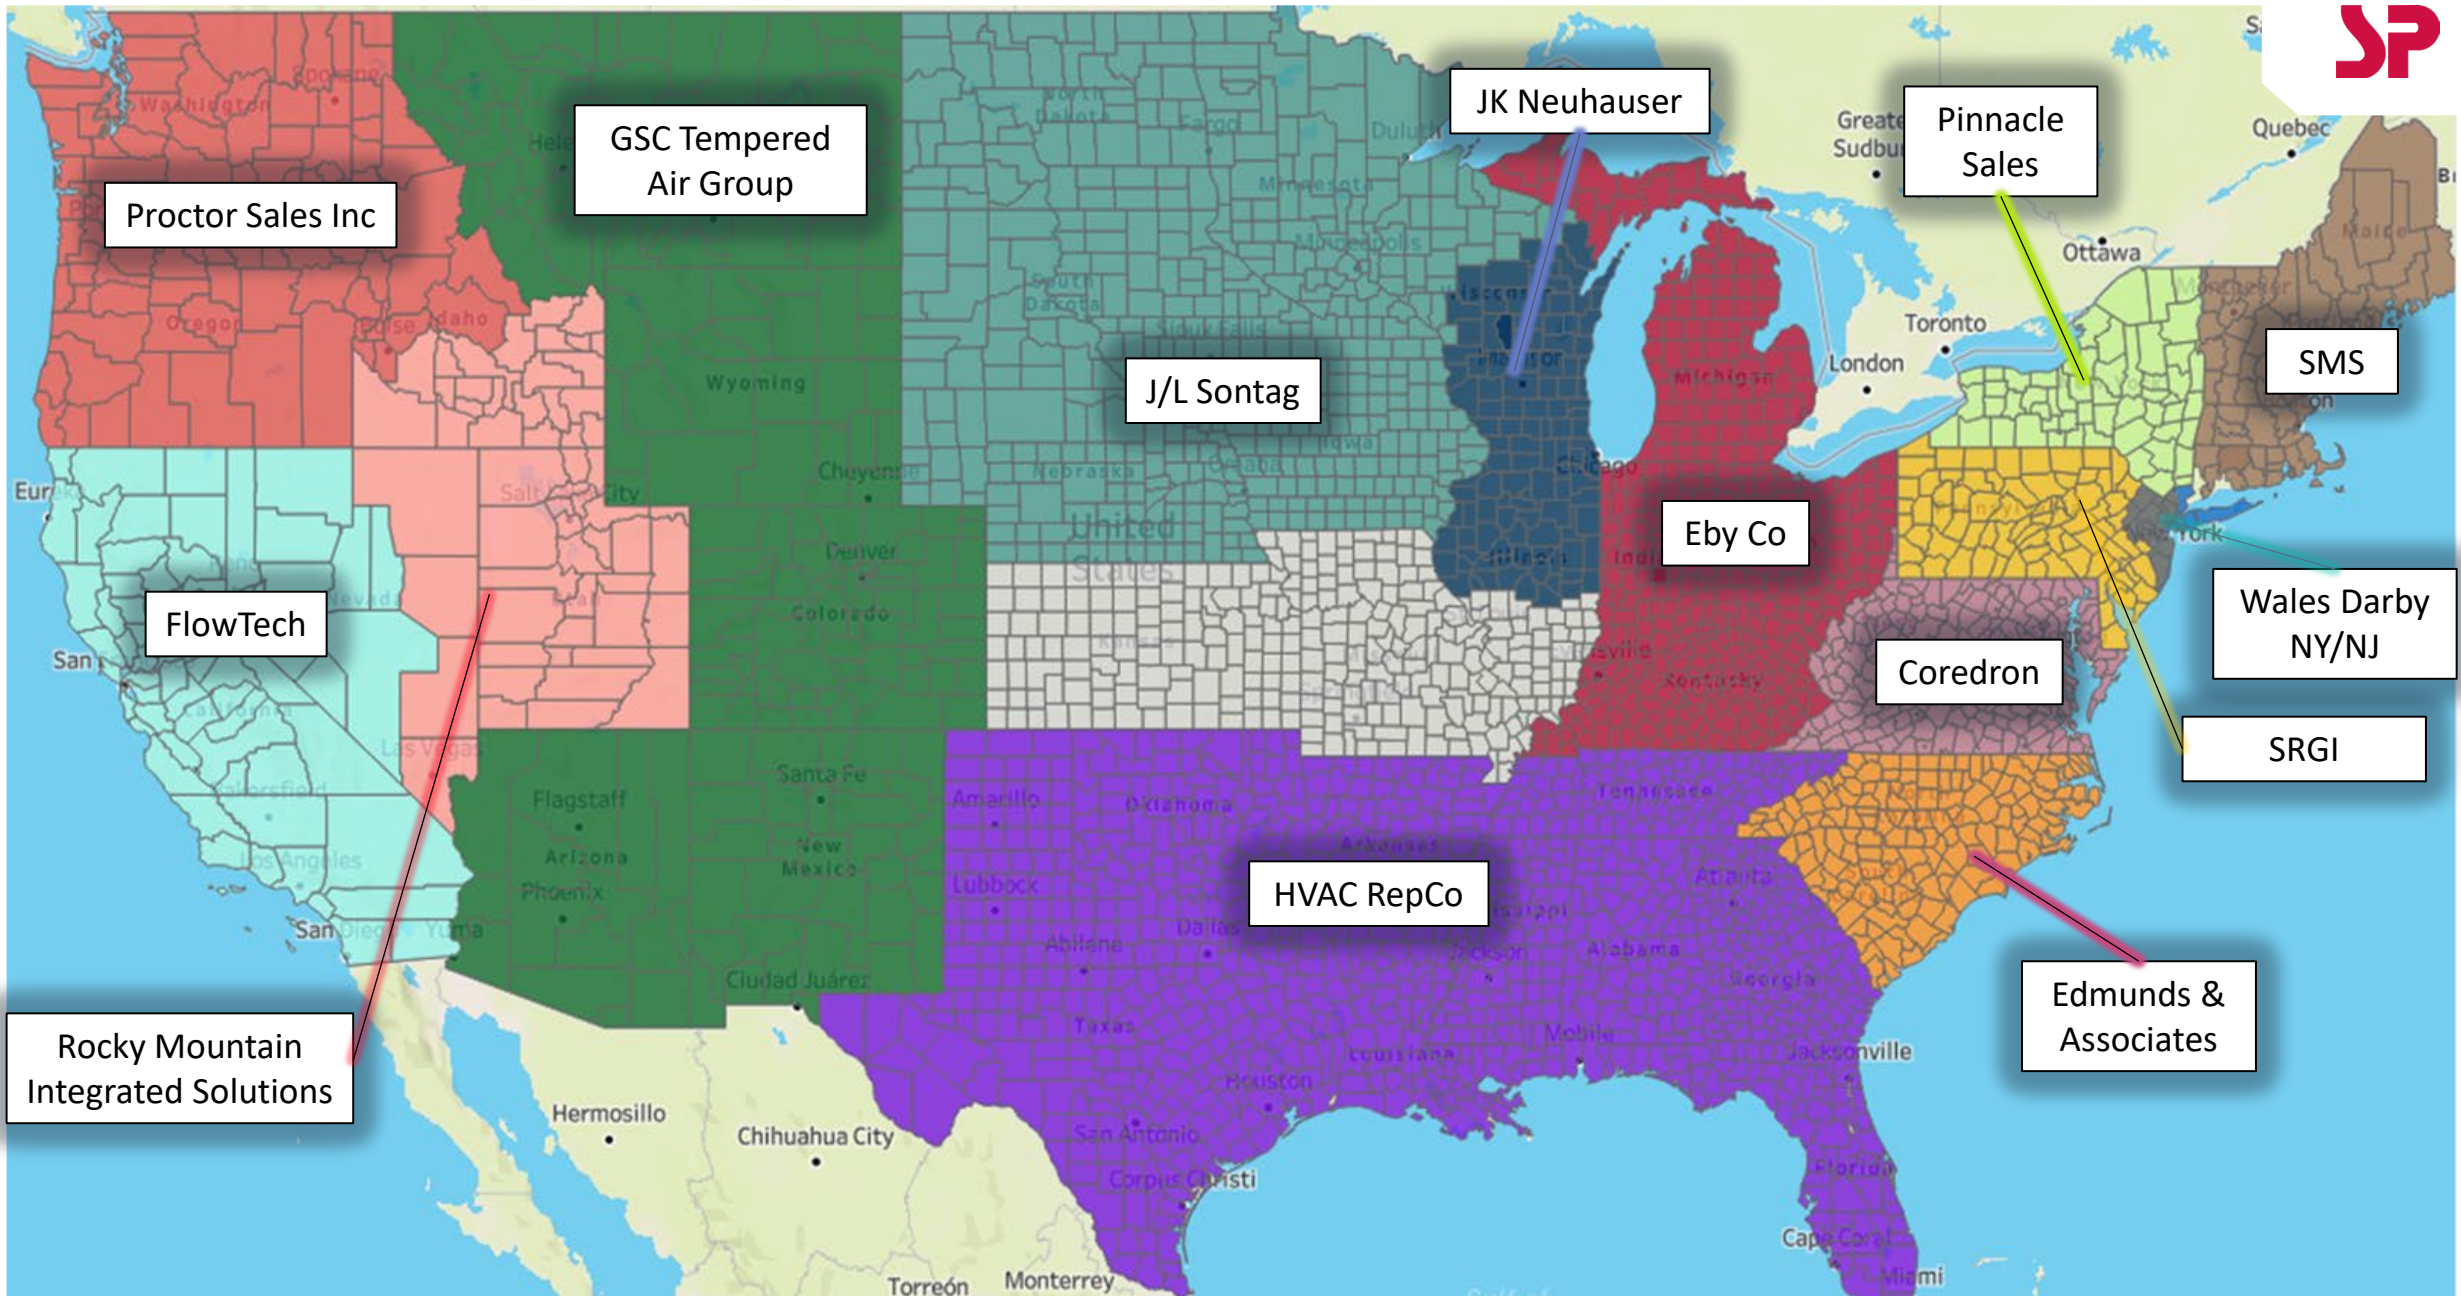

U.S. Manufacturer Representative Network

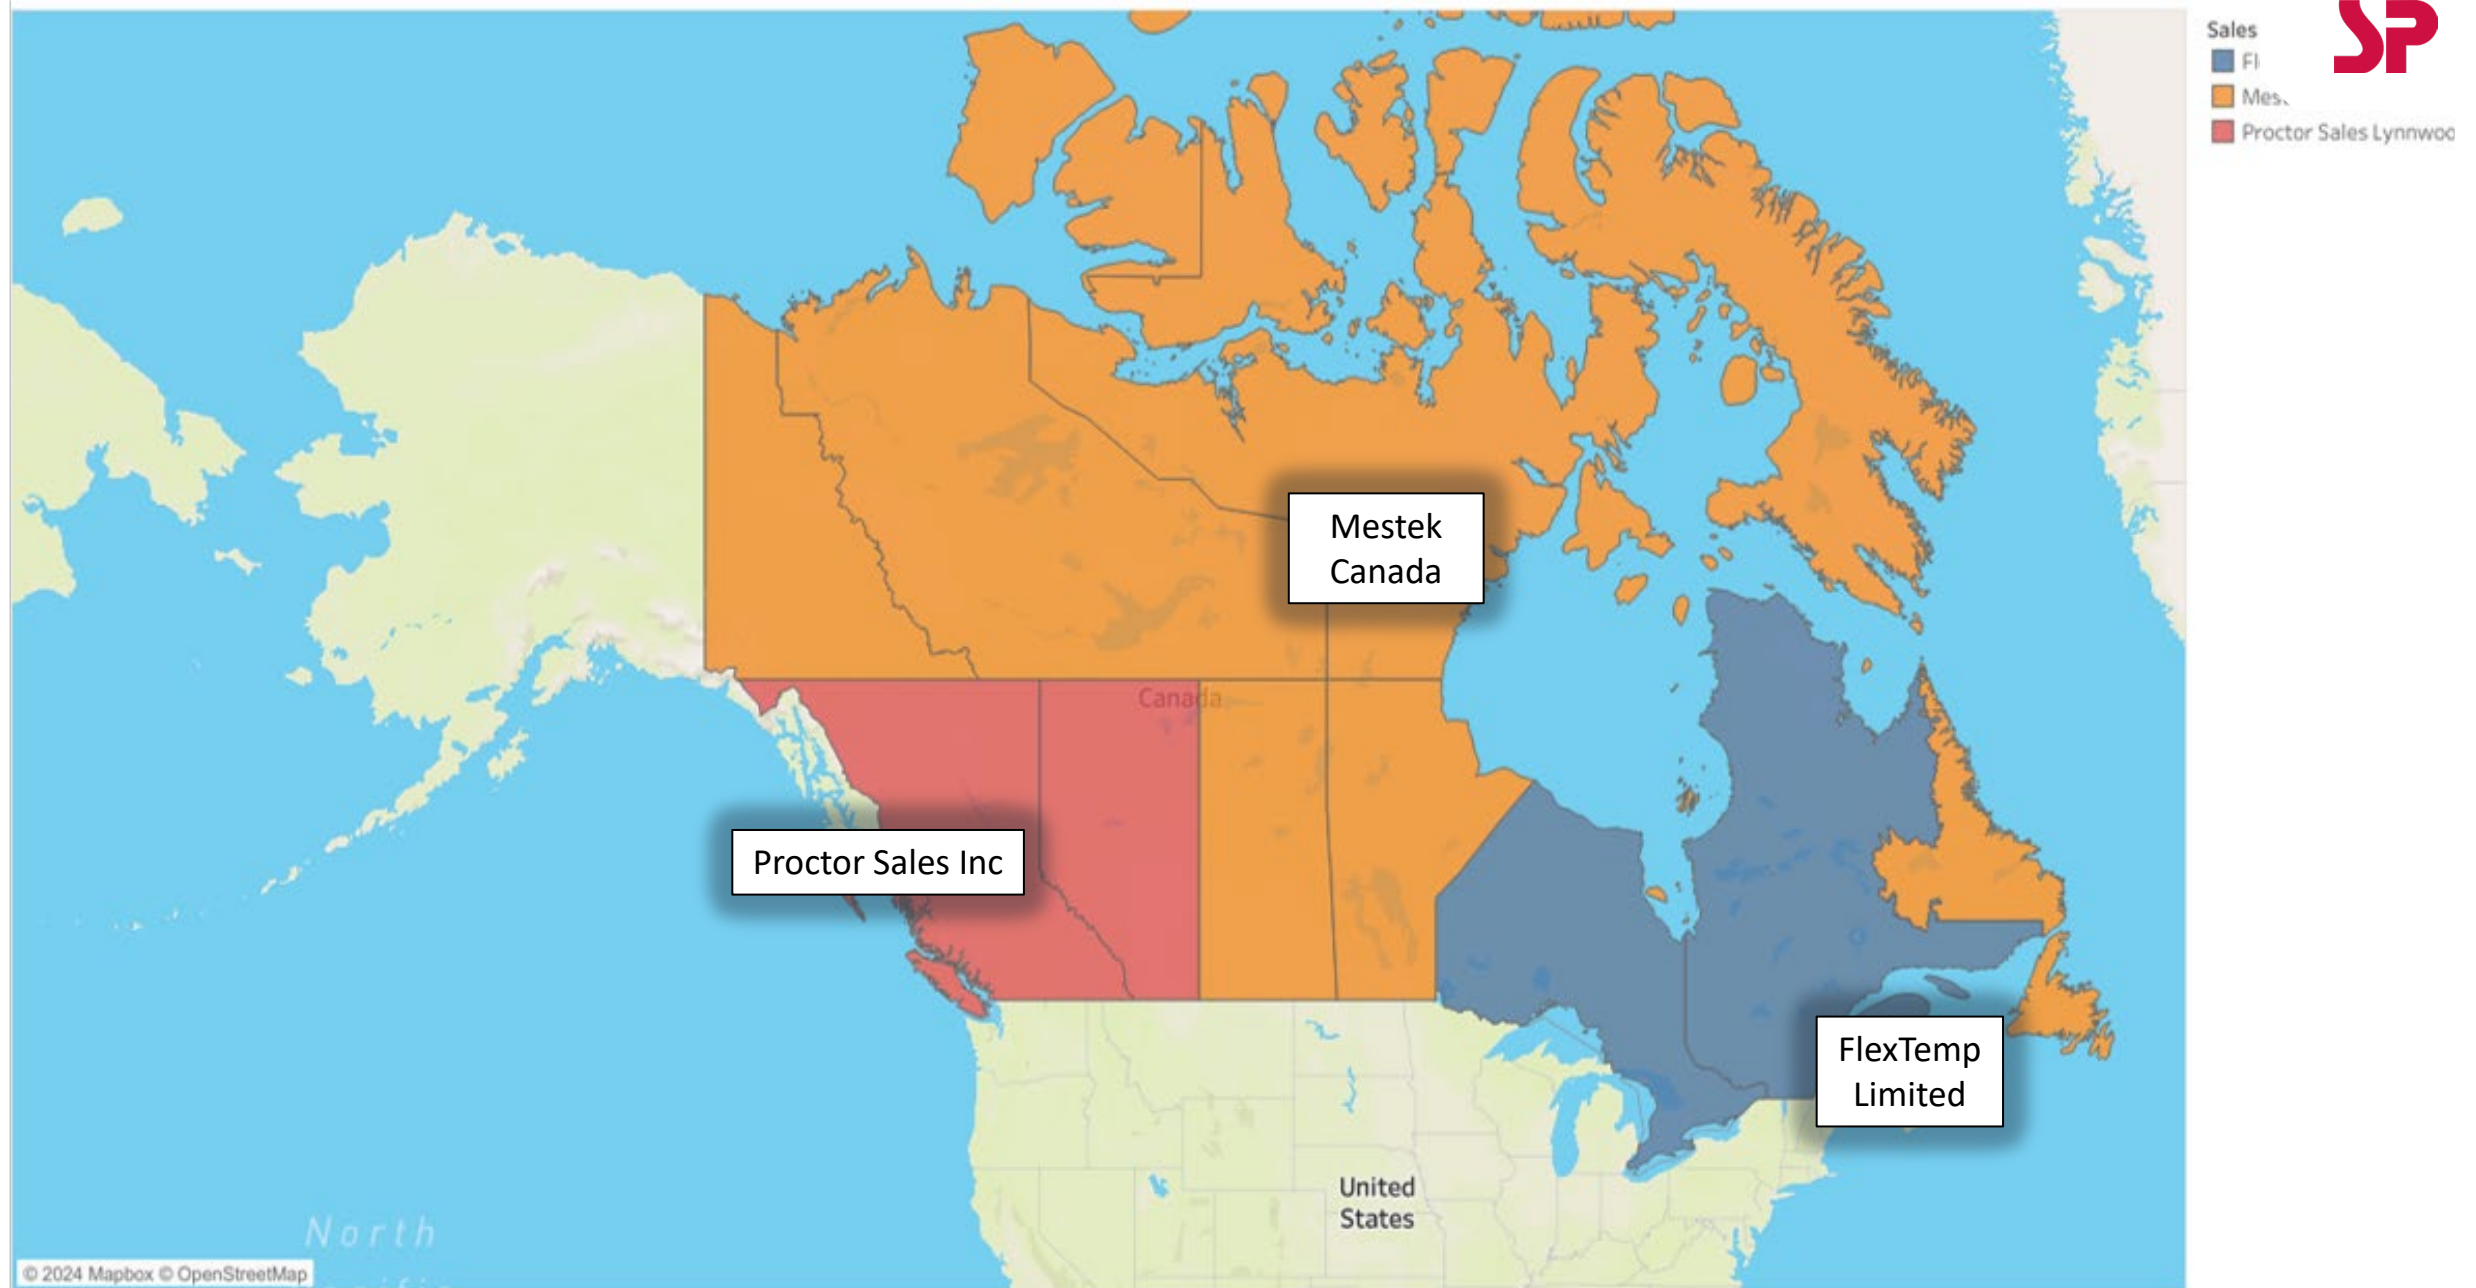

Canada Manufacturer Representative Network

Certified Installer Program



Warranty Program

Small duct high velocity, hydronic fan coils, & associated equipment

Standard Warranty

- 1-year parts

Extended Warranty

- 5-year parts*

Extended Warranty Requirements*

- Must be listed as a SpacePak Certified Contractor at time of installation
- Must register project/equipment via the website
- Must follow warranty process which includes calling technical support to verify proper diagnoses




Certified Contractor Program

- Extended warranty*
- Listed on website
- Homeowner leads
- Pre-sale support
- Marketing support – co-op dollars



[Find a Certified Contractor](#)[Representative Locator](#)[SpacePak System](#)[Spacepak Hydraulics](#)[About Us](#)[Resources](#)[Training](#)[Product Registration](#)[Contact Us](#)[Technical Library](#)

Warranty Registration



Who are you?

- ☐ Homeowner/End-user
- ☐ Installing Contractor

Next

Contractor Locator Map & Lead Generation

30mi

Find Me a Contractor

Certified Contractors in your area

Charland Refrigeration 0 miles

North Road

Westfield

MA, 01085

tel: 413-564-0333

Durfey Heating Systems 12 miles

131 Cross Rd

Granville

MA, 01034

tel: 413-357-6132

Comfort Heating & Cooling 14 miles

7 Hinckley Street

Florence

MA, 01062

tel: 413-579-2380

WL Heating & Cooling 15 miles

59 King Spring Road

Windsor Locks

CT, 06096

tel: 860-627-8000

ASM Sheetmetal 19 miles

140 West St

West Hatfield

MA, 01088

Your Company Here

Homeowner Leads Emailed Directly to you

Find a Certified Contractor

Are you interested in installing a SpacePak system in your home? Get the process started by requesting a free, no-commitment consultation. Once you've submitted your request, you'll receive contact information for local SpacePak certified contractors.



STEP 1

Who are you?

☐ Homeowner
☐ Contractor
☐ Architect
☐ Other

Which of these options best describes your need?

☐ Installing SpacePak in a current home
☐ Installing SpacePak in a new construction
☐ Installing SpacePak in a commercial space
☐ Service or repair for my SpacePak System

Which system are you most interested in?

☐ SpacePak Central Heating & Cooling
☐ SpacePak Hydronics
☐ Unsure

Next

NOTE: Extensive form guarantees only serious inquiries.

Pre-Sale Application Support Team

PreSaleSupport@SpacePak.com

Available to Representatives, Wholesalers and Contractors

- System application support
- Equipment selection
- Load calculation and rough material list

Any questions regarding equipment already shipped should be directed to

TechnicalService@SpacePak.com (413) 564 - 5530



Customer & Technical Service

Customer Service – *During-Sale*

CustService@SpacePak.com

Technical Service – *Post-Sale*

questions regarding equipment already shipped

TechnicalService@SpacePak.com


(413) 564 - 5530



Central-Air, *Anywhere*



Small Duct High Velocity Heating and Air Conditioning Distribution System

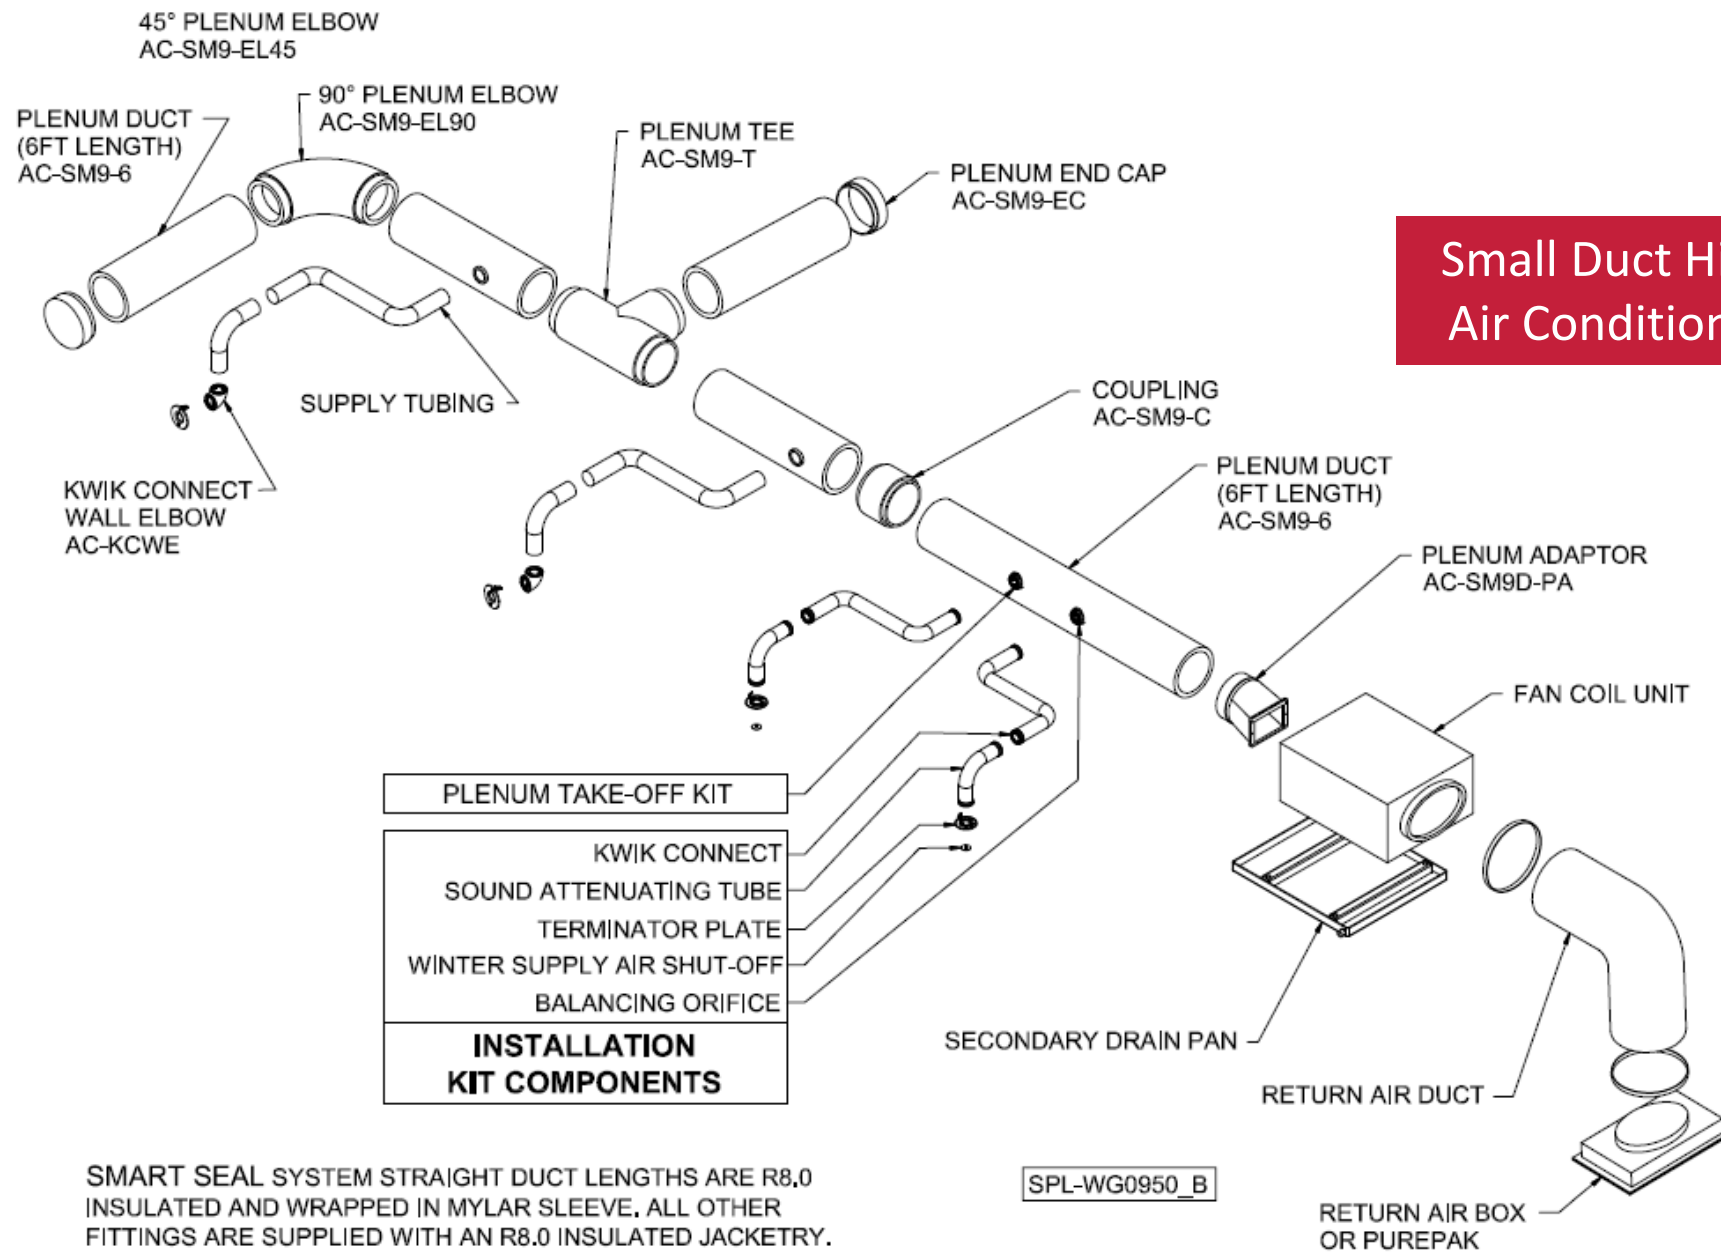


SMART SEAL SYSTEM STRAIGHT DUCT LENGTHS ARE R8.0 INSULATED AND WRAPPED IN MYLAR SLEEVE. ALL OTHER FITTINGS ARE SUPPLIED WITH AN R8.0 INSULATED JACKETRY. DUCT COMPONENTS SHOWN WITHOUT FACTORY SUPPLIED R8.0 INSULATED JACKETRY.

Small Duct High Velocity (SDHV) Heating & Cooling


- SpacePak delivers uniform, year-round comfort, with fewer of the unwanted challenges common to other central heating and air-conditioning systems. Making sure there are:
 - No Major Renovations
 - No Loss of Usable Floor Space
 - No High Energy Bills
 - No Unsightly Components
- Simply quiet, cost-effective comfort for virtually any home or building, regardless of the structure's design, age, size, or construction type.
- SpacePak is an air distribution system which uses a principle known as aspiration - as the air stream enters the room, it creates a gentle mixing of air in the room to provide thorough, comfortable draft-free air circulation.
- SpacePak eliminates stratification with a minimum floor-to-ceiling temperature difference.

Comparing Conventional Duct Space Vs. Small Duct Space

When space and efficiency counts

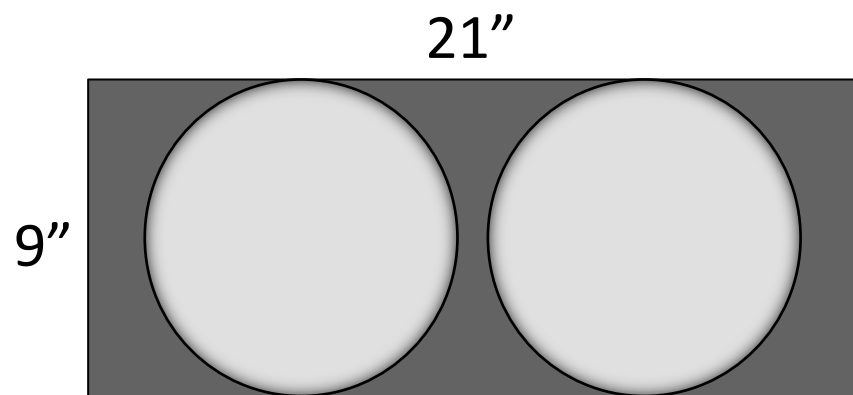


1 CONVENTIONAL TRUNK
60,000 Btu Cooling
90-120,000 Btu Heating




2 SDHV MAIN
TRUNK SIZE
120,000 Btu

SAME SPACE. MORE BTU's.

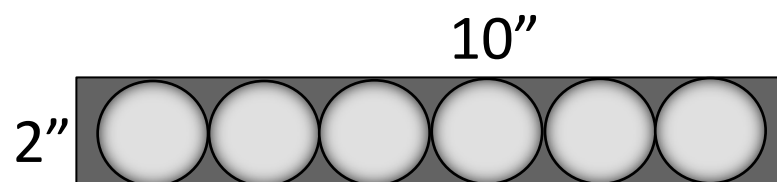


1 CONVENTIONAL DUCT
2,000 Btu cooling
3,000+ Btu Heating



6 SDHV DUCTS
12,000 Btu


Conventional Air Distribution

- Diffusion, throw, & return
- Conventional units generally need individual returns for every room
- Needs complete air change
- Works for and is generally designed for heating or cooling applications. NOT BOTH.



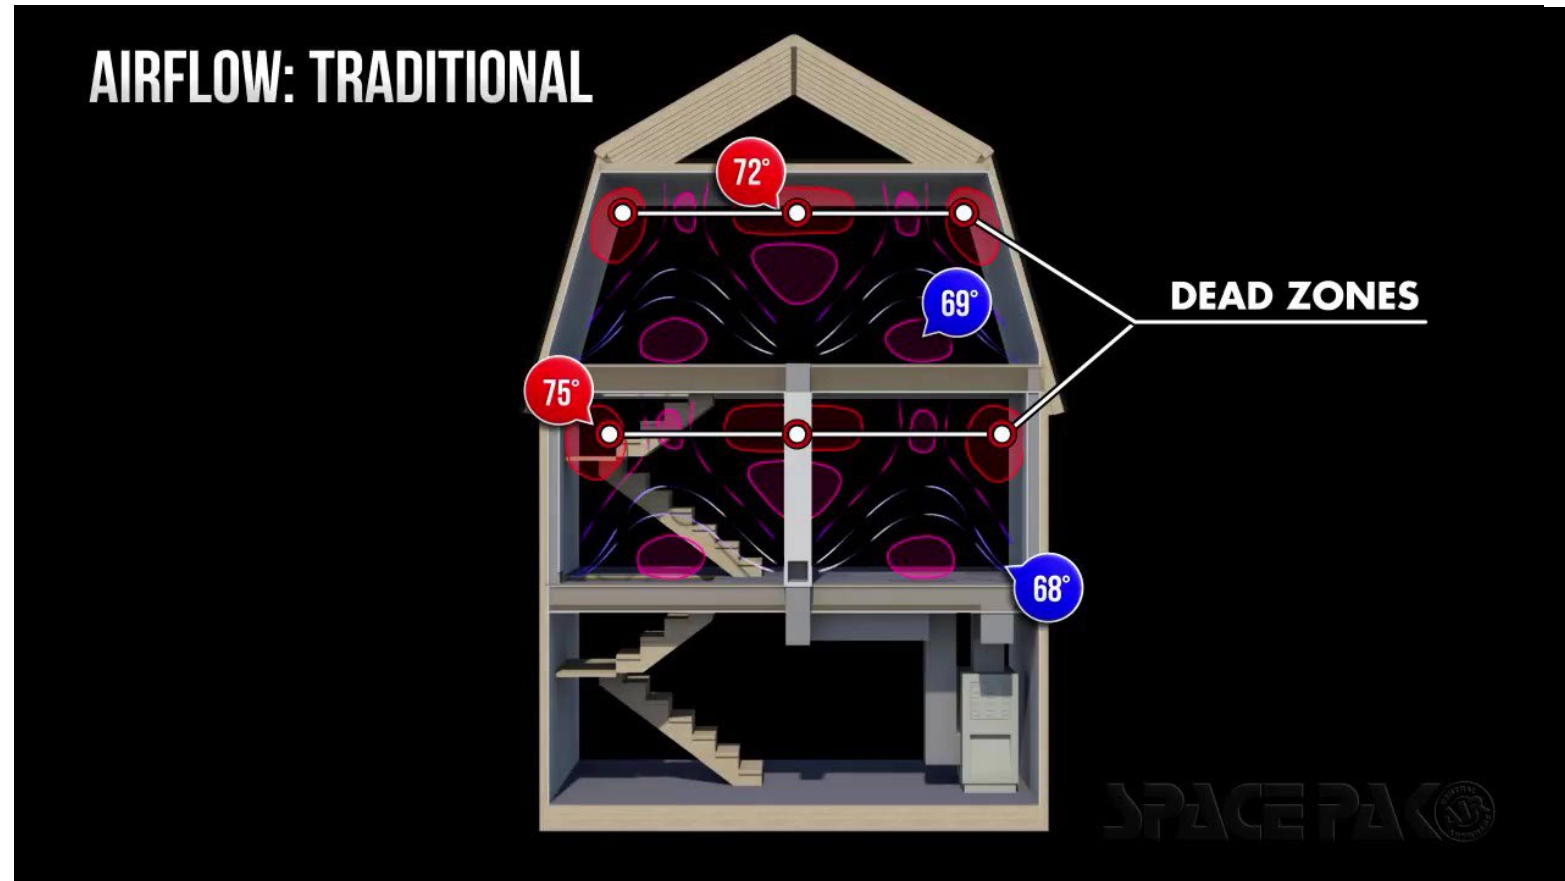


Uniform, Draft-Free Comfort

- The SDHV air distribution system utilizes a principle known as **aspiration**.
- As the air stream enters the room, it gently and continuously mixes air to provide uniform, draft-free air circulation.
- Eliminates stratification with a less than 2°F floor-to-ceiling temperature differential.

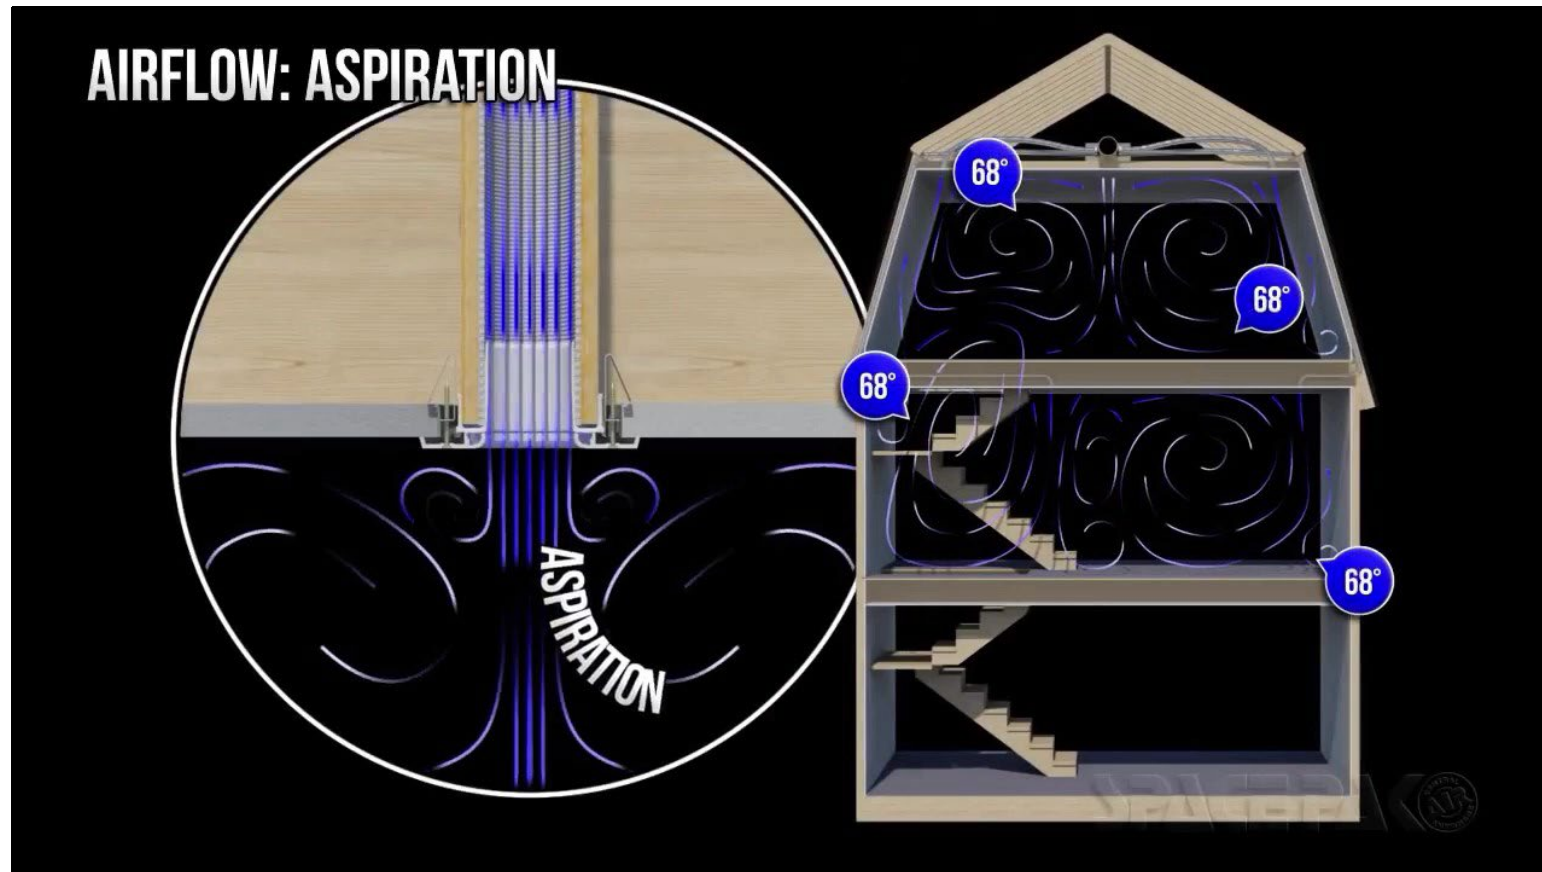


Outlet Orientation

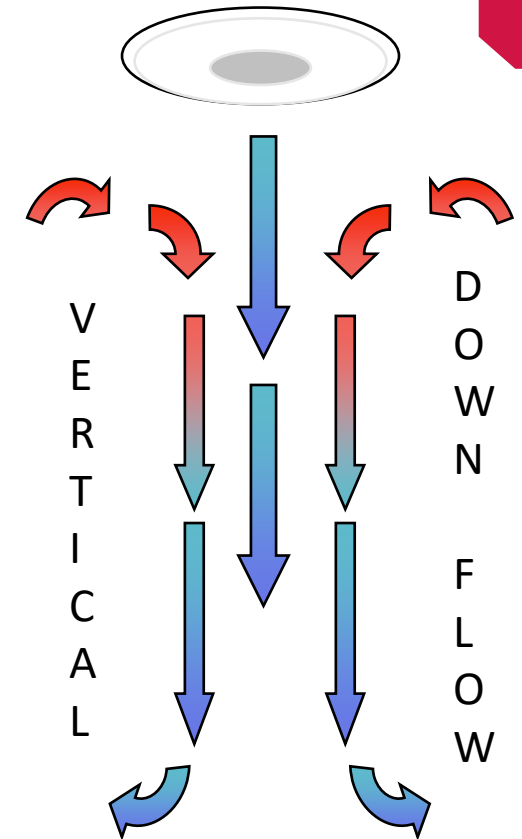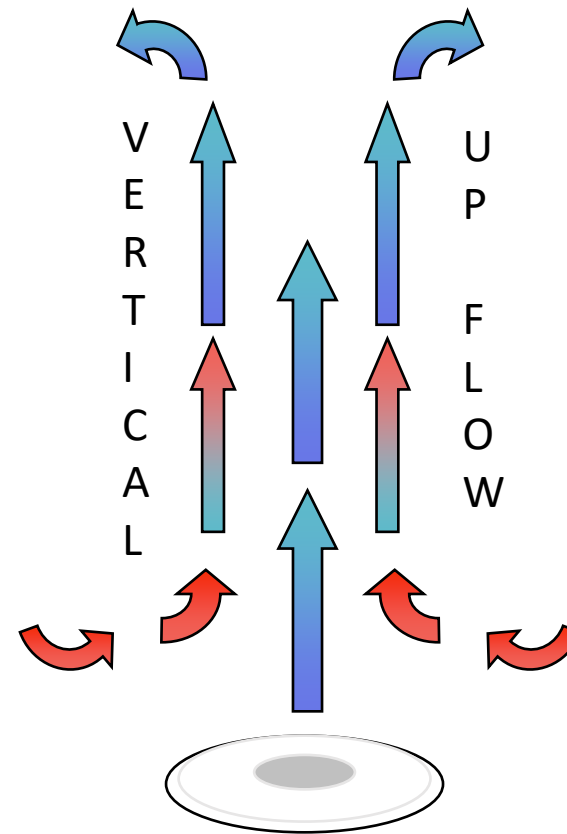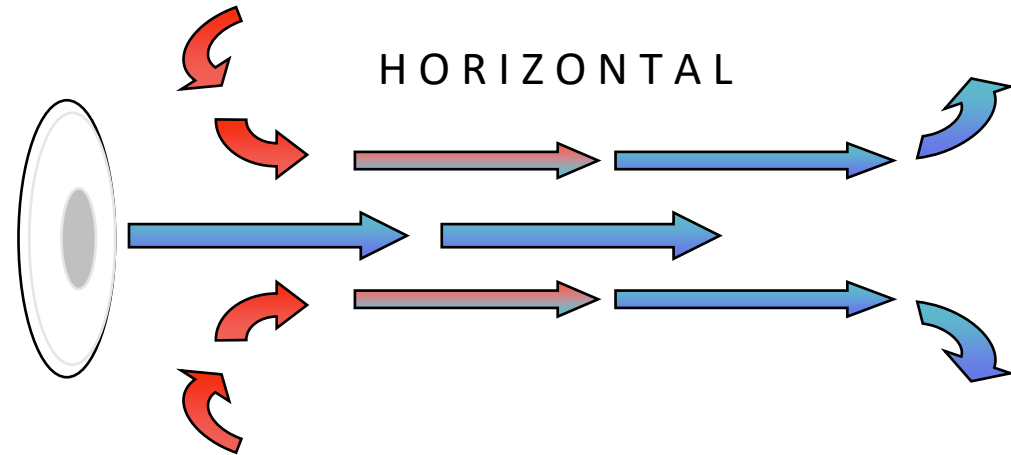

Motor & Blower

SPACEPAK	CONVENTIONAL
1.2 - 1.8" + WC STATIC PRESSURE	.5" WC STATIC PRESSURE
220 - 250 CFM PER NOMINAL TON	350 - 400 CFM PER NOMINAL TON


STATIC = EQUAL PRESSURE ON ALL INSIDE SURFACES

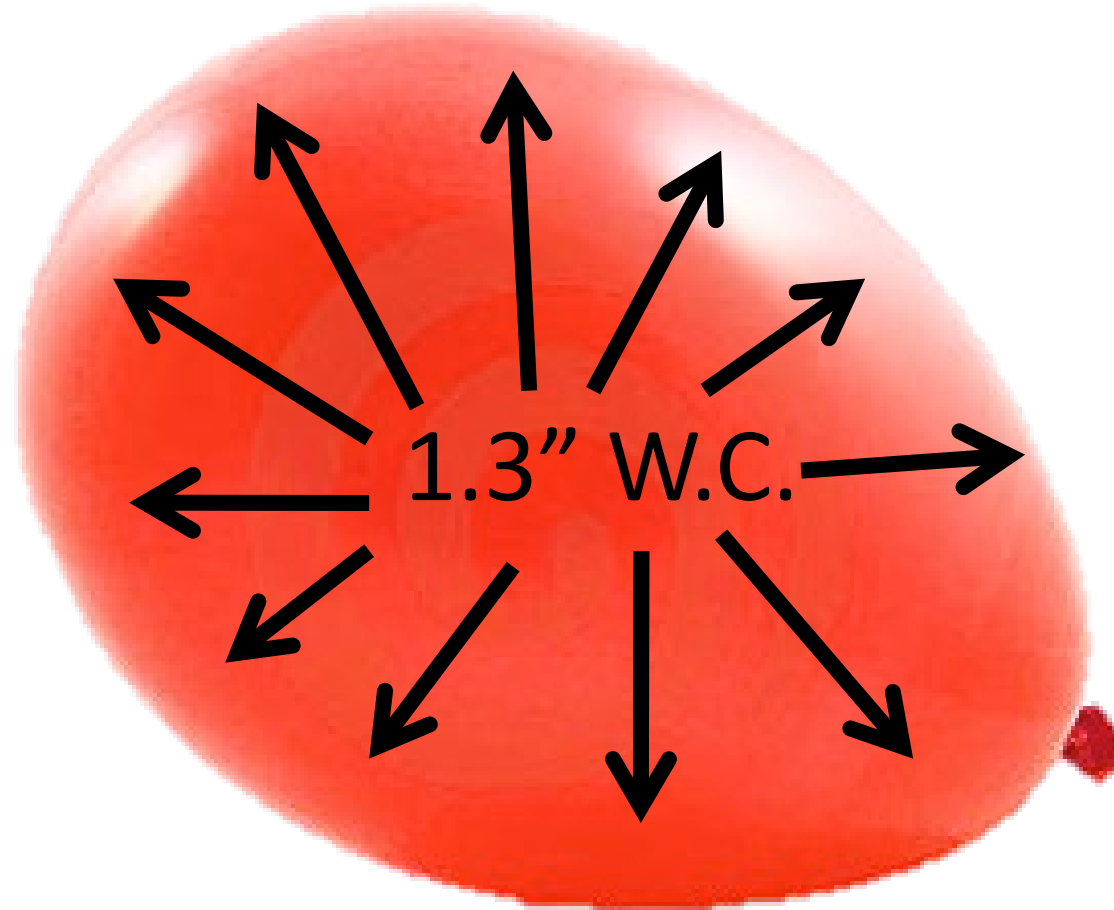

The Process of Static Regain (Its about the pressure)



MAIN PLENUM

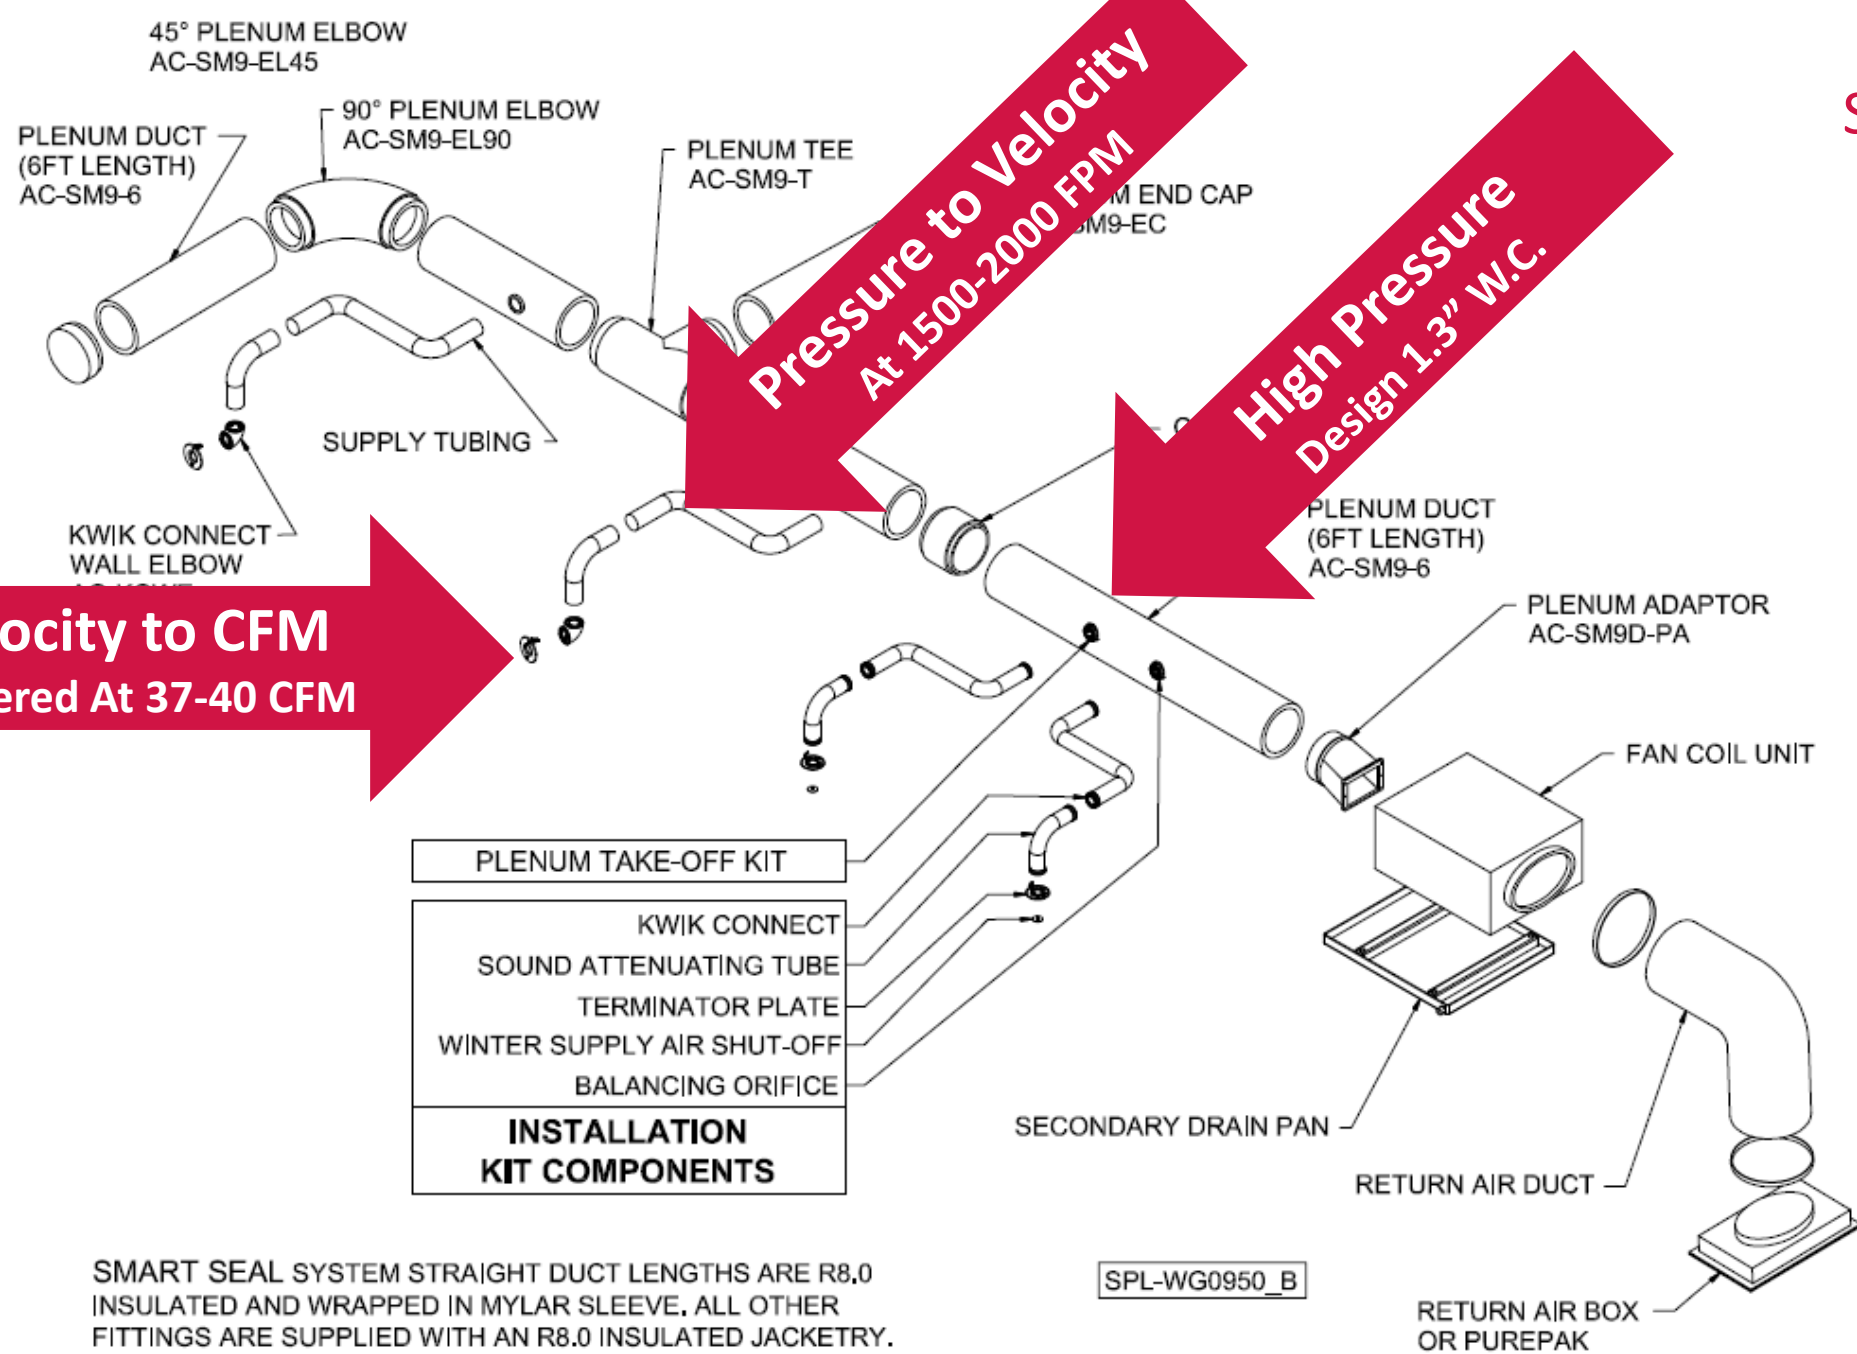


Static Regain
System layout
and target
pressures

SMART SEAL SYSTEM STRAIGHT DUCT LENGTHS ARE R8,0 INSULATED AND WRAPPED IN MYLAR SLEEVE, ALL OTHER FITTINGS ARE SUPPLIED WITH AN R8.0 INSULATED JACKETRY. DUCT COMPONENTS SHOWN WITHOUT FACTORY SUPPLIED R8.0 INSULATED JACKETRY.

SPL-WG0950_B

Static Pressure Check

Note: This is the first place to start during commissioning then we move on to delivered CFM

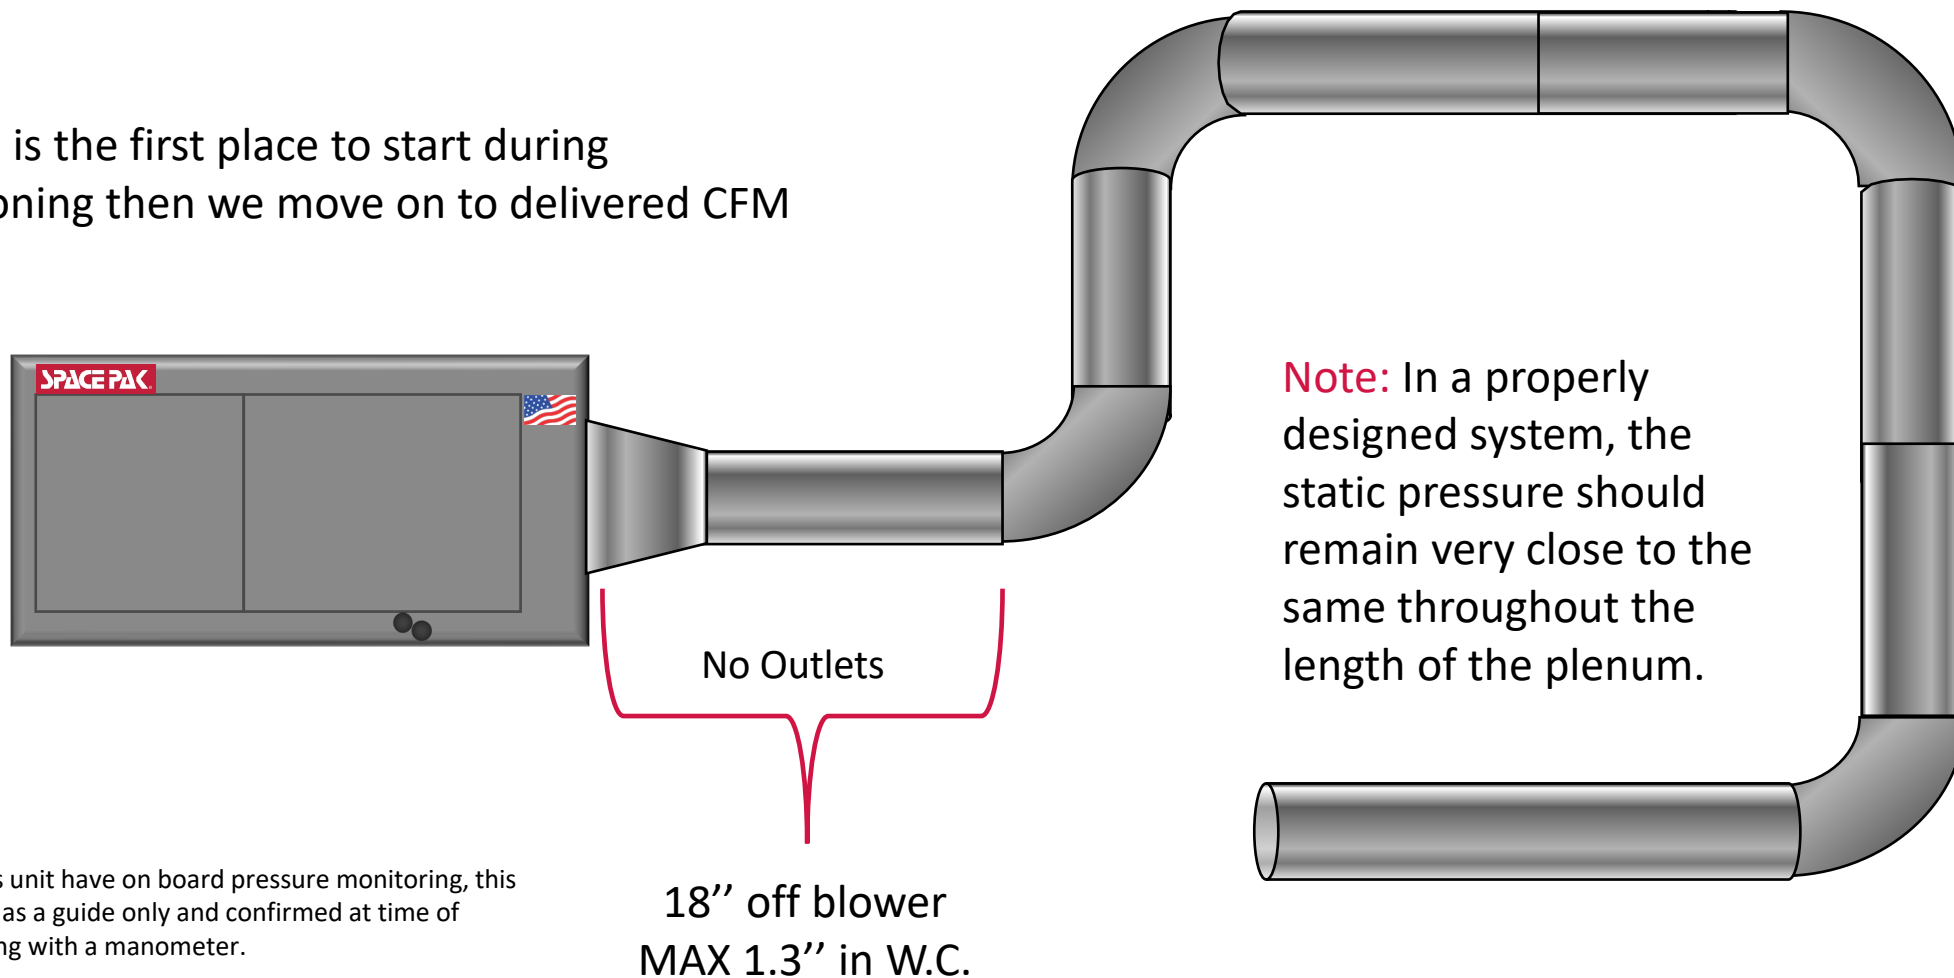

NOTE:

J and K series unit have on board pressure monitoring, this is to be used as a guide only and confirmed at time of commissioning with a manometer.

Questions?



DX & Hydronic Models

ESP Model (DX Coil)



ESP-K

DX Horizontal



ESP-KV

DX Vertical

WCSP Model (Water Coil)



WCSP-J

Hydronic Horizontal



WCSP-JV

Hydronic Vertical

Available in 3 sizes

2430 - 24,000 to 30,000 BTU/Hr. (2-2½ tons)

3642 - 36,000 to 42,000 BTU/Hr. (3-3½ tons)

4860 - 48,000 to 60,000 BTU/Hr. (4-5 tons)

Note: Units are not field convertible


ESP- K Series DX **Horizontal** Air Handler

- A2L Refrigerant Sensors
 - (R32 and R454B)
- No Adjustment or Rework Required
- Red K Series Control Board Indicates A2L Refrigerant Compliance
- 2 Line Display
- High Efficiency EC Integrated Motor/Blower Assembly
- Mode Specific Adjustable Speed Control
- Heat Pump Compatible
- Chatleff Thermal Expansion Valve
- Slide Out Blower
- Sweat-Type Refrigerant Connections
- 24V 50/60hz Transformer
- Industry Leading Corrosion Resistant Cabinet
- Float Switch
- Mold Resistant Primary Drain Pan
- Anti-Vibration Foam Strips



A2L COMPLIANT
Safer & Greener



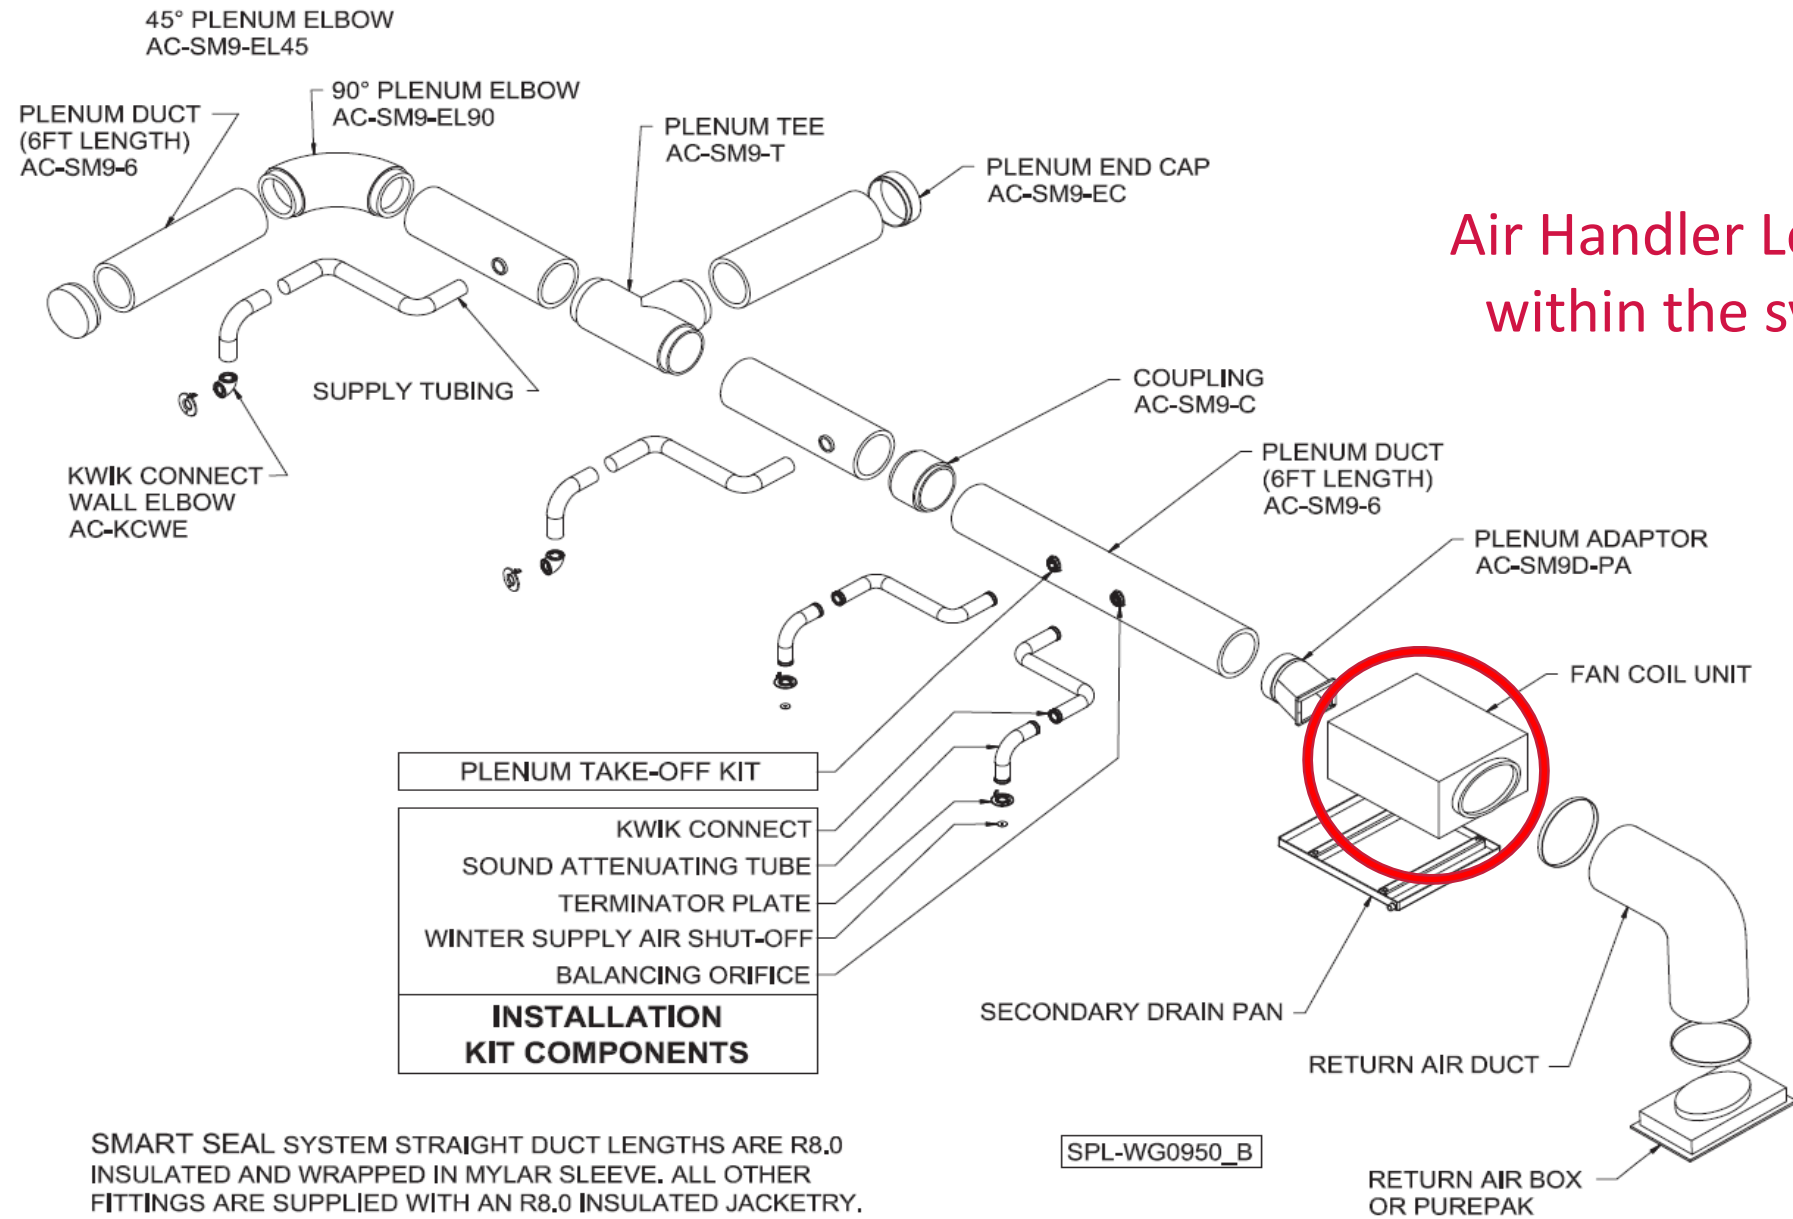

Air Handler Location within the system

SMART SEAL SYSTEM STRAIGHT DUCT LENGTHS ARE R8.0 INSULATED AND WRAPPED IN MYLAR SLEEVE. ALL OTHER FITTINGS ARE SUPPLIED WITH AN R8.0 INSULATED JACKETRY. DUCT COMPONENTS SHOWN WITHOUT FACTORY SUPPLIED R8.0 INSULATED JACKETRY.

ESP- K Series DX **Vertical** Air Handler

A2L COMPLIANT
Safer & Greener

- A2L Refrigerant Sensors
 - (R32 and R454B)
- No Adjustment or Rework Required
- Red K Series Control Board Indicates A2L Refrigerant Compliance
- 2 Line Display
- High Efficiency EC Integrated Motor/Blower Assembly
- Mode Specific Adjustable Speed Control
- Heat Pump Compatible
- Chatleff Thermal Expansion Valve
- Slide Out Blower
- Sweat-Type Refrigerant Connections
- 24V 50/60hz Transformer
- Industry Leading Corrosion Resistant Cabinet
- Float Switch
- Mold Resistant Primary Drain Pan
- Anti-Vibration Foam Strips



ESP-K Specifications

Model	System Capacity (Nom. Tons)	Electrical Characteristics*	Maximum Current Ampacity (230V)	Maximum Current Ampacity (115V)	Rating of Over Current Protective Device (230V)	Rating of Over Current Protective Device (115V)	Connections				Recommended Condensing Unit				
							Suction Line (.O.D.)	Liquid Line (.O.D.)	Cond. Drain (FPT)	Return Inlet (in/mm)	Nominal Capacity (MBH)	Nominal Capacity (kW)	Min SEER	Short Circuit Current Rating	Maximum Allowable Pressure for Refrigerant Circuit
ESP-2430 (K,V)	2 - 2 1/2	230/60/1	9.5 A	13.25 A	15 A	20 A	7/8"	3/8"	3/4"	15/381	24 - 30	7.03 - 8.79	13+	5 kA	700 PSI
ESP-3642 (K,V)	3 - 3 1/2	230/60/1								19/483	36 - 42	10.55 - 12.31			
ESP-4860 (K,V)	4 - 5	230/60/1								24/610	48 - 60	14.07 - 17.58			


*Unit Includes Optional Conversion Kit to 115V

Model	System Capacity (Nom. Tons)	Blower				Coil		Ship. Wt. (lbs/kg)	
		Std. CFM @ 1.2" W.C.	Wheel Dia. and Width	Motor HP	115V/230V F.L. Amps*	No. of Rows Deep	Flow Control Device	K	KV
ESP-2430(K,V)	2 - 2 1/2	440, 550	10" x 6"	3/4	5.6/2.8	6	TXV	105 / 47.63	135 / 61.24
ESP-3642(K,V)	3 - 3 1/2	660, 850	10" x 6"	3/4	7.6/4	6	TXV	123 / 55.79	170 / 77.11
ESP-4860(K,V)	4 - 5	880, 1150	10" x 6"	3/4	10.6/5.4	6	TXV	144 / 65.32	210 / 95.25


*Unit Includes Optional Conversion Kit to 115V

ESP- K Series DX Horizontal Dimensions

Inches (MM)

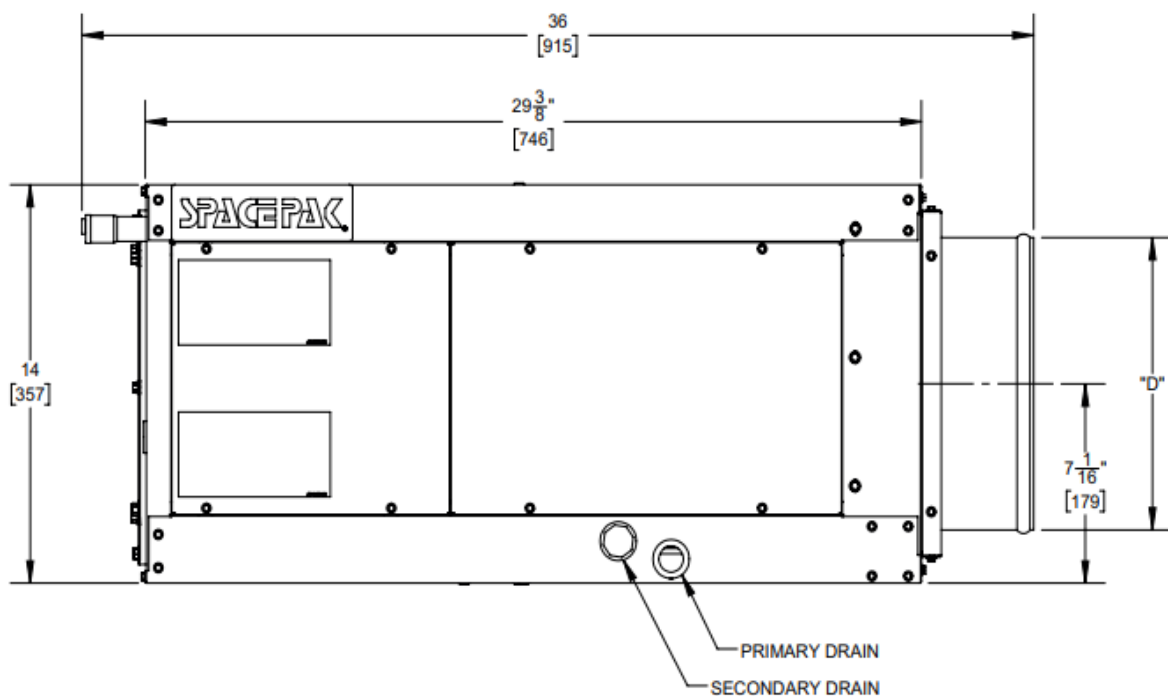

Model	A	B	C	D	E
2430K	24 1/4" (616mm)	12 1/8" (308mm)	18 1/2" (470mm)	10 1/2" (267mm)	9 1/2" (240mm)
3642K	33 1/4" (845mm)	16 5/8" (423mm)	25 3/4" (654mm)	10" (254mm)	14" (356mm)
4860K	43 1/4" (1100mm)	21 5/8" (550mm)	34 1/4" (8700mm)	10 1/4" (260mm)	19" (483mm)

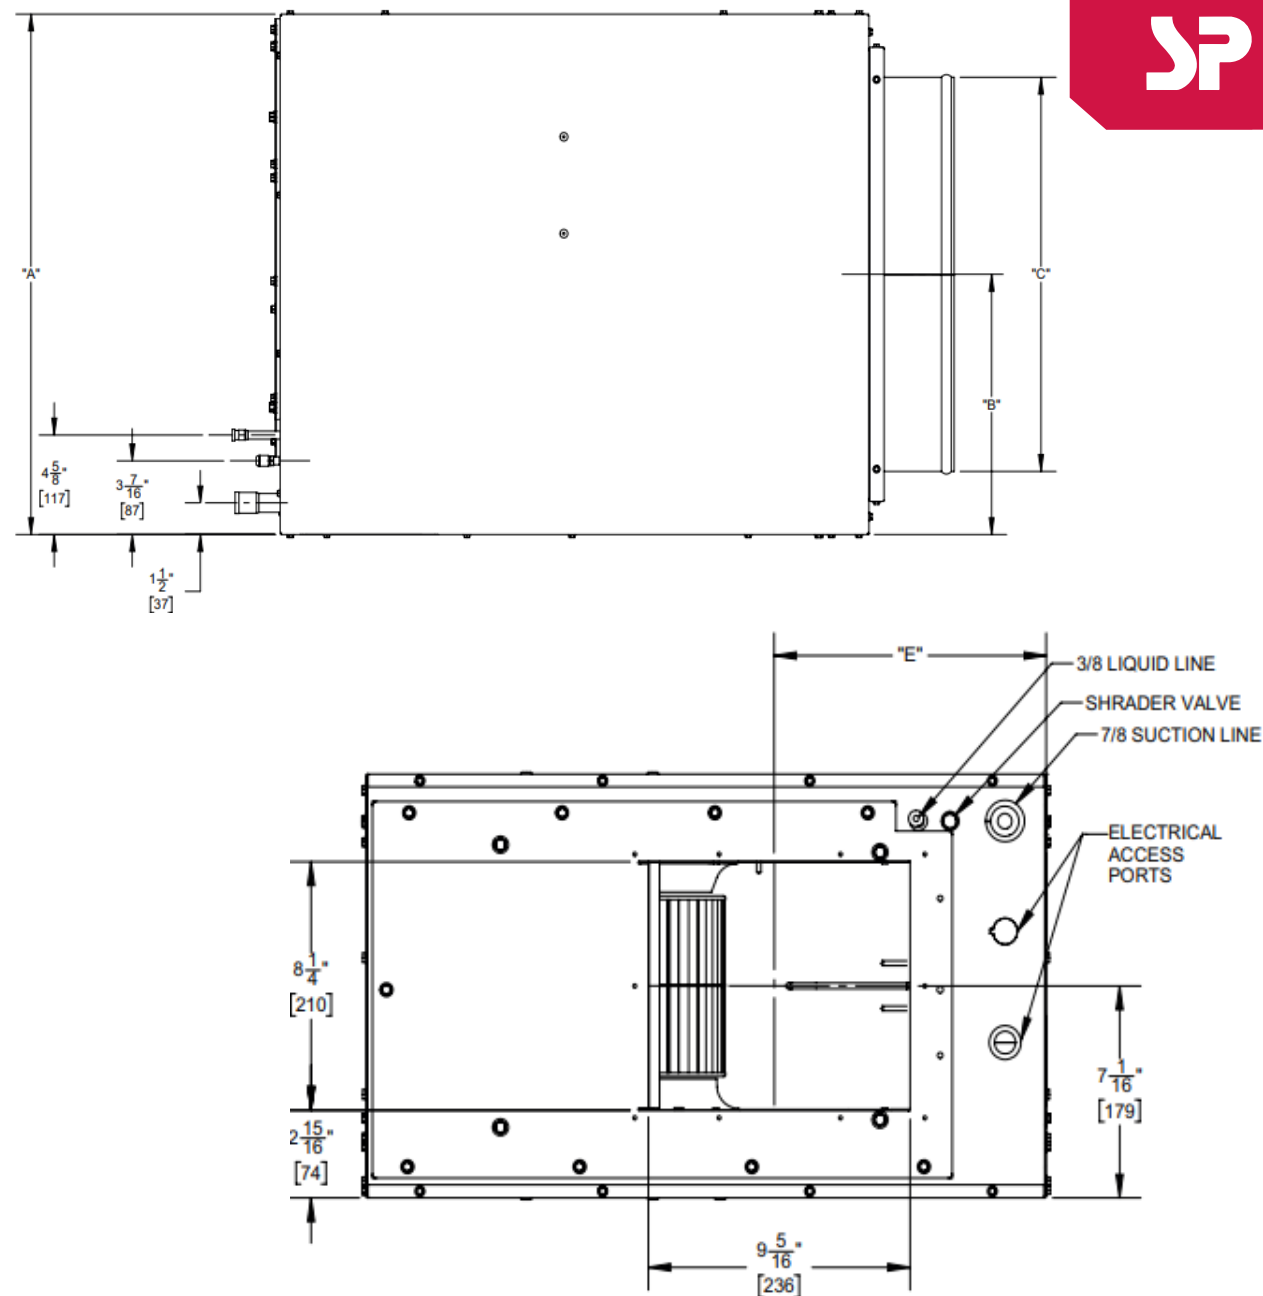

ESP- K Series DX **Horizontal** Air Handler

Match up with your favorite condenser!


Visit AHRI website frequently to see the growing list of certified matches





Steps For How to Find SpacePak Match Ups on AHRI Directory:

<https://www.spacepak.com/AHRI-Search>

ESP- K Series DX Vertical Dimensions

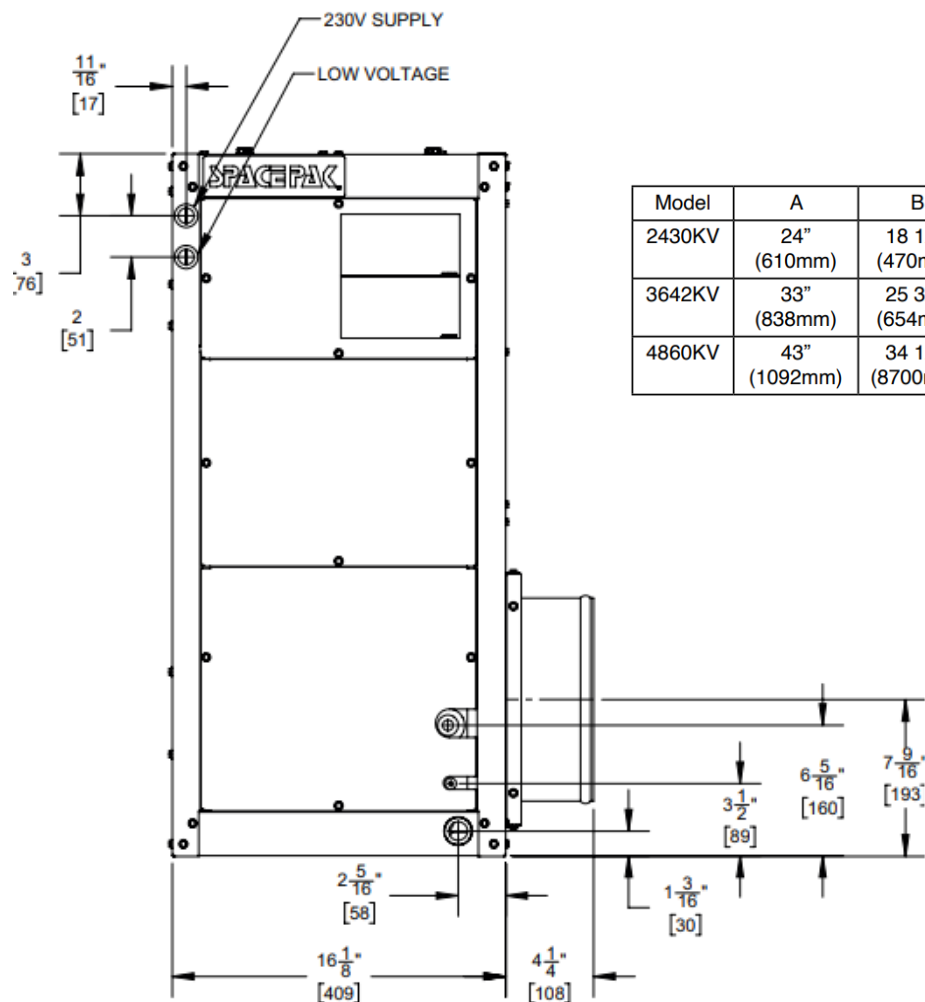

Model	A	B	C	D	E
2430KV	24" (610mm)	18 1/2" (470mm)	18 1/2" (470mm)	10 7/8" (276mm)	10 1/2" (267mm)
3642KV	33" (838mm)	25 3/4" (654mm)	25 3/4" (654mm)	15 3/8" (390mm)	10" (254mm)
4860KV	43" (1092mm)	34 1/4" (8700mm)	34 1/4" (8700mm)	20 3/8" (518mm)	10 1/4" (260mm)

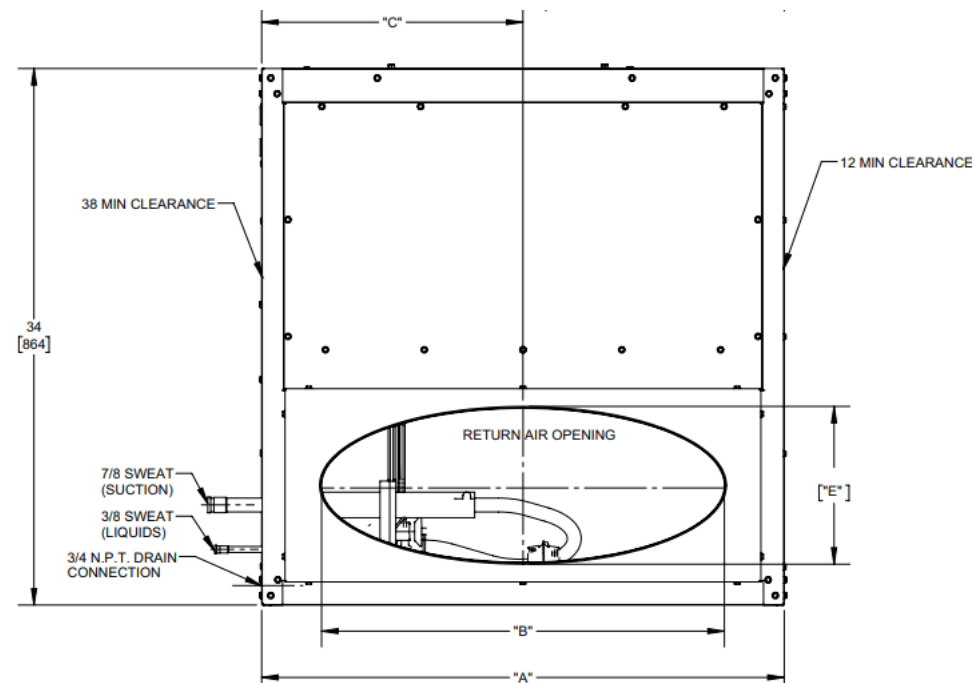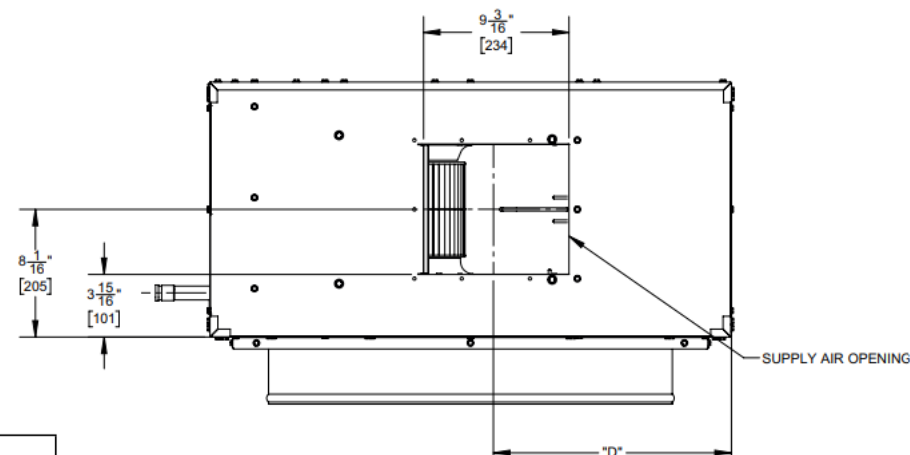


Coated Replacement Coils (On all K Series Units and replacement coils)


ElectroFin[®] heat transfer coatings

Factory-Applied Corrosion-Resistant Coil Coating


ElectroFin[®] E-Coat is a stand-alone brand in the HVAC&R industry, and offers the highest level of corrosion protection available from an electro coating applicator. Recognized internationally, ElectroFin[®] E-Coat extends the lives of HVAC&R heat transfer coils and components while reducing maintenance and operating costs.

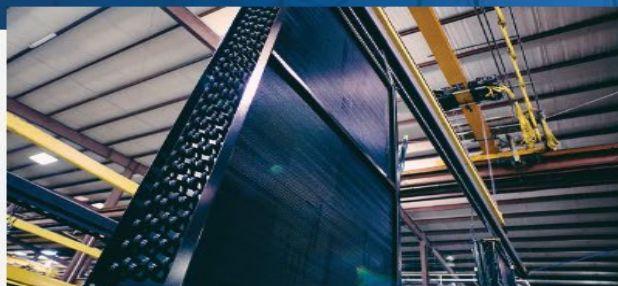


K Series units have a **RED** control Board

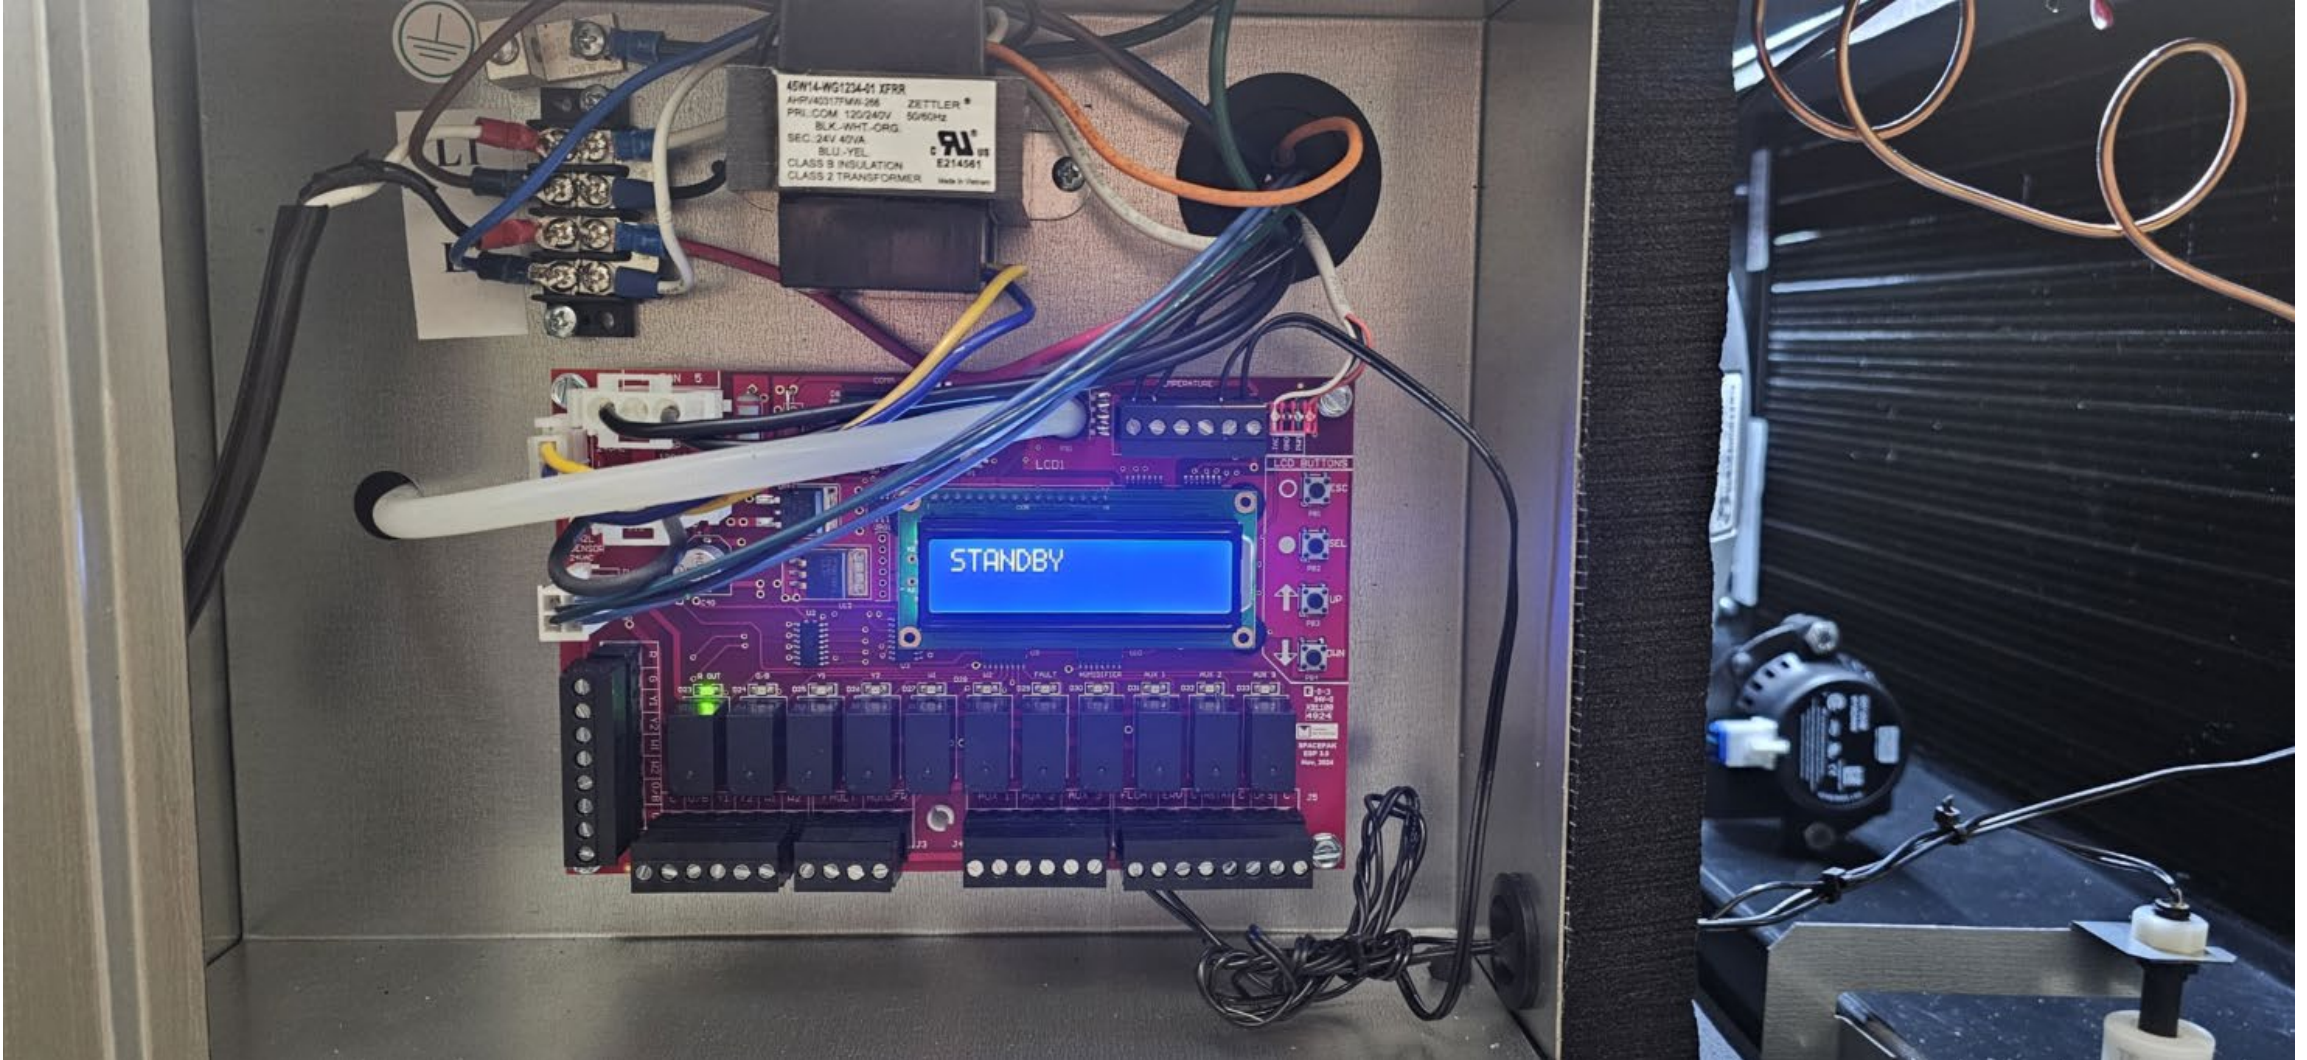

Independent R32 and 454B Sensors (Coated Coil Shown)

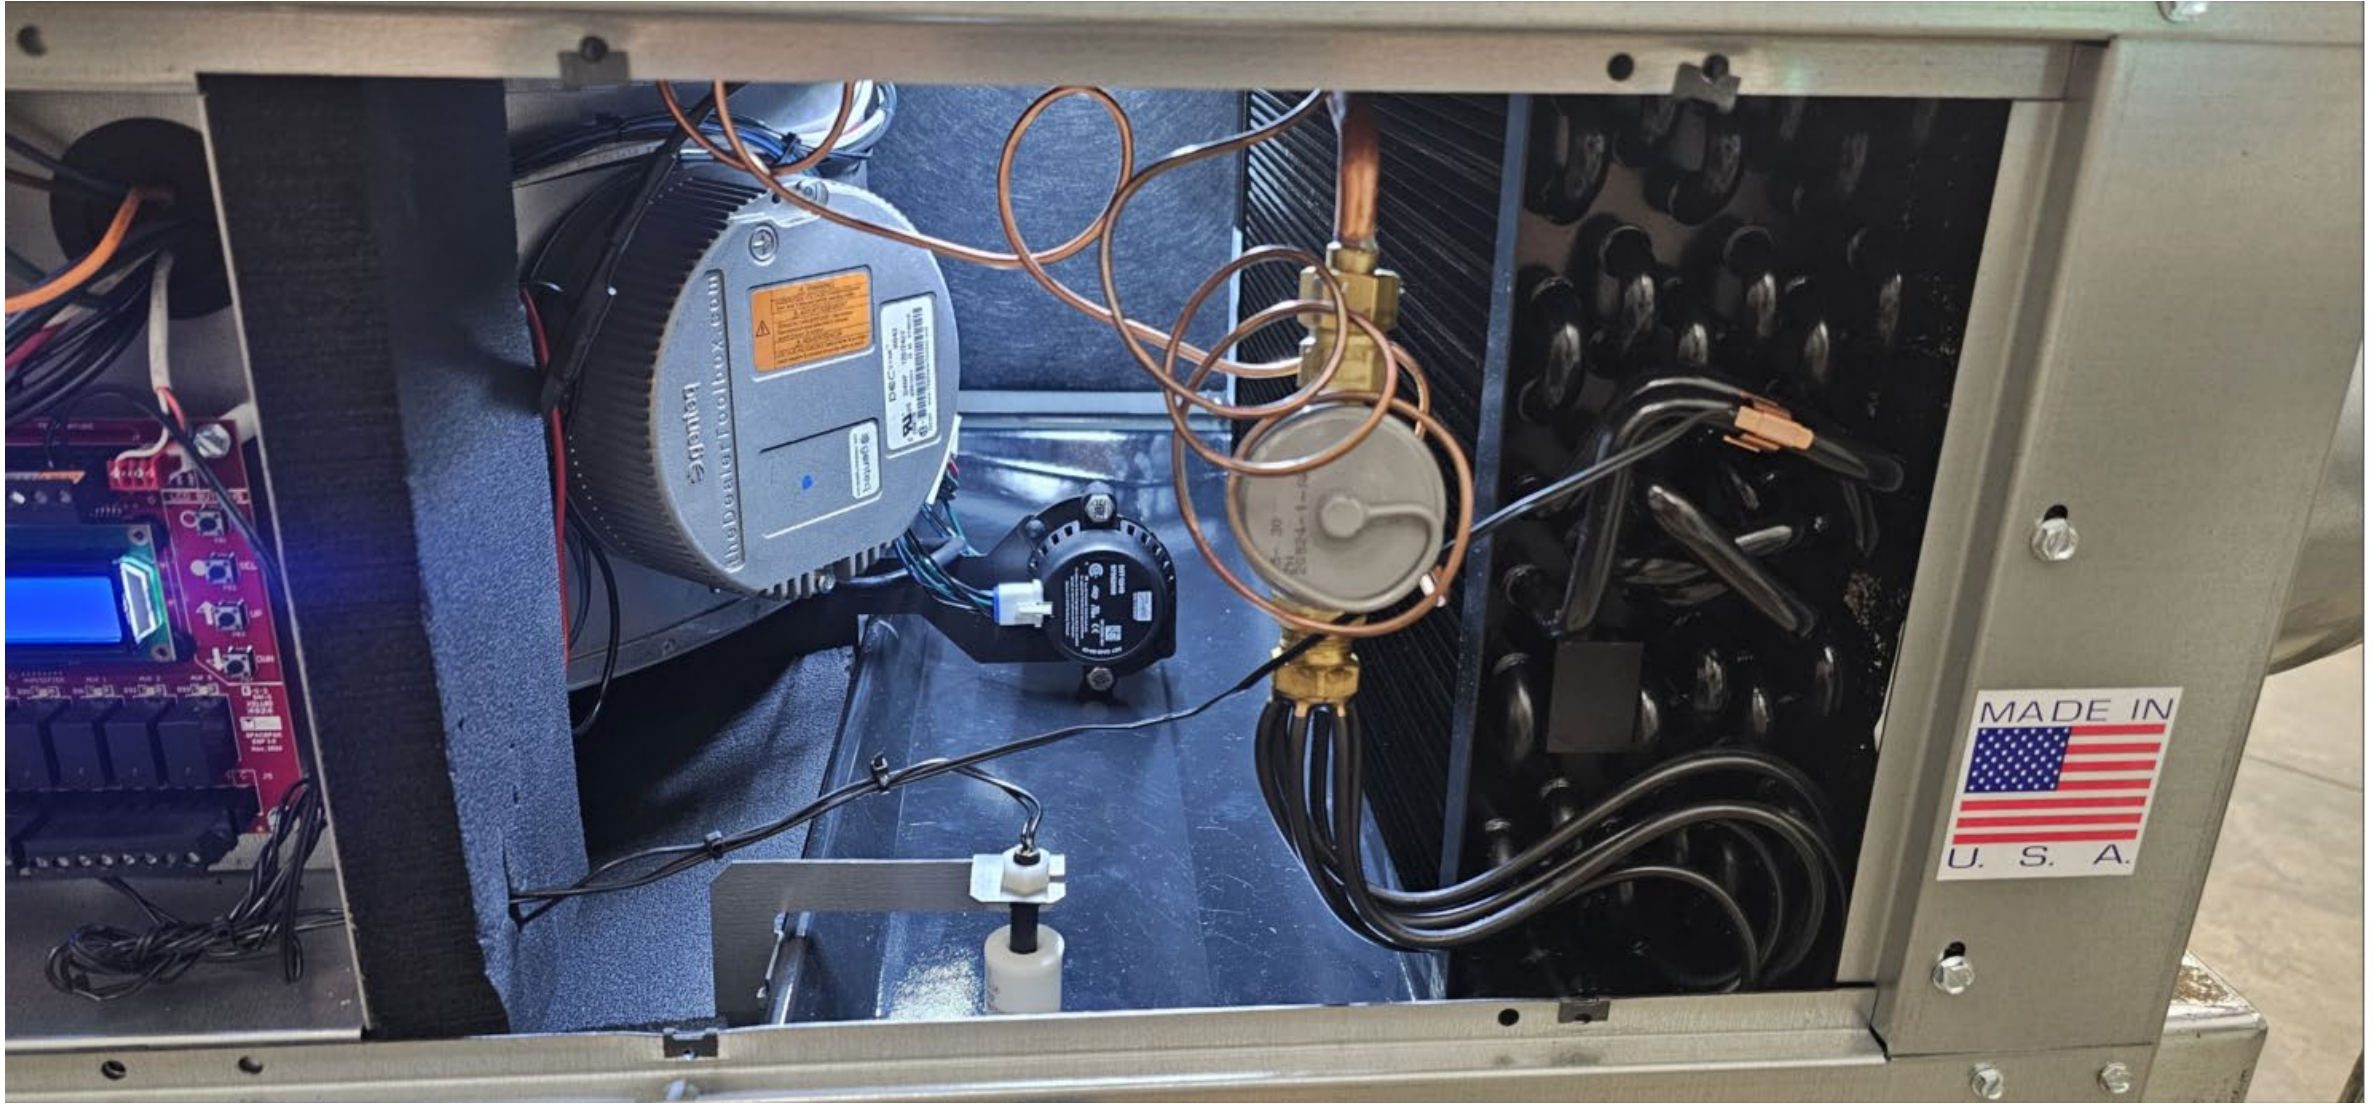


K Series Wiring Diagram

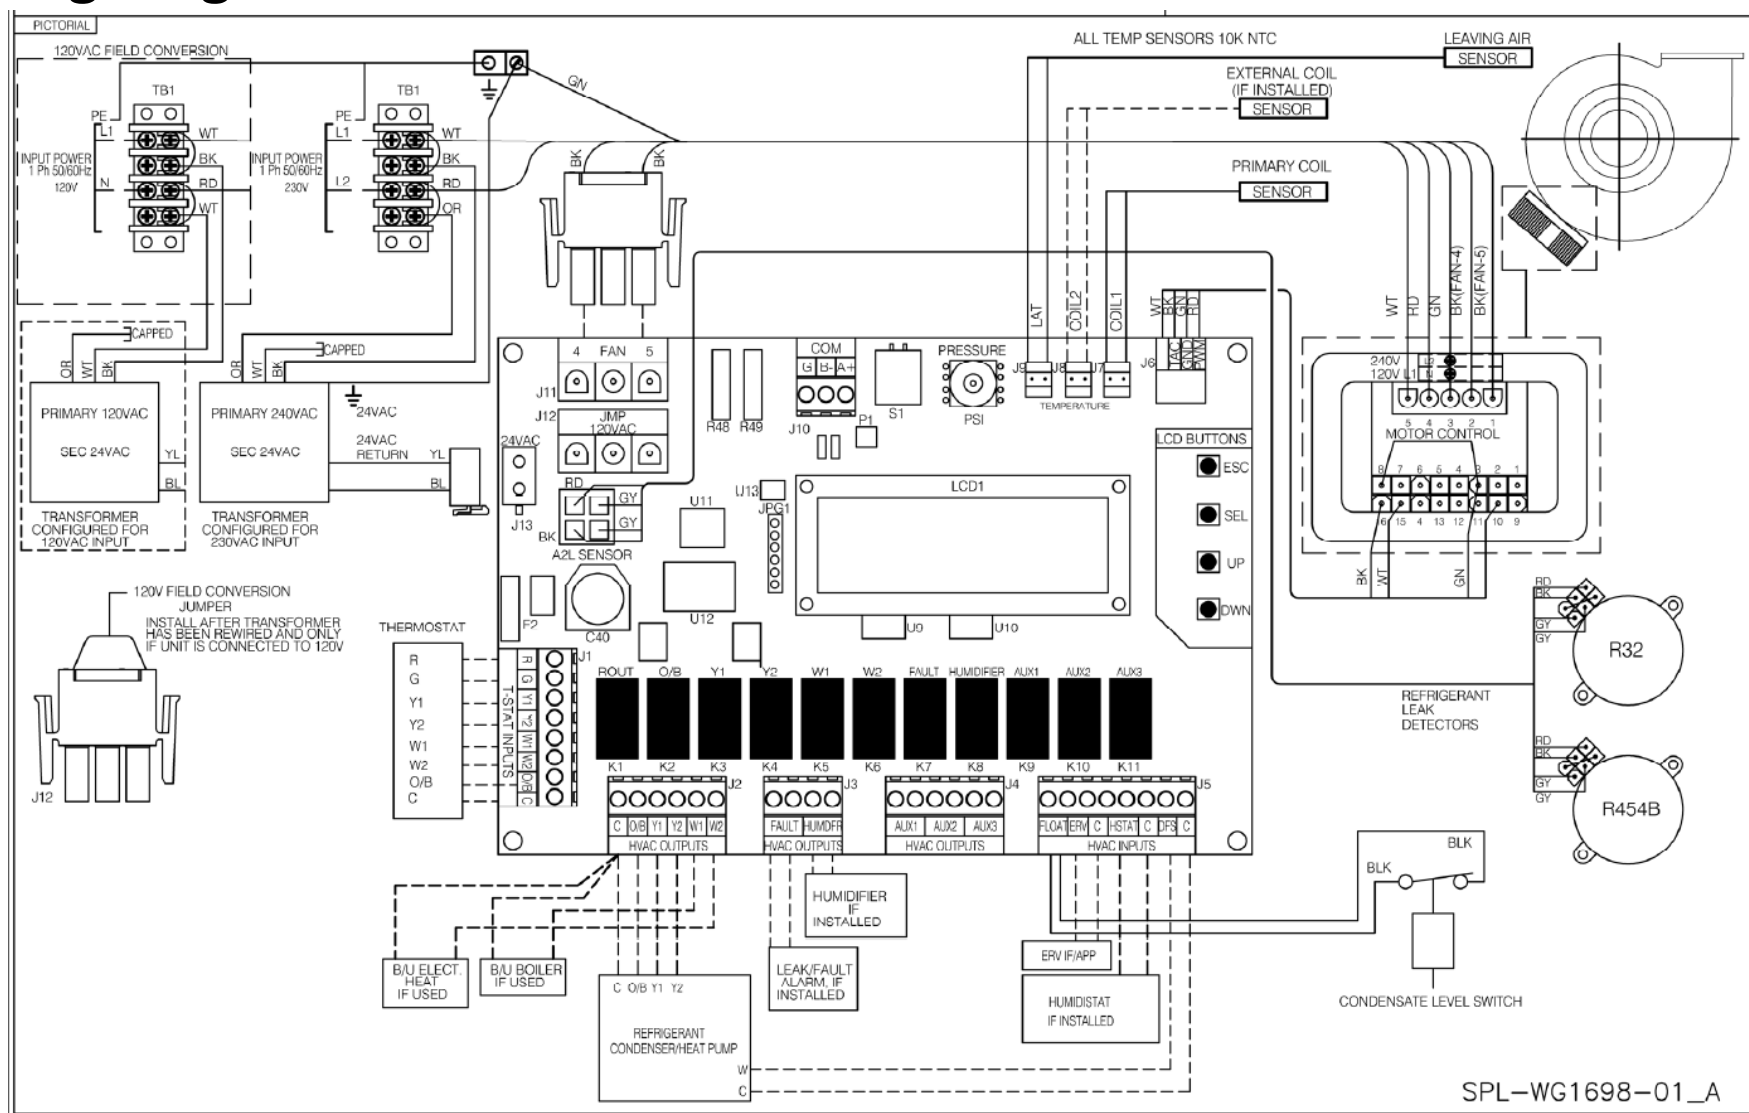


Superior Coil

- 6-row copper coil
- More coil surface = greater humidity removal
- 30% more moisture removed
- More Btus at lower CFMs
- Up to a 28°F air delta across the coil
- Colder discharge allows for lower volumes of air movement
- Suitable for R-32 and R-454B refrigerants

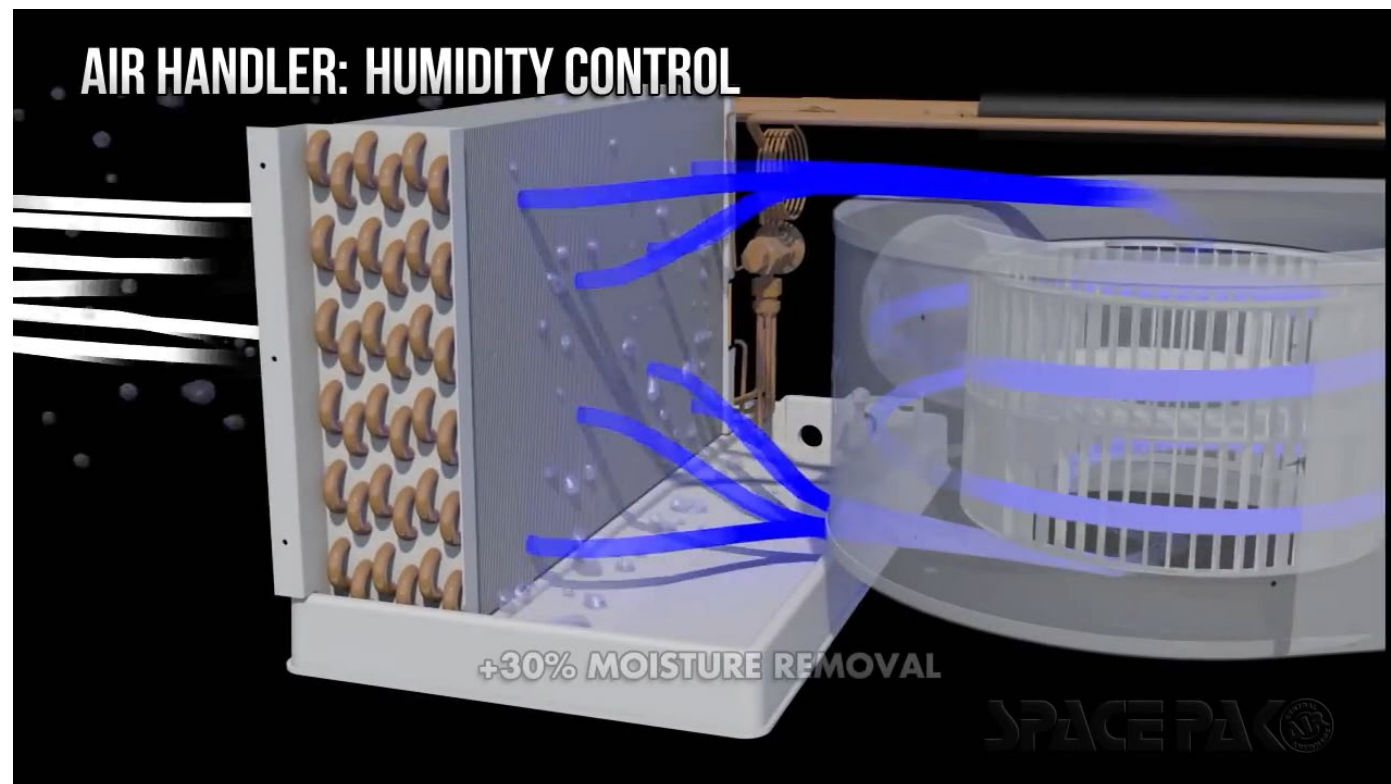

Superior Coil

- With more moisture removed a higher temperature set point will feel “Cooler”

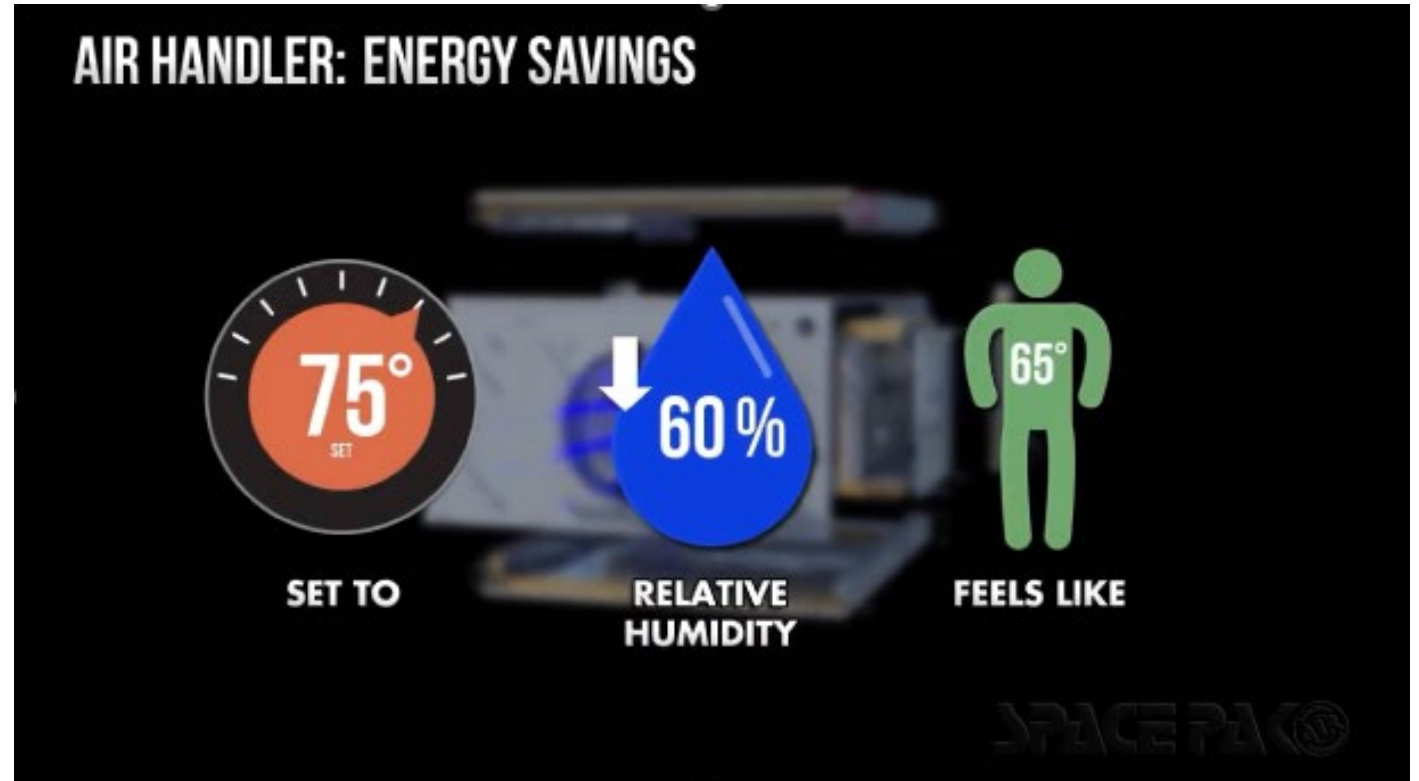


System Charging Basics

Follow Outdoor Condenser Manufacturer Instructions For

- All charging procedures
- Temperature and Pressure charts




TXVS: Then & Now

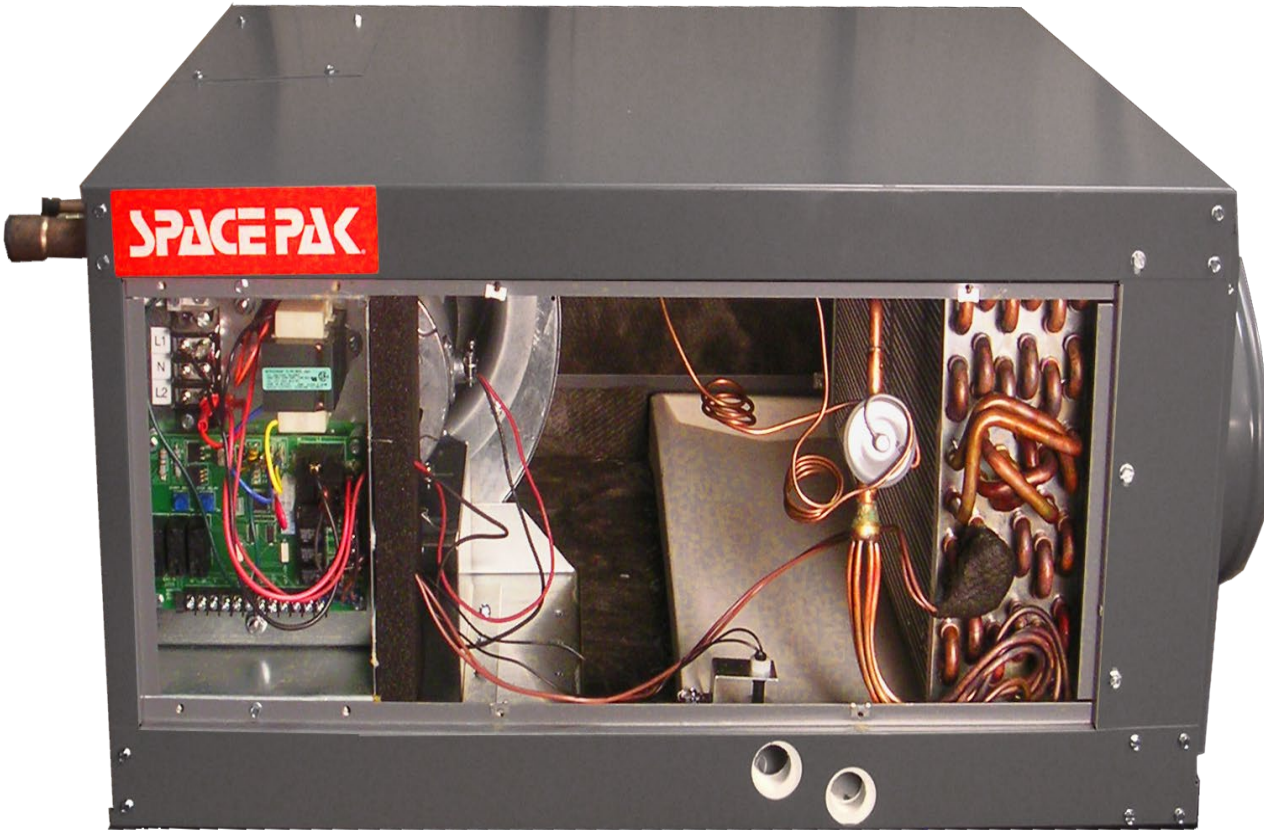

Note: Our TXV is suitable for use in air-to-air heat pump applications.

Condensate Trap Assembly

- The proper installation of the trap is critical to the correct operation of the system!
- Supplied by SpacePak

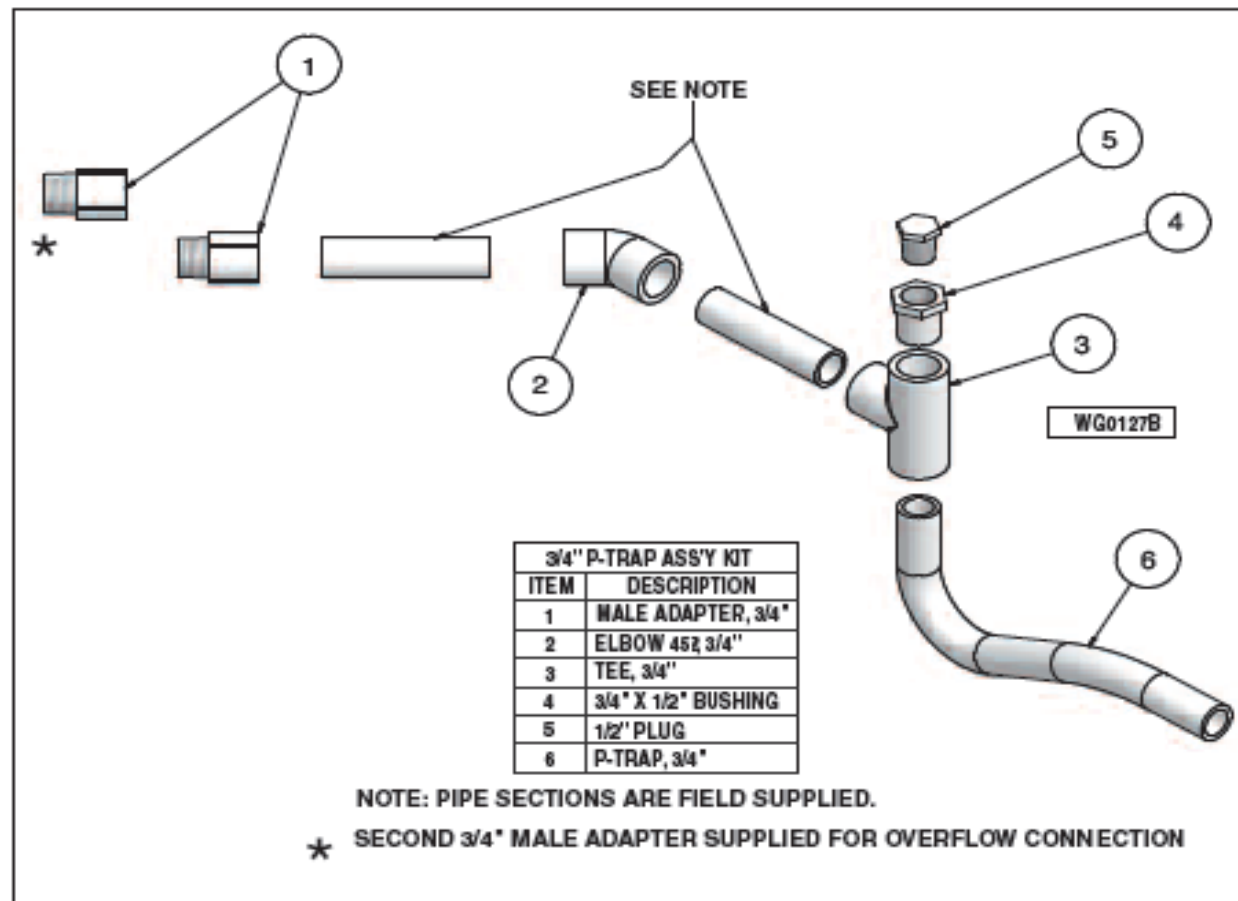

Additional Heating & Cooling



EEH Direct Mount Electric Heater

(Includes K Series)

6 Sizes Available

2kw


5kw

7.5kw

10kw



15kw

20kw

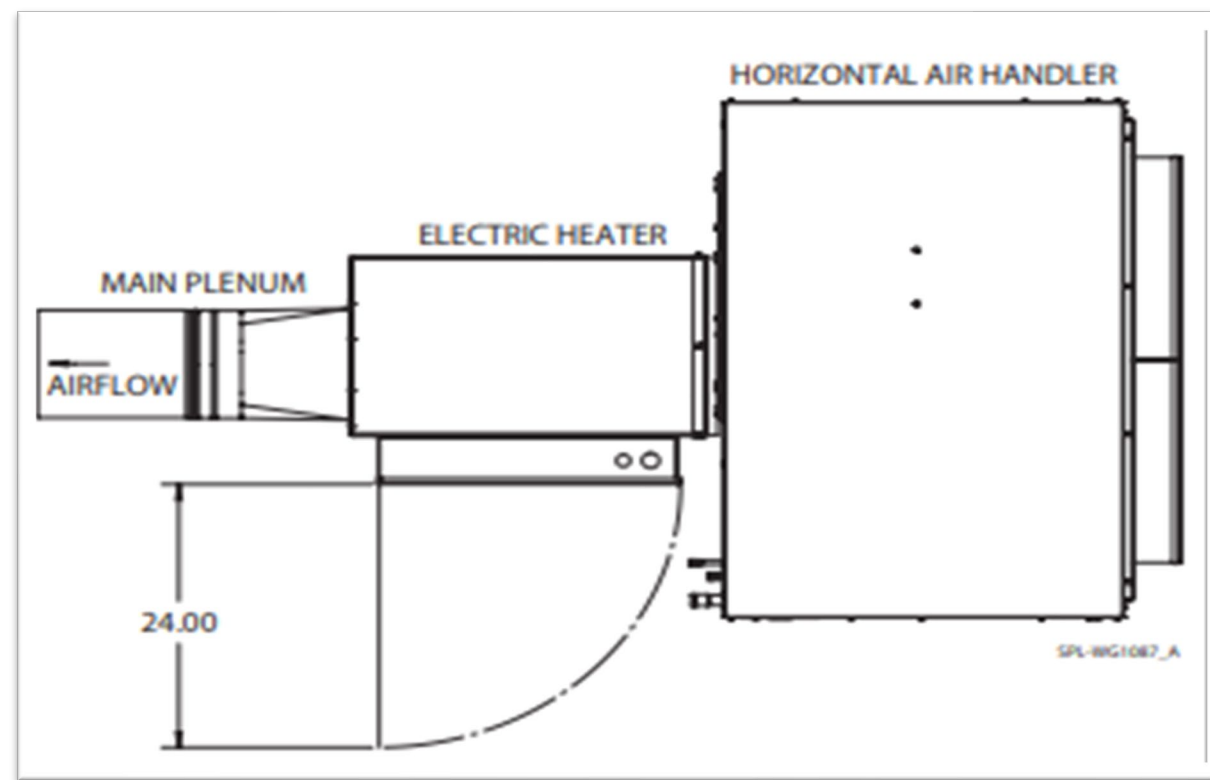


EEH Electric Heating Mounting & Wiring

(Includes K Series)

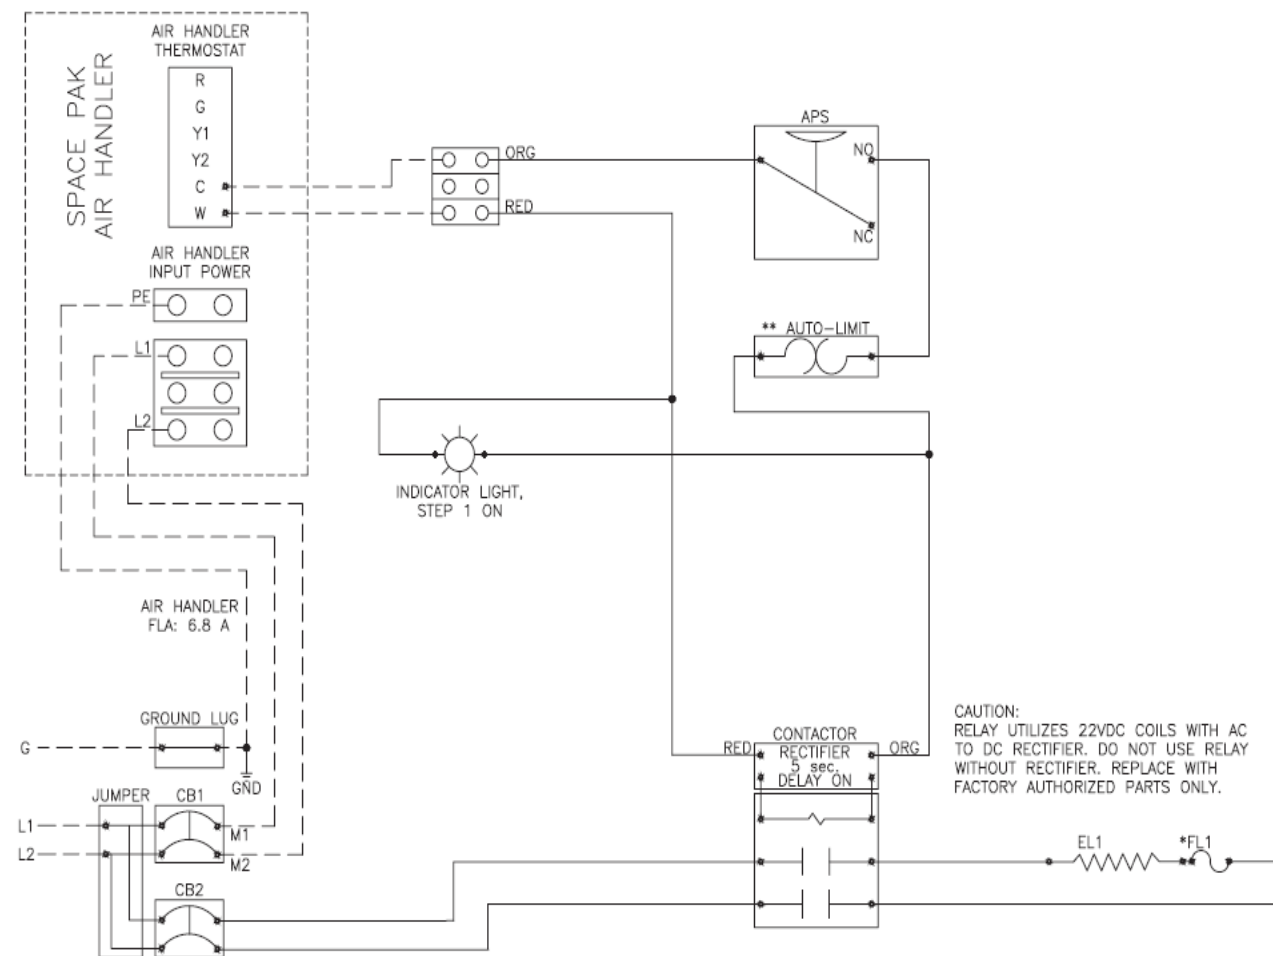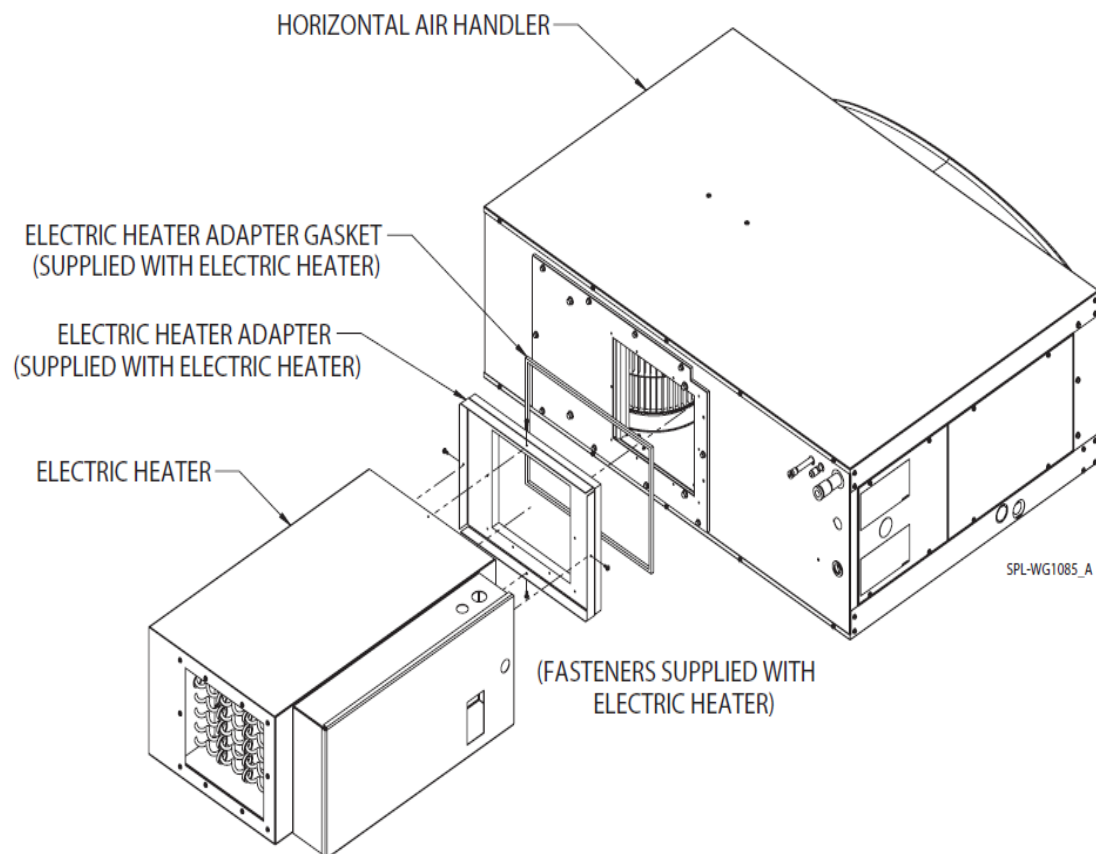

Hot Water Coil

K Series Compatible

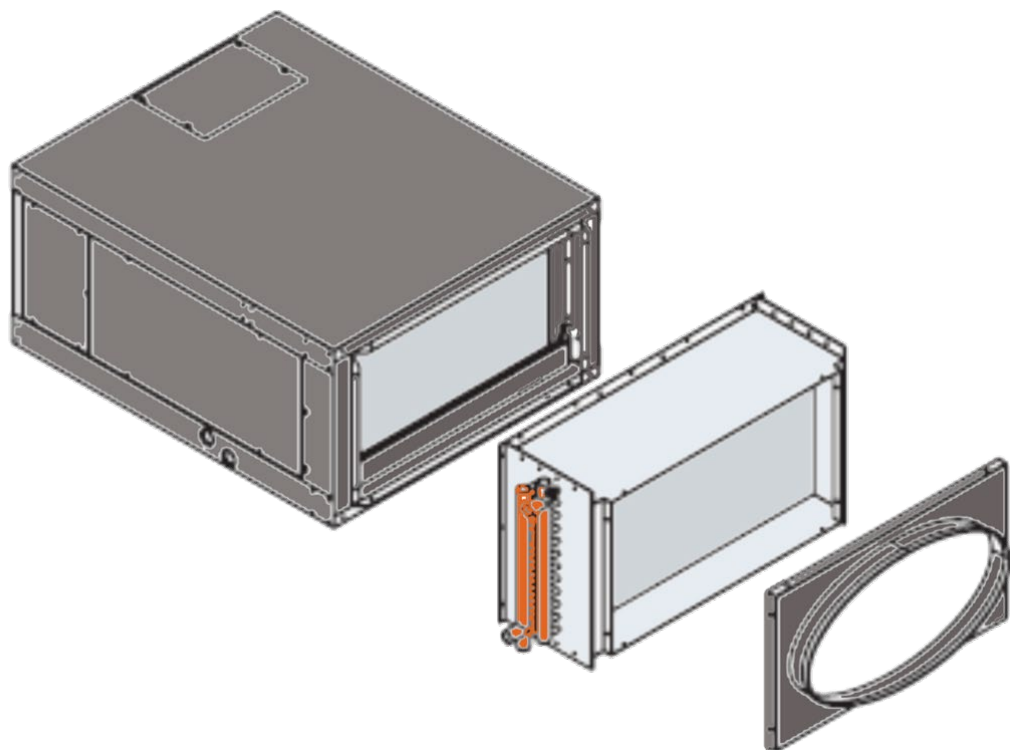

Model AC-WPAK-60 for ESP 2430

GPM	Entering Water Temperature °F				
	120	140	160	180	200
2	20.5	30.0	39.1	48.1	57.2
4	25.2	35.6	46.1	56.6	67.1
6	26.6	37.4	48.3	59.2	70.2
8	27.2	38.2	49.3	60.4	71.6
10	27.5	38.7	49.9	61.1	72.3

At 550 CFM and 70°F Entering Air Temperature*

Model AC-WPAK-90 for ESP 3642

GPM	Entering Water Temperature °F				
	120	140	160	180	200
2	28.8	39.2	51.6	63.4	75.2
4	36.0	50.8	65.7	80.8	95.8
6	39.0	54.9	70.9	87.0	103.1
8	40.4	56.8	73.3	89.9	106.5
10	41.2	57.9	74.7	91.5	108.4

At 850 CFM and 70°F Entering Air Temperature*



Model AC-WPAK-120 for ESP 4860

GPM	Entering Water Temperature °F				
	120	140	160	180	200
2	31.7	46.2	61.2	75.1	89.0
4	45.6	64.2	83.0	102.0	120.9
6	50.6	71.2	92.0	112.9	133.8
8	53.1	74.7	96.4	118.2	140.1
10	54.6	76.7	98.9	121.2	143.6

At 1150 CFM and 70°F Entering Air Temperature*


Hot Water Coil Installation Location

K Series Compatible

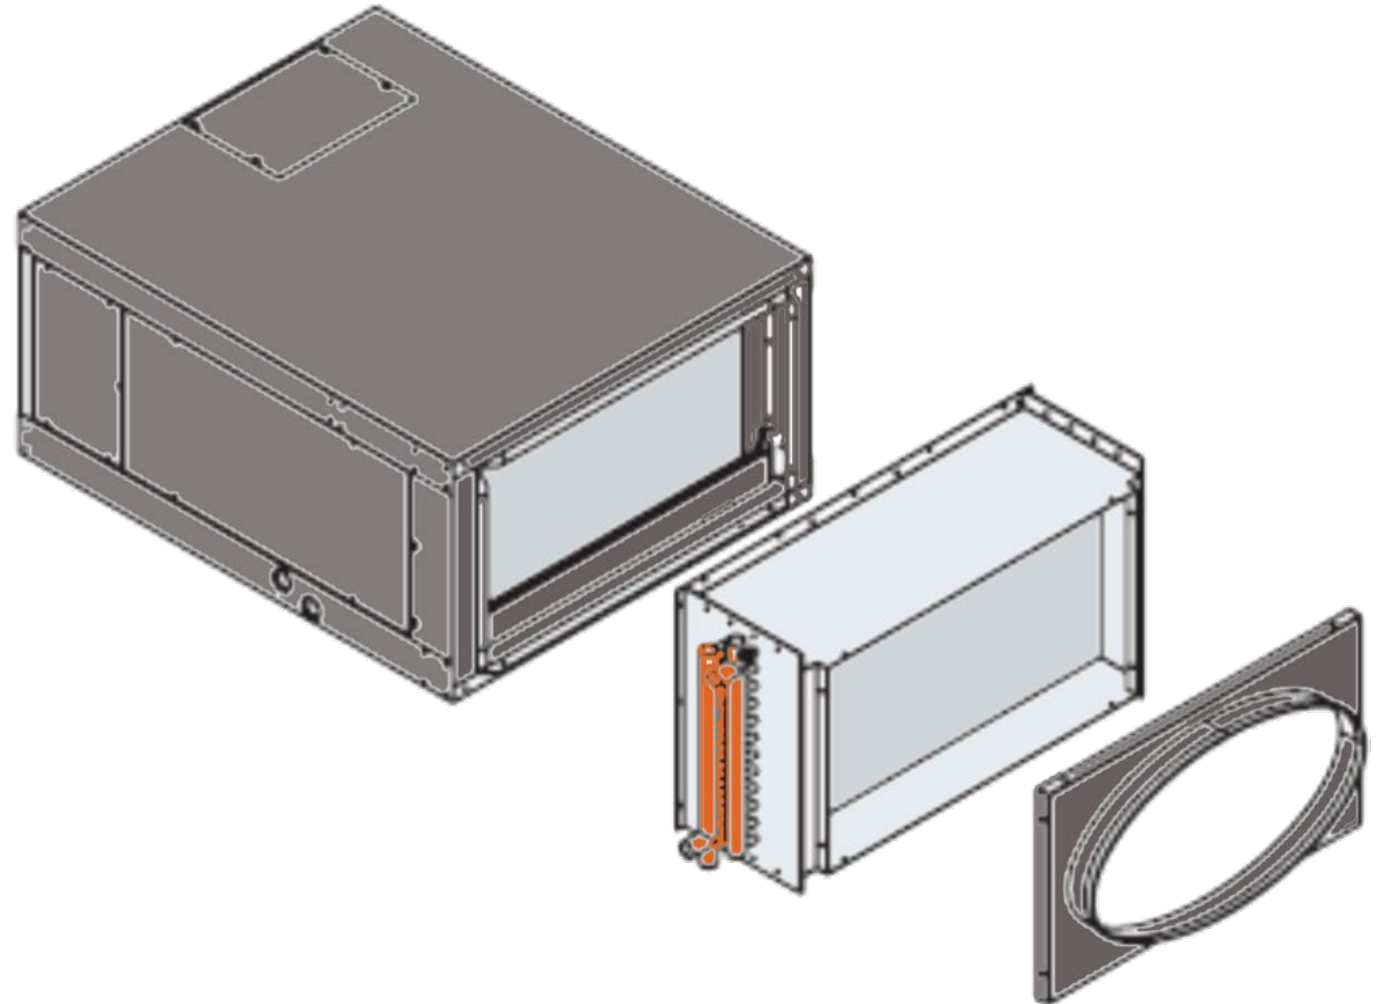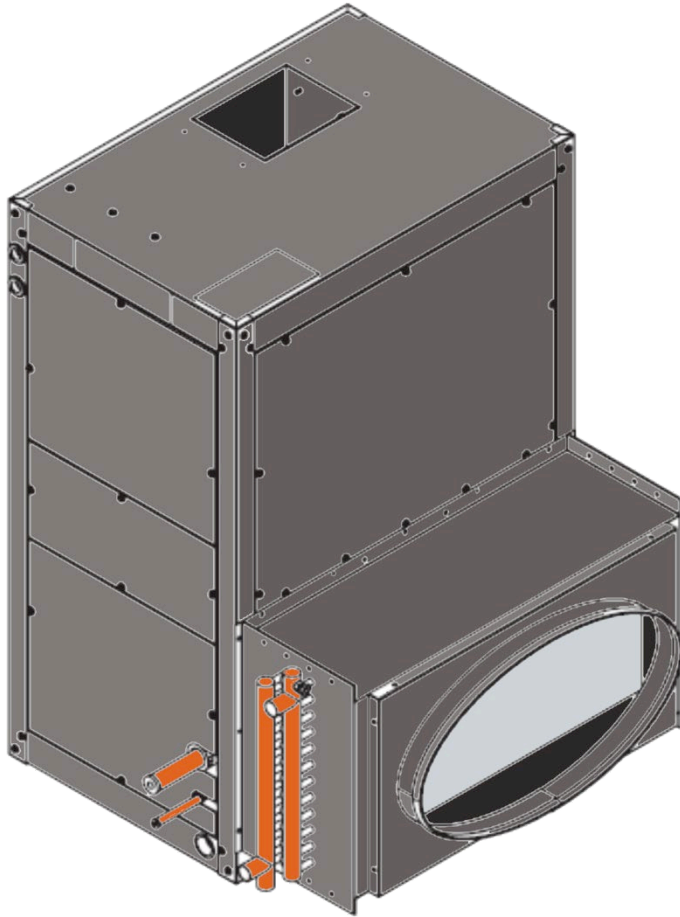

Hot Water Coil Installation

Hot Water Coil Model #	BTUH Capacity (Nominal)	Return Air Duct Adaptor* Model #	Fan Coil Unit Model #s
AC-WPAK-60	60,000	AC-WRDA-60	ESP-2430
AC-WPAK-90	90,000	AC-WRDA-90	ESP-3642
AC-WPAK-120	120,000	AC-WRDA-120	ESP-4860

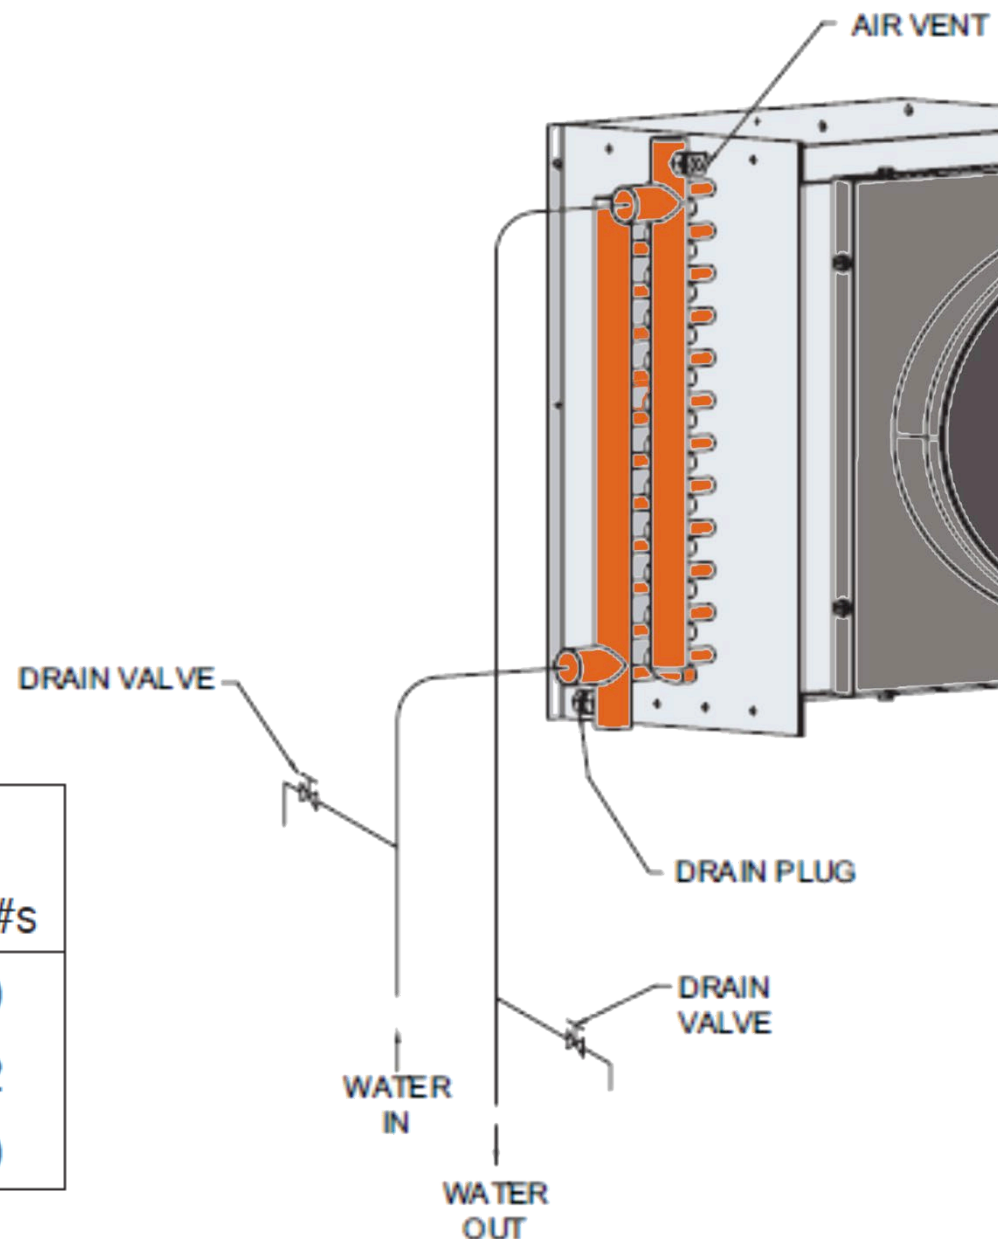


BasePak Secondary Drain Pans for Horizontal Fan Coils

- Durable polyethylene will not rust
- Resistant to mold growth
- UL recognized material
- Integral, multi-function support channels
- Supports unit when suspended with threaded rod
- Fits through hole-cut used for Return Air Box
- Threaded $\frac{3}{4}$ " drain connection
- Meets international mechanical code 307.2.3



Hot Water Installation with Drain Pan

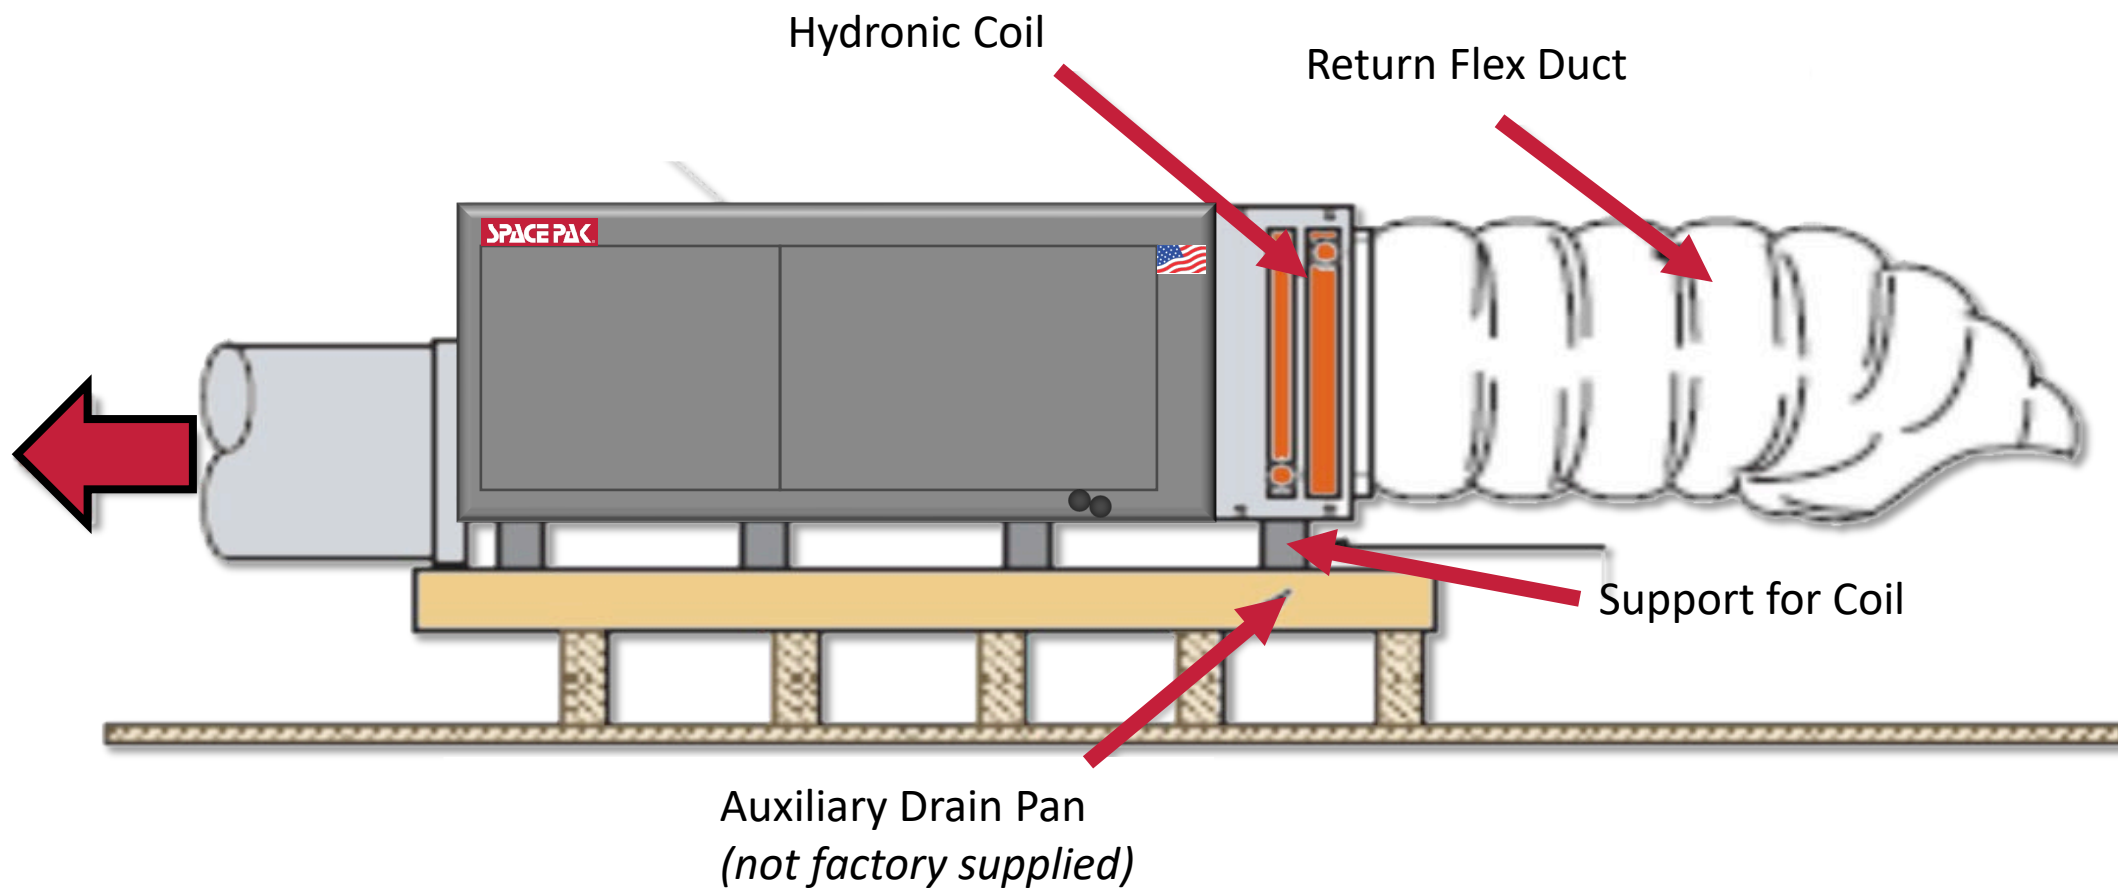


Note: Be sure that the drain pan installed is large enough to protect anything that may drip, this is cheap insurance!

Questions?



The Return


Option of Central or Multiple Returns

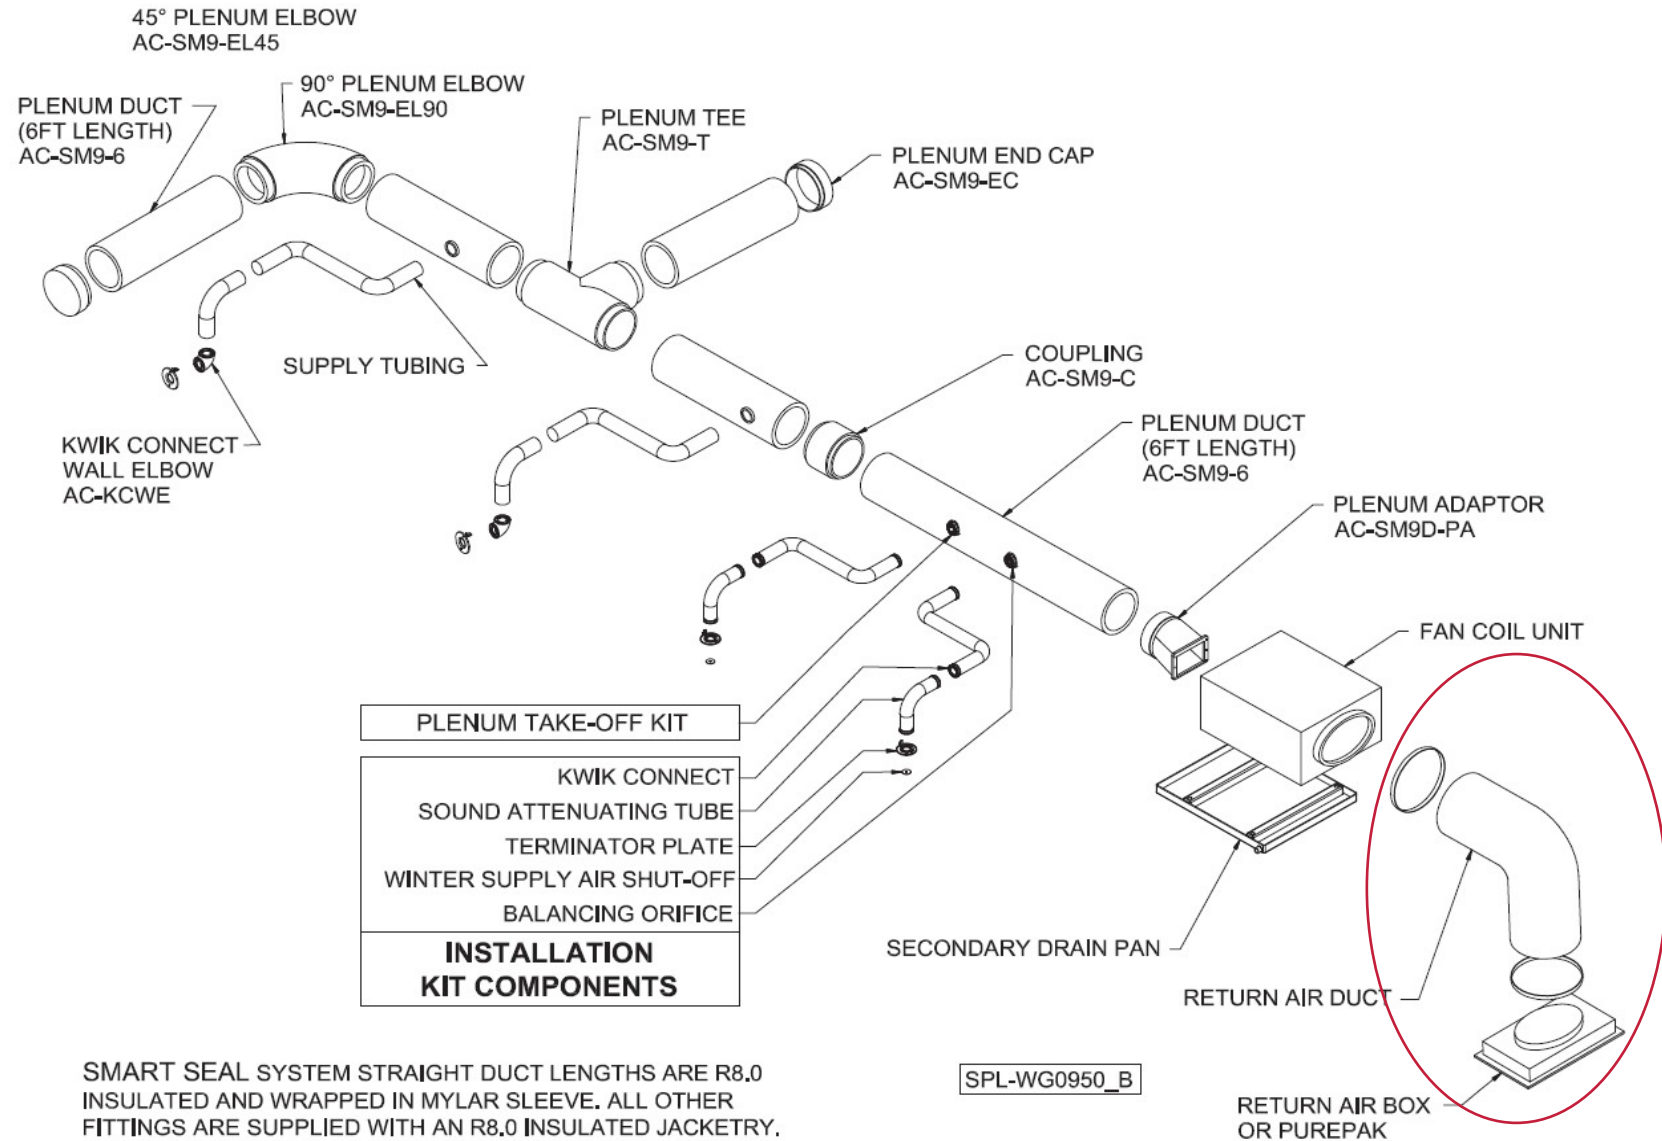


SMART SEAL SYSTEM STRAIGHT DUCT LENGTHS ARE R8,0 INSULATED AND WRAPPED IN MYLAR SLEEVE. ALL OTHER FITTINGS ARE SUPPLIED WITH AN R8,0 INSULATED JACKETRY. DUCT COMPONENTS SHOWN WITHOUT FACTORY SUPPLIED R8,0 INSULATED JACKETRY.

Locate and Roughing in the Return

- Central Location (Hallway/Foyer)
- All Equipment Can Fit through the Return Hole Cut Including the Air Handler
- Be Sure to Have More than Enough Return Air for the System
- Do Not “Skimp” On Return. You cannot have too much.

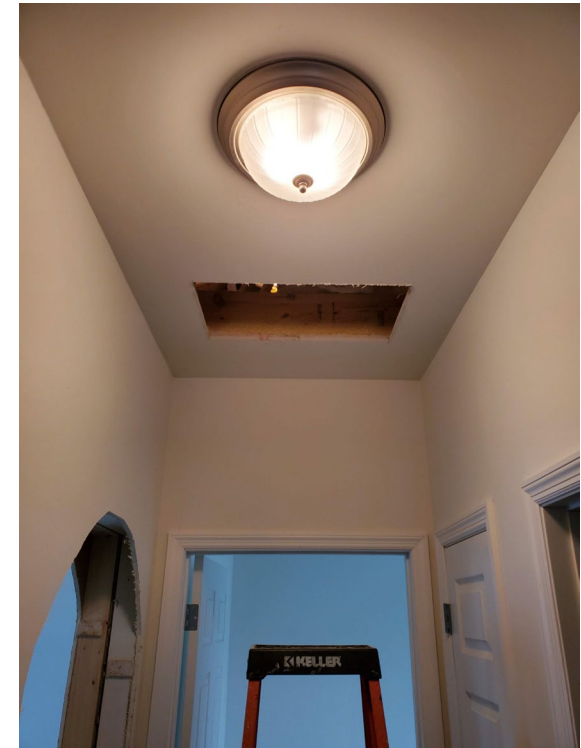

Return Considerations

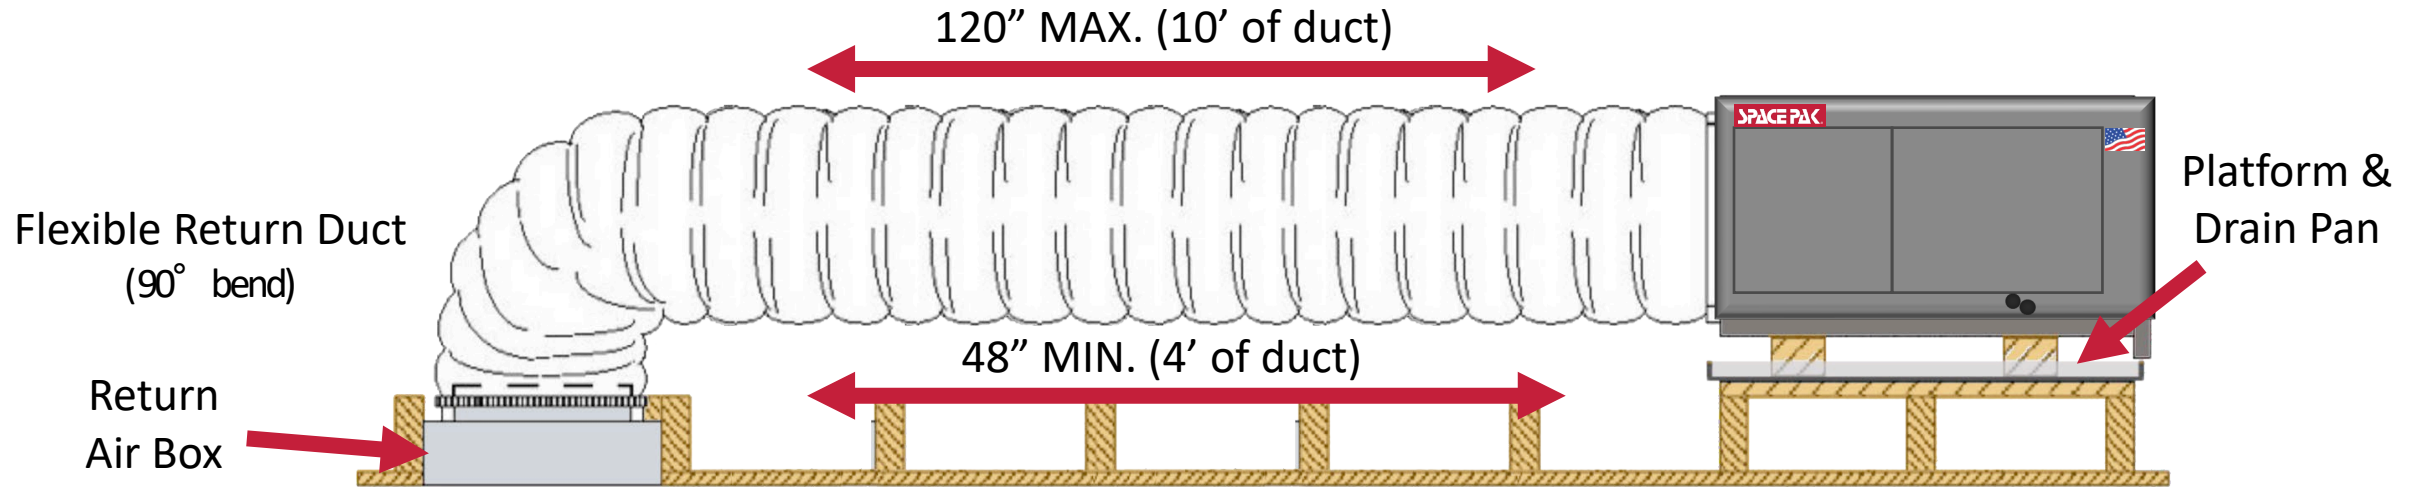

Model	Return Duct
ESP-2430	15"
ESP-3642	19"
ESP-4860	24"

NOTE: When return lengths of longer than 10ft exist, using a standard return duct sizing chart at 500 FPM and no more than -0.25" WC may be necessary for proper upsizing.

Return Basics

- Size Return in each location for less than 500 FPM (similar to conventional)
- Size Return in each location for a total $-.25''$ static or less including the filter
- Install at least One 90-degree elbow (this will aid in the abatement of unwanted noise)
- Return Box must be lined with sound attenuation material (also for noise abatement)
- Size transfer grills for the CFM and Free Area (use standard duct sizing chart)

Note: If return creates too much “suction” over $-.5''$ wc this suggests the lack of return air and creates the potential to cause issues with proper condensate draining resulting in faults or water damage.

Central Floor Return

This was a central return for (1) 5-ton heating and cooling system (approx. 30" x 30")



Best Practices for Multiple Returns

MULTIPLE RETURN ACCEPTABLE DUCT SIZE BY TONNAGE

ROUND DUCT SIZE, THESE SIZES WILL INSURE A QUIET AIR SPEED OF LESS THAN 500 FPM

	2 TON	2.5 TON	3 TON	3.5 TON	4 TON	5 TON
AIR FLOW	440	550	660	770	880	1100


2 RETURNS

10' OR LESS	9"	10"	11"	12"	13"	15"
10' TO 20'	10"	11"	12"	13"	13"	15"
30' TO 40'	11"	12"	13"	13"	14"	16"

3 RETURNS


10' OR LESS	8"	9"	9"	10"	12"	12"
10' TO 20'	8"	9"	10"	11"	12"	12"
30' TO 40'	9"	10"	11"	12"	13"	13"

Multiple Returns

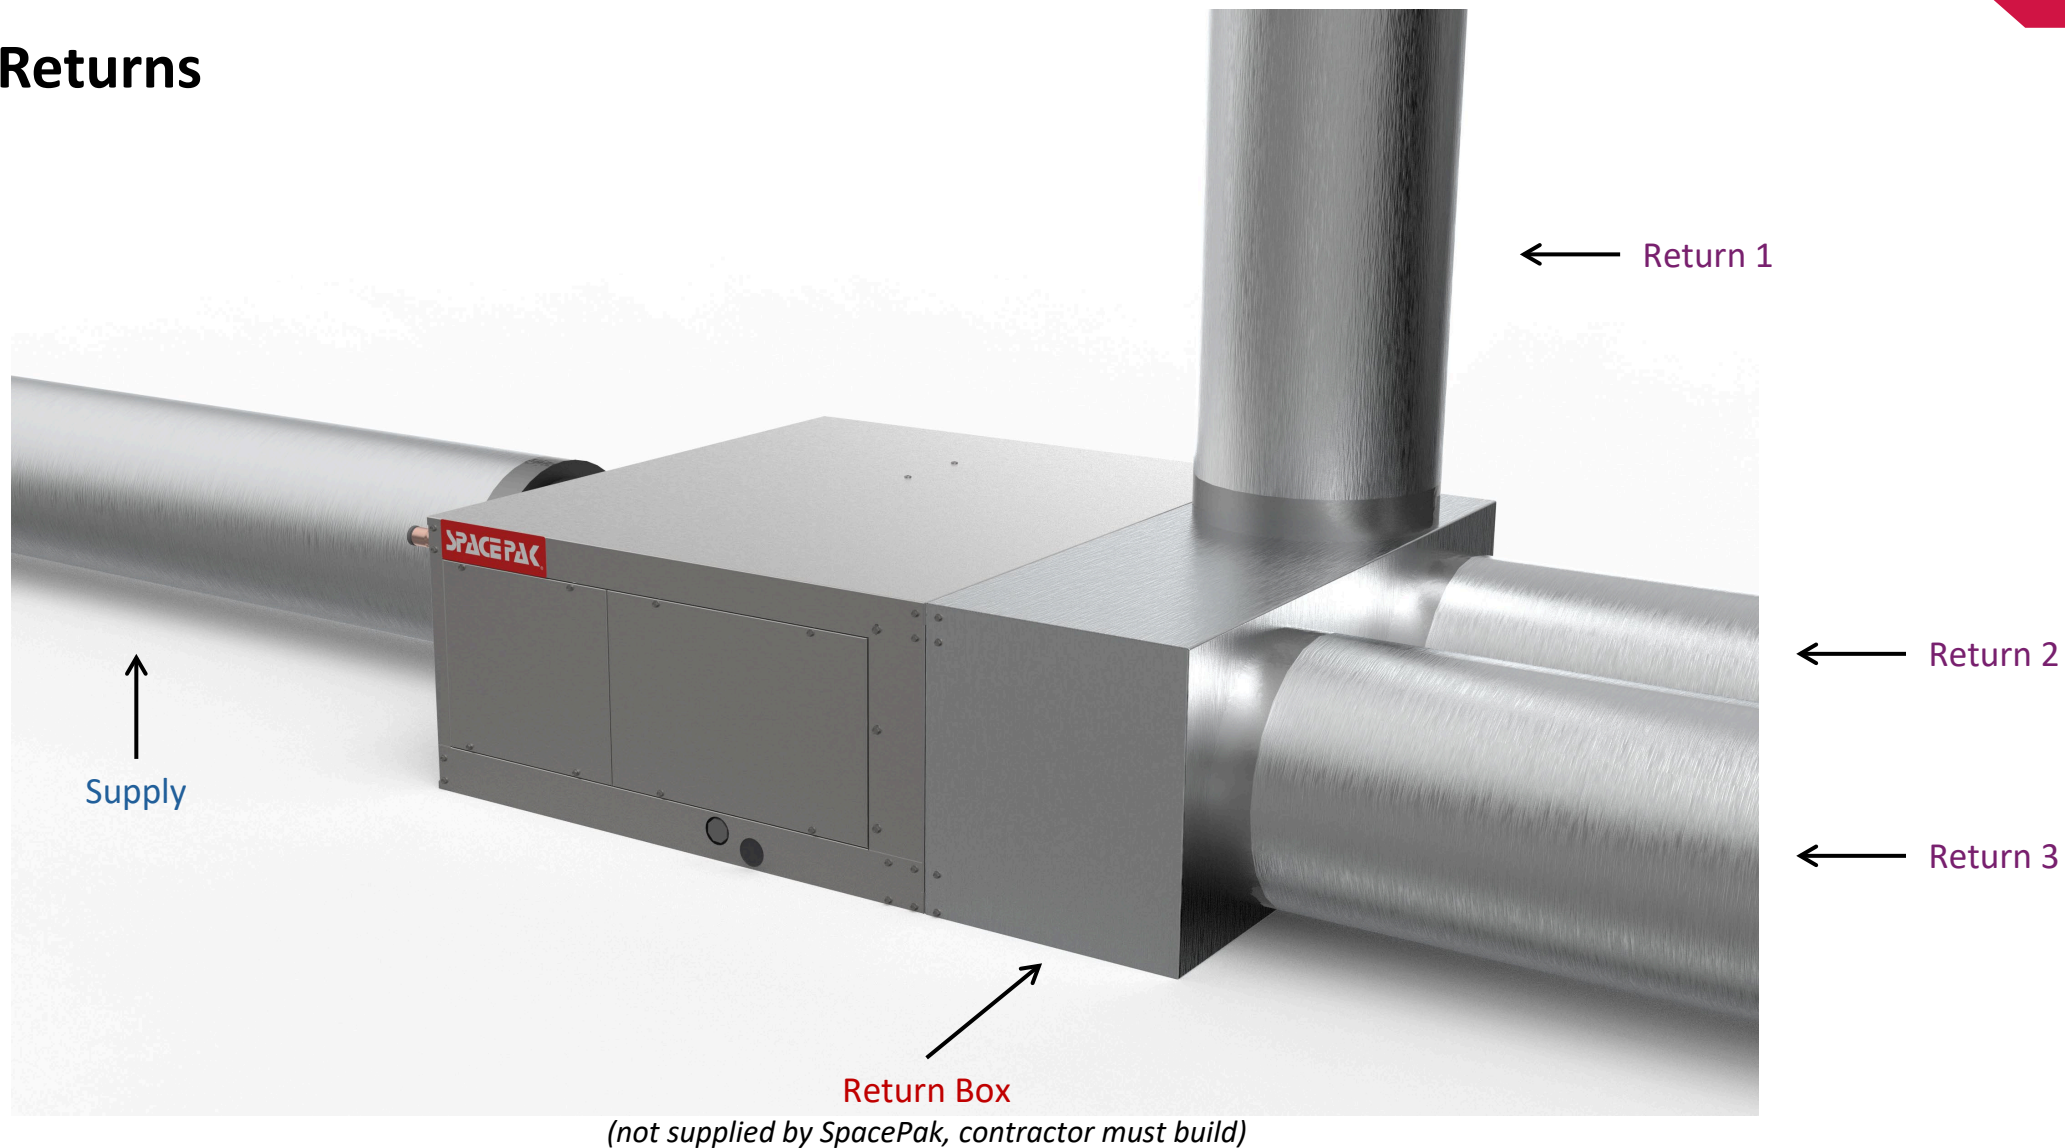

IAQ Options (J and K Series Control Board)

TYPICAL HRV/ERV SPACEPAK SYSTEM INSTALLATION

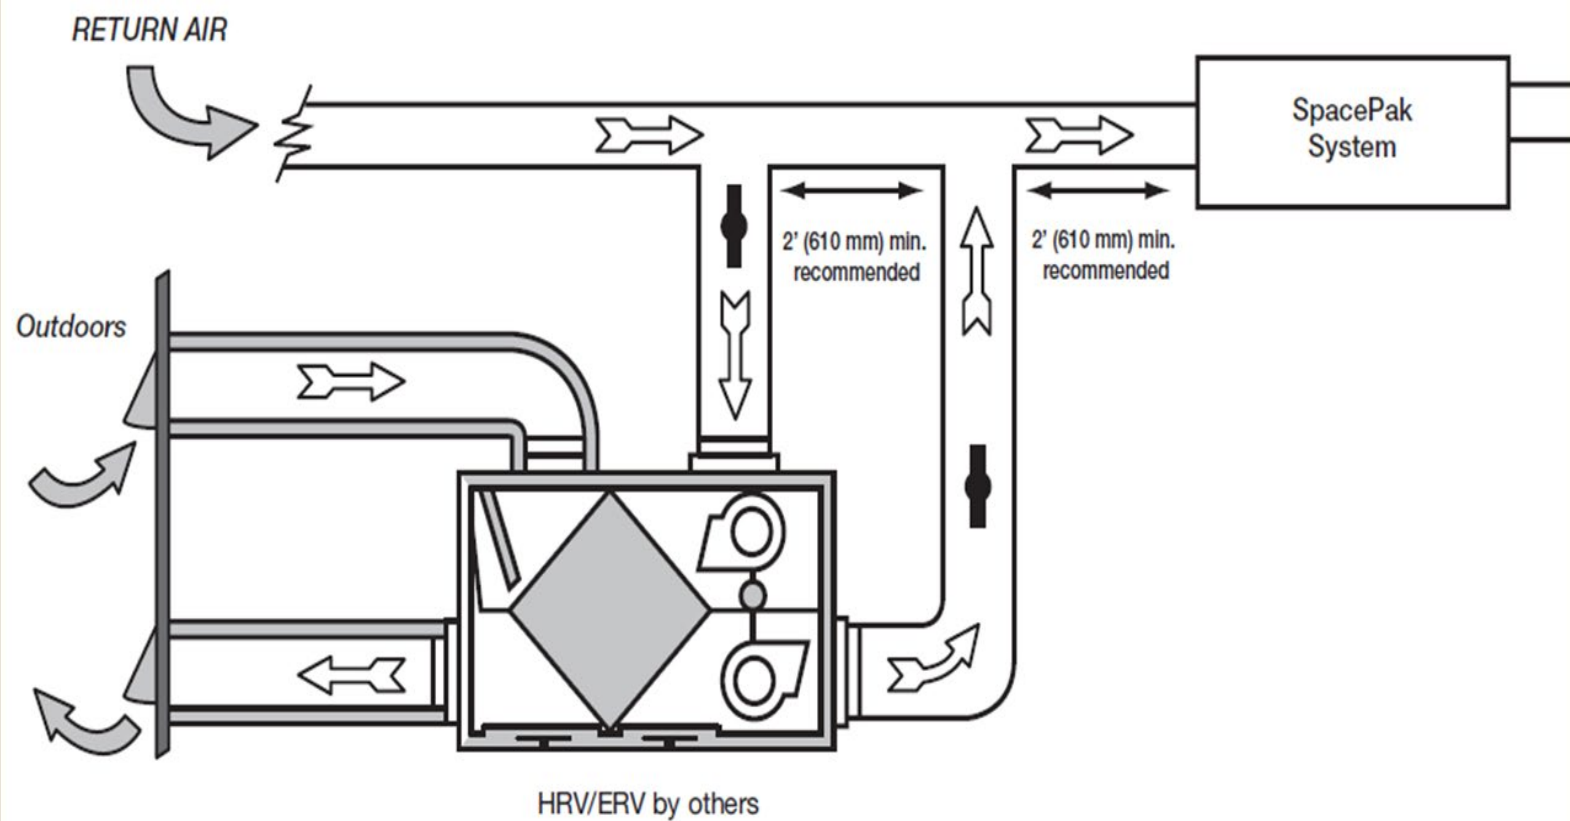


Note: Aftermarket air cleaning solutions are okay to use, but please be sure that the correct amount of return air is maintained, and that the third-party product is certified for use with SDHV.

Questions?



Main Trunk

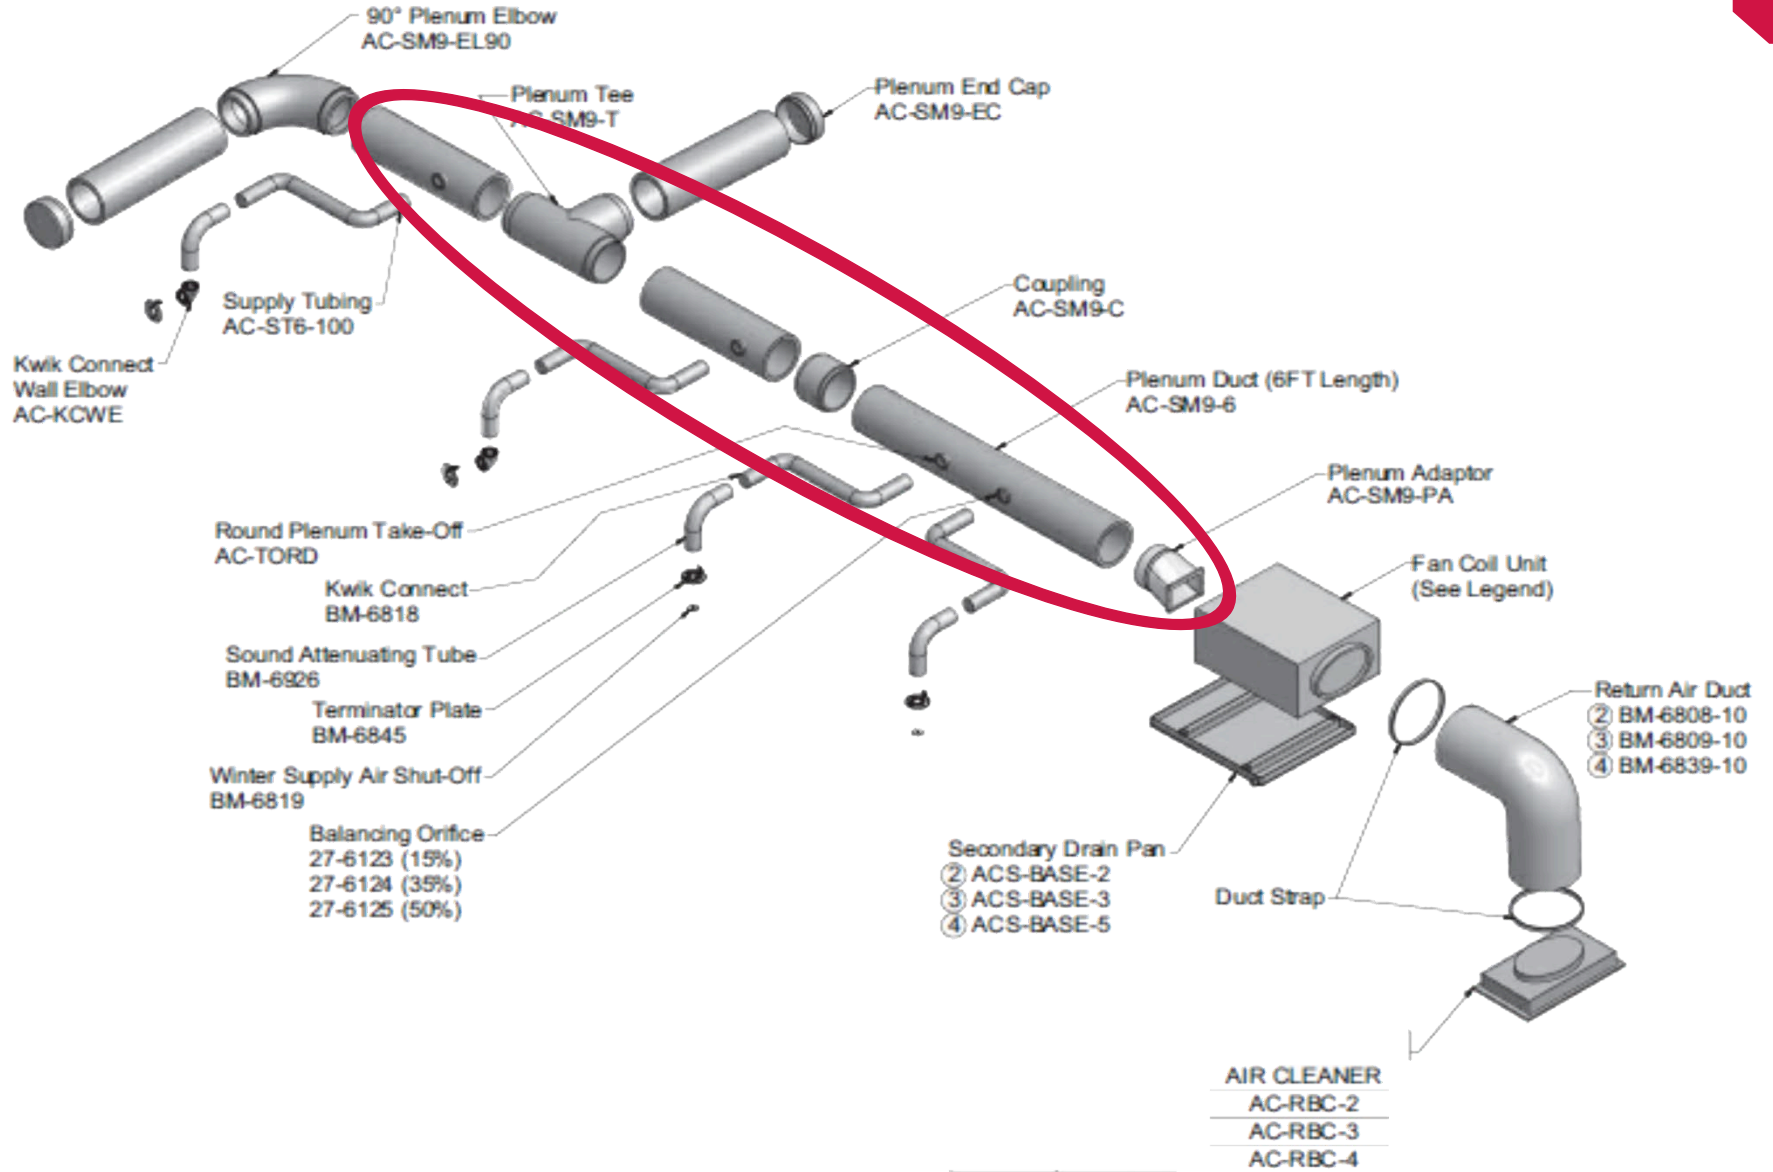

Plenum Rules & Topics

- Plenum requirements and allowances
- Round, Rectangular and Square will work
- Minimum and Maximum allowable run lengths
- Fittings (tees, elbows, couplings and endcaps)
- Most Common Mistakes



SmartSeal Pipe & Fittings


Standard Smart Seal System Duct Features

- Approved to SMACNA Duct Construction Standards and Leakage Class 3
- 100% Leak Resistant (to 10" W.C.)
- Fittings & Couplings Have Factory Installed Gasket
- Operating Temperature Range -20°F to 212°F
- Gasket is on the Leading Edge of Fittings, Allowing Substantial Space for Screw Insertion
- Recyclable Material
- Contains up to 58% Recycled Materials
- Eligible for LEED Points
- Significantly Reduced Installation Time



SmartSeal


Keeps pressure IN &
keeps contaminants OUT

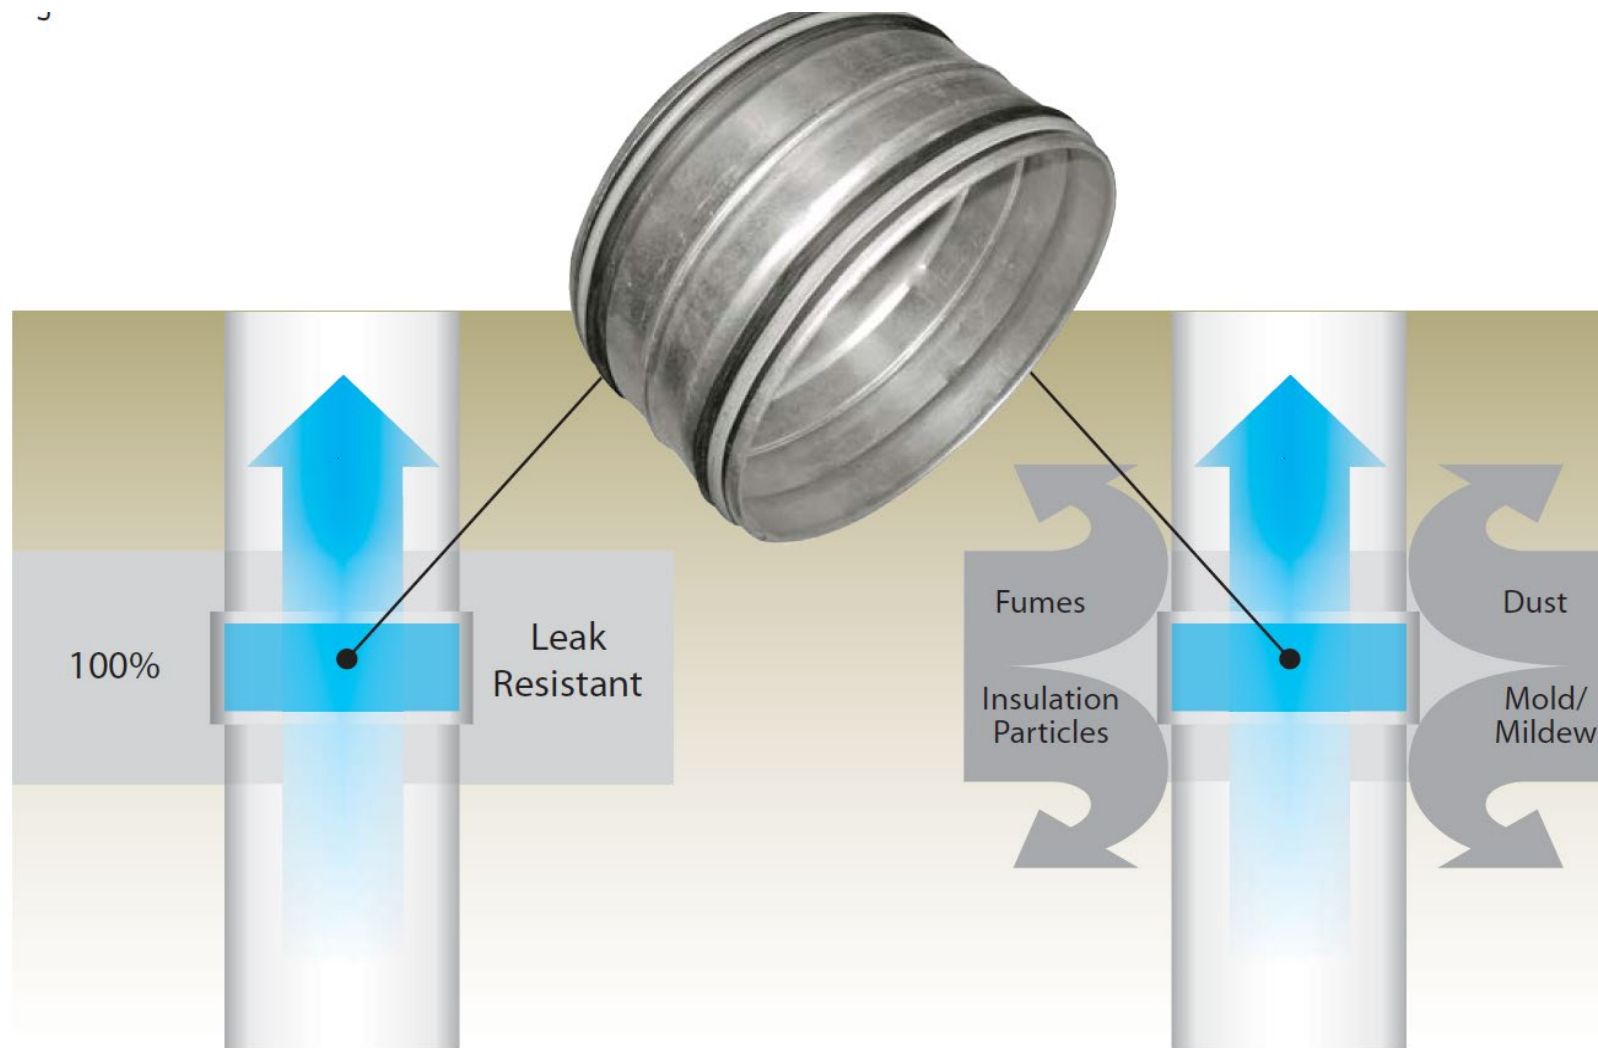

Plenum Size

9-inch round = 64 square inches

- 8 X 8-inch square
- 7 X 9 rectangular
- 6 X 11 rectangular
- 5 X 13 rectangular
- 4 X 16 rectangular
- 3 X 21 rectangular

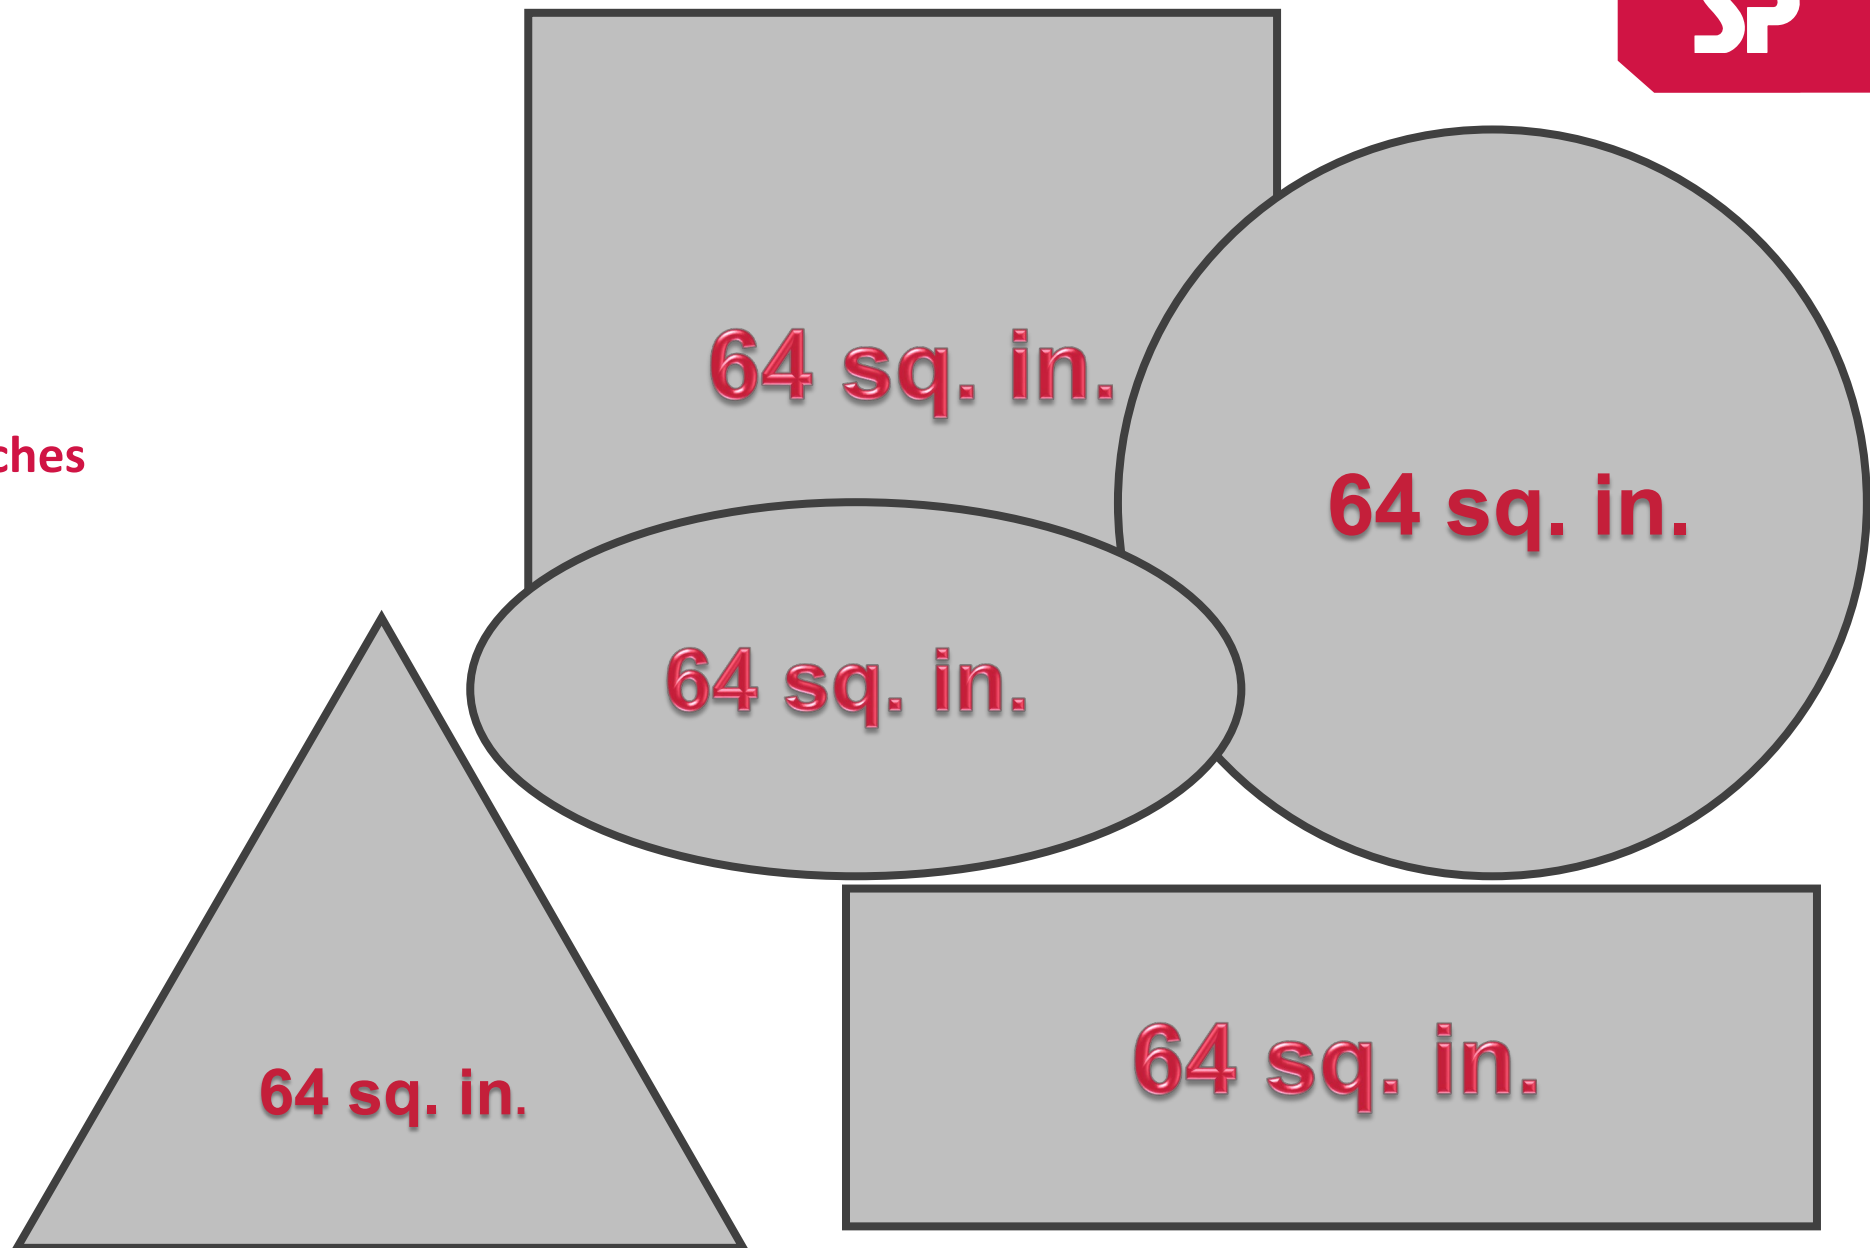

Maximum Allowable Plenum Length


250 ft (or equivalent) at 9" Round IF:

- All fittings are long radius
- The system is sealed to stop duct leakage **“completely”**
- Fittings reduce length by:
 - 30 ft for Tees
 - 15 ft for Elbows




4 Main Plenum Configurations


Shotgun

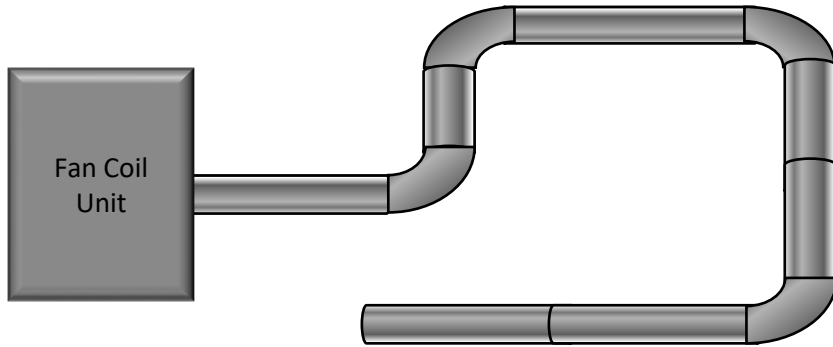


Side Branch

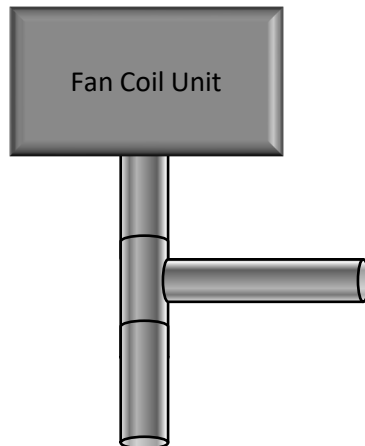

Perimeter Loop

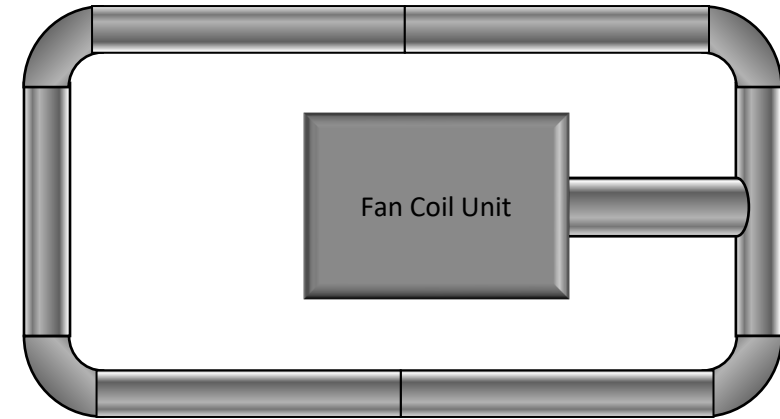

Horseshoe

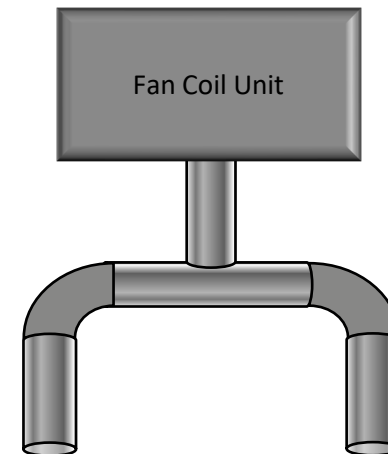


Minimum Plenum Length Determined By


- 18" from blower before a 2" take off
- 18" from a fitting before a 2" take off
- 18" from the end cap before a 2" take off
- 6" on center between take-offs "minimum"

So, with straight pipe you can have a "short" plenum even at larger tonnage outputs


Never install on an end cap

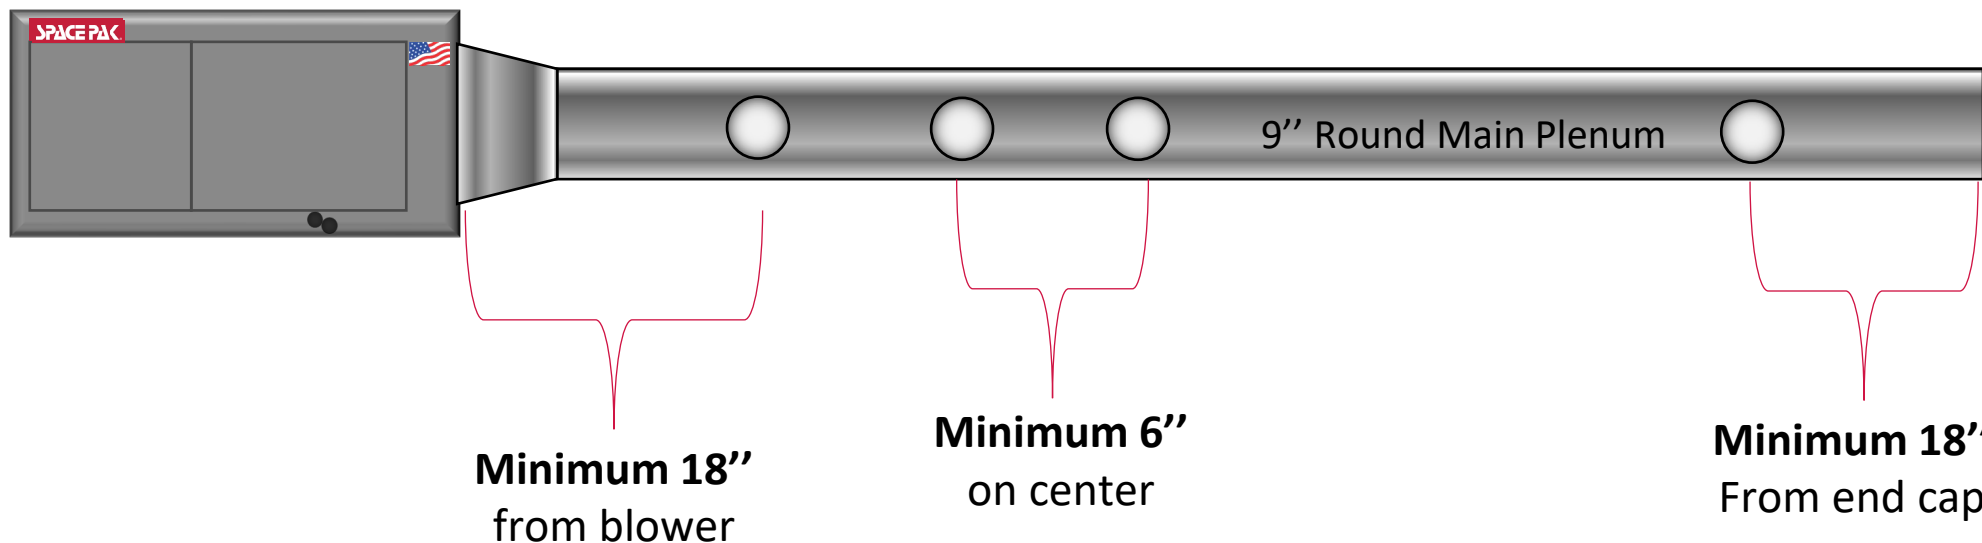


Straight Duct aka "Shotgun"

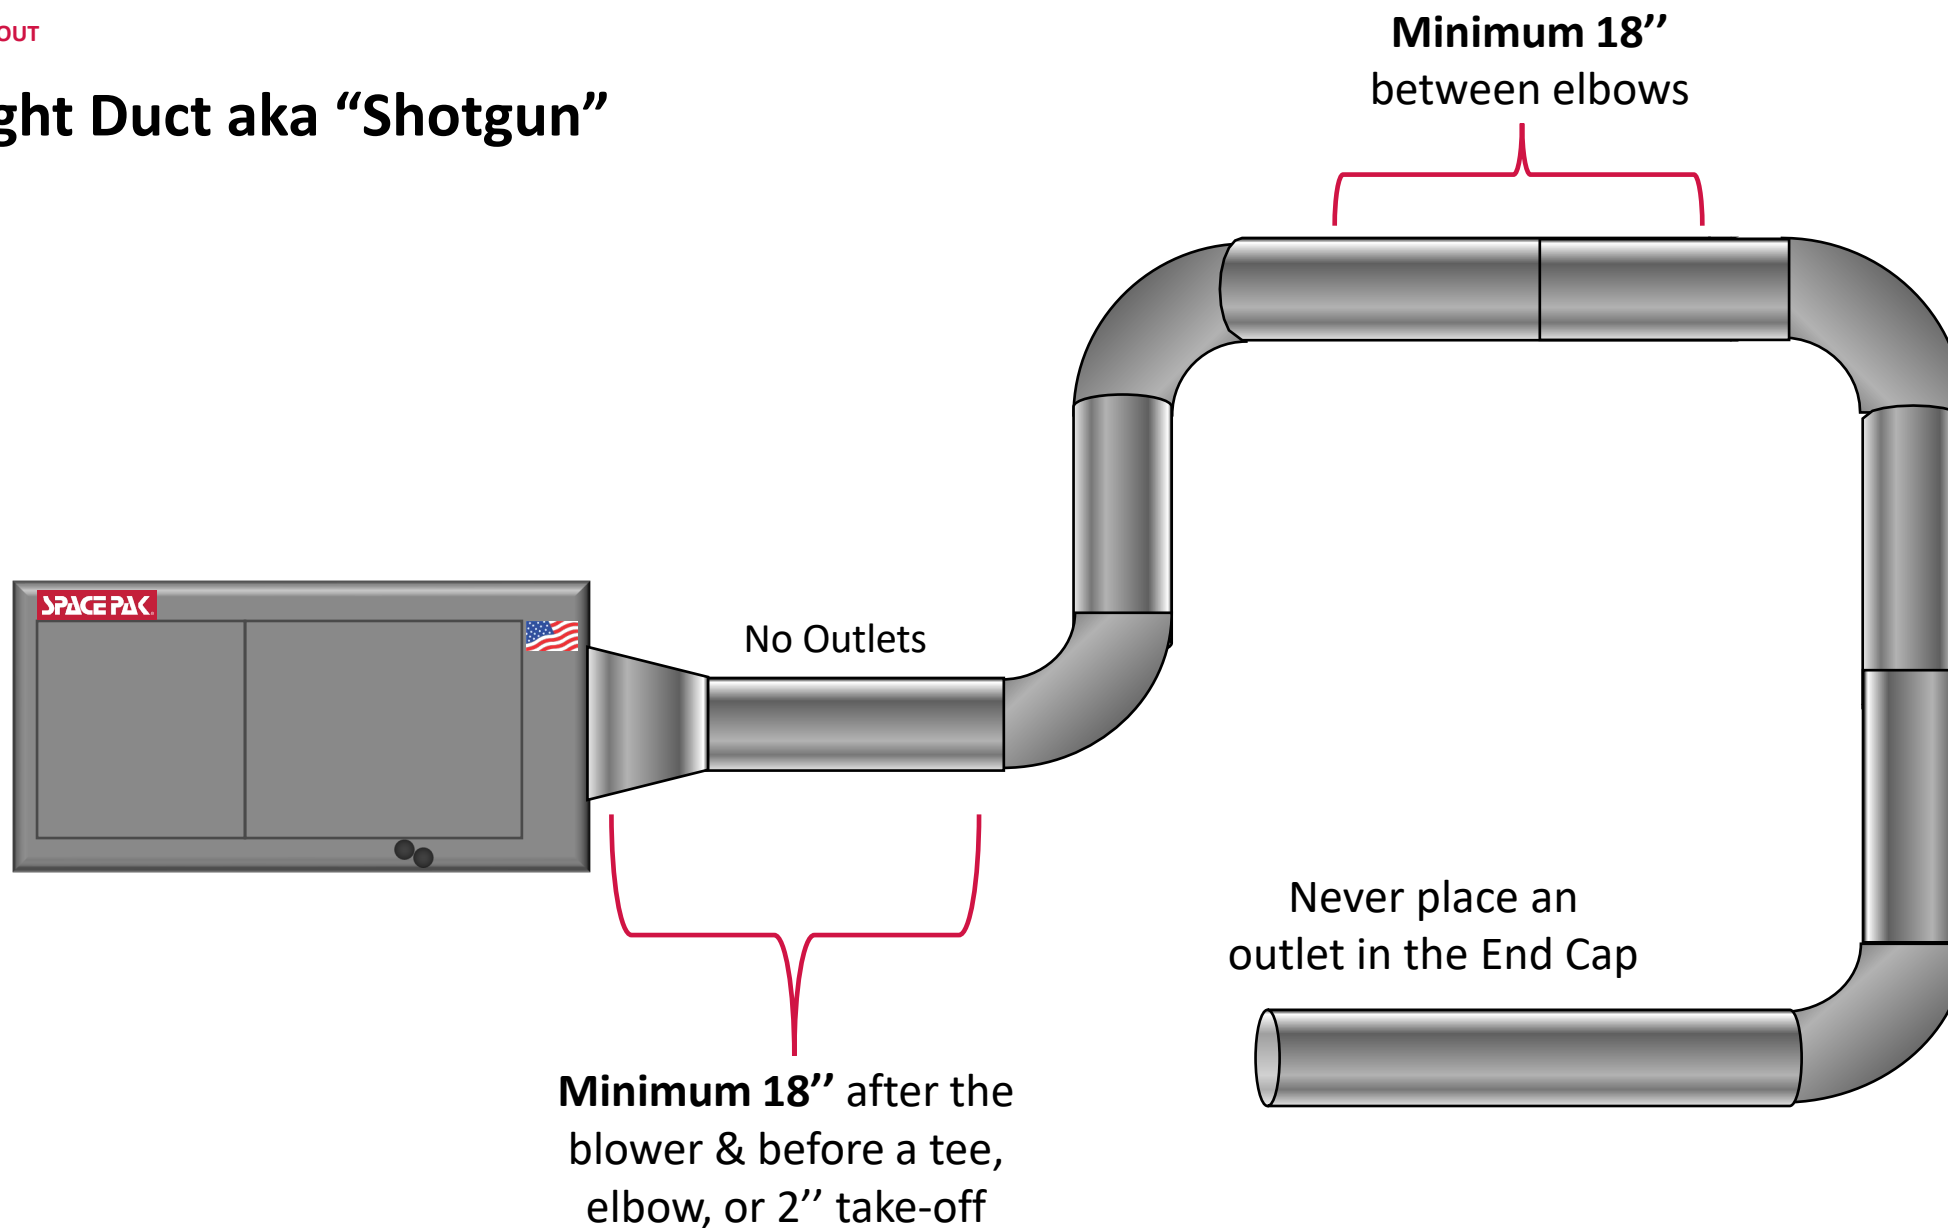


Side Branch

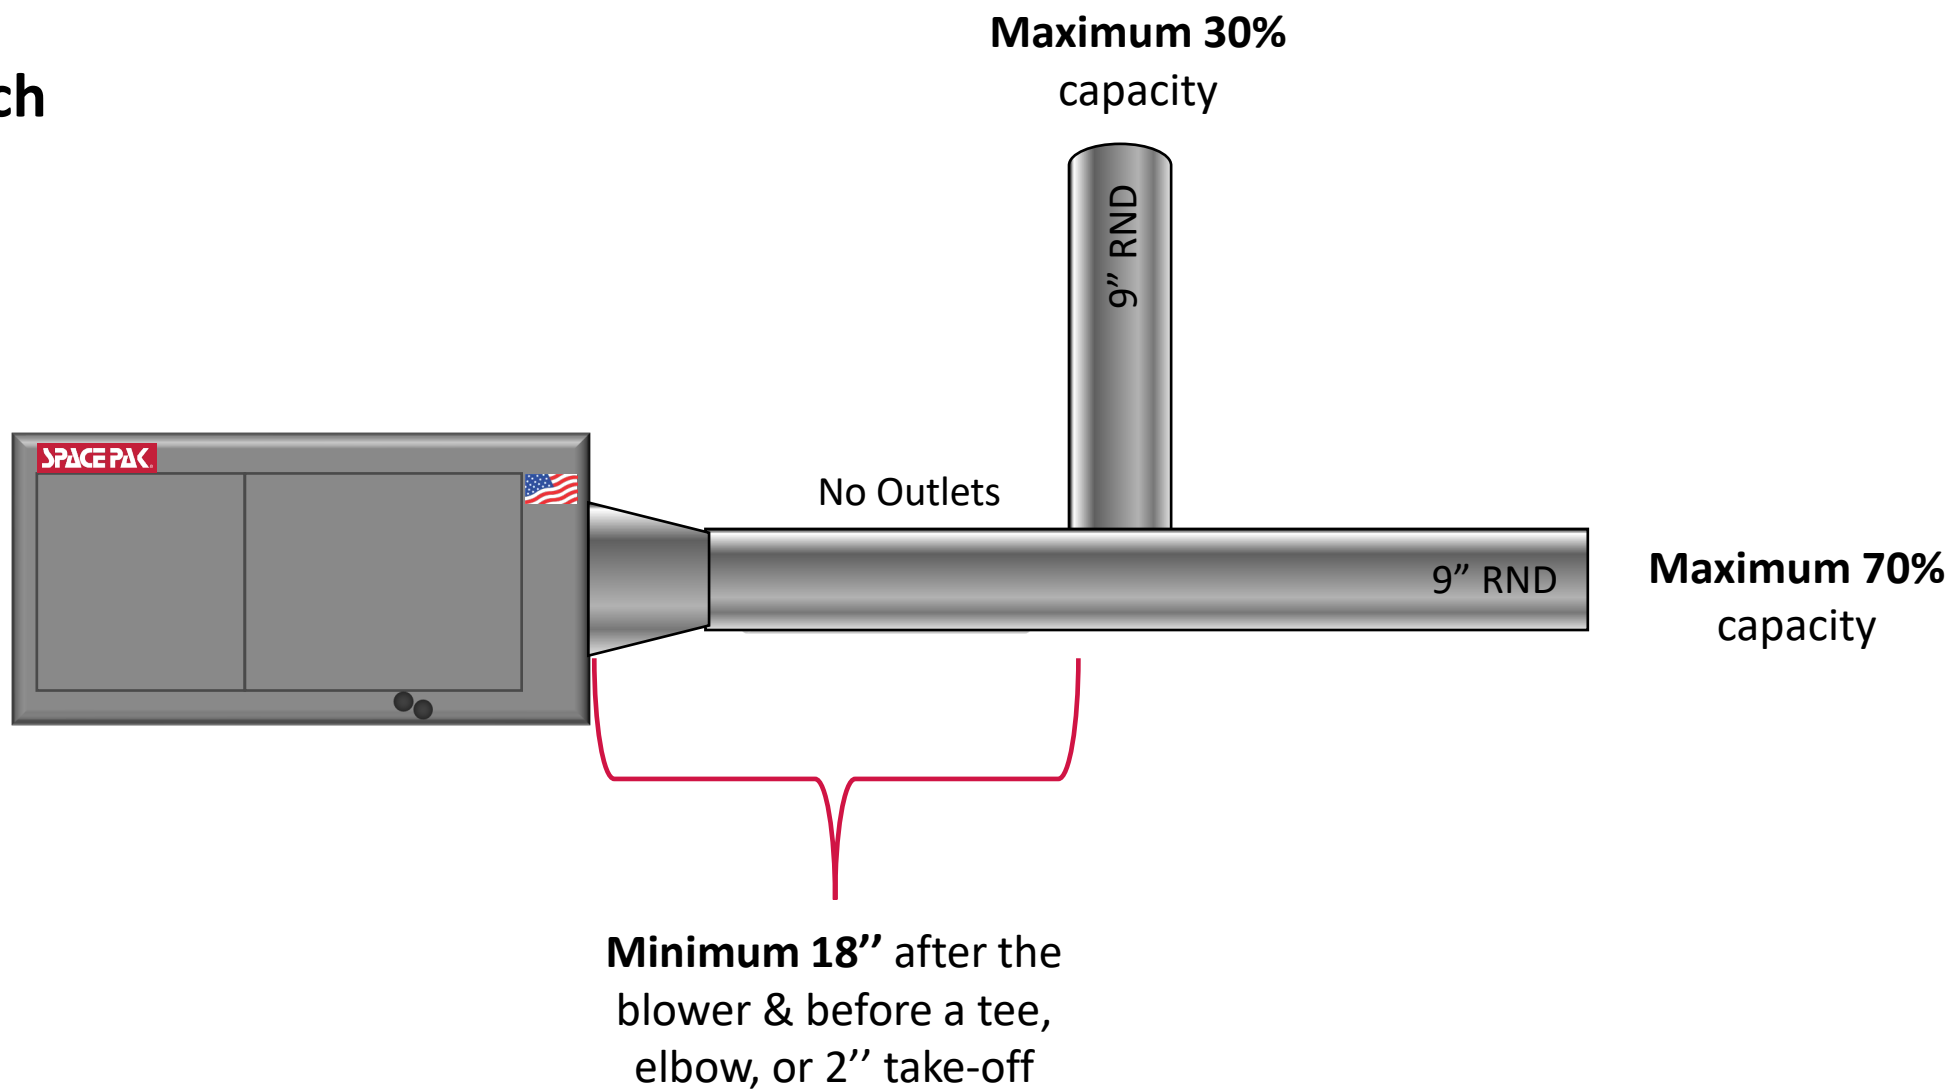

Horseshoe

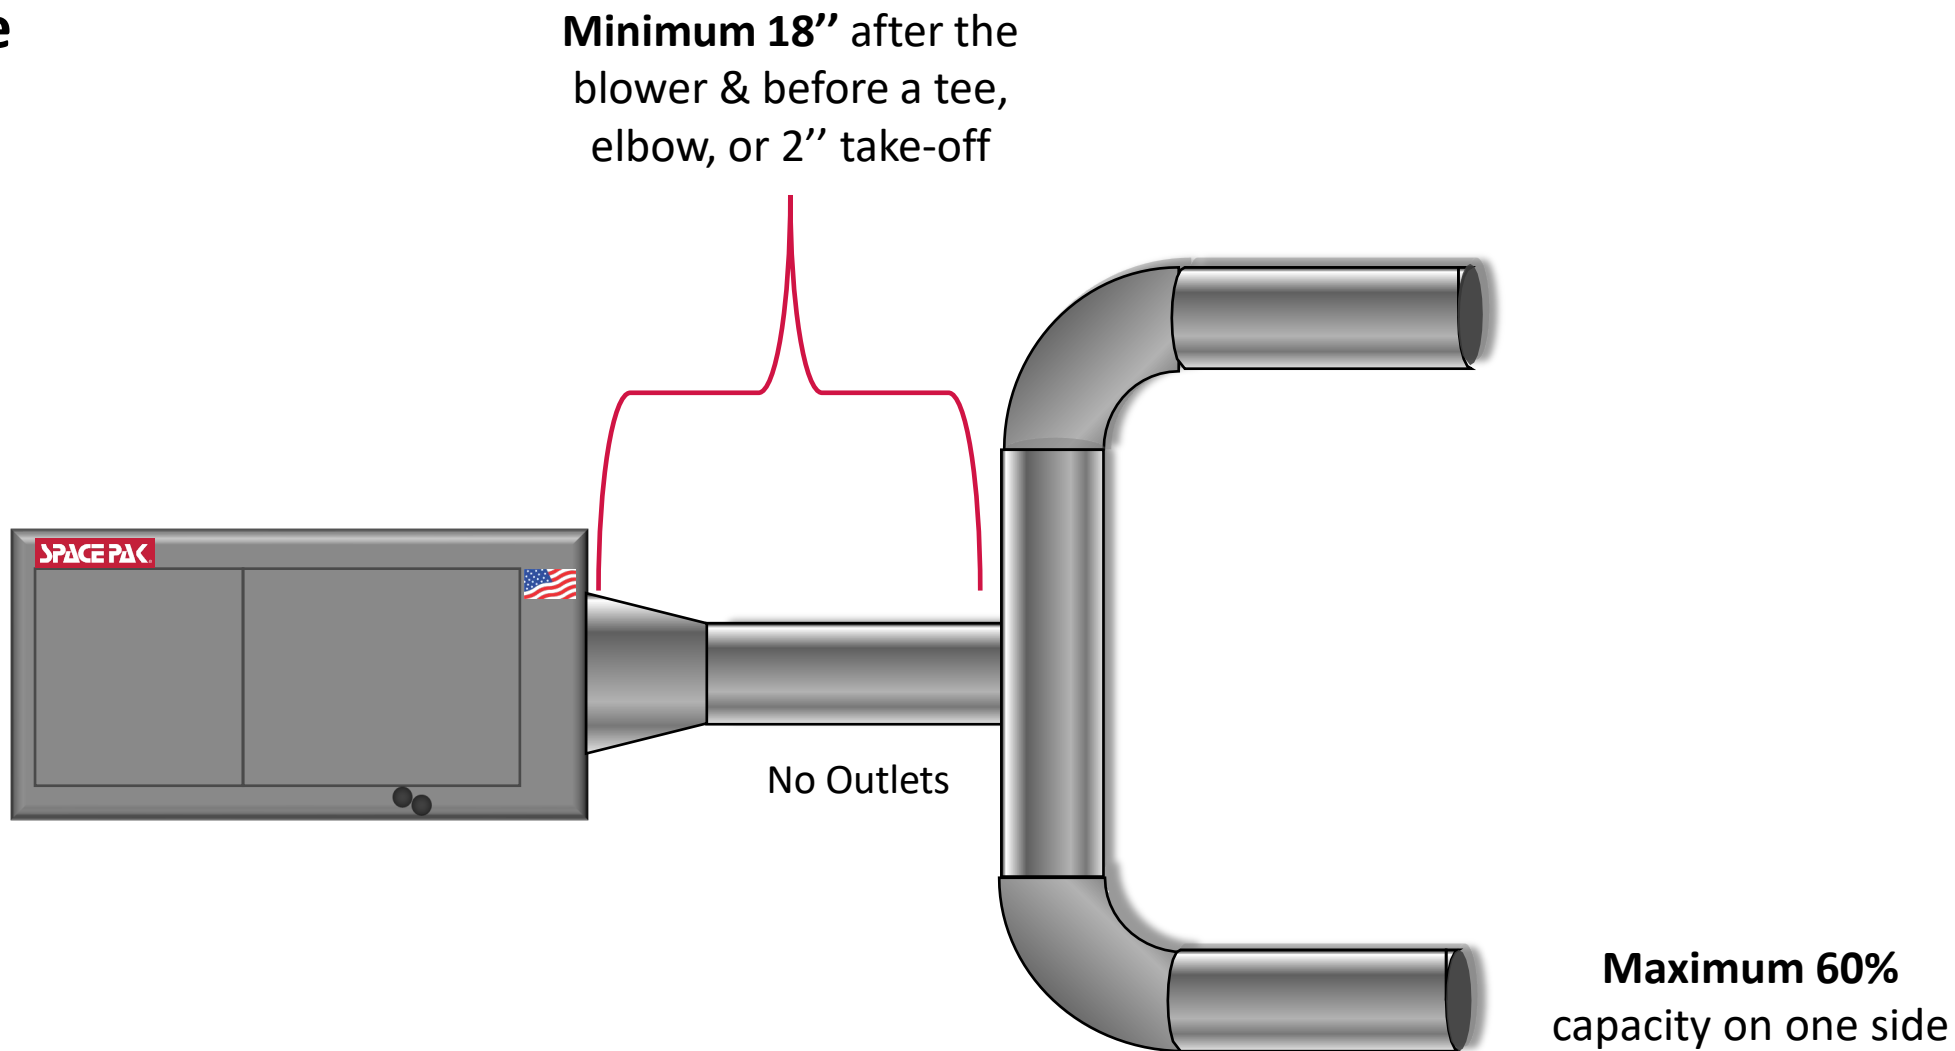


Perimeter Loop

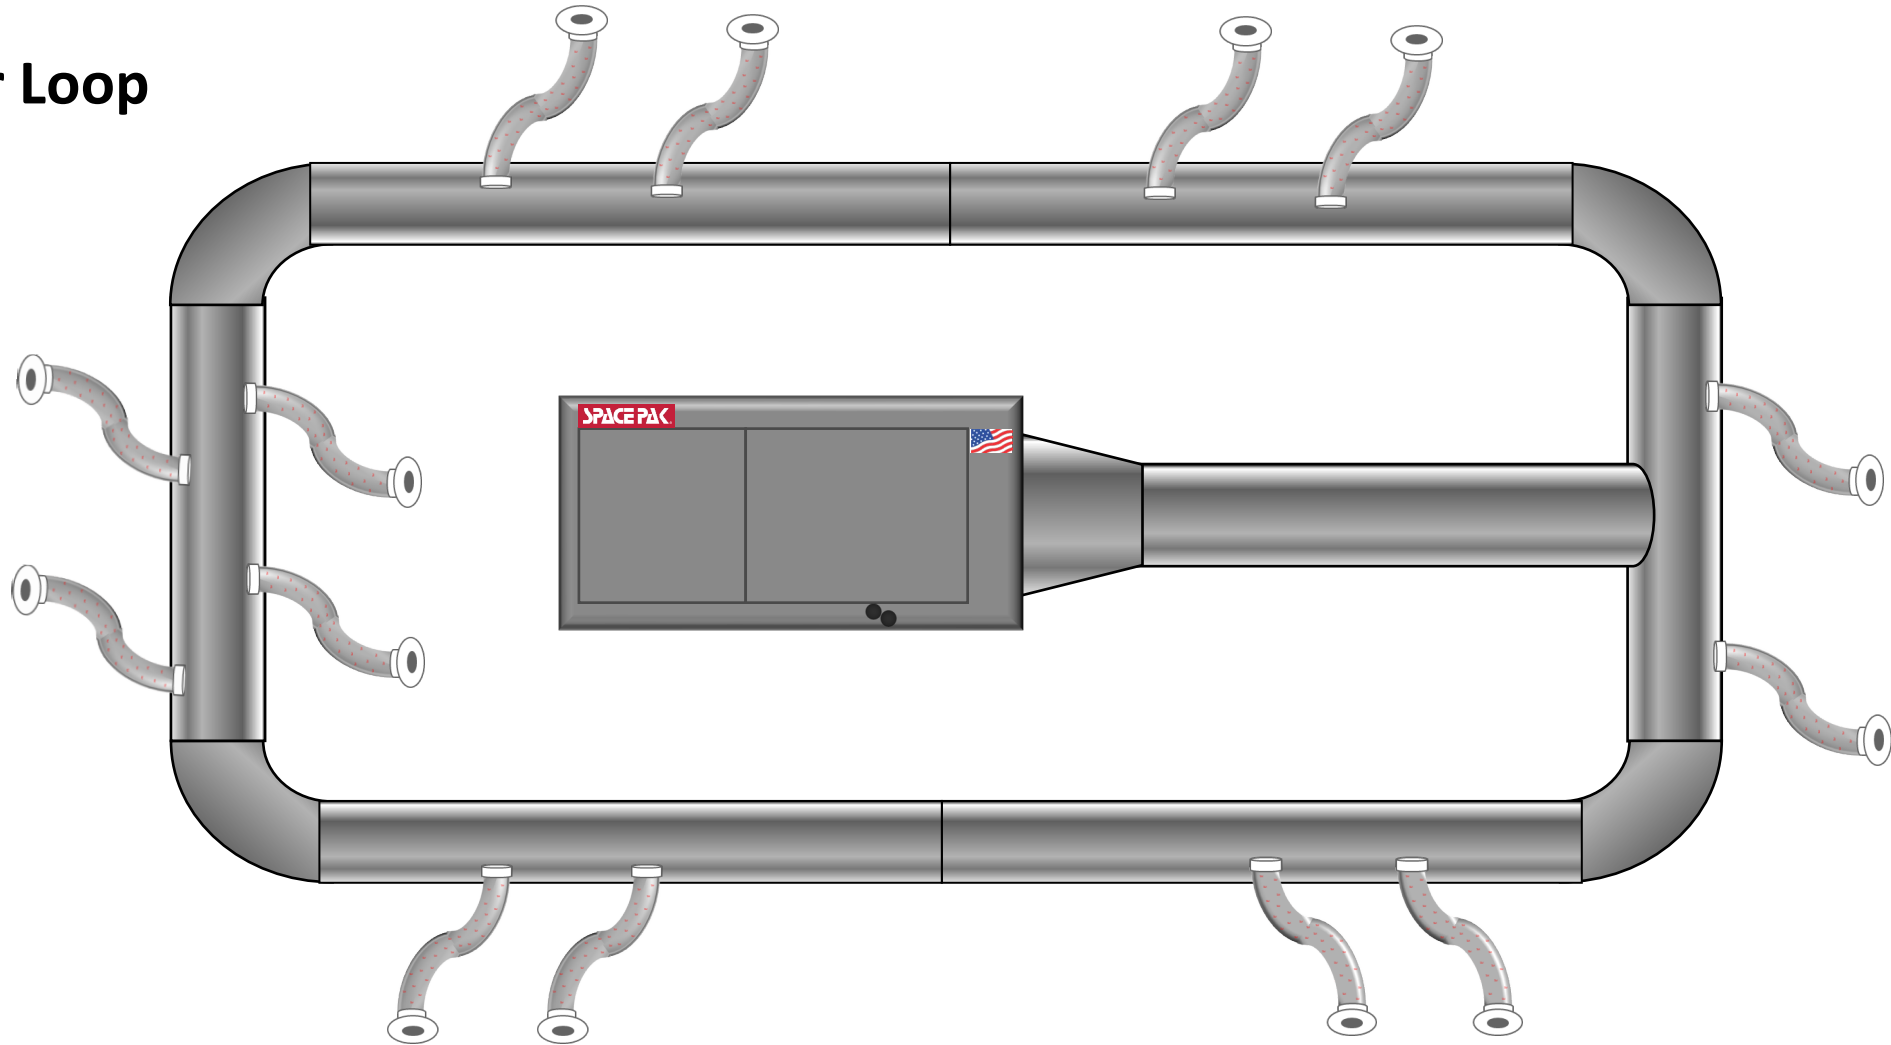


Note: Takeoffs can be evenly spaced or mostly one side or the other, the 50/50 rules do not apply when dealing with a perimeter loop. This set up will balance regardless of the layout.


Shotgun with a Tee

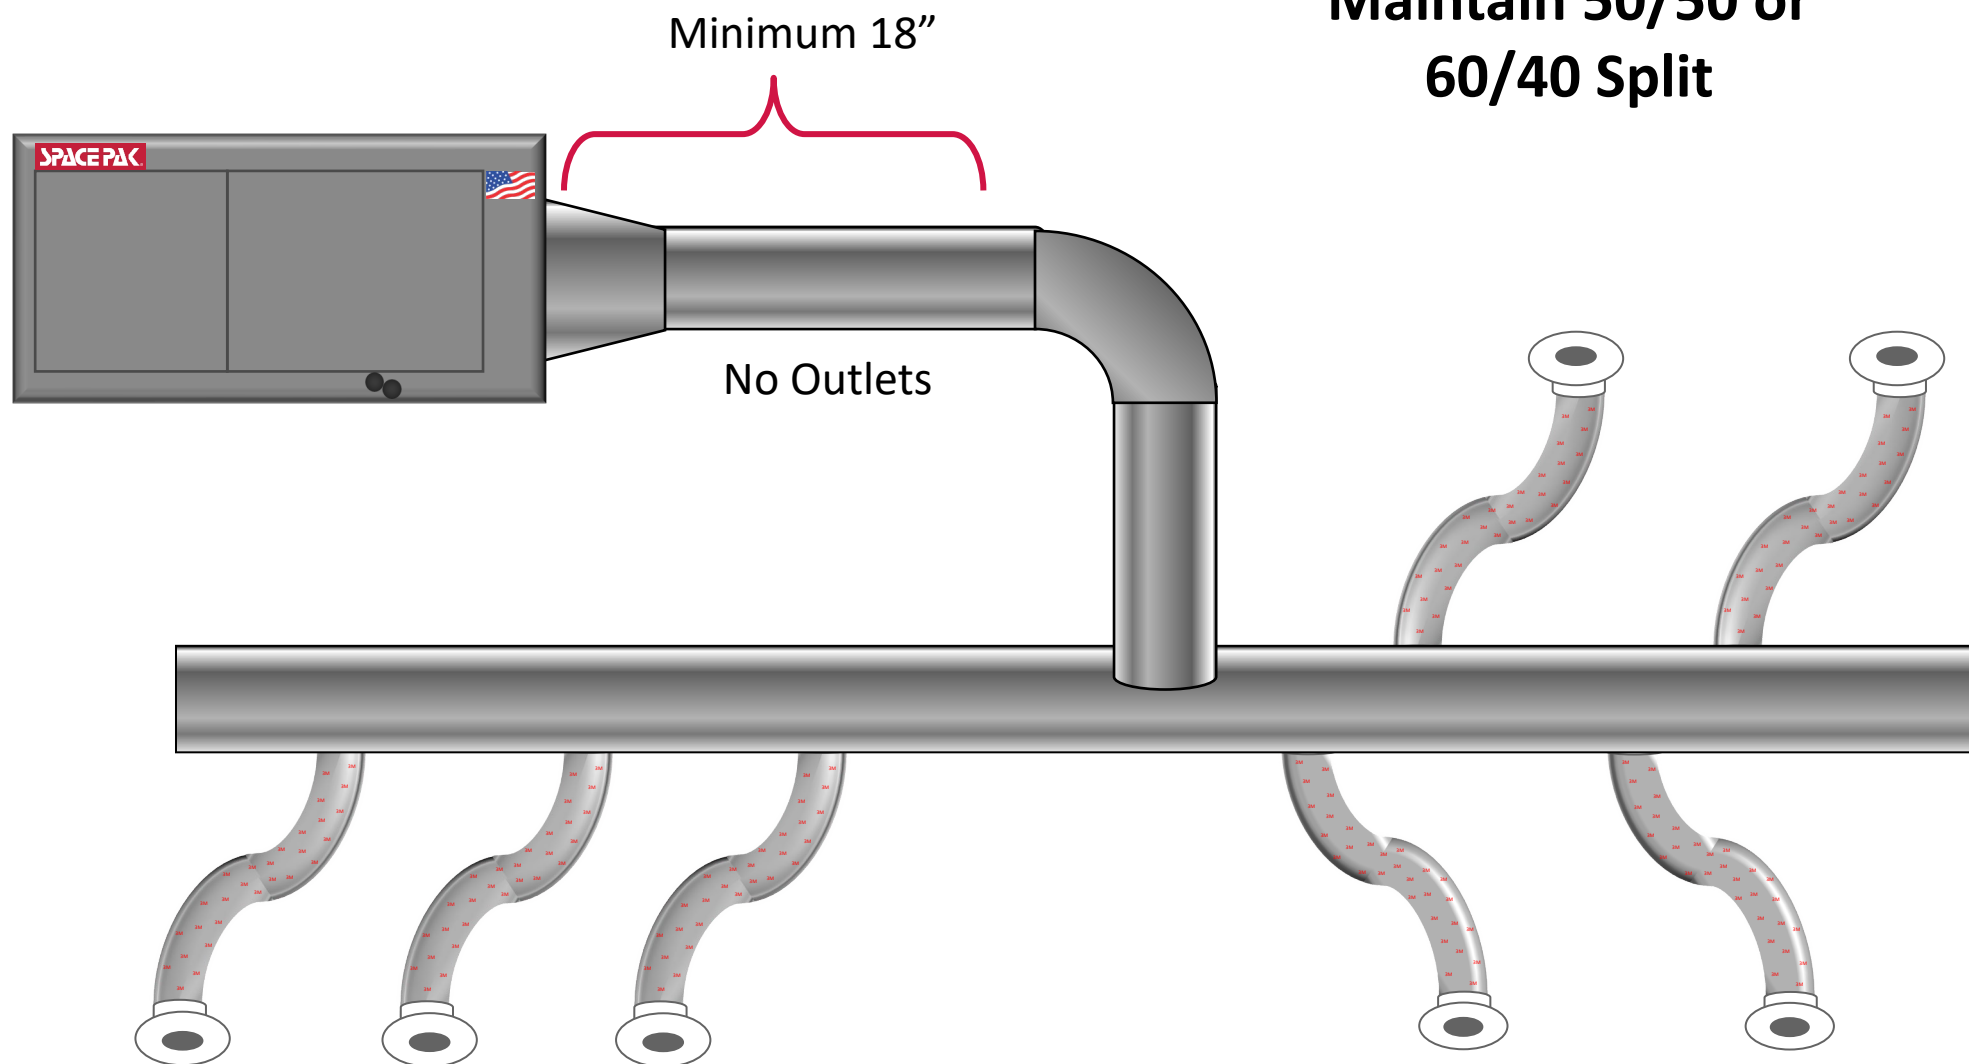

System One
50/50 Split

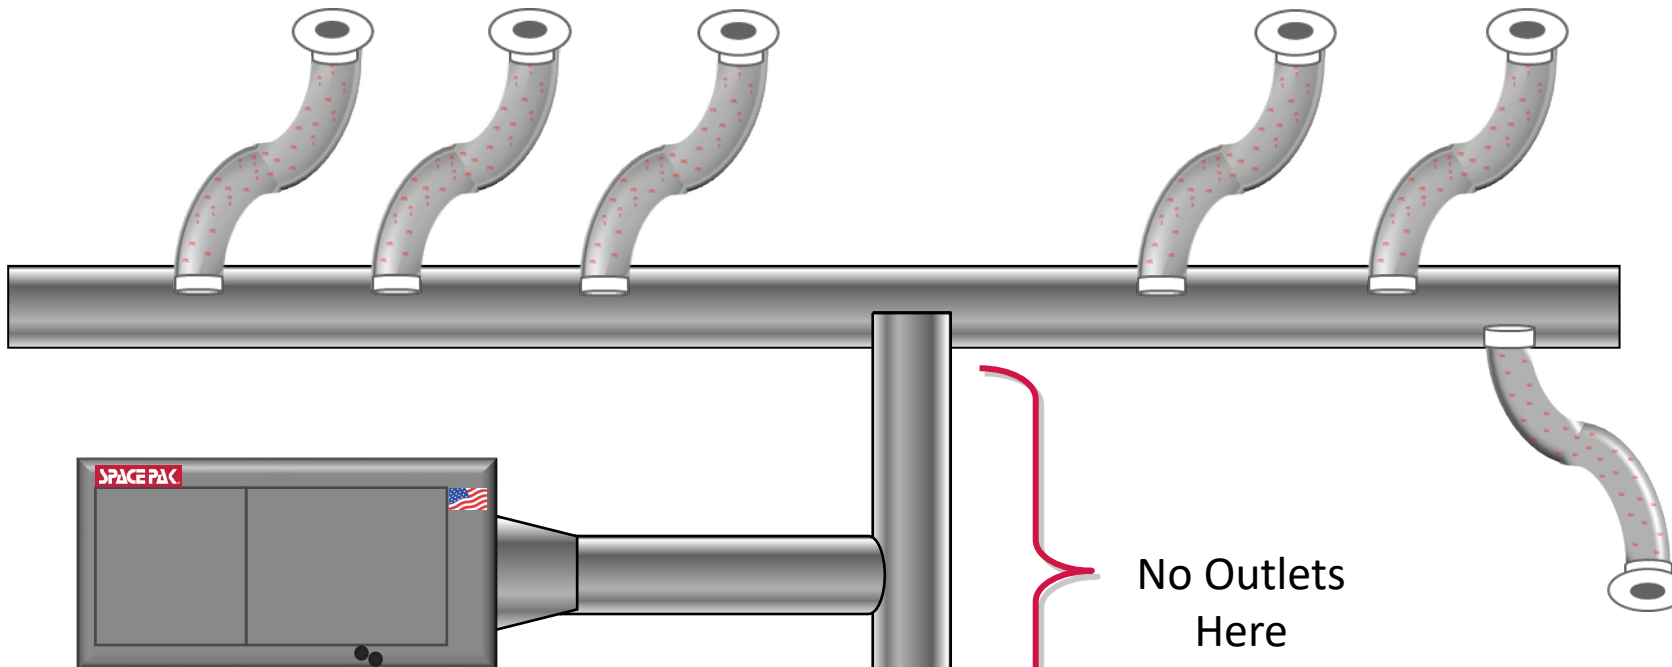


System Two
60/40 Split

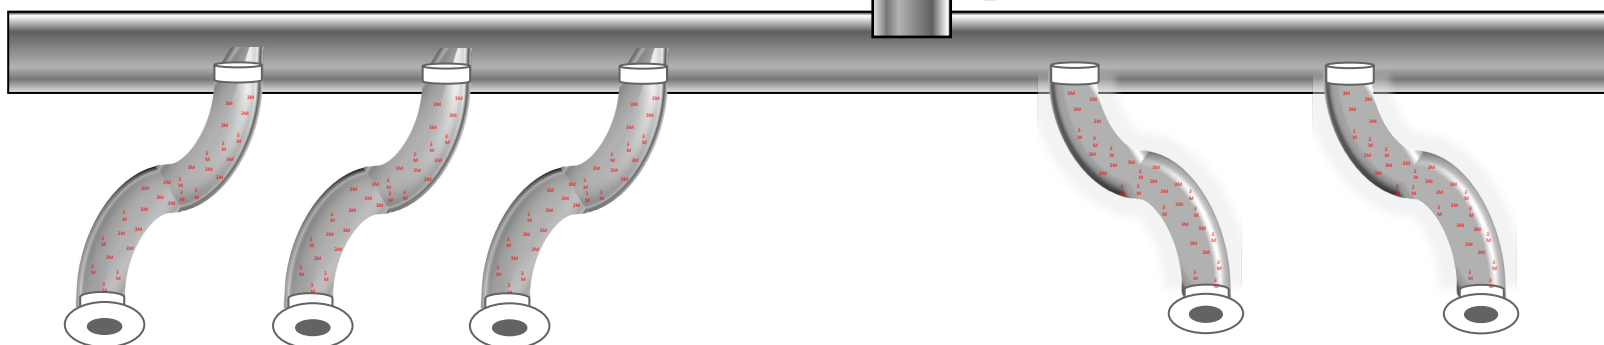

Think of it
as Two
Systems!

What do you see wrong?

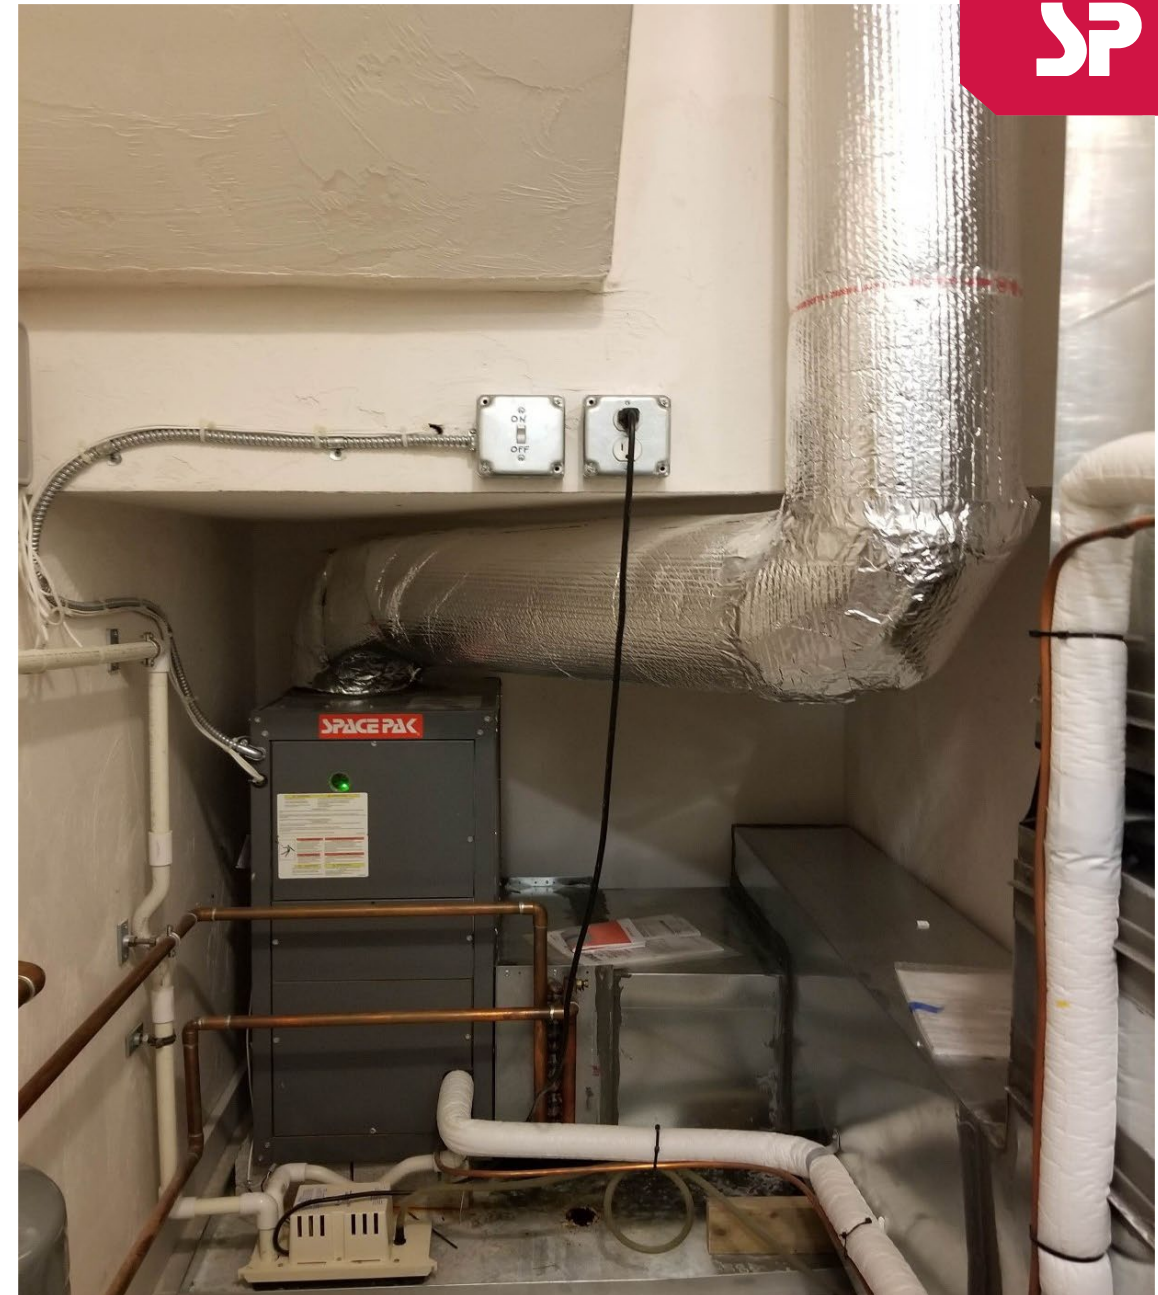

What do you see wrong?



Questions?



Retrofit: *Can we run a smaller duct size?*


Note: When retrofitting to existing 7" duct - replace as much of the existing accessible 7" with the preferred 9".

This is even more important in systems over 2 ton.

RETROFIT CONSIDERATIONS!


- Just because a 2-, 3- or 5-ton unit was installed DOES NOT mean the same unit can go back in without looking at the existing system, its layout and available CFM's
- IT IS STILL GOOD TO DO A LOAD CALCULATION. Many times, if a system has been installed for many years there may have been considerable efficiency improvements to the home. Ex.(the house may no longer require 5 tons of cooling due to window, roof and insulation upgrades)
- Count the total existing supply terminations
- If the blower in the existing system runs (even if the condenser does not) turn it on and take CFM readings at ALL outlets. Confirm total available CFMs are equal or greater than the amount required for the new system. (220-250 CFM PER TON)
- Verify, when possible, the main trunk "inside" diameter and overall length
- If the evaluation of the existing system reveals anything that may lead to the new system not operating properly without improvements, please note the specifics on your installation proposal.

Straight Duct aka “Shotgun”

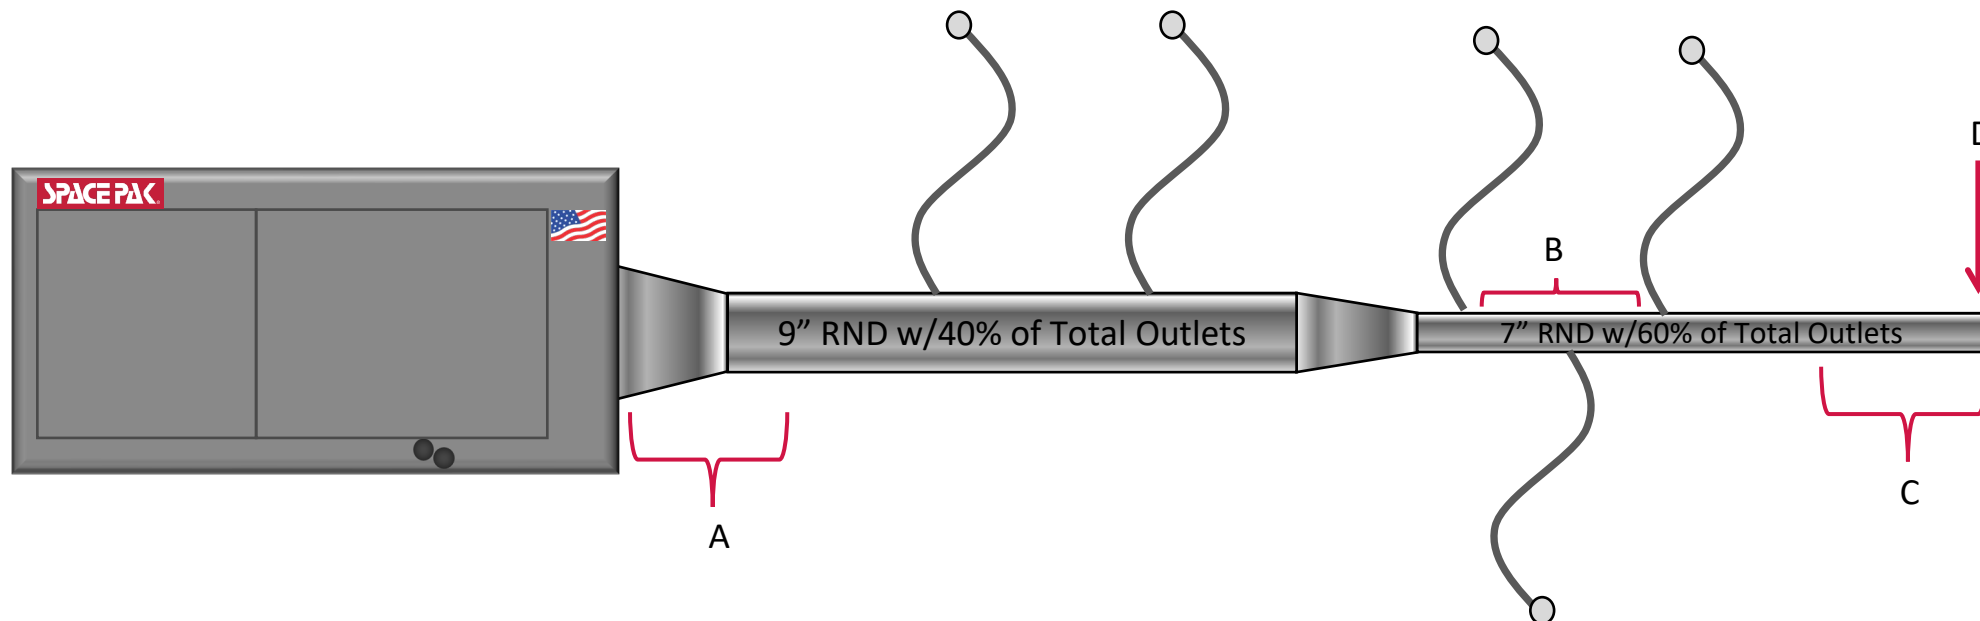


DESIGN RULES FOR RETRO-FITTING B & C MODEL SERIES AIR HANDLERS TO NEWER D, E, F, G, J SERIES EQUIPMENT

- A: No outlets in the first 18" of straight pipe coming off the Air Handler
- B: Minimum distance between outlets is 6" on center
- C: Minimum distance when placing an outlet from end cap is 12"
- D: NEVER place an outlet in the End Cap

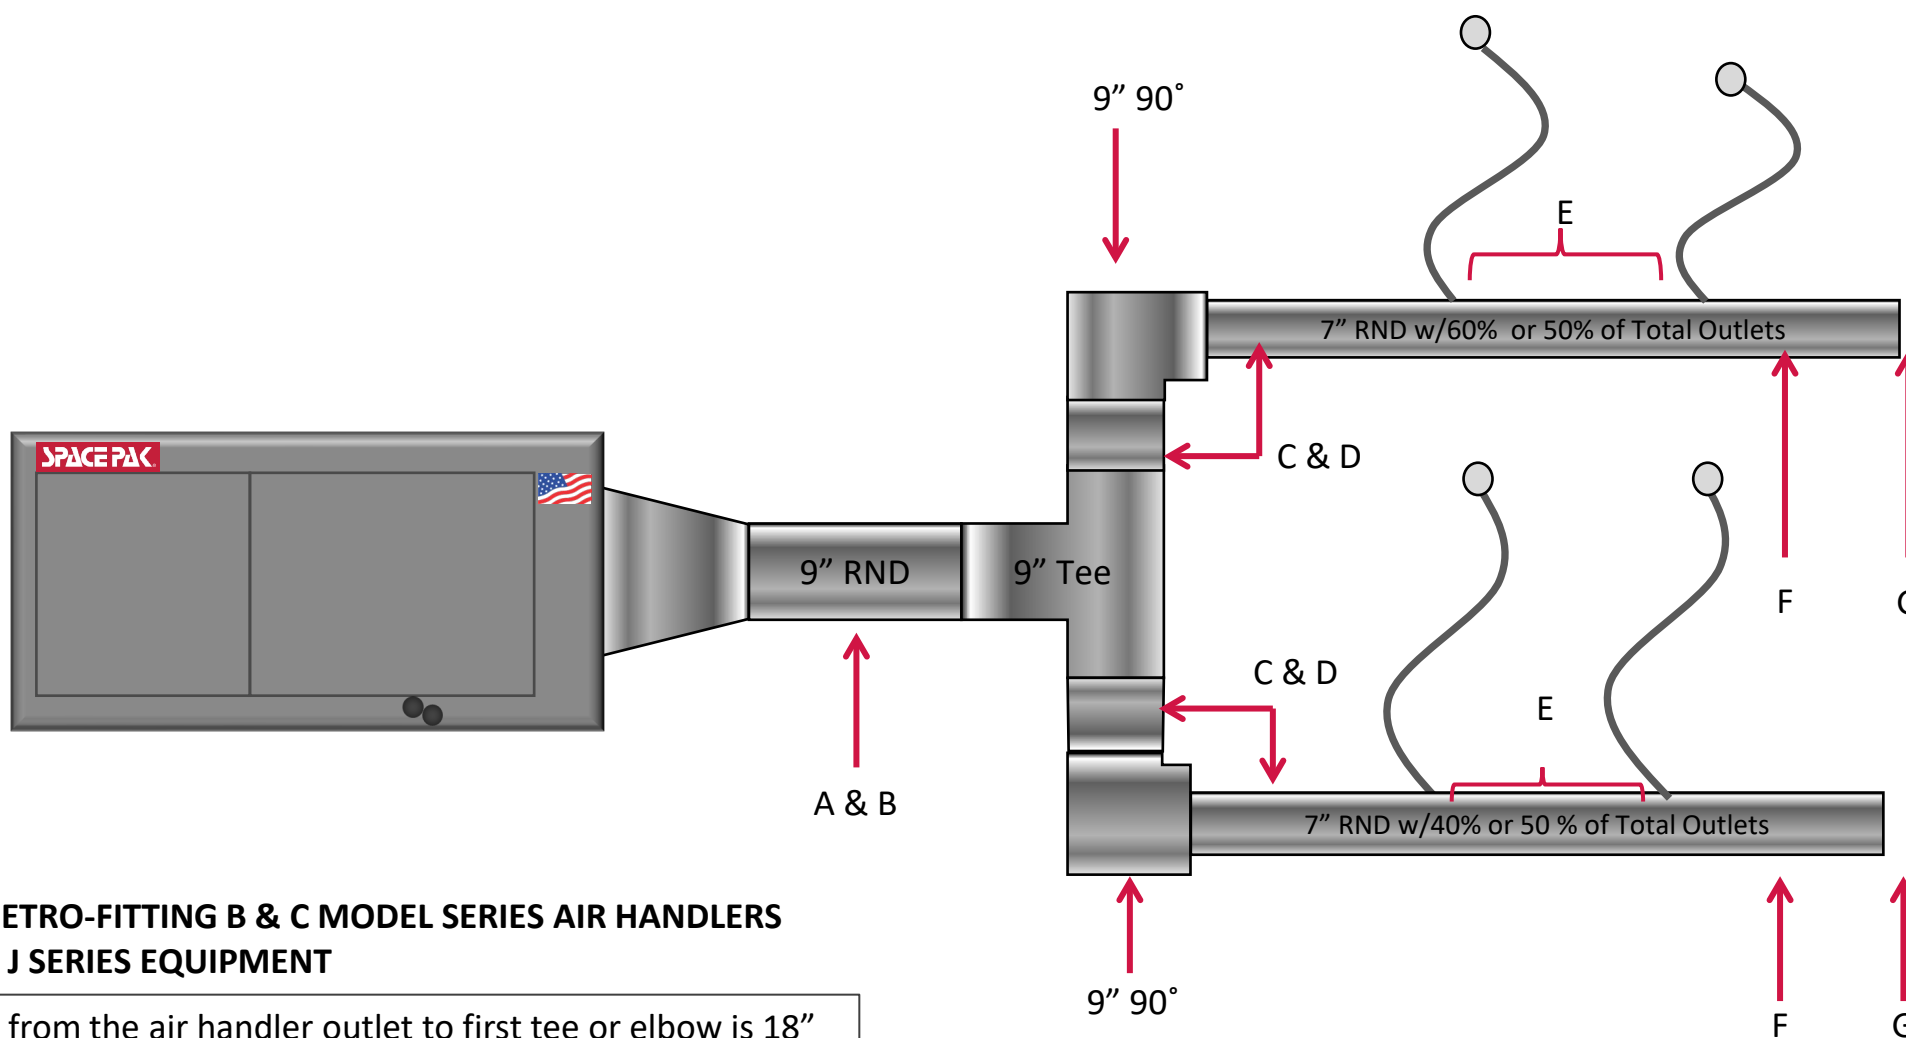

Side Branch

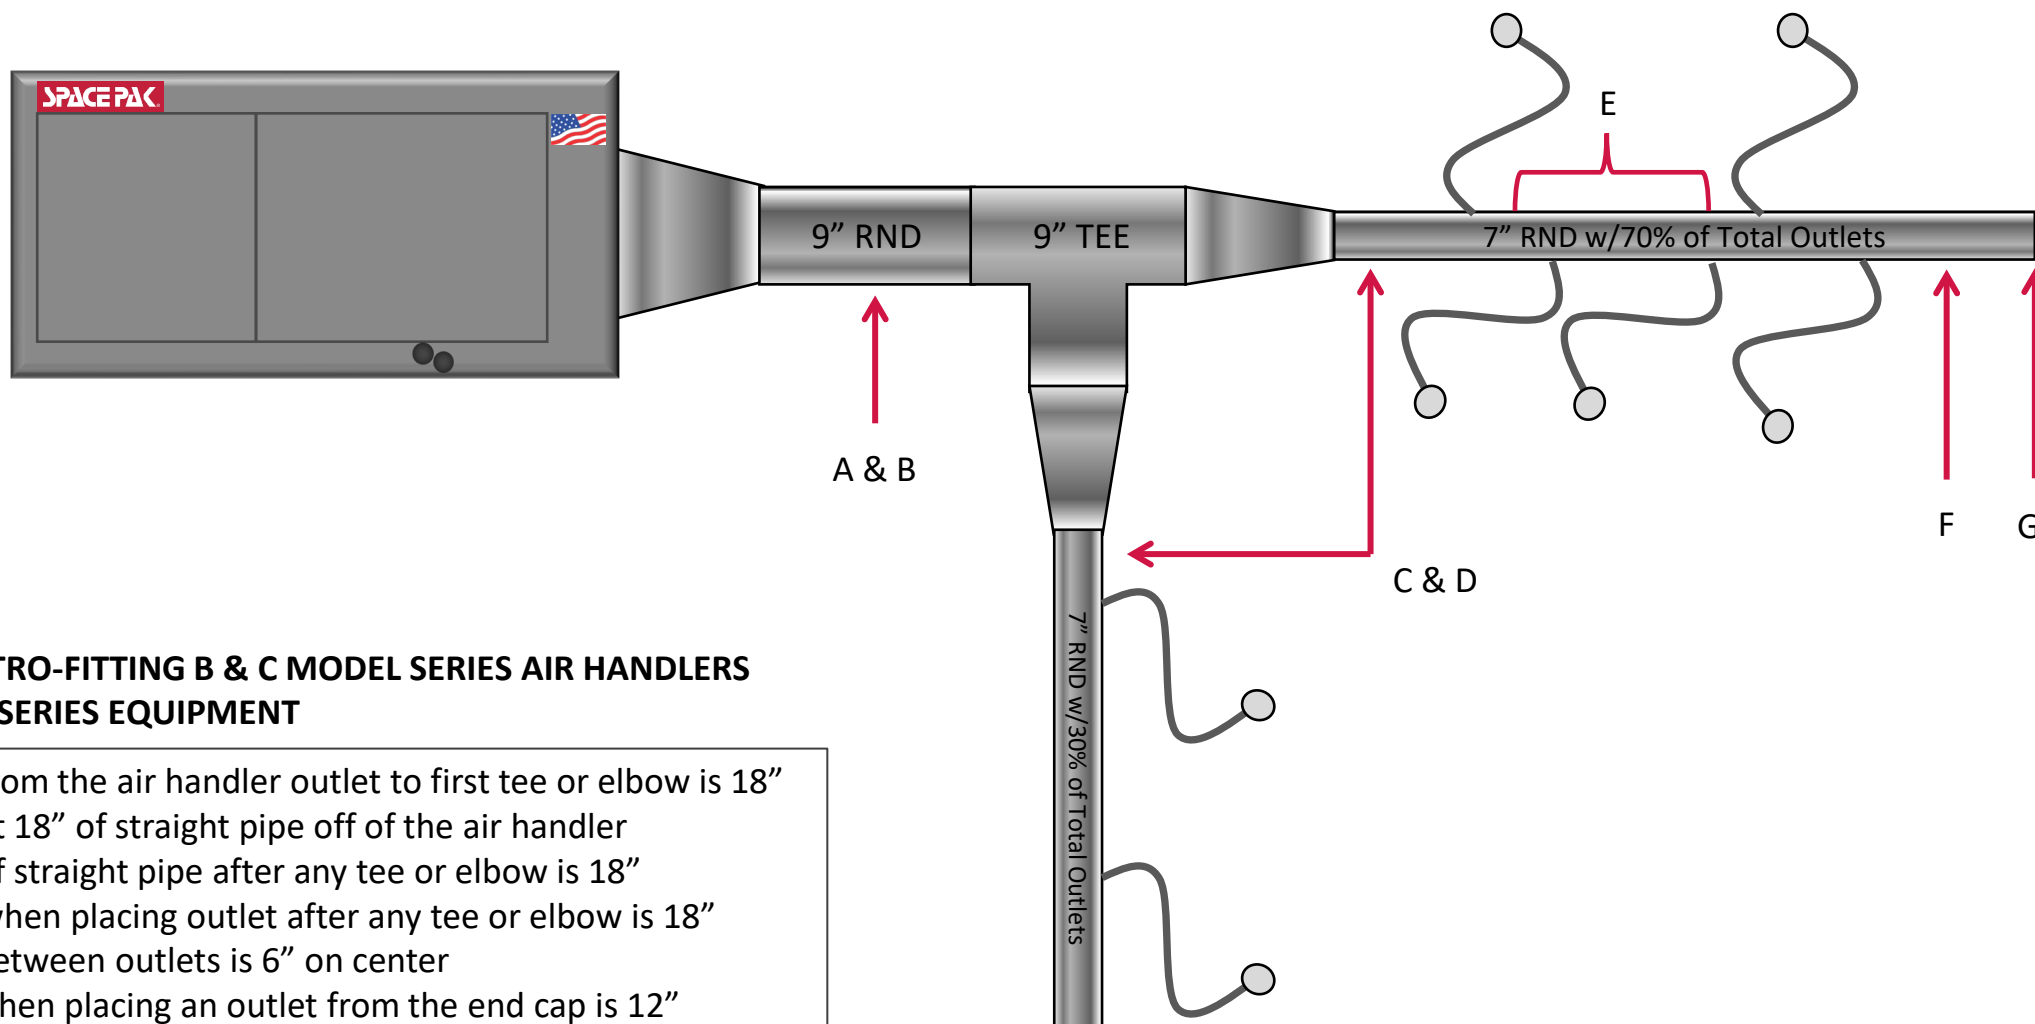


DESIGN RULES FOR RETRO-FITTING B & C MODEL SERIES AIR HANDLERS TO NEWER D, E, F, G, J SERIES EQUIPMENT

- A: Minimum distance from the air handler outlet to first tee or elbow is 18"
- B: No outlets in the first 18" of straight pipe off of the air handler
- C: Minimum distance of straight pipe after any tee or elbow is 18"
- D: Minimum distance when placing outlet after any tee or elbow is 18"
- E: Minimum distance between outlets is 6" on center
- F: Minimum distance when placing an outlet from the end cap is 12"
- G: Never place an outlet in the end cap


Questions?




Plenum Take-Offs

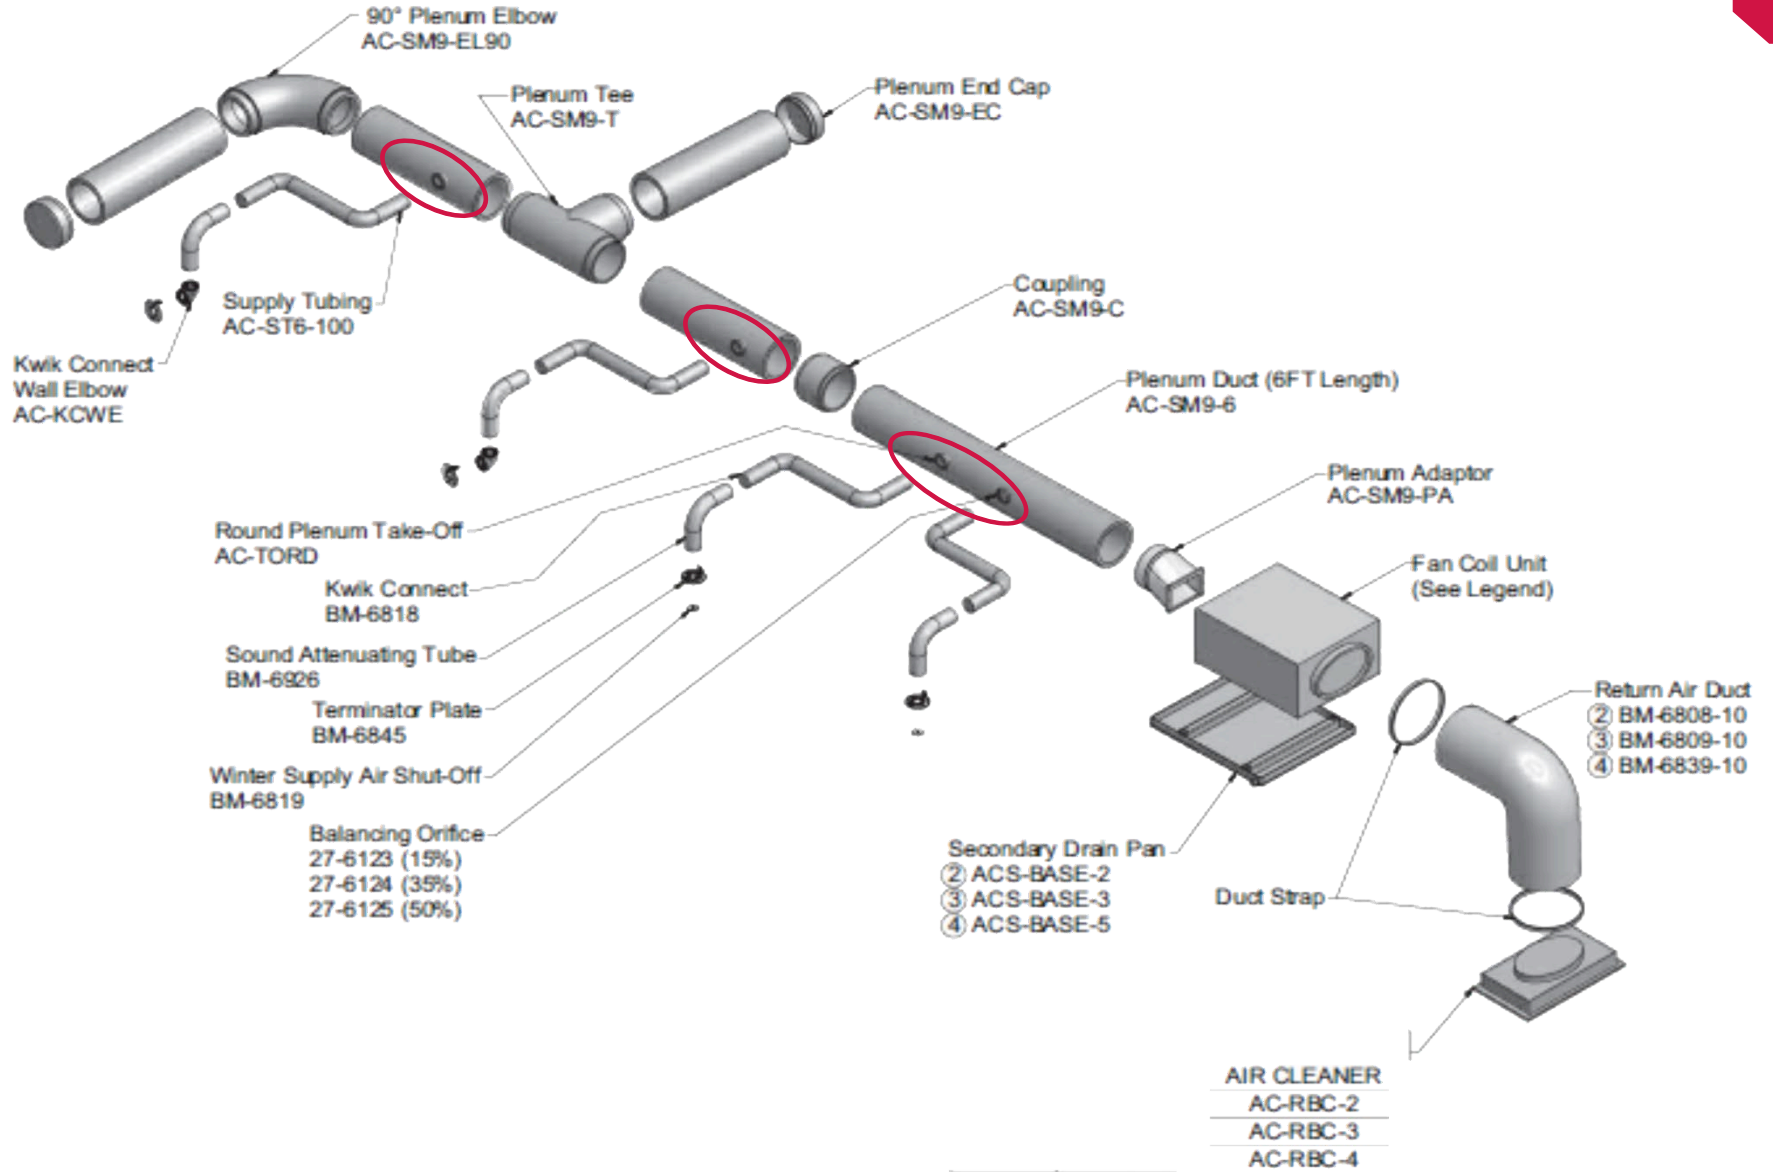


Plenum Take-Off Installation

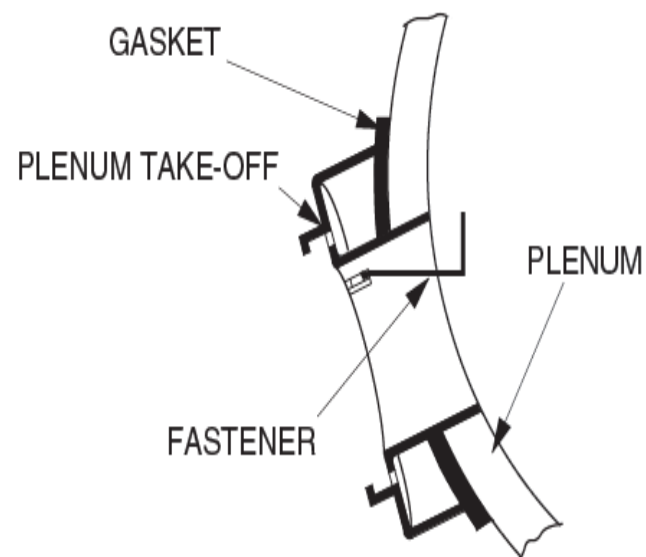

1. HAND INSERT FASTENER INTO PLENUM TAKE-OFF

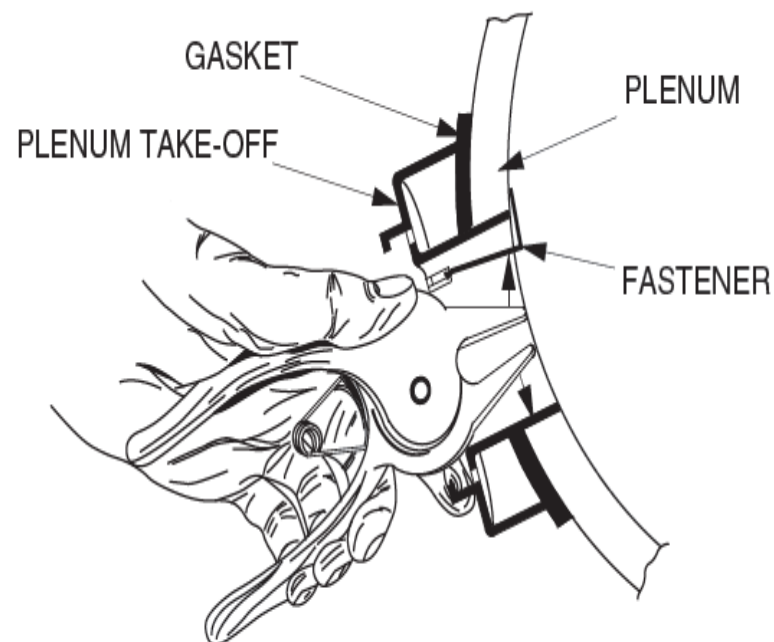

2. WITH PLIERS, SNAP FASTENER INTO PLACE UNTIL IT LOCKS IN PLACE

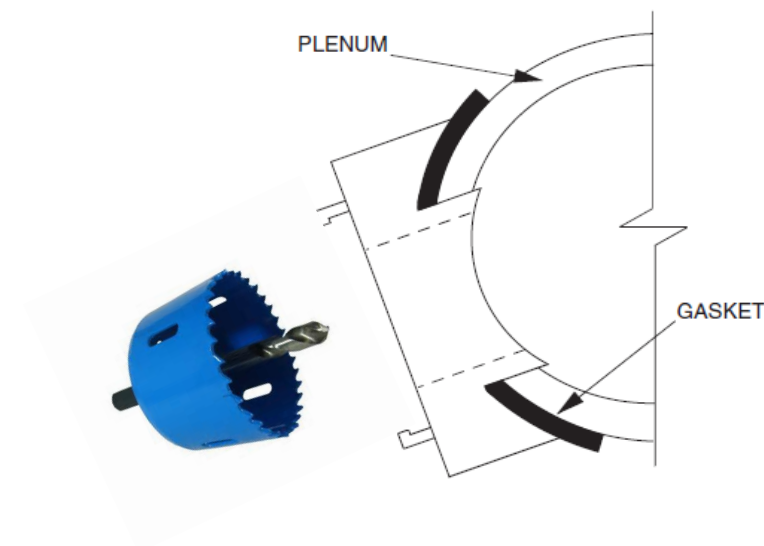


Pliers



2 and 1/8" Hole Saw

Pliers Part #
BM-6998

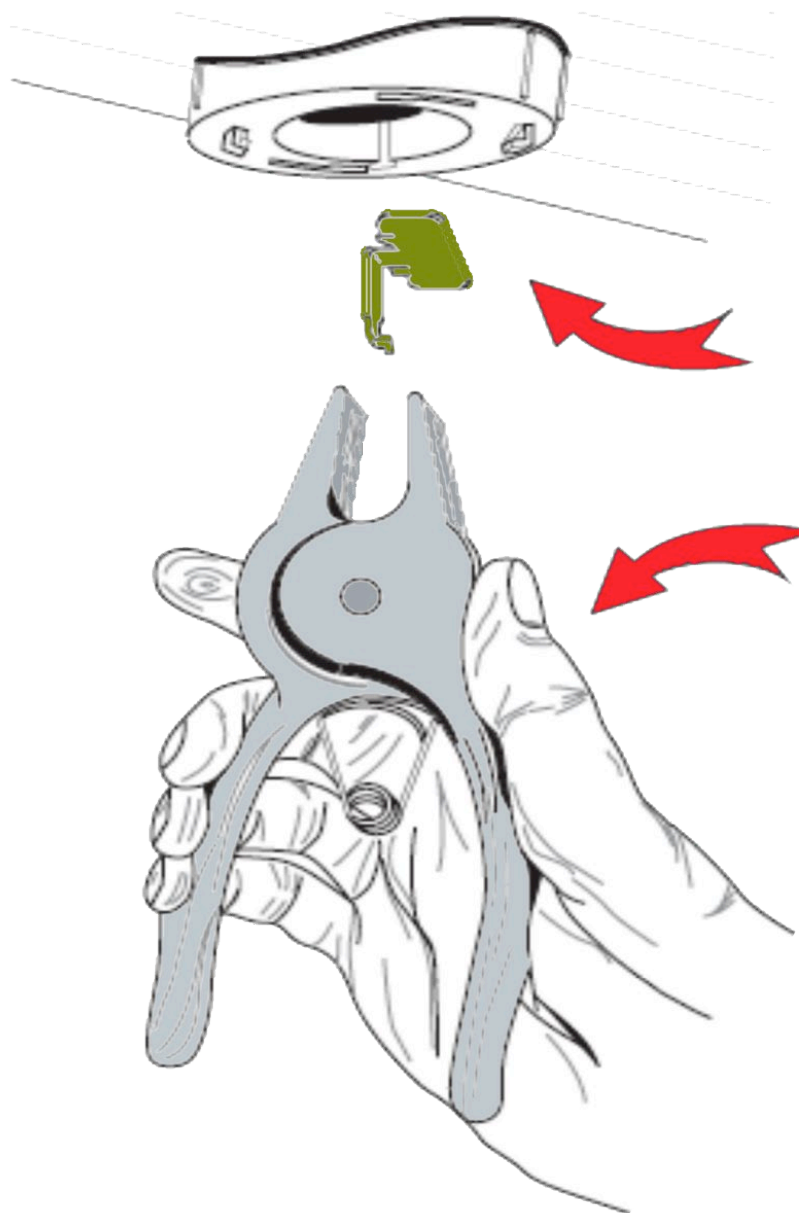

Note: Be sure to install **ALL** 4 retainer clips on each takeoff to maintain a good seal

Plenum Take-Off Kits

Come in packs of 2 or 5 to match **Installation Kits**

Available for both:

- Round Sheet Metal Duct (MR)
- 1" Square Fiberboard Plenum Duct (FS)


Order Codes	FS	MR
2 - Outlets	AC-TKFS-2	AC-TKMR-2
5 - Outlets	AC-TKFS-5	AC-TKMR-5

Note: You will receive these in the box

Example Take-Off Kit for (2) Outlets



Supply Tubing

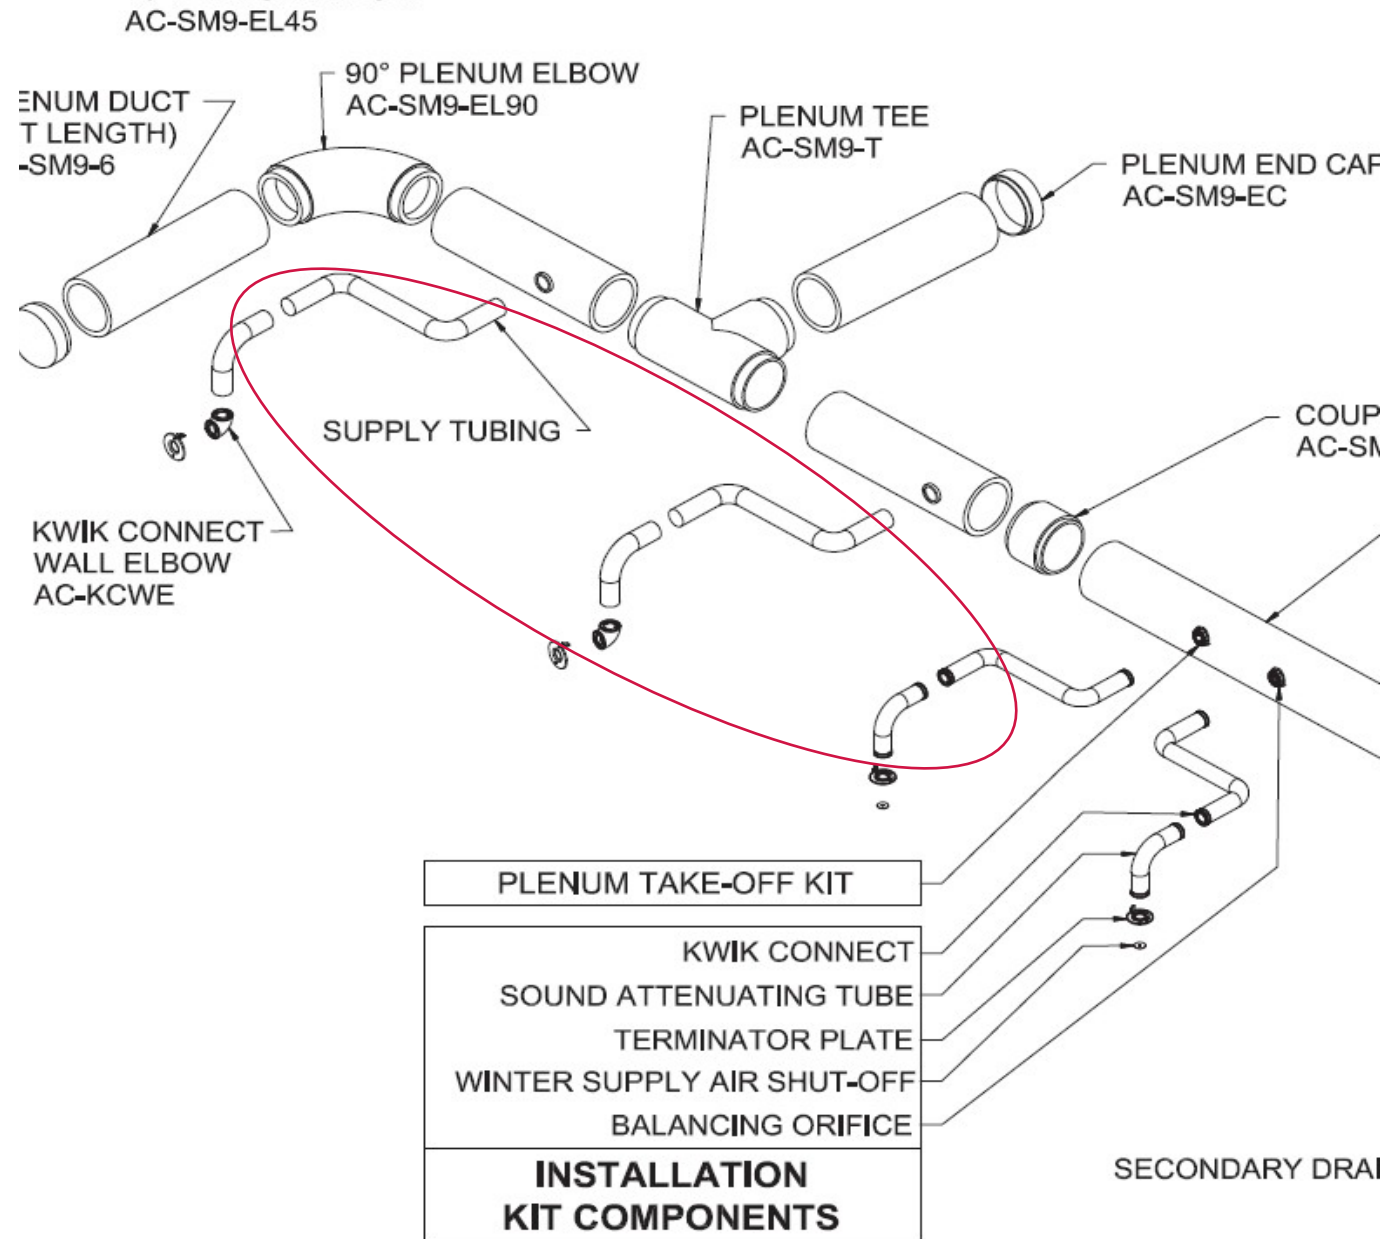

Small Duct Supply Tubing

Note: Local building codes will be the deciding factor in your R-Value required for installation

R-6

- Boxes of 100 Feet
- Total diameter 3.75"



R-8

- Boxes of 75 Feet
- Total diameter 7"



Small Duct Supply Tubing

- Rated pressure 0.0 – 2.5 W.C.
- Resistant to fungi growth
- Class 1, 25/50 flame/smoke spread
- Max operating temperature 250°F
- Duct closure tape min to max temperature range: -37 °F to 260 °F
- Meets surface burning characteristics & limited combustibility per UL 723, NFPA 90A & 90B, ASTM E84, CAN/ULC S102-1188
- Meets Buy American Standard
- SCS Certified for Green Building Recycled Content



Unique Tubing Machine

Farmville
North
Carolina



Supply Rules & Topics

- 6-7 outlets minimum per Ton on an AC-only
- In cooling only above 5000' use 8 outlets per ton and above 6500' use 9 outlets per ton
- 7-8 outlets minimum per Ton on a Heat Pump System (due to higher coil pressures)
- 2,000 BTUs per outlet (fully rated) in Cooling at 37 cfm
- 3,000 BTUs per outlet (fully rated) in Heating at 37 cfm
- Outlet placement in a room
- Room-by-room load Calculations to ensure the number of outlets in a room
- Best length of a duct run (includes sound attenuator)
- Maximum length of a duct run (9' to 15' this length includes the 3' sound attenuator)
- If the termination "hole" is closer to the trunk than 9 feet you can also loosely coil the supply (not tight)

Best Length of Duct Run

- Best length to balance the outlets run: 9 to 15 feet (with attenuator)
- Shorter than 9 feet work with duct orifice balancers
- Longer runs work if more runs are added to make up for the CFM lost
- 10% rule (after 15' of supply run you lose 10% for every additional 5') Loss of CFM and BTU's
- CFMs directly affect the amount of Btu's delivered

2" SUPPLY TUBING LENGTH ADJUSTMENT FACTOR CHART								
RUN	6'	8'	10'	12'	15'	20'	25'	30'
FACTOR	1.18	1.14	1.11	1.06	1.0	.9	.8	.66

6 Outlets Per Ton Minimum

System Size	System CFM	Number of Outlets	Average CFM	COOLING BTUs per outlet	HEATING BTUs per outlet
2 Ton	440	12	37	2000	3000
2.5 Ton	550	15	37	2000	3000
3 Ton	660	18	37	2000	3000
3.5 Ton	770	21	37	2000	3000
4 Ton	880	24	37	2000	3000
5 Ton	1100	30	37	2000	3000

10 Outlets Per Ton Maximum

System Size	System CFM	Number of Outlets	Average CFM	COOLING BTUs per outlet	HEATING BTUs per outlet
2 Ton	440	20	22	1200	1800
2.5 Ton	550	25	22	1200	1800
3 Ton	660	30	22	1200	1800
3.5 Ton	770	35	22	1200	1800
4 Ton	880	40	22	1200	1800
5 Ton	1100	50	22	1200	1800



CFM per Outlet

	CFM Per Outlet				
	Plenum Static Pressure "WC				
Supply Tube Length	1.8	1.5	1.2	1	0.5
10	45	40	36	33	22
15	37	33	30	27	18
20	32	28	26	23	15
25	29	25	23	21	14
30	26	23	21	19	13
35	24	22	19	18	12
40	23	20	18	16	11

Note: When delivered CFMs are low additional supplies may have to be added in a room to achieve the required Btus

Kwik Connects / Radius


- Minimum 4" radius for tubing
- For tighter radius use ridged elbow
- Tube cuts easily with bread knife or similar
- “crunch” down 2" of aluminum core before twisting in quick connect
- No need to overtighten
- Tuck remaining insulation under twist collar
- Tape connection

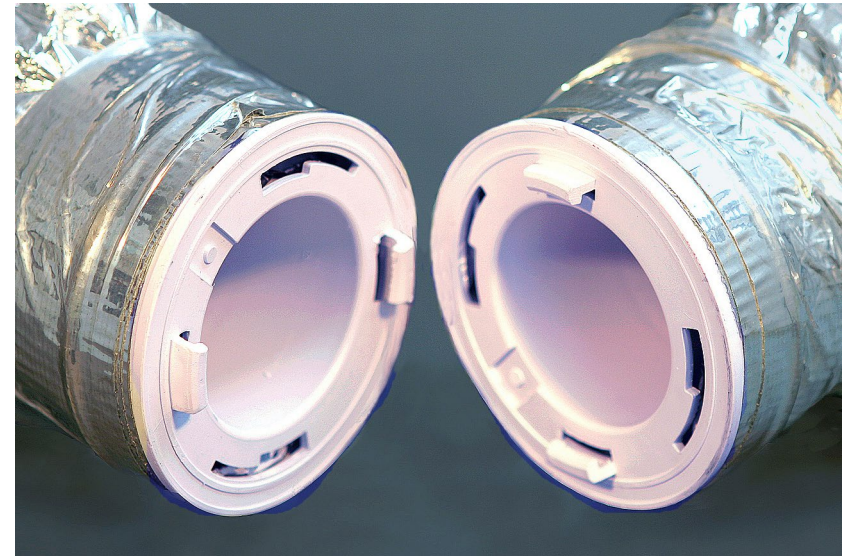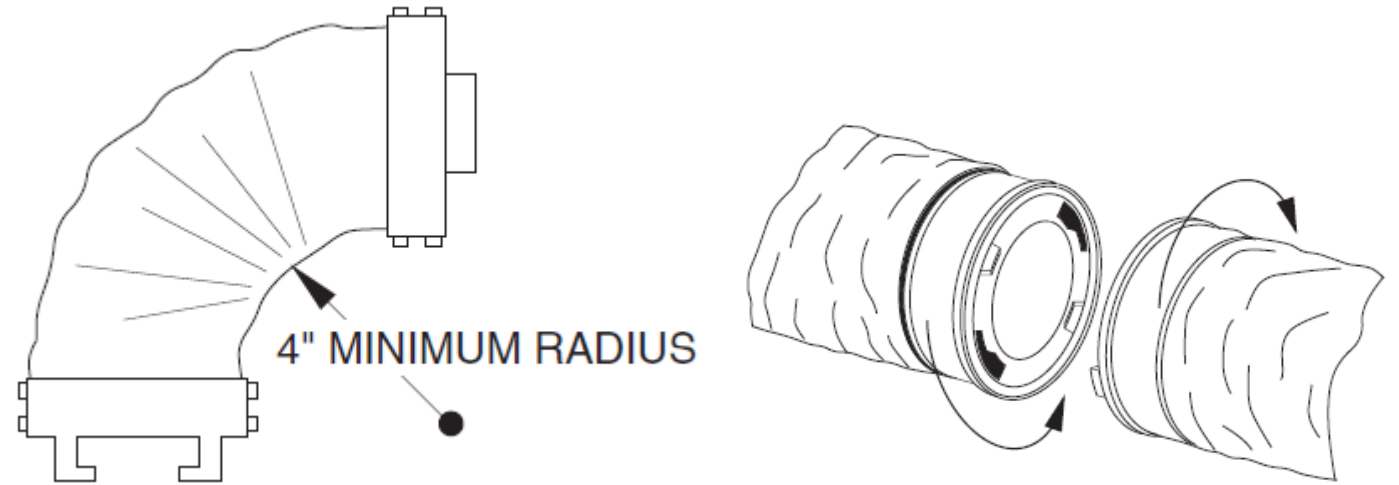

Kwik Connects / Radius

No need to screw or fasten beyond tape

No need to overtighten

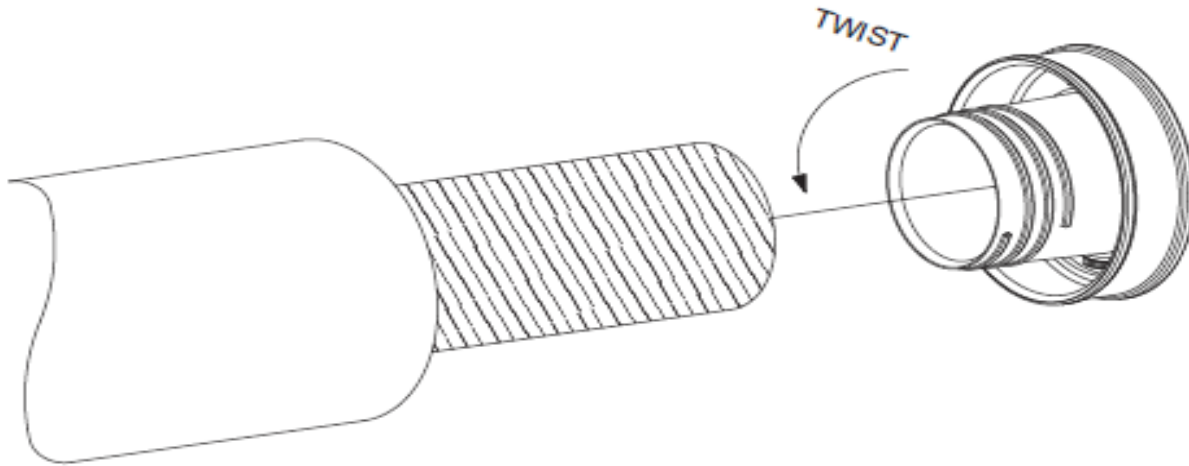

finished internal connection



Sound Attenuator

- 3-foot standard section
- Pre-assembled connectors
- Reduces velocity noise/cloth-lined
- End of every run
- Included in the total run length



Installation Kits / Common Parts Box

Used for all duct system types





Note: Take-off clips and gaskets supplied in “Take-Off Kits”

Balancing Orifices

Available in 3 sizes 15, 35, 50% (restriction)

- Install ONLY in the Plenum
- Do NOT install in the room-side termination
- Only used for balancing or areas that need reduced BTUs
- Most commonly used for small room/bathroom supplies
- If installed, please mark plenum and make a note for future service.

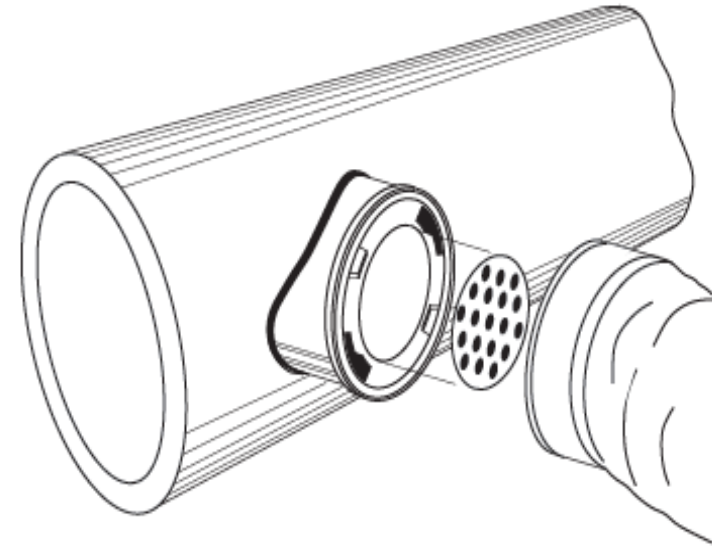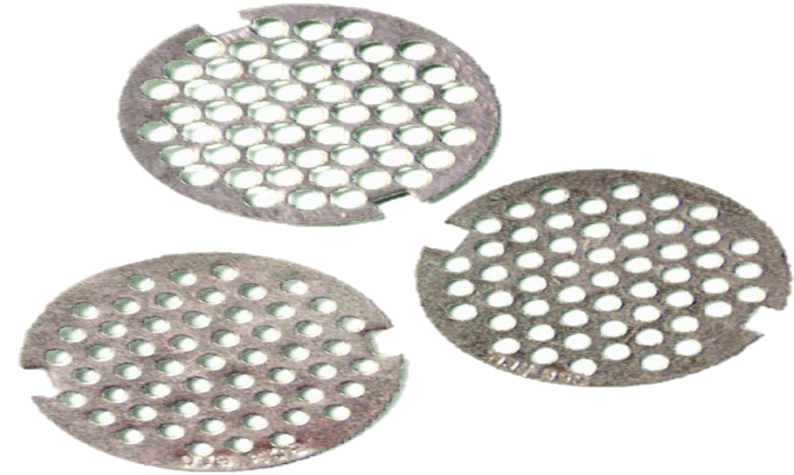

Balancing Orifices

- WILL result in unwanted noise and reduction of output
- Only to be installed at the plenum and only used for balancing and BTU reduction


NOTE: Use ¼" screen for floor installs to prevent the introduction of small objects






Questions?



Outlets

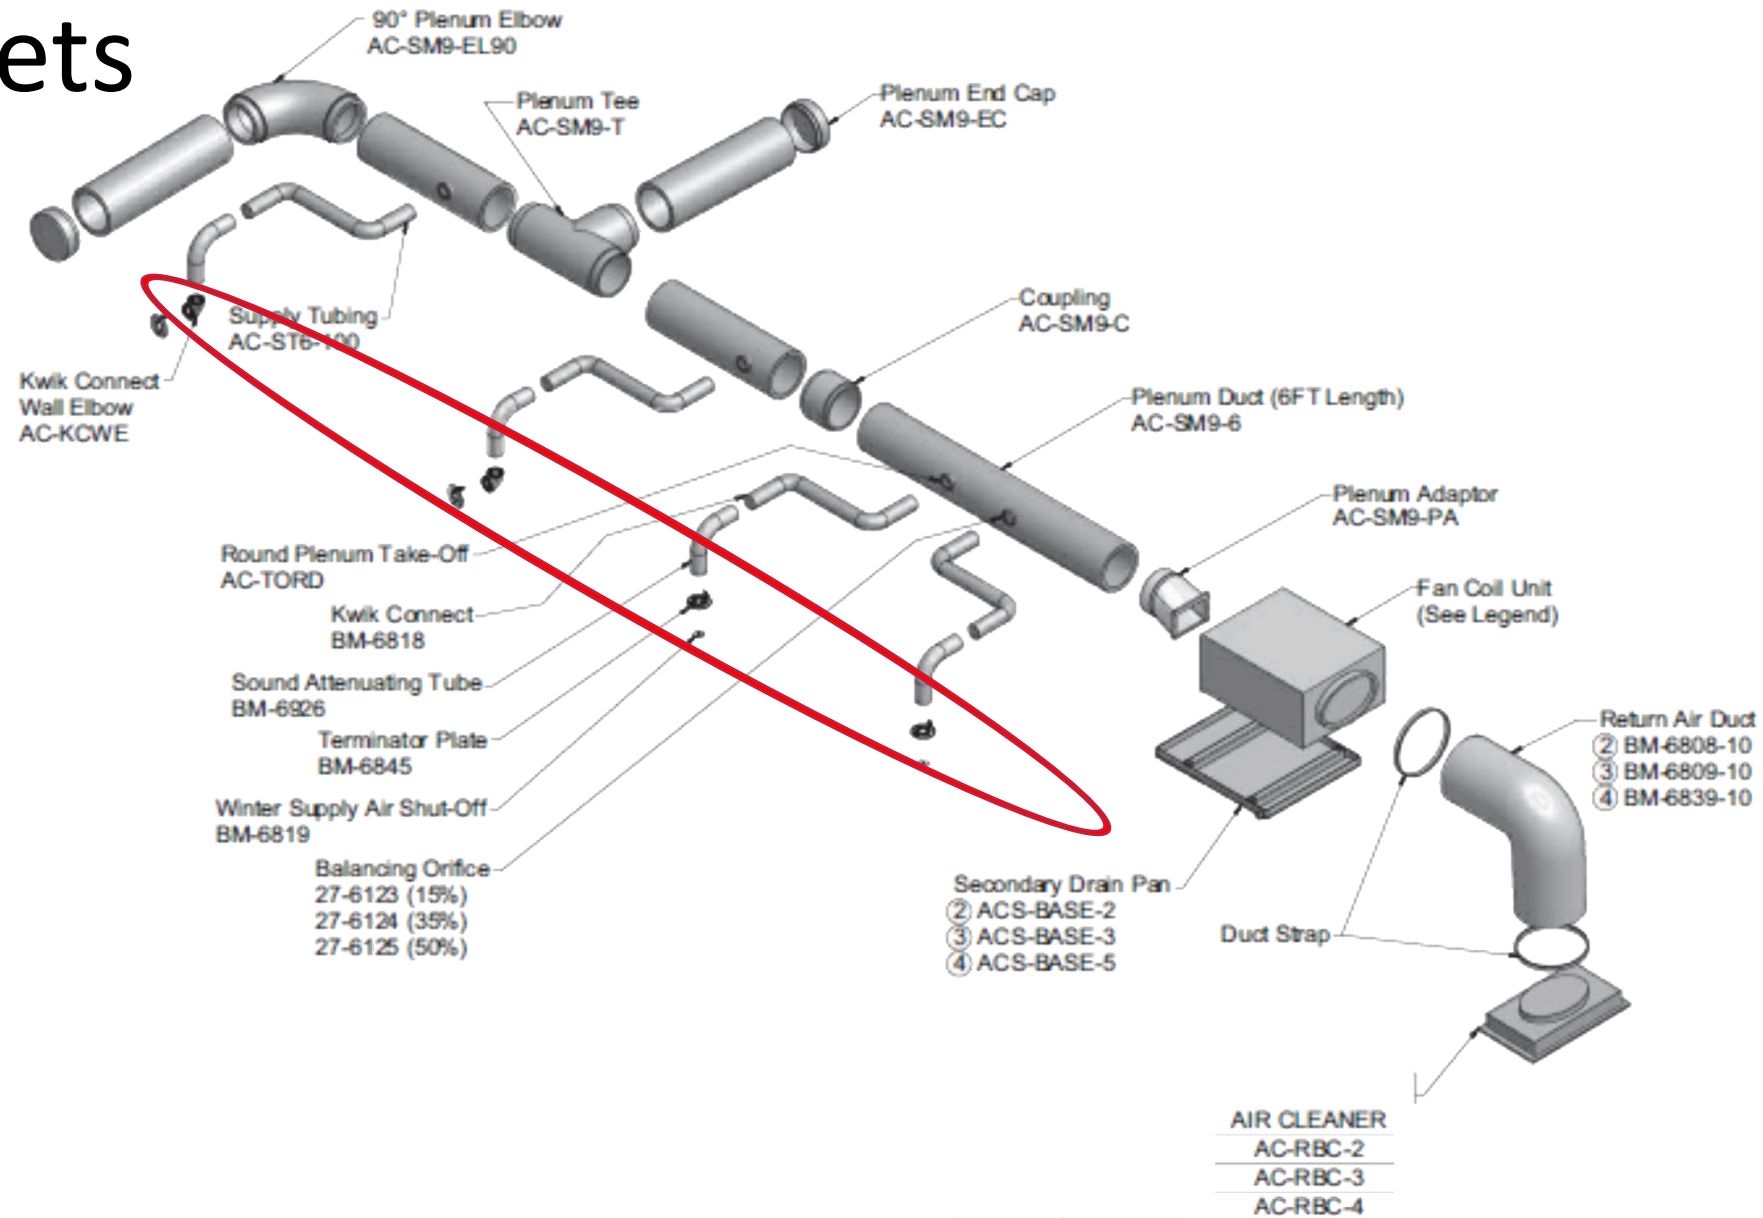

Outlet Orientation

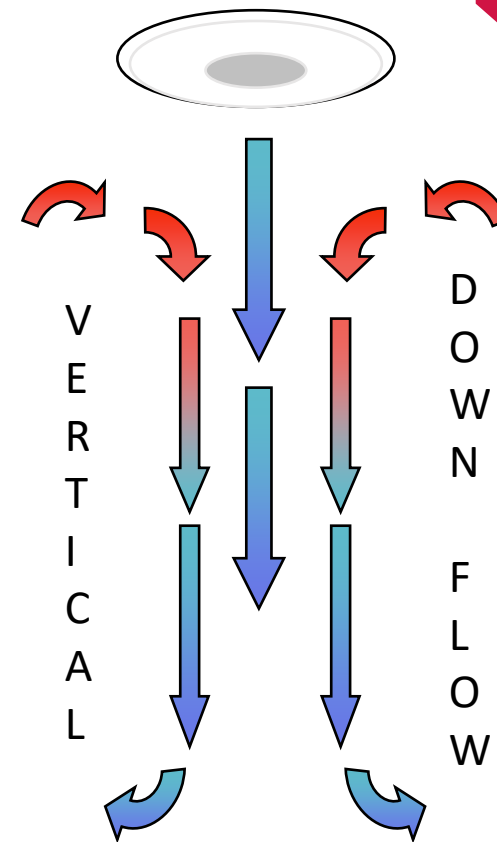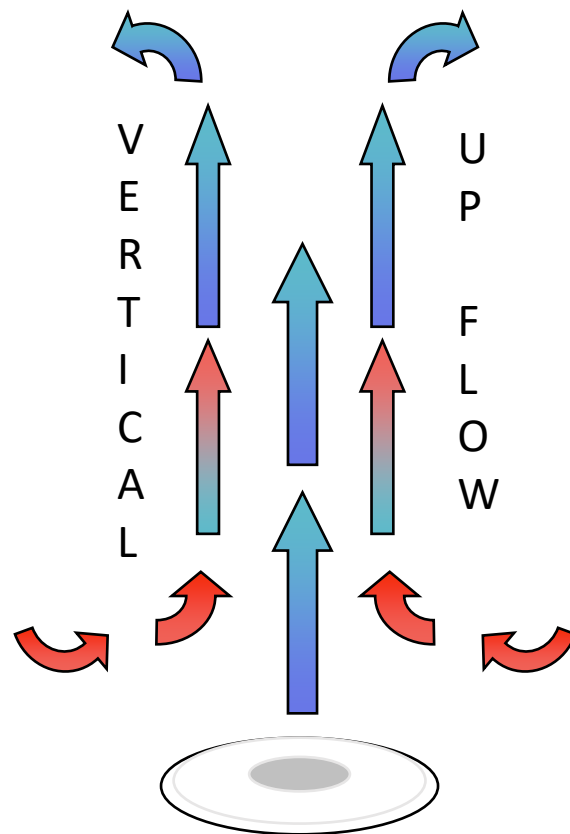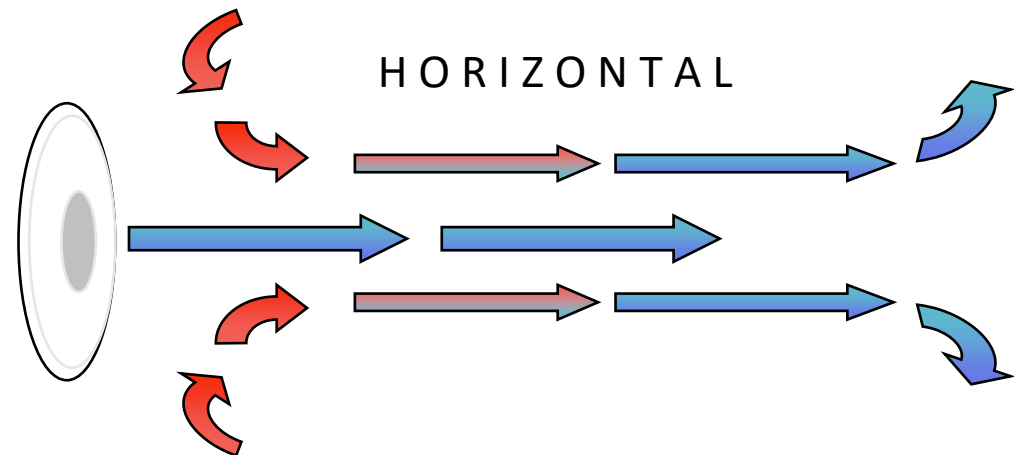

Outlet Placement Rules

DON'T DO THESE

- Place in traffic patterns (*room ceiling & floor corners, and behind door swings are ideal*)
- where it will blow on someone (*air can travel 15+ Feet*)
- where it will blow on something that will move (*example; curtains*)
- Never block an outlet (*reduction of airflow can reduce system performance*)
- Have at least 6 inches from the center of an outlet to a wall
- If an outlet is mounted in the floor, a ¼" screen can be used to prevent the introduction of foreign objects into the system.
- Ceiling, sidewall, or floor are all ok! ***Aspiration will work anywhere!!!***

The number of outlets in a room is determined by:

- A proper Room by Room Load Calculation
- The BTU'S required in the room based on the load
- CFM per outlet based on supply run and trunk layout
- Length of the run

SpacePak offers presale support to help with load calculations

SYSTEM

Basic System Overview

Residential House in Albany N.Y.


Heating

45,700/ 3000 BTU per full rated outlet = **15.2 outlets minimum**


Cooling

27,300/ 2000 BTU per full rated outlet = **13.6 outlets minimum**

Note: This is a good way to get an approximate system size; however, a full room-by-room load calculation should be done to ensure that the individual rooms are supplied properly.

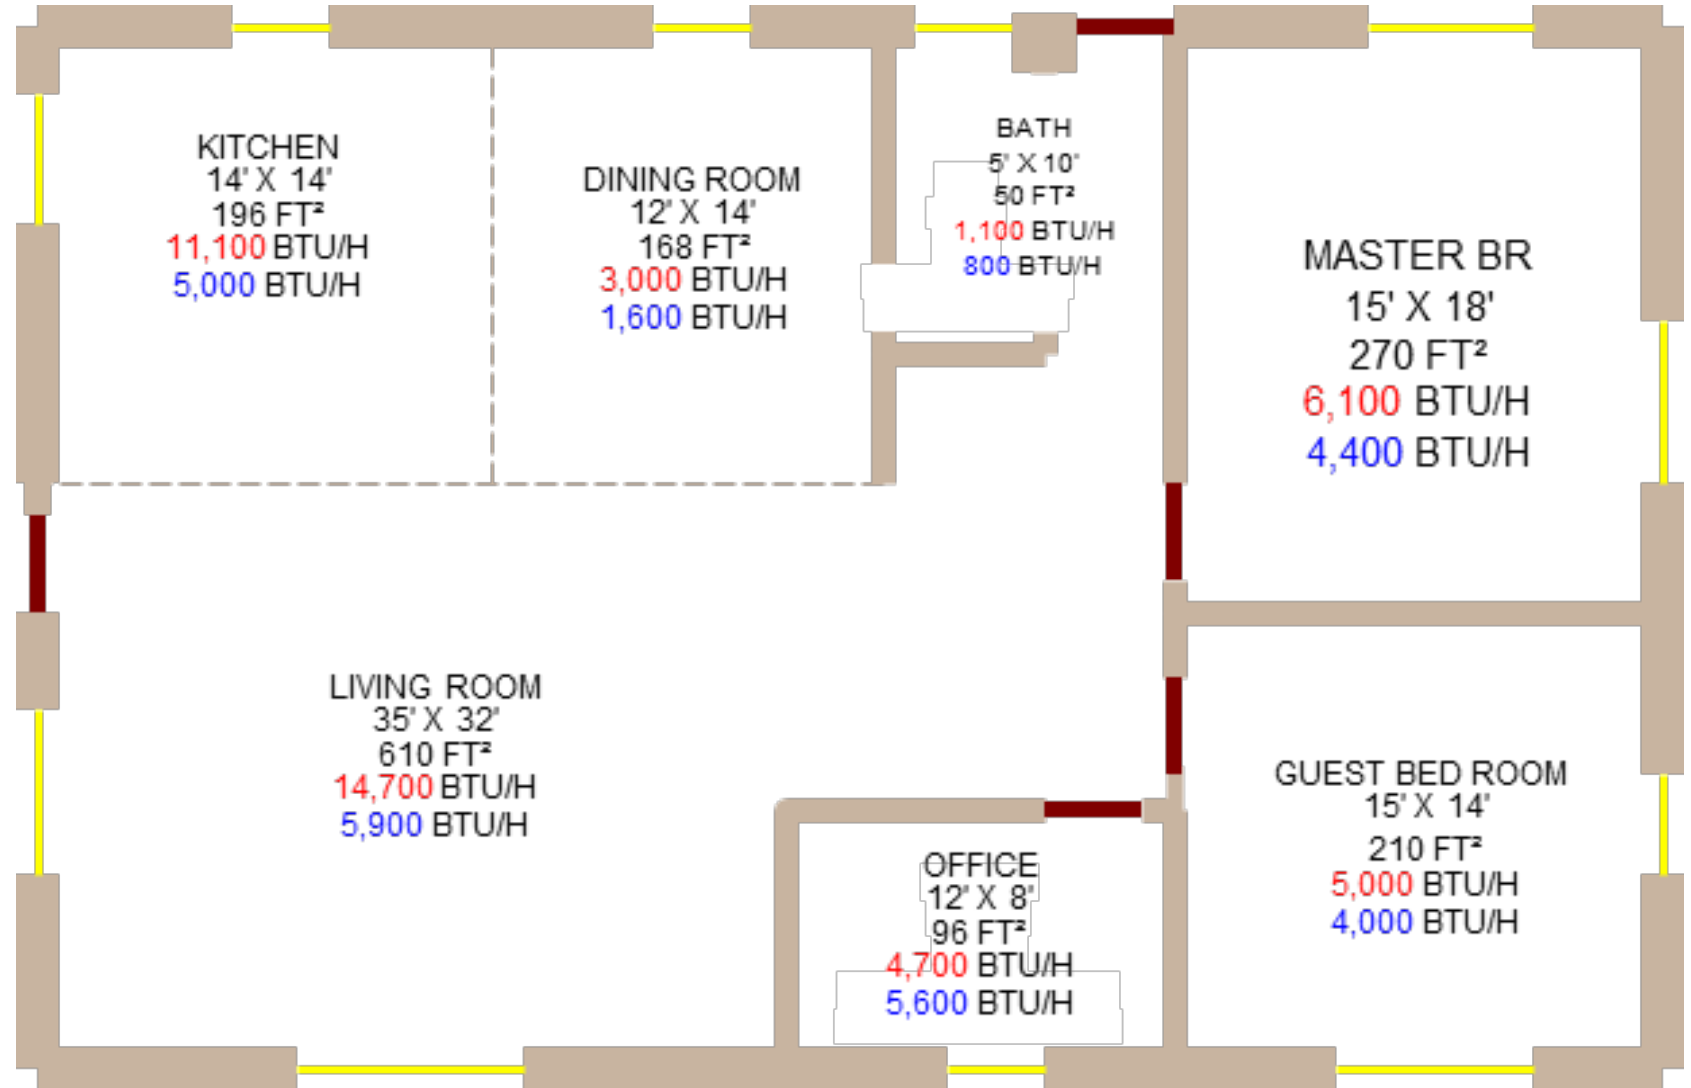

DX Coil Cooling Only

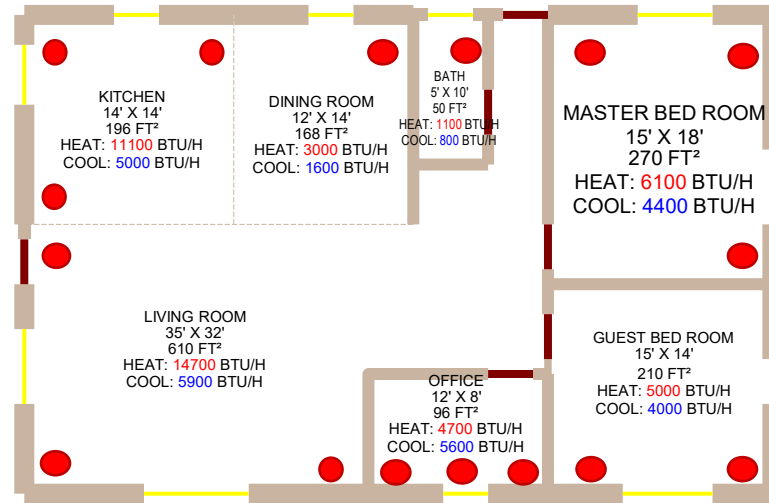


Kitchen
5,000 Btu Cooling
÷ 2,000 = 2.5

How Many
outlets?

3 Outlets

- Dining Room 1, Bath Room 1, Master Bed 3, Guest Bed 2, Office 3, Living Room 3
- Our Cooling Load is 27,300 BTUH ÷ 2000 = 13.65 outlets.
- The unit we would use is an ESP-2430KHZA DX FAN COIL with a 2.5 ton Condenser, 30,000 BTUH ÷ 2000 requires 15 Outlets we have 16 so your good to go !

Dx Coil Option With Hydronic Coil For Heating

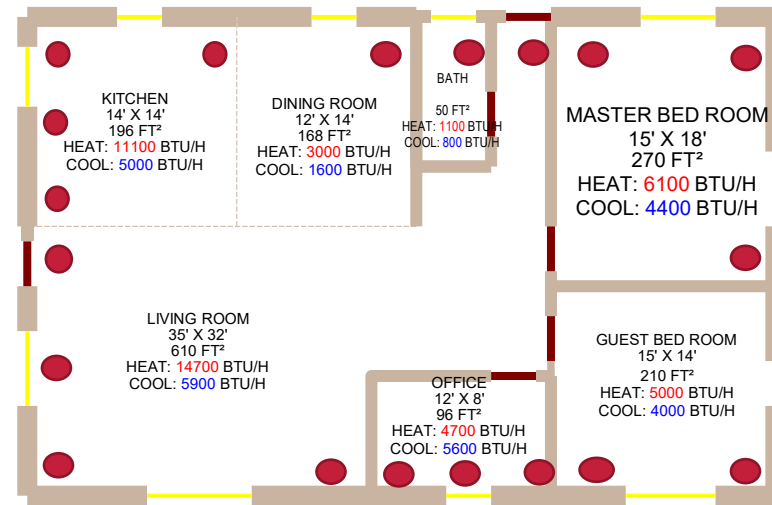

Kitchen
11,100 Btuh
Heating
 $\div 3,000 = 3.7$


5,000 Btuh Cooling
 $\div 2,000 = 2.5$

How Many
outlets ?


4 Outlets

- Dining Room 1, Bathroom 1, Master Bed 3, Guest Bed 2, Office 3, Living Room 5
- Our Largest Load is the Heating Load of 45,700 BTUH $\div 3000 = 15.2$ outlets.
- The unit we would use is an ESP-3642KHZA DX FAN COIL combined with a 2.5-ton Condenser, add an AC-WPAK-90 Hydronic Coil requiring 16 Outlets we have 19 so your good to go !


The Shotgun Duct System

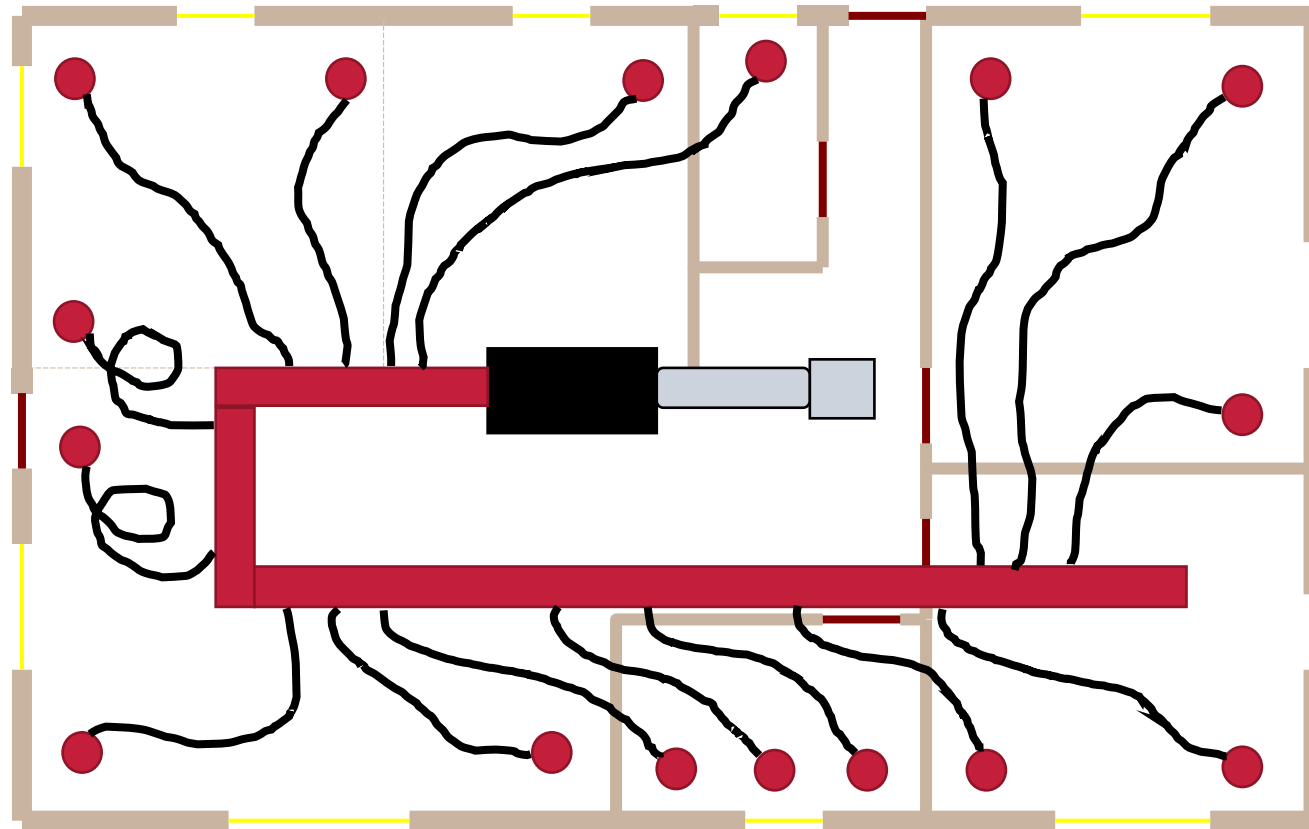

The Shotgun with a Tee (be sure to follow the “TEE” rules)

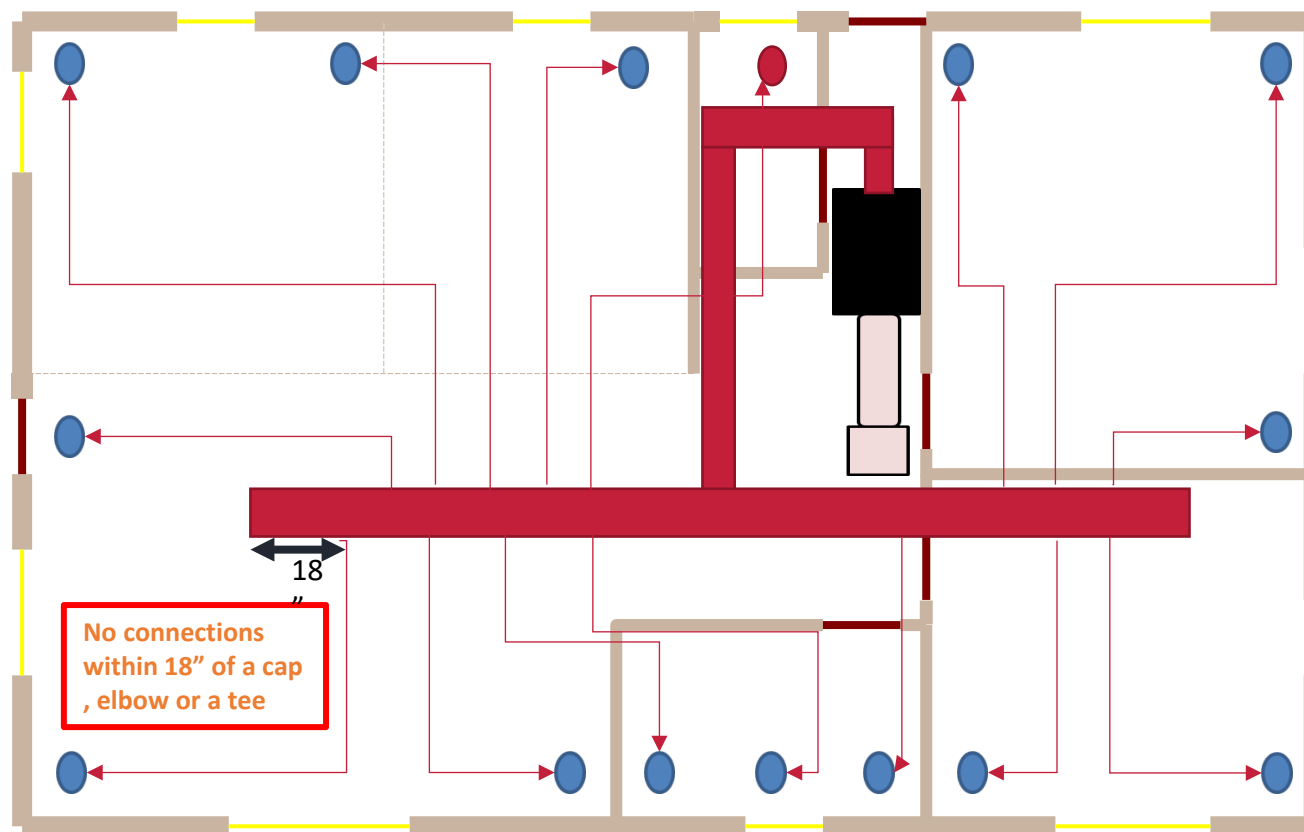



Perimeter Loop

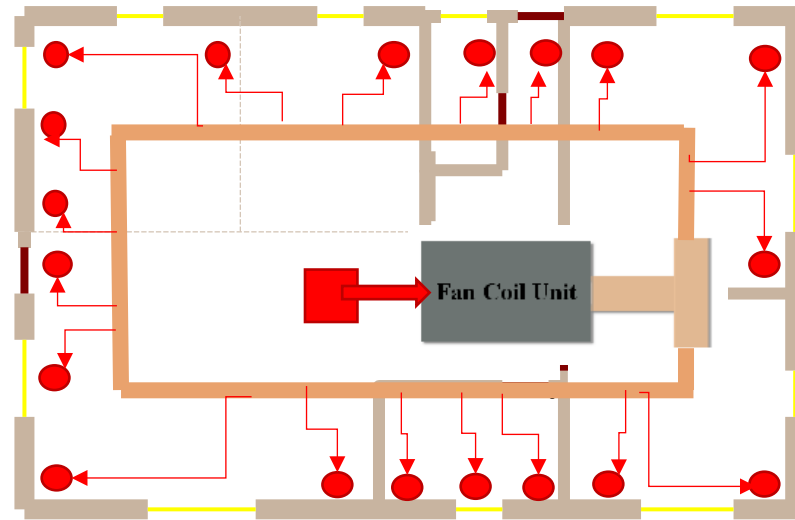

Layout with a centrally located return, this system would need no “extra balancing” based on our load calculations and duct design chosen.

Supply Outlets and Terminations

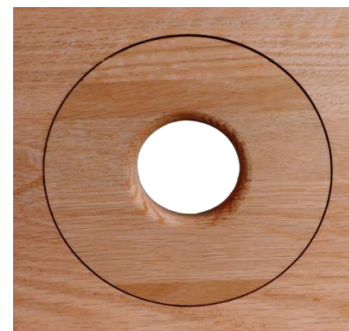

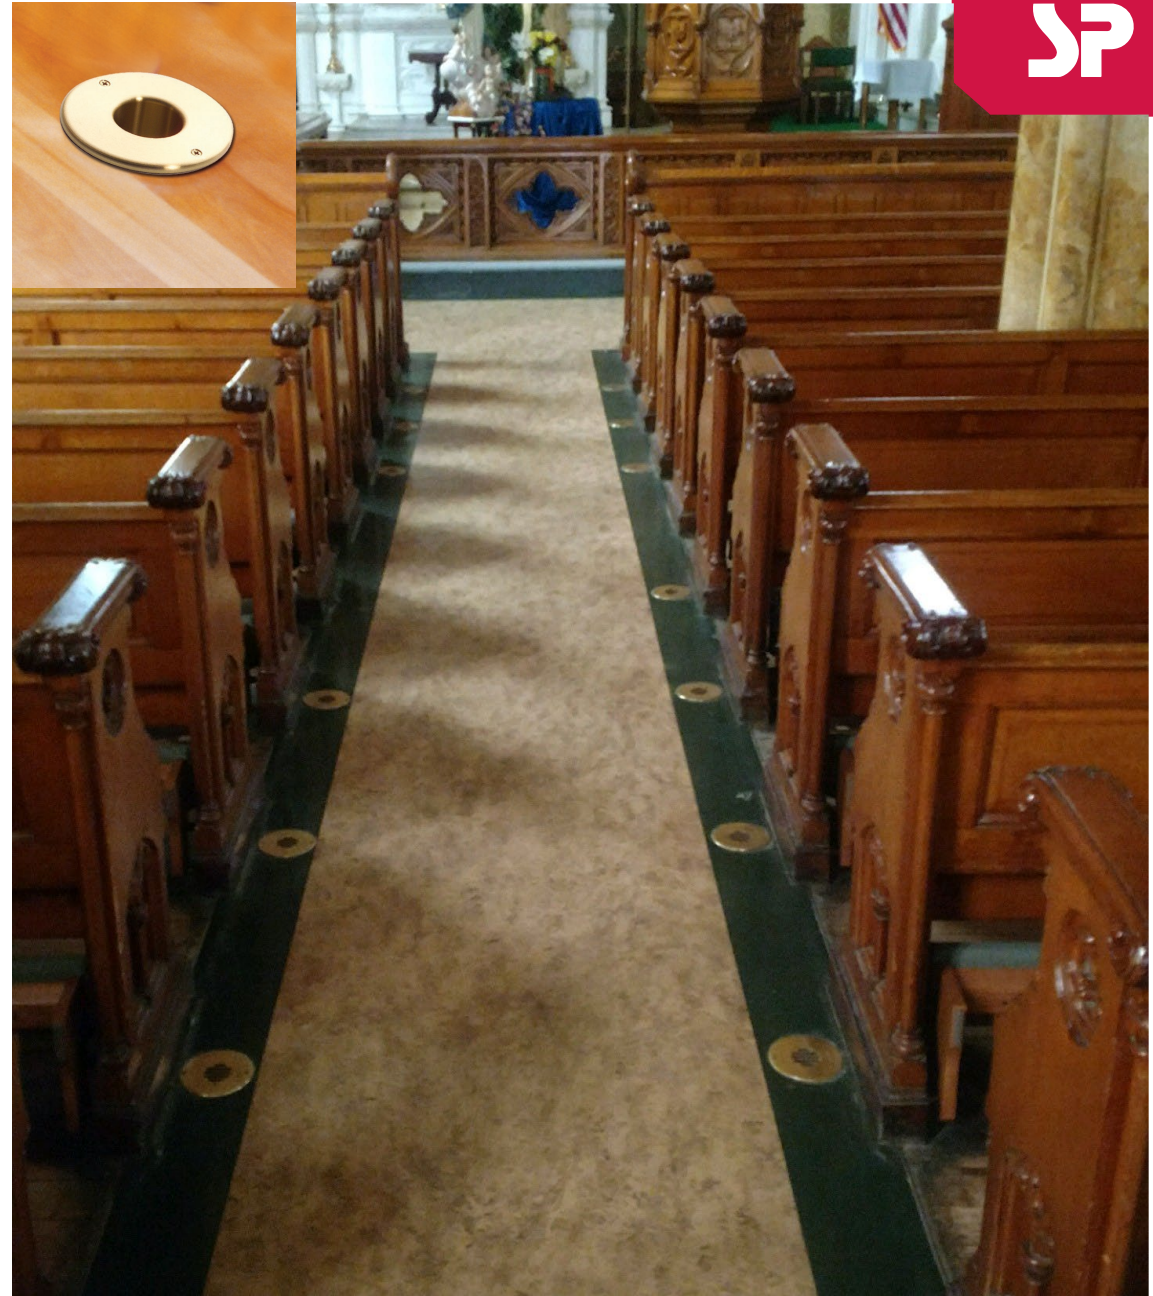


Outlets



When installing in a standard sheetrock ceiling be sure to use a 4" hole saw other ceiling and floor material may require a slightly different installation processes.

Installation of termination plate and mounting clips

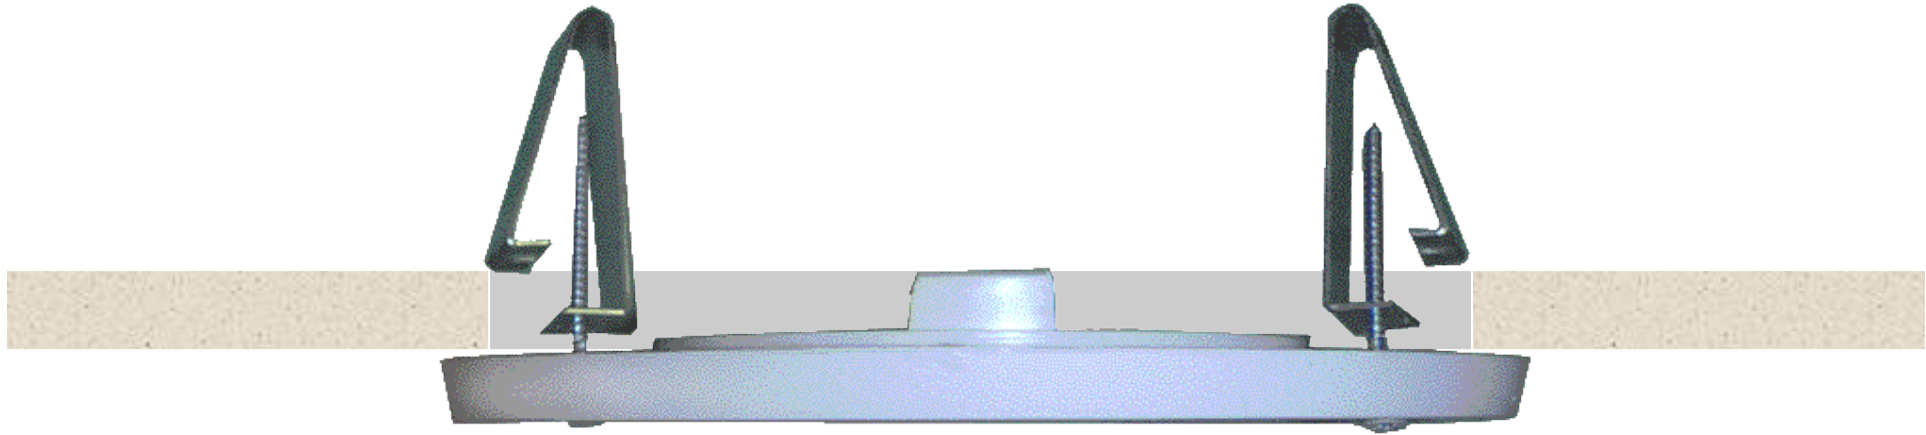

- The sound attenuator is usually attached to the termination plate at this time
- Altering the clips or hole size may be required in some applications for proper fastening as different installations may require adjustments - this is all considered ok as long as you are not restricting air flow (should not have any effect on system performance)


Additional Installation Parts

KWIK CONNECT WALL ELBOW




Kwik Connect wall elbows simply snap into place for fast, easy installation.

ROUGH-IN BRACKET

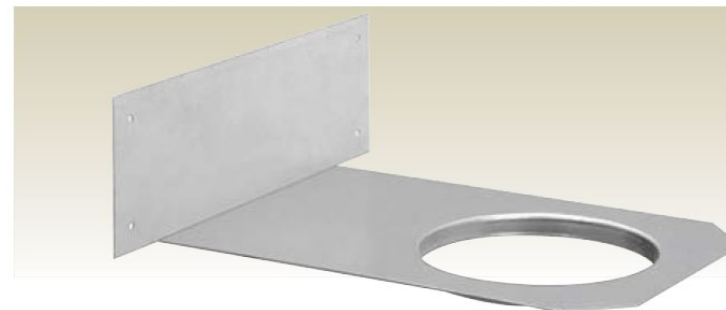

Serves as a reference point for sheetrock outlet locations during the framing portion of new construction.

KWIK CONNECT EXTENSION

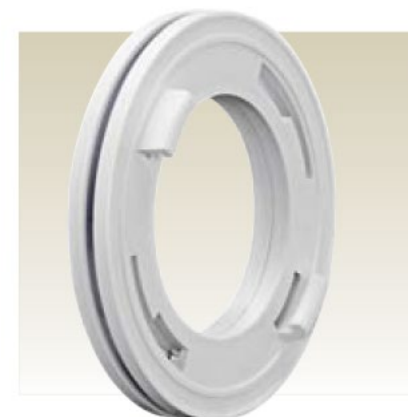


Designed for installations using wall thicknesses above 1/2".


Common supply wall and common return air



If we were standing in this picture, all windows would be at our back.

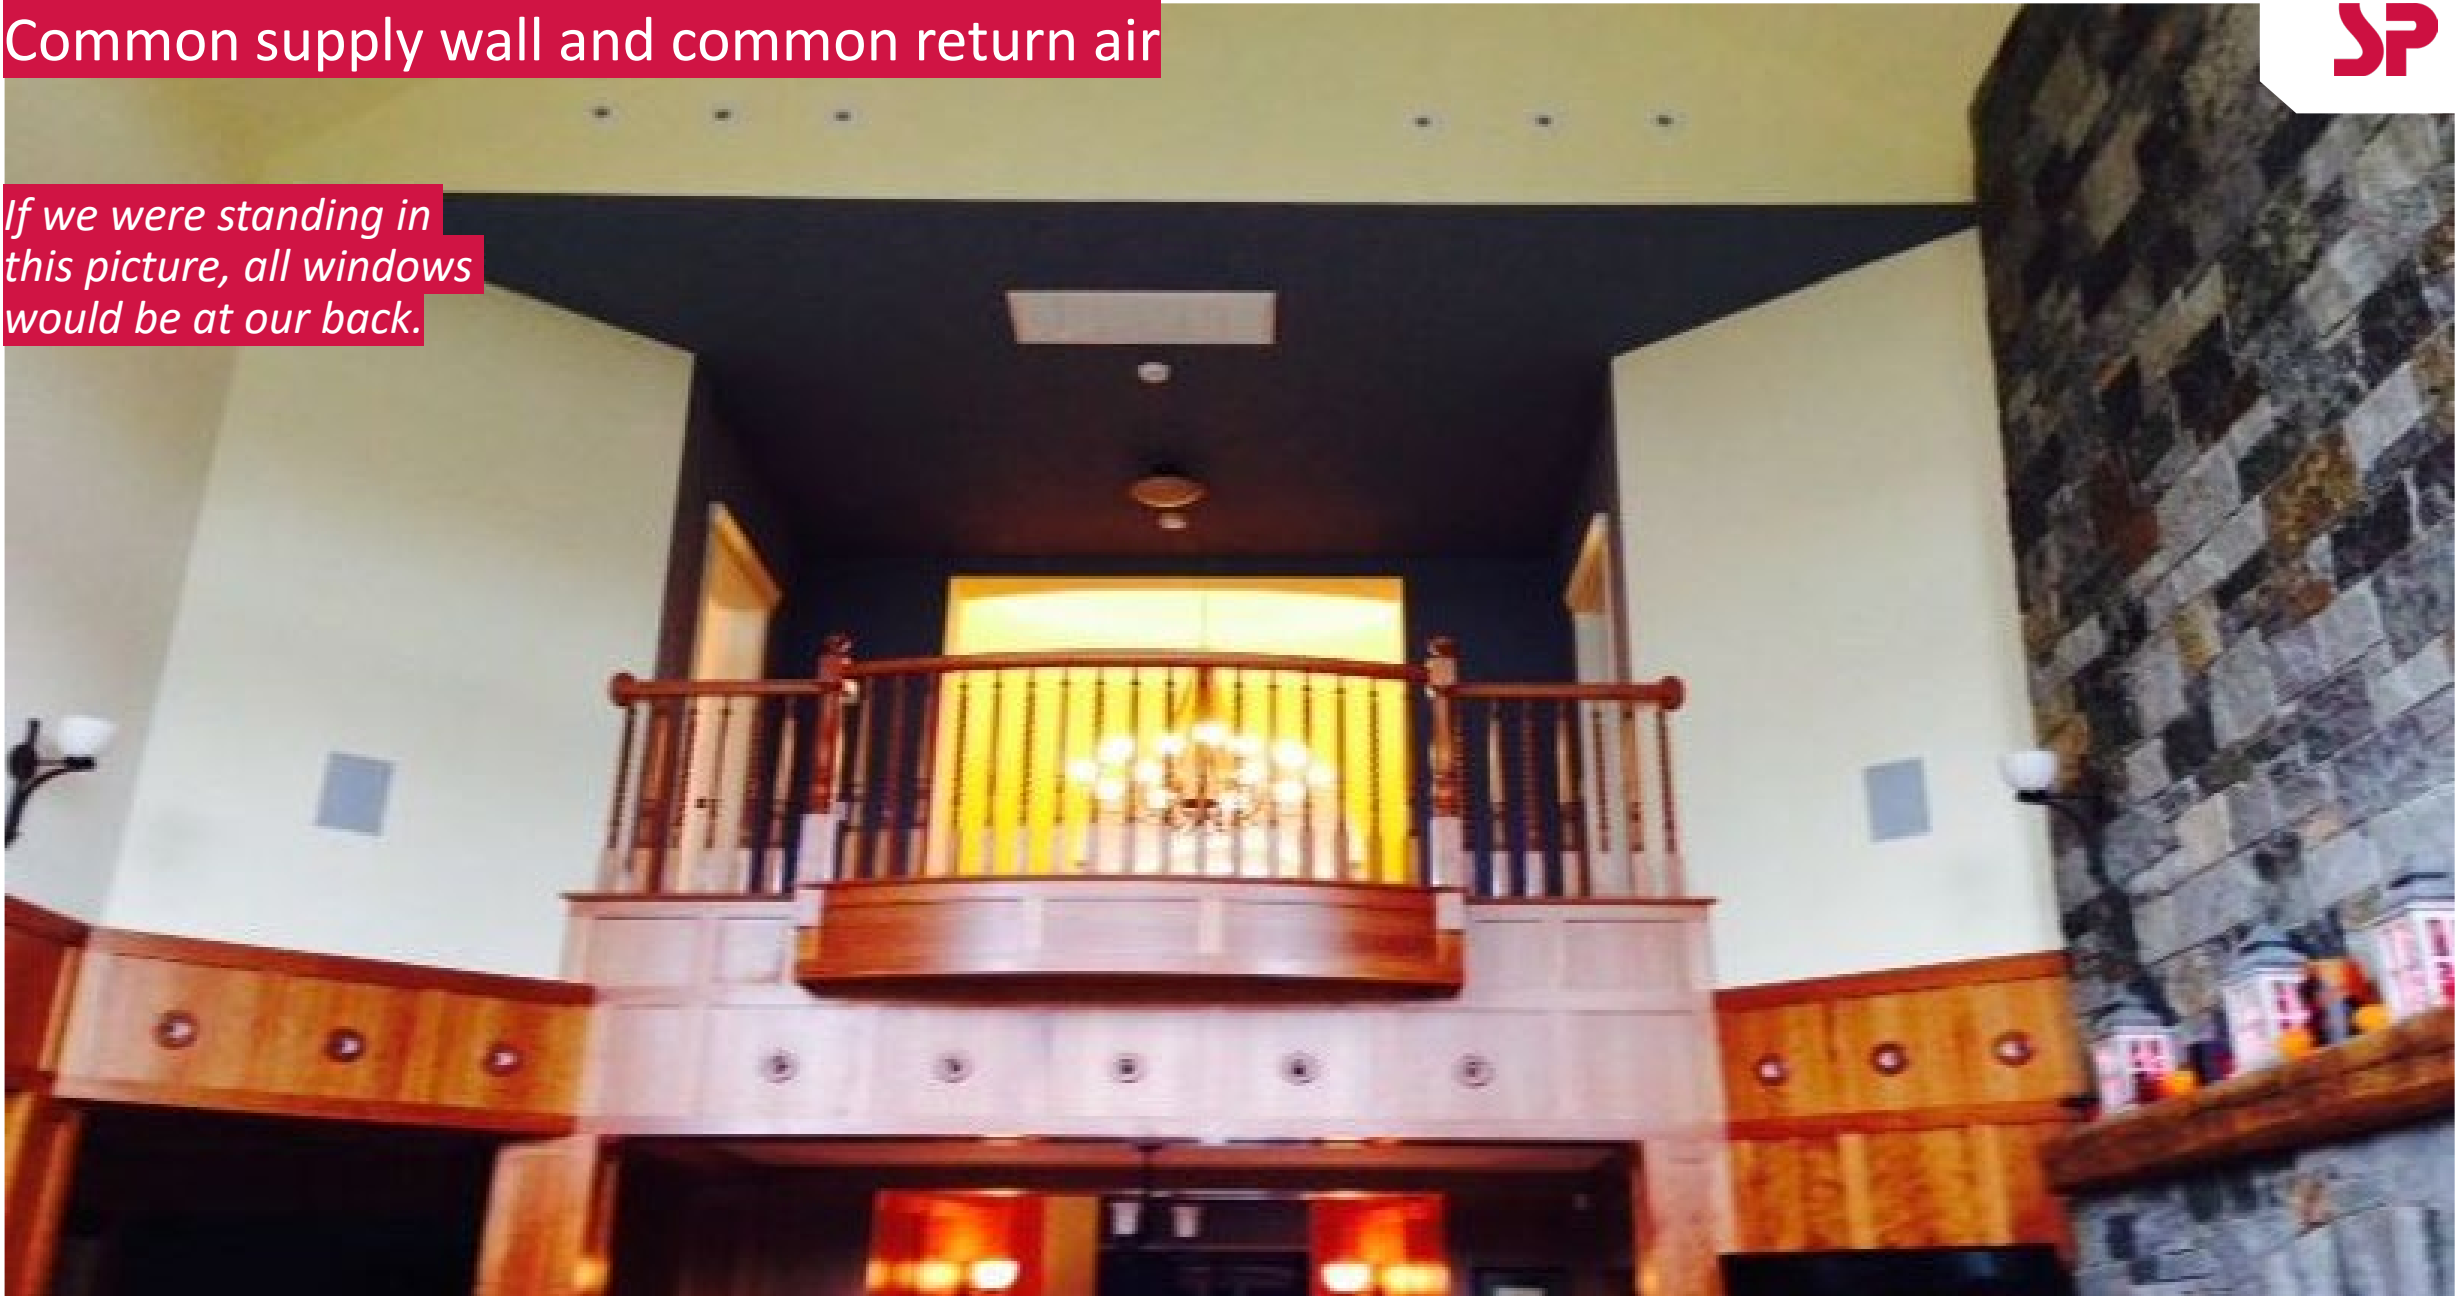




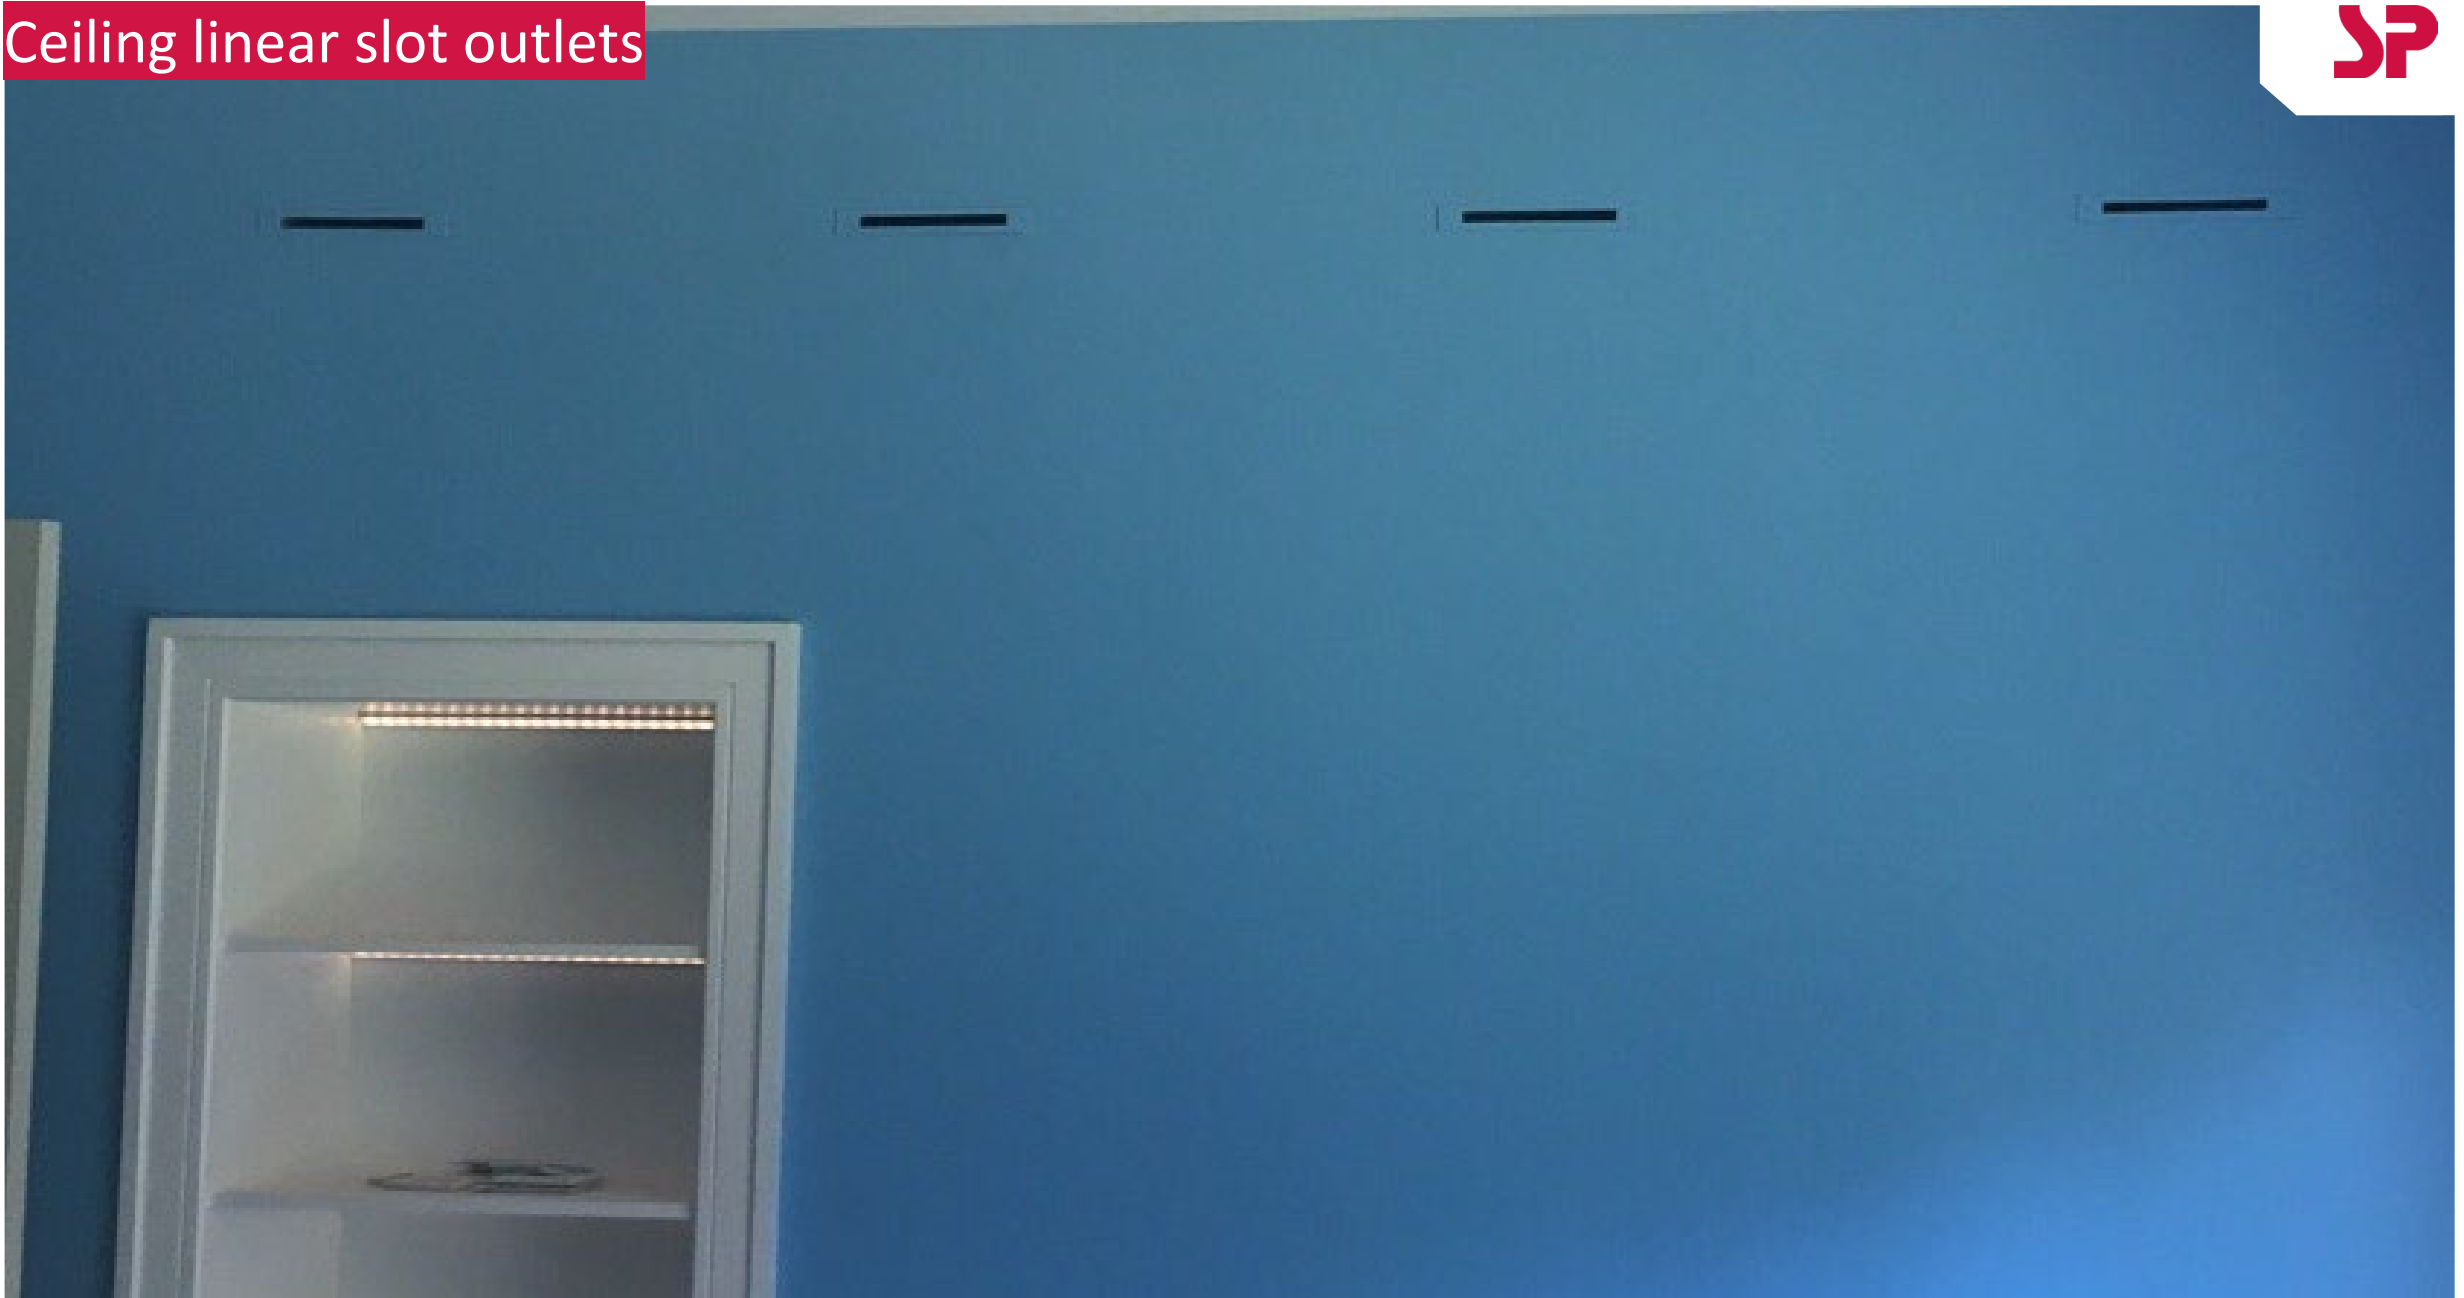

Hallway Ceiling Installation

- Notice the best place for outlet termination is in the center of the hall
- Rough-in plates were used in this installation to ensure proper locations

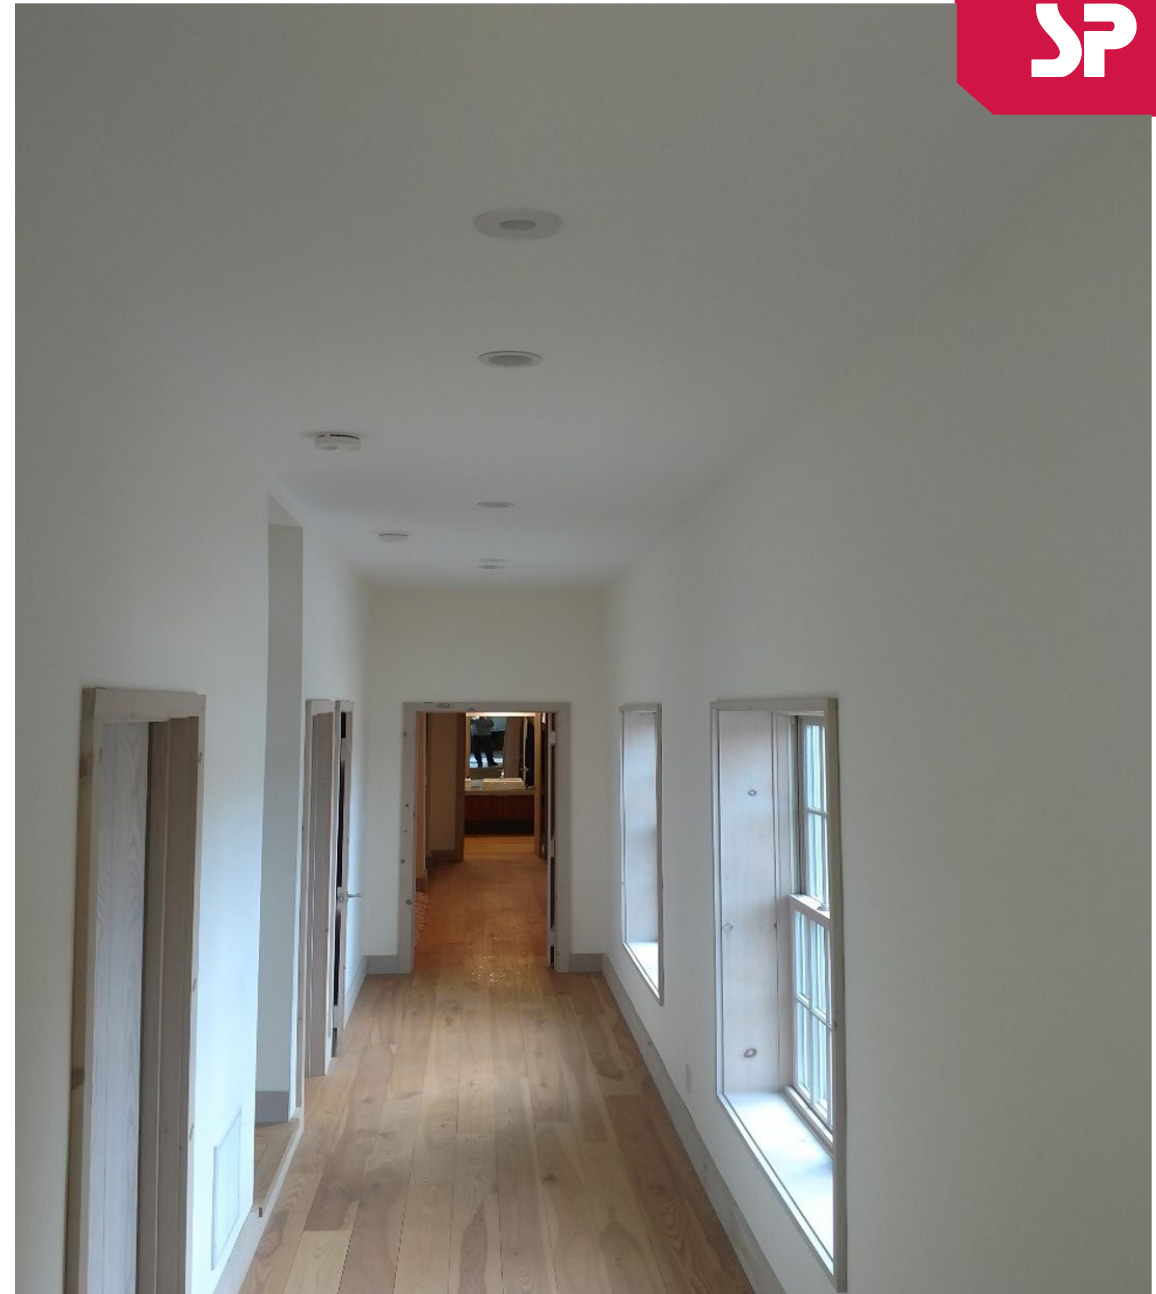



Ceiling outlets

9 - 10 runs per ton were used in this installation to ensure that air noise would not be an issue due to the lack of natural sound deadening material (full carpets, low ceilings, etc.).





Exterior wall outlets

The main trunk was rectangle and located in the floor.

The supplies were run up the outside walls between the windows and out creating a thermal curtain.

This rooms cooling load was 42,000 btu.


No termination plates

The cabinet maker made holes and the contractor attached to the back of the top plate. Notice the slight angle to the top plate. This will allow the air to travel under the timbers and across the room.

Spot Conditioning


Great for

- areas where it would be financially exhausting to condition the entire space
 - kitchen prep lines
 - Assembly lines
-
- Gives a great commercial look
 - You can run fewer outlets per ton due to the loss of restriction applied by the normally installed supply tubing
 - Generally, 4-5 outlets per ton will work here

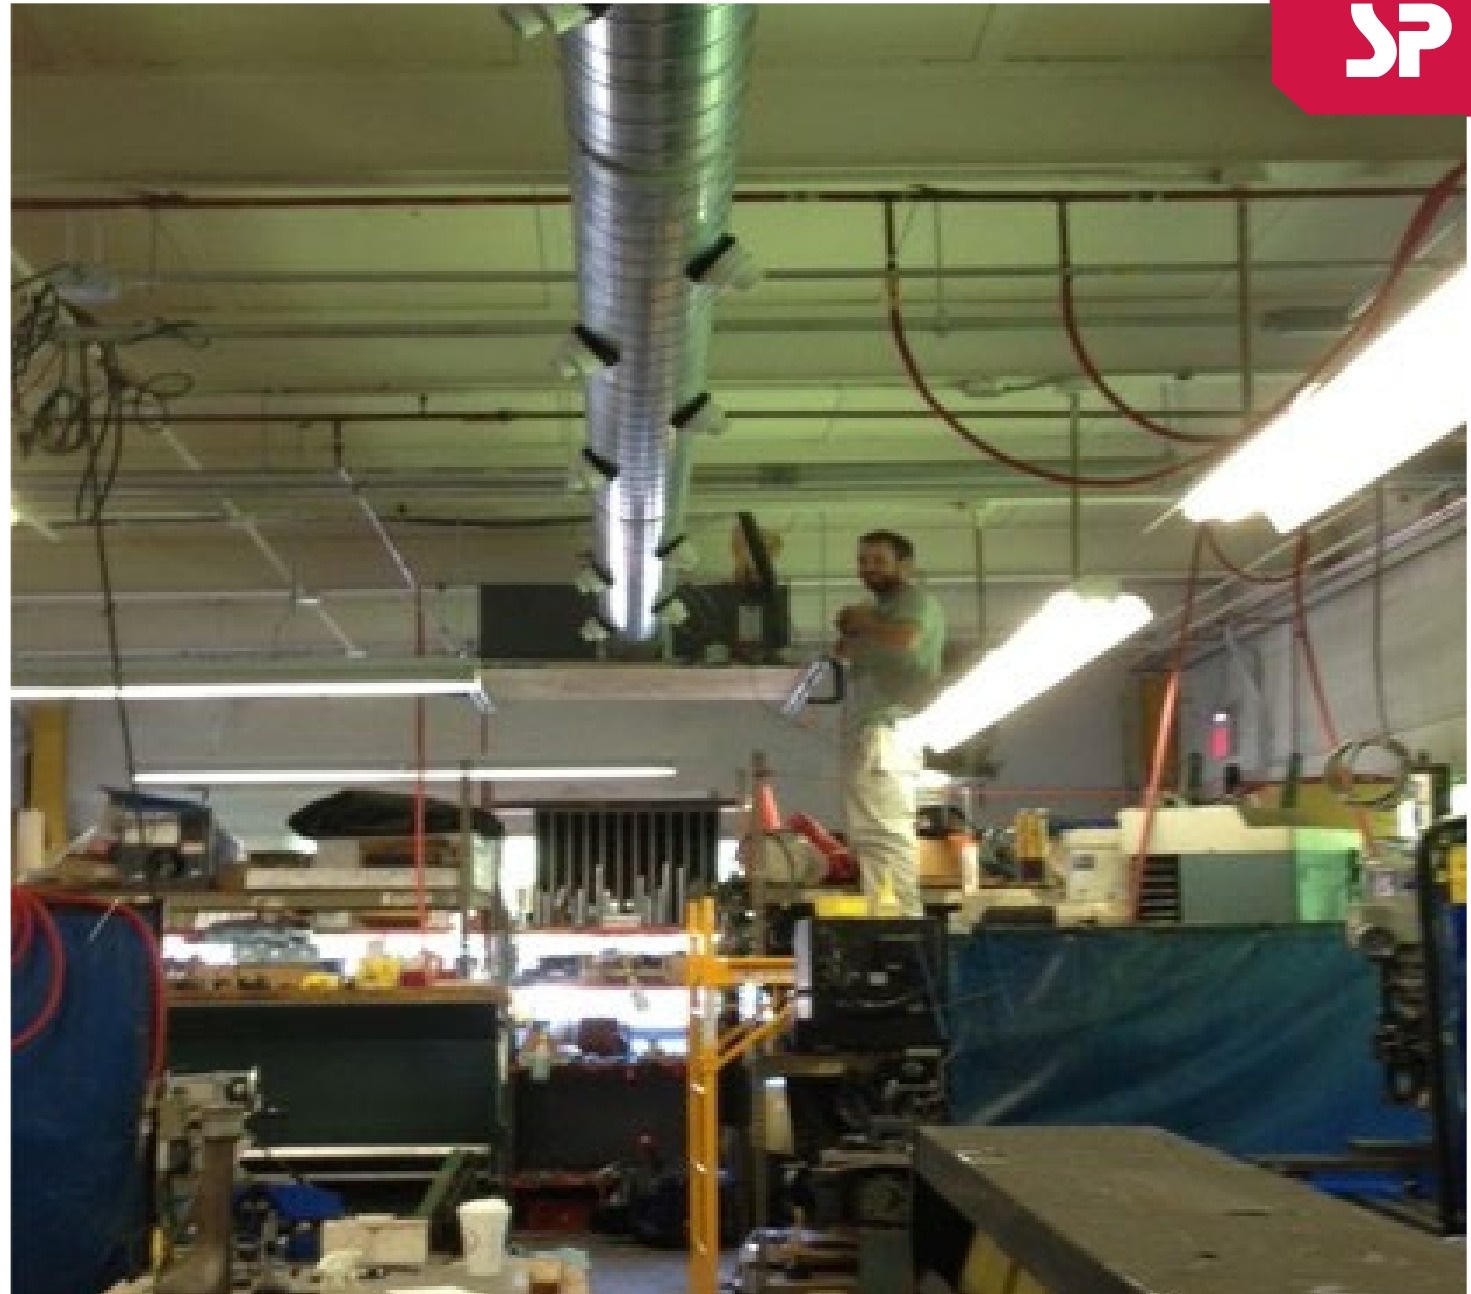


Zoning Basics (Same with K Series)

- A staged or fully inverter condenser MUST be used.
- In a multi-zone system, the smallest zone must be of the same size or larger output than the compressors lowest turned-down capacity.
Example: if the inverter condenser turns down to 12,000 btu, the smallest zone must be capable of handling that one-ton capacity.
- When using multiple zones, Control allows you to match airflow to specific system needs.
- Be sure to follow all duct design rules.
- Do not under any circumstances use an air bypass!

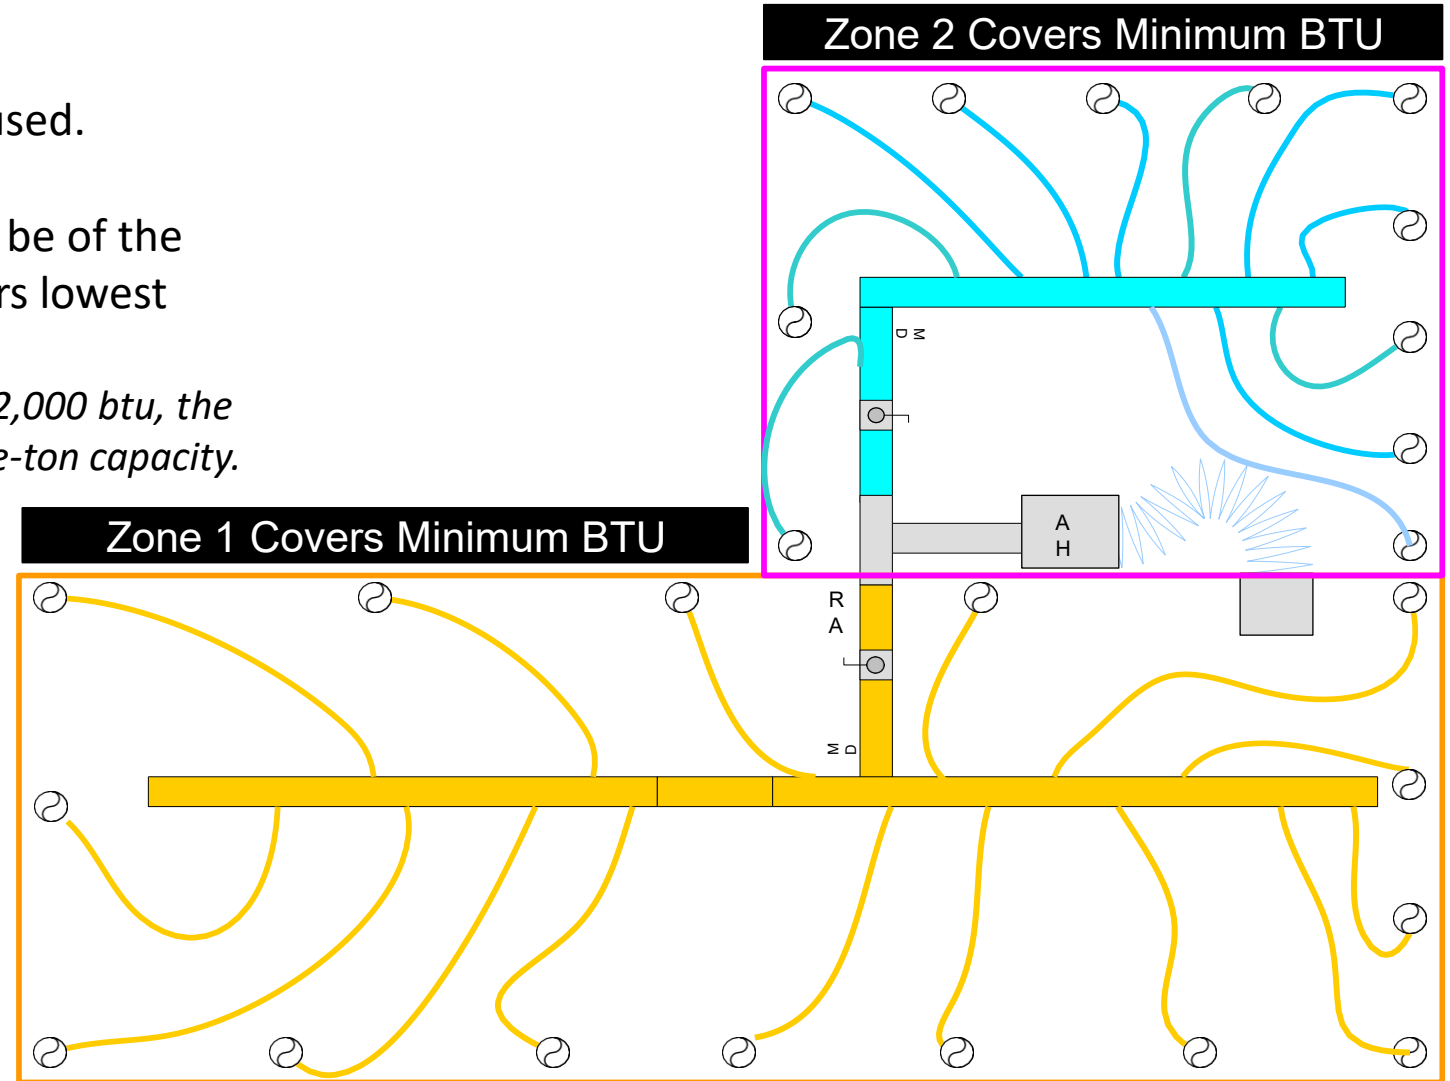

Zoning Basics

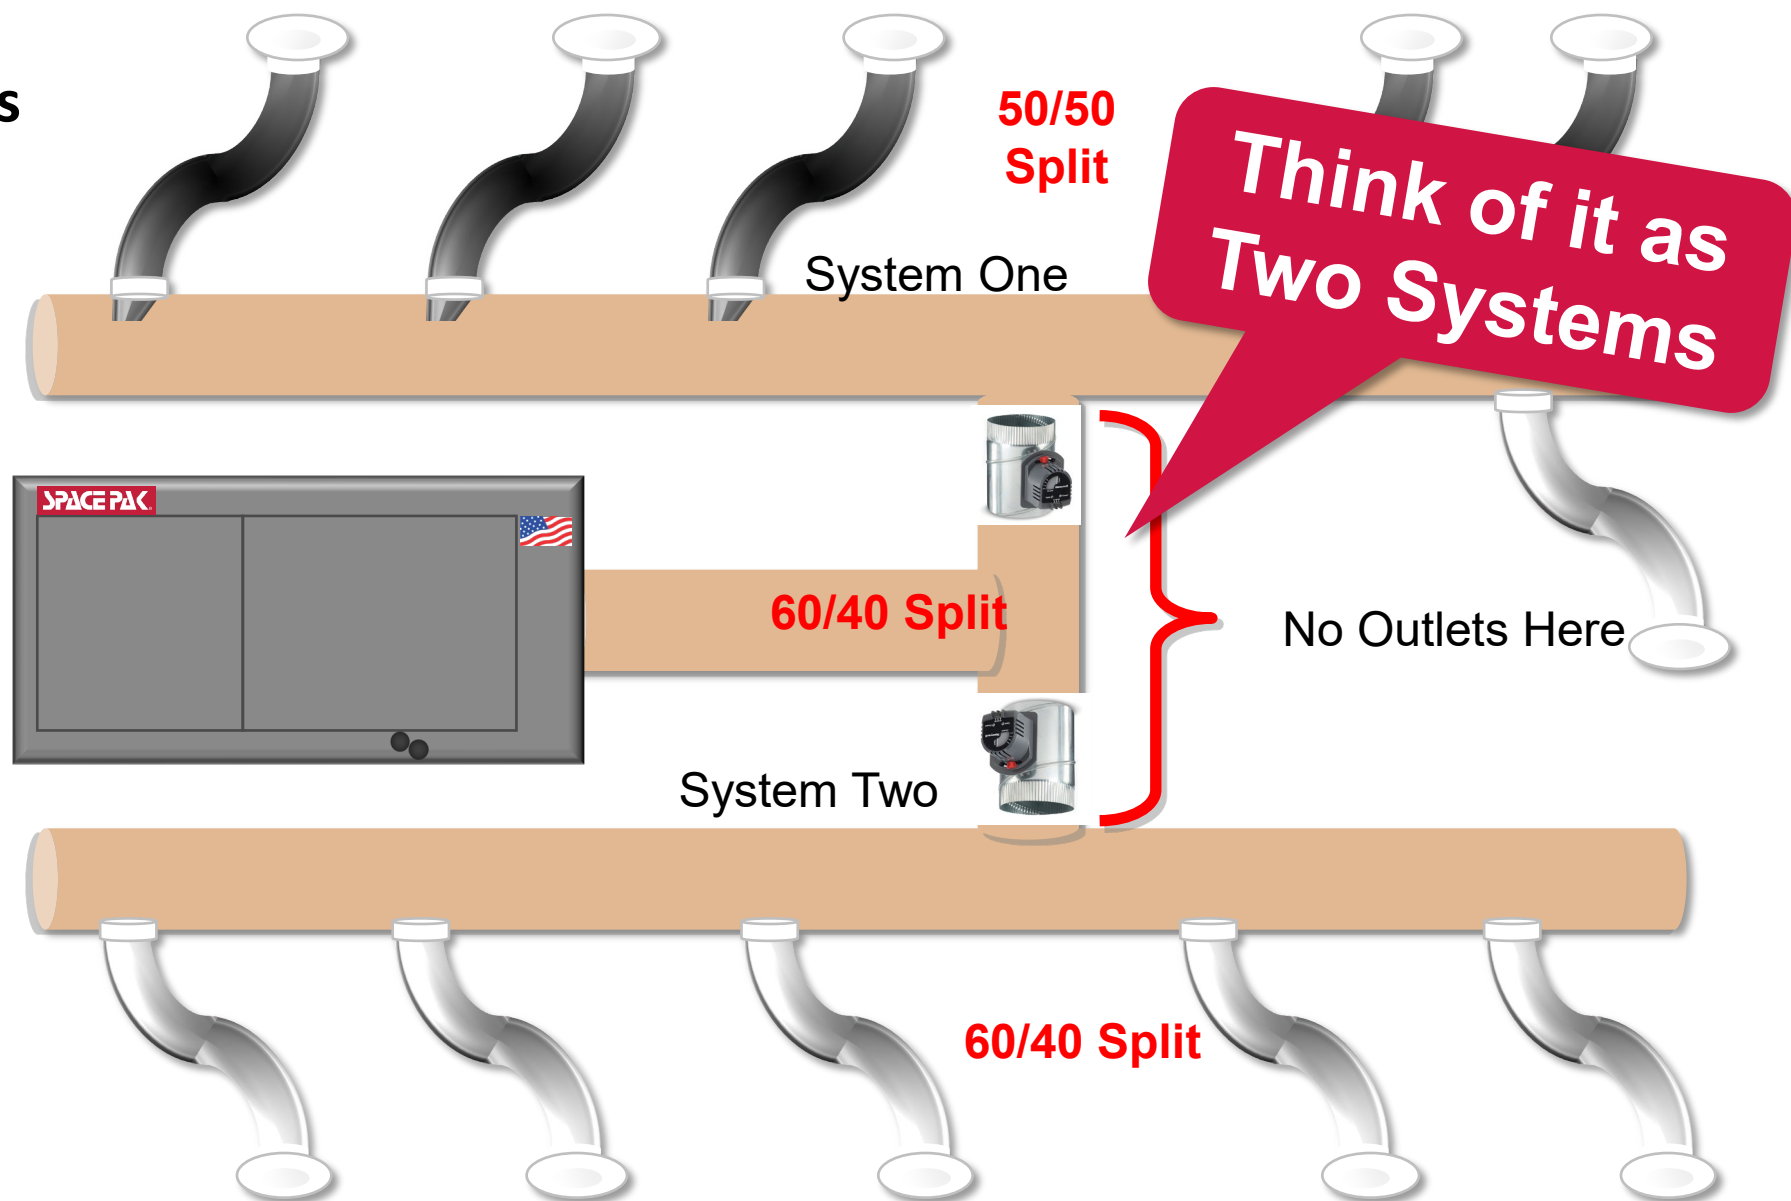

Pre-Sale Application Support Team

PreSaleSupport@SpacePak.com

Available to Representatives, Wholesalers and Contractors

- System application support
- Equipment selection
- Load calculation and rough material list

Any questions regarding equipment already shipped should be directed to

TechnicalService@SpacePak.com (413) 564 - 5530



Let's Connect



#spacepak #hydronics
#airtowaterheatpumps

@spacepaksystem
@thespacepakjim

let's connect

Questions?



Thank you!
